



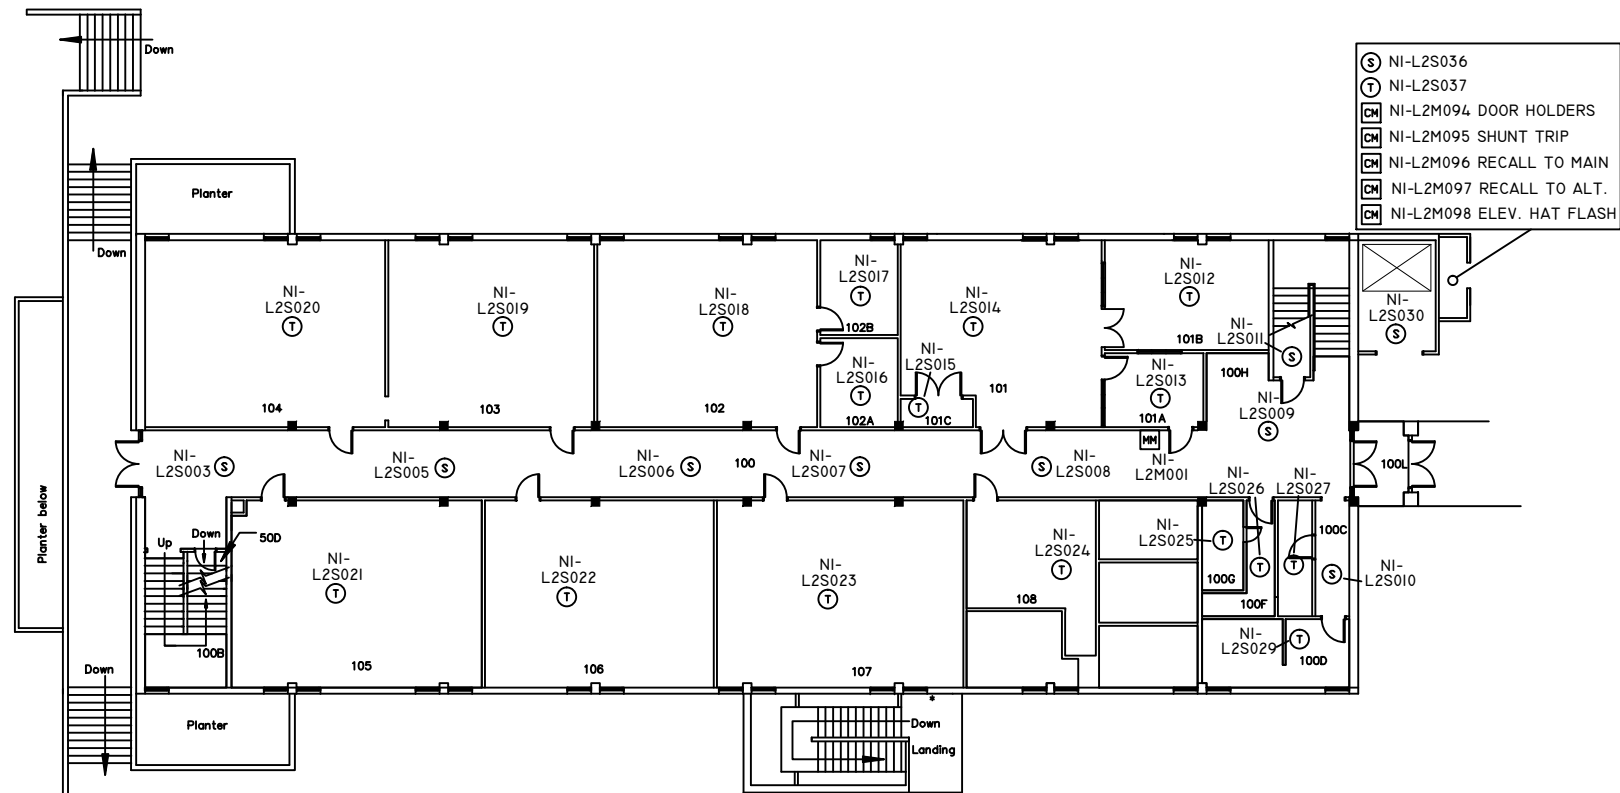


LEVEL ONE

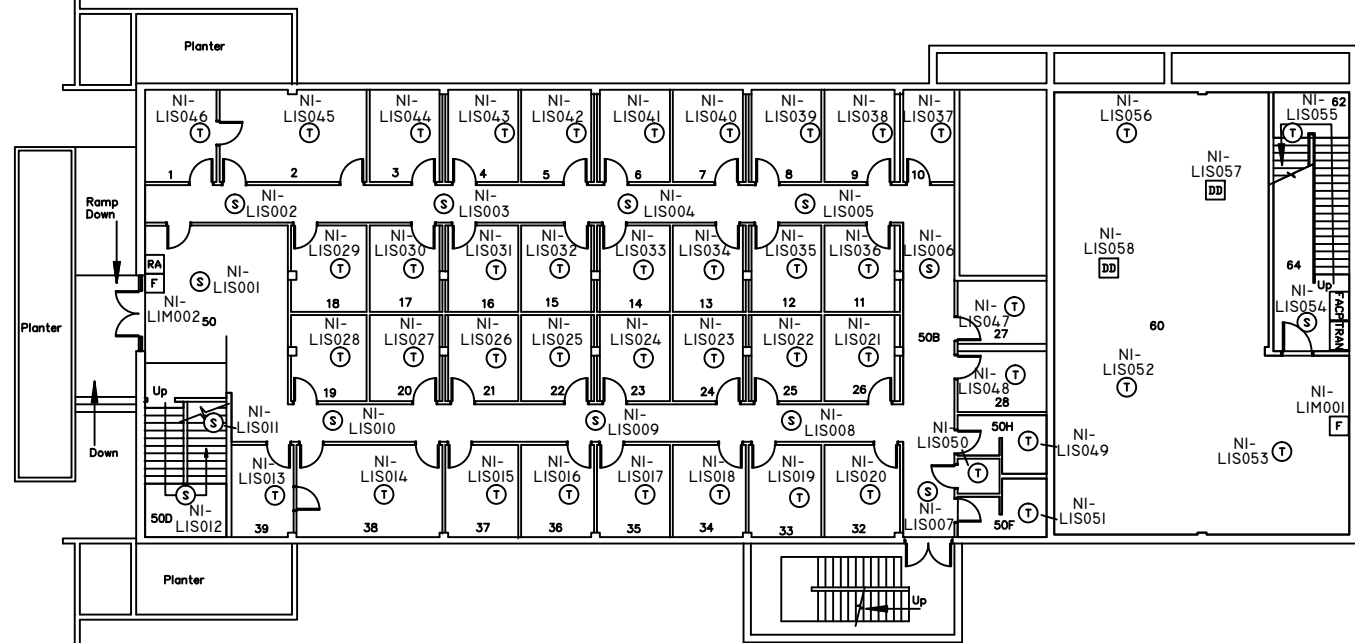

BASEMENT

- ③ NI-L2S036
- ① NI-L2S037
- ② NI-L2M094 DOOR HOLDERS
- ② NI-L2M095 SHUNT TRIP
- ② NI-L2M096 RECALL TO MAIN
- ② NI-L2M097 RECALL TO ALT.
- ② NI-L2M098 ELEV. HAT FLASH

DEVICE LEGEND	
SYMBOL	DESCRIPTION
③	SMOKE DETECTOR
①	THERMAL DETECTOR
F	MANUAL PULL STATION
②	DUCT SMOKE DETECTOR
②	MONITOR MODULE
②	CONTROL MODULE
②	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

BUSINESS CLASSROOM BUILDING
DAVID ECCLES SCHOOL OF BUSINESS
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
SALT LAKE CITY, UTAH 84112

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: XXXX
APPROVED BY: DS
DATE: 6/28/2011
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
BUC FINAL I.DWG.

FIRE ALARM SYSTEM
ADDRESSABLE NUMBERS

PAGE:
FA-I-01



BUSINESS CLASSROOM BUILDING
DAVID ECCLES SCHOOL OF BUSINESS
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
SALT LAKE CITY, UTAH 84112

FA-2-01