


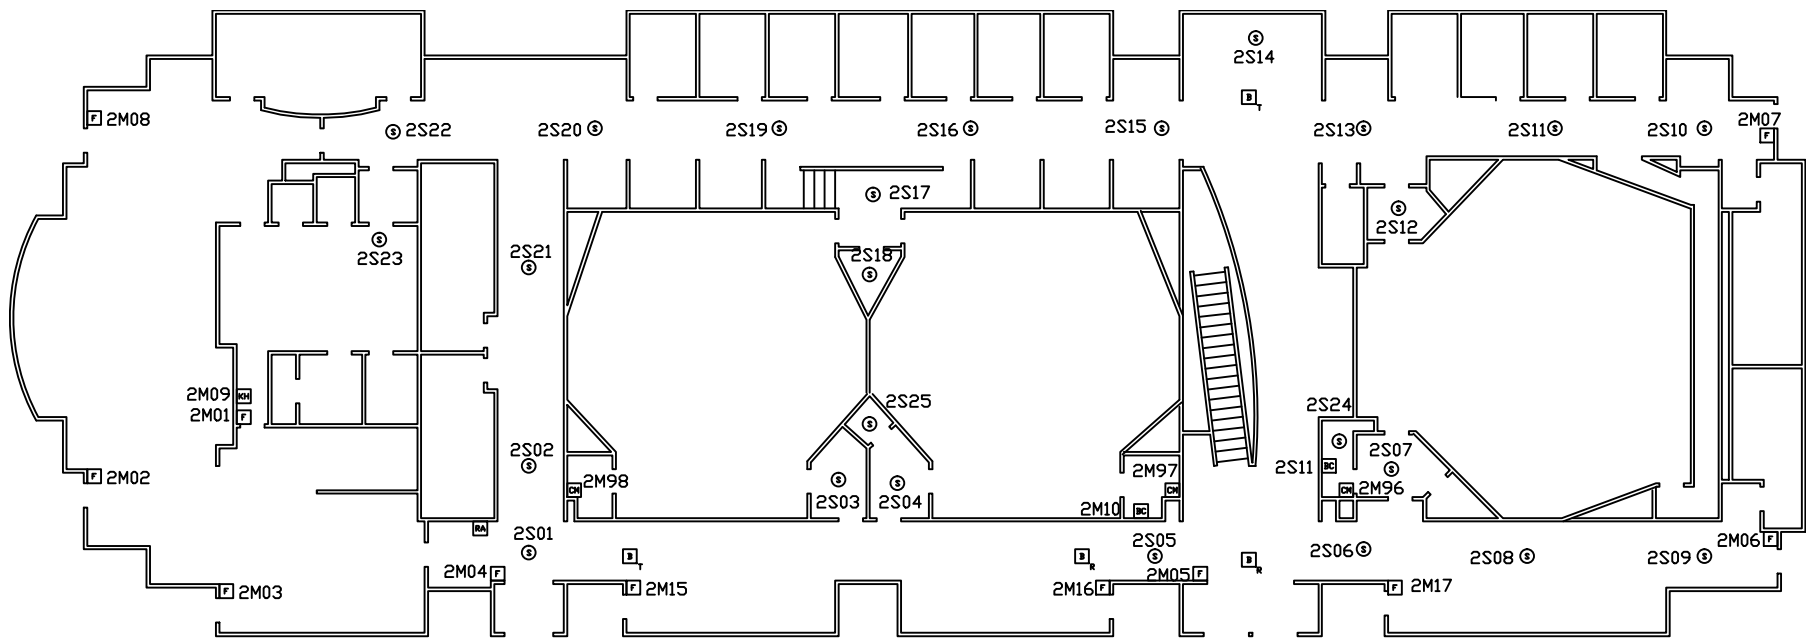


C. ROLAND CHRISTENSEN CENTER
 ECCLES SCHOOL OF BUSINESS
 UNIVERSITY OF UTAH
 FEBRUARY 21, 2000
 CRC.DWG

LEGEND

- ⊙ SMOKE DETECTOR ASD-I/ADB-F
- ⊙ HEAT DETECTOR ATD-R/ADB-F
- MANUAL PULL STATION- MS-2/AMM-2
- ▣ DUCT DETECTOR- DH500 AC/DC
- ▤ WATERFLOW SWITCH- AMM-4
- ▥ TAMPER SWITCH- AMM-4
- ▧ MONITOR MODULE- AMM-4
- ▨ CONTROL MODULE- ADM-2
- ▩ FIRE ALARM CONTROL PANEL- EN-4
- TRANSPONDER PANEL- EN-24

PLAZA LEVEL



NFS
 NELSON FIRE SYSTEMS
 801-288-9905

MALL LEVEL

