



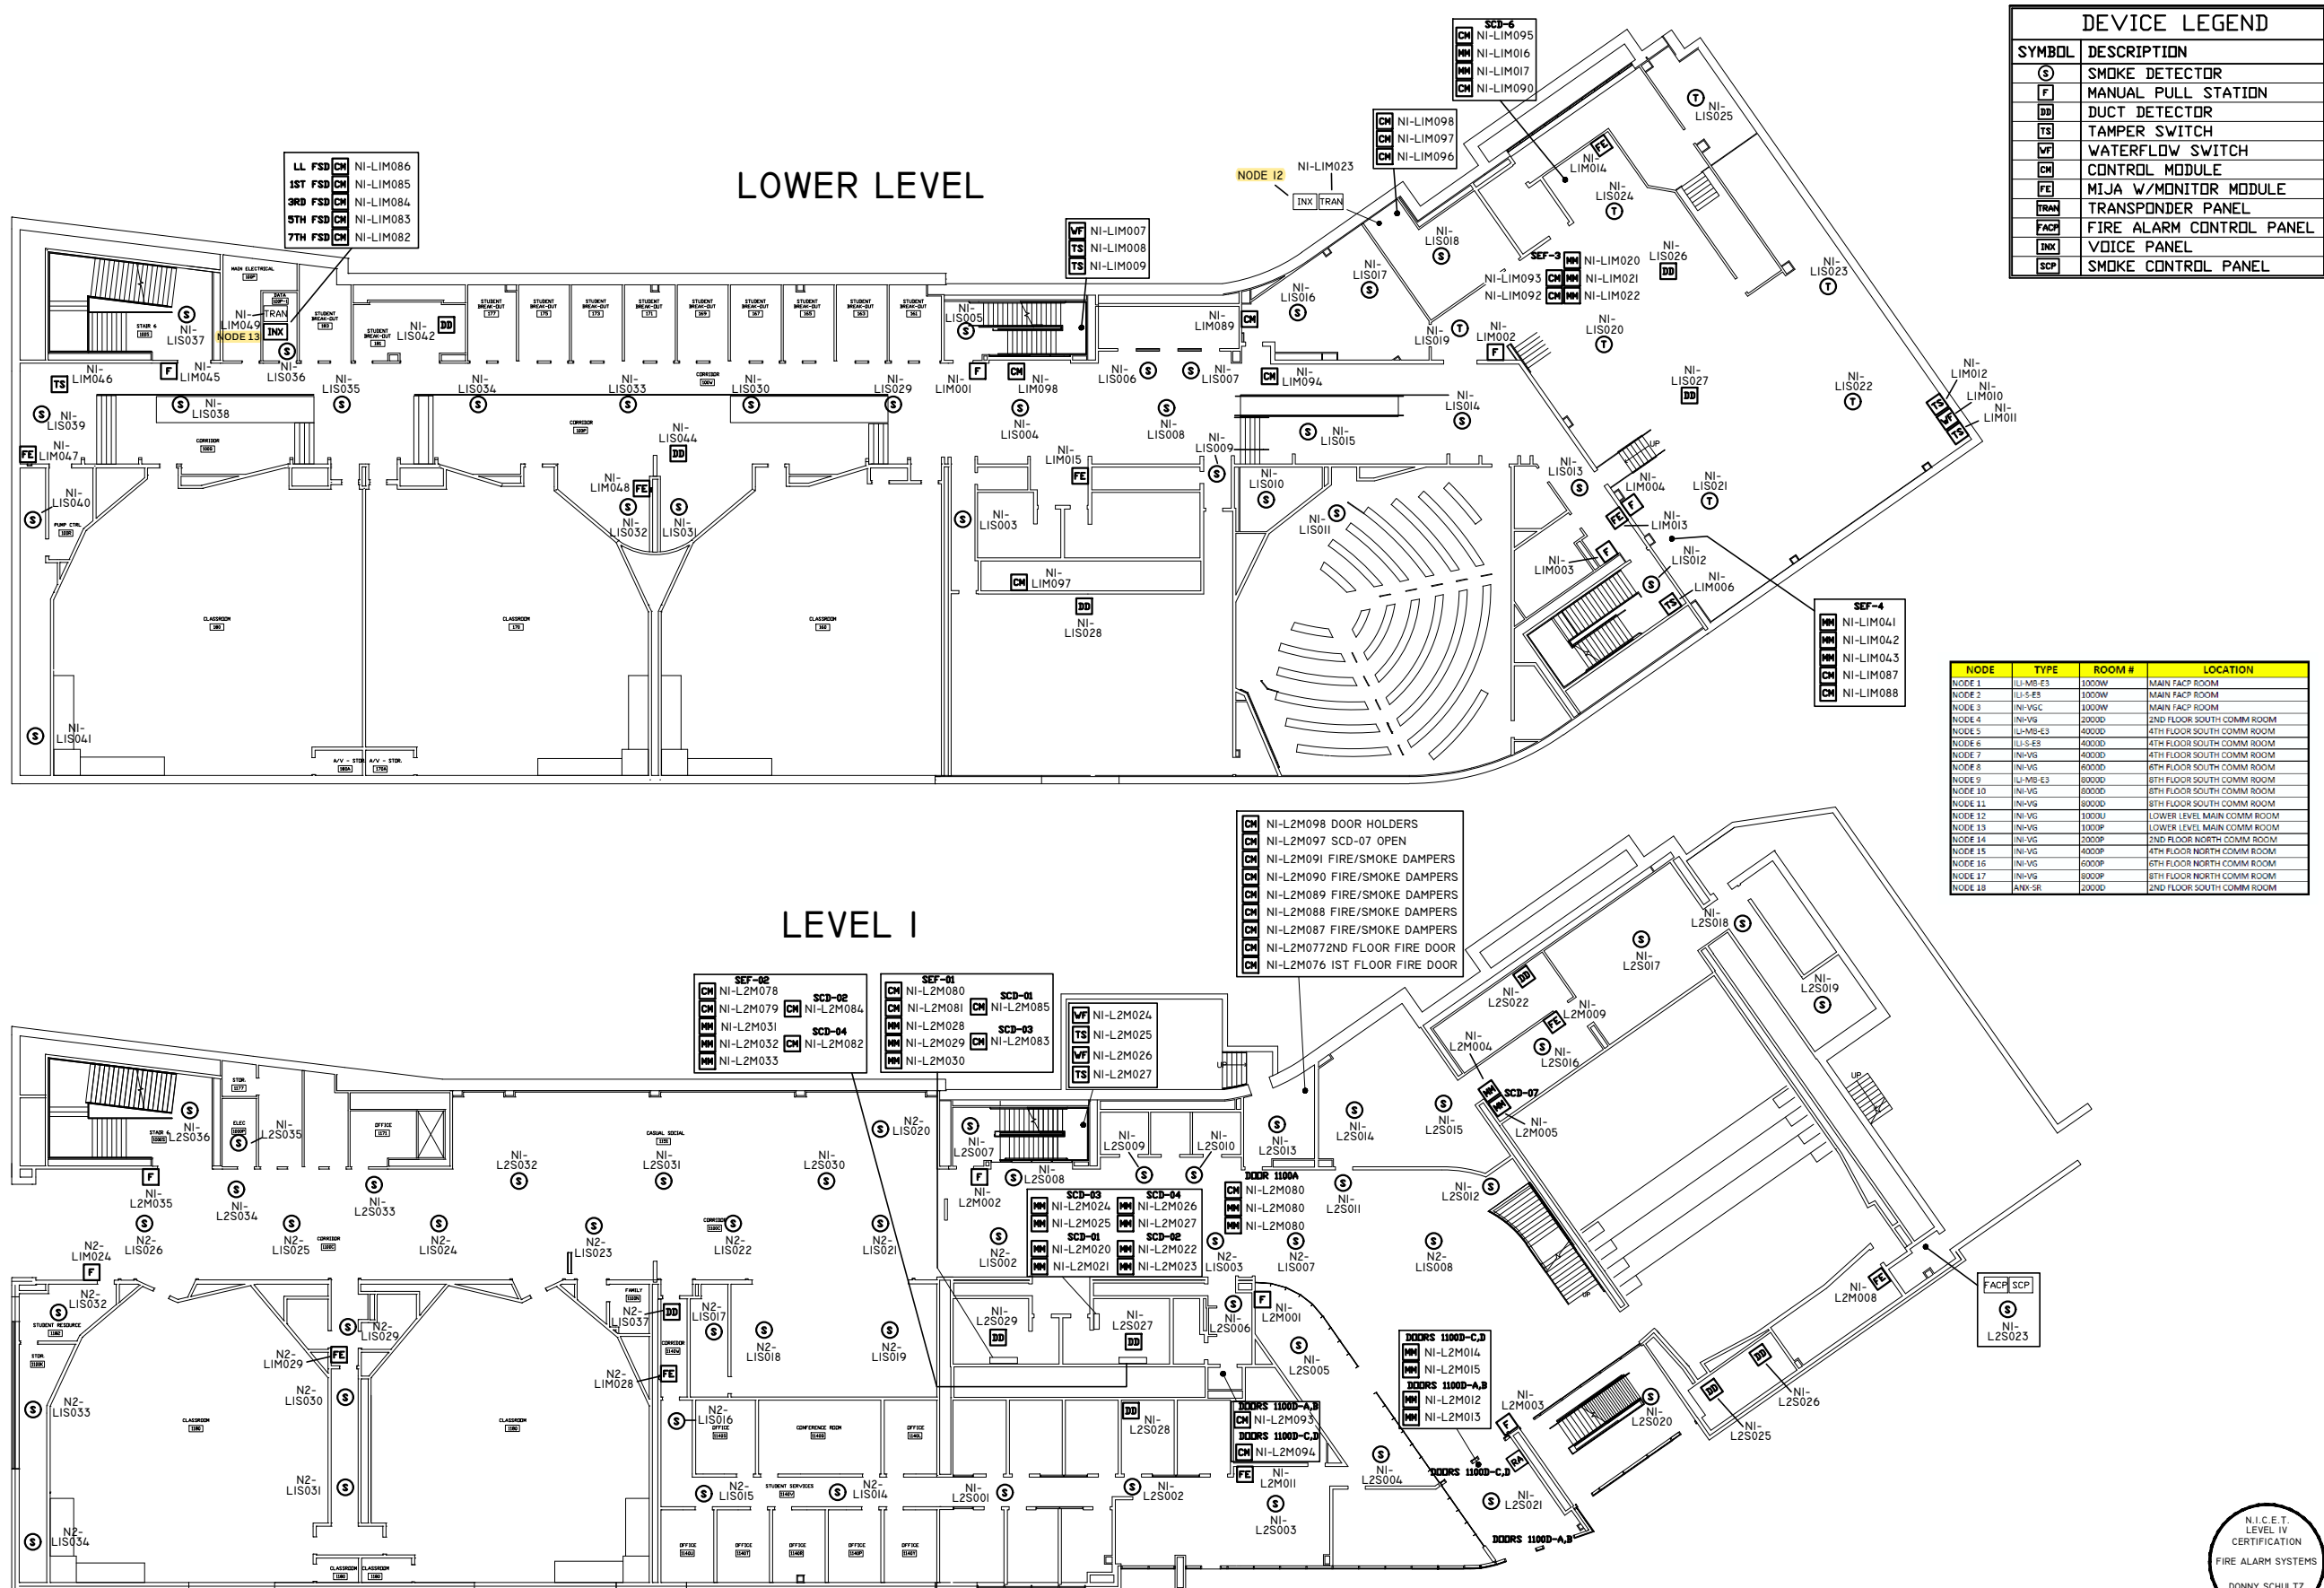

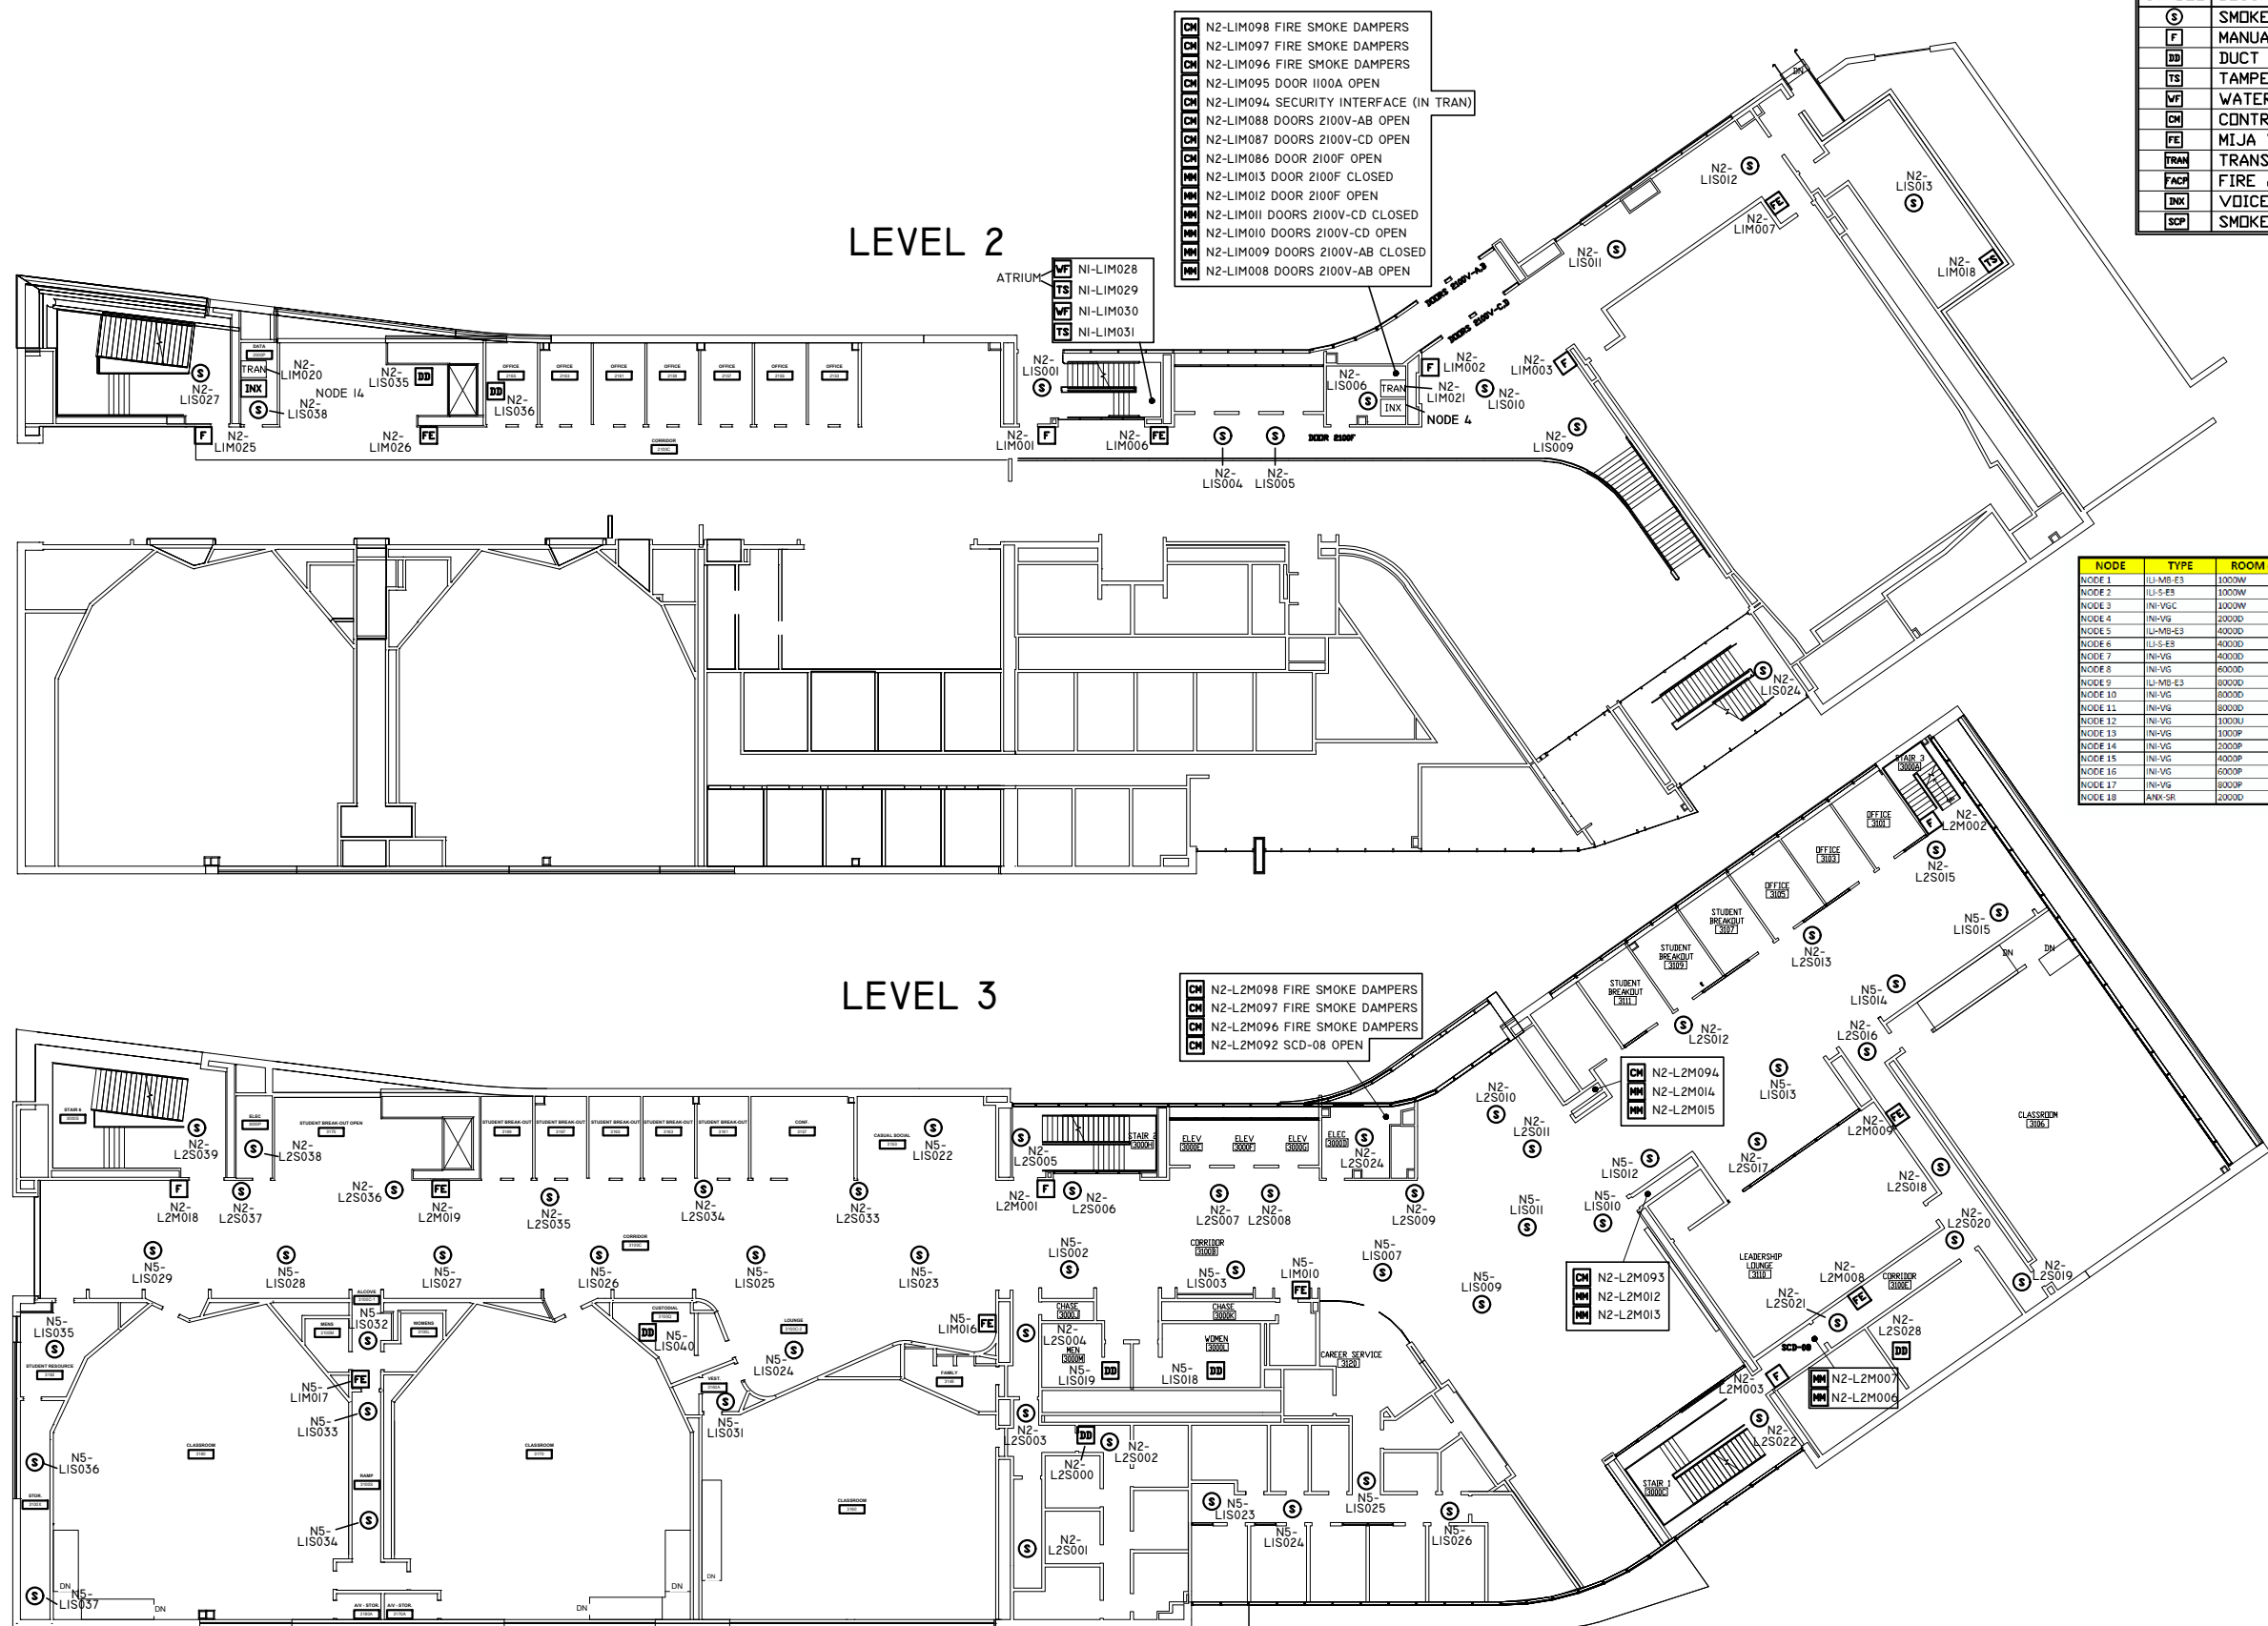

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	MANUAL PULL STATION
	DUCT DETECTOR
	TAMPER SWITCH
	WATERFLOW SWITCH
	CONTROL MODULE
	MIA W/MONITOR MODULE
	TRANSPONDER PANEL
	FIRE ALARM CONTROL PANEL
	VOICE PANEL
	SMOKE CONTROL PANEL

NODE	TYPE	ROOM #	LOCATION
NODE 1	LI-MB-E3	1000W	MAIN FACP ROOM
NODE 2	LI-S-E3	1000W	MAIN FACP ROOM
NODE 3	INI-VSC	1000W	MAIN FACP ROOM
NODE 4	INI-VG	2000D	2ND FLOOR SOUTH COMM ROOM
NODE 5	LI-MB-E3	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 6	LI-S-E3	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 7	INI-VG	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 8	INI-VG	6000D	6TH FLOOR SOUTH COMM ROOM
NODE 9	LI-MB-E3	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 10	INI-VG	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 11	INI-VG	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 12	INI-VG	1000U	LOWER LEVEL MAIN COMM ROOM
NODE 13	INI-VG	1000P	LOWER LEVEL MAIN COMM ROOM
NODE 14	INI-VG	2000P	2ND FLOOR NORTH COMM ROOM
NODE 15	INI-VG	4000P	4TH FLOOR NORTH COMM ROOM
NODE 16	INI-VG	6000P	6TH FLOOR NORTH COMM ROOM
NODE 17	INI-VG	8000P	8TH FLOOR NORTH COMM ROOM
NODE 18	ANI-SR	2000D	2ND FLOOR SOUTH COMM ROOM

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
NFS DIRECT/ENGINEERED PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
DAVID ECCLES SCHOOL OF BUSINESS
LEVELS 2 & 3
1655 CAMPUS CENTER DR.
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 5/3/13
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
DESB FINAL 2 3 DWG


FIRE ALARM SYSTEM
LEVELS 2 & 3
FINAL MAPS

PAGE:
FA-2

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

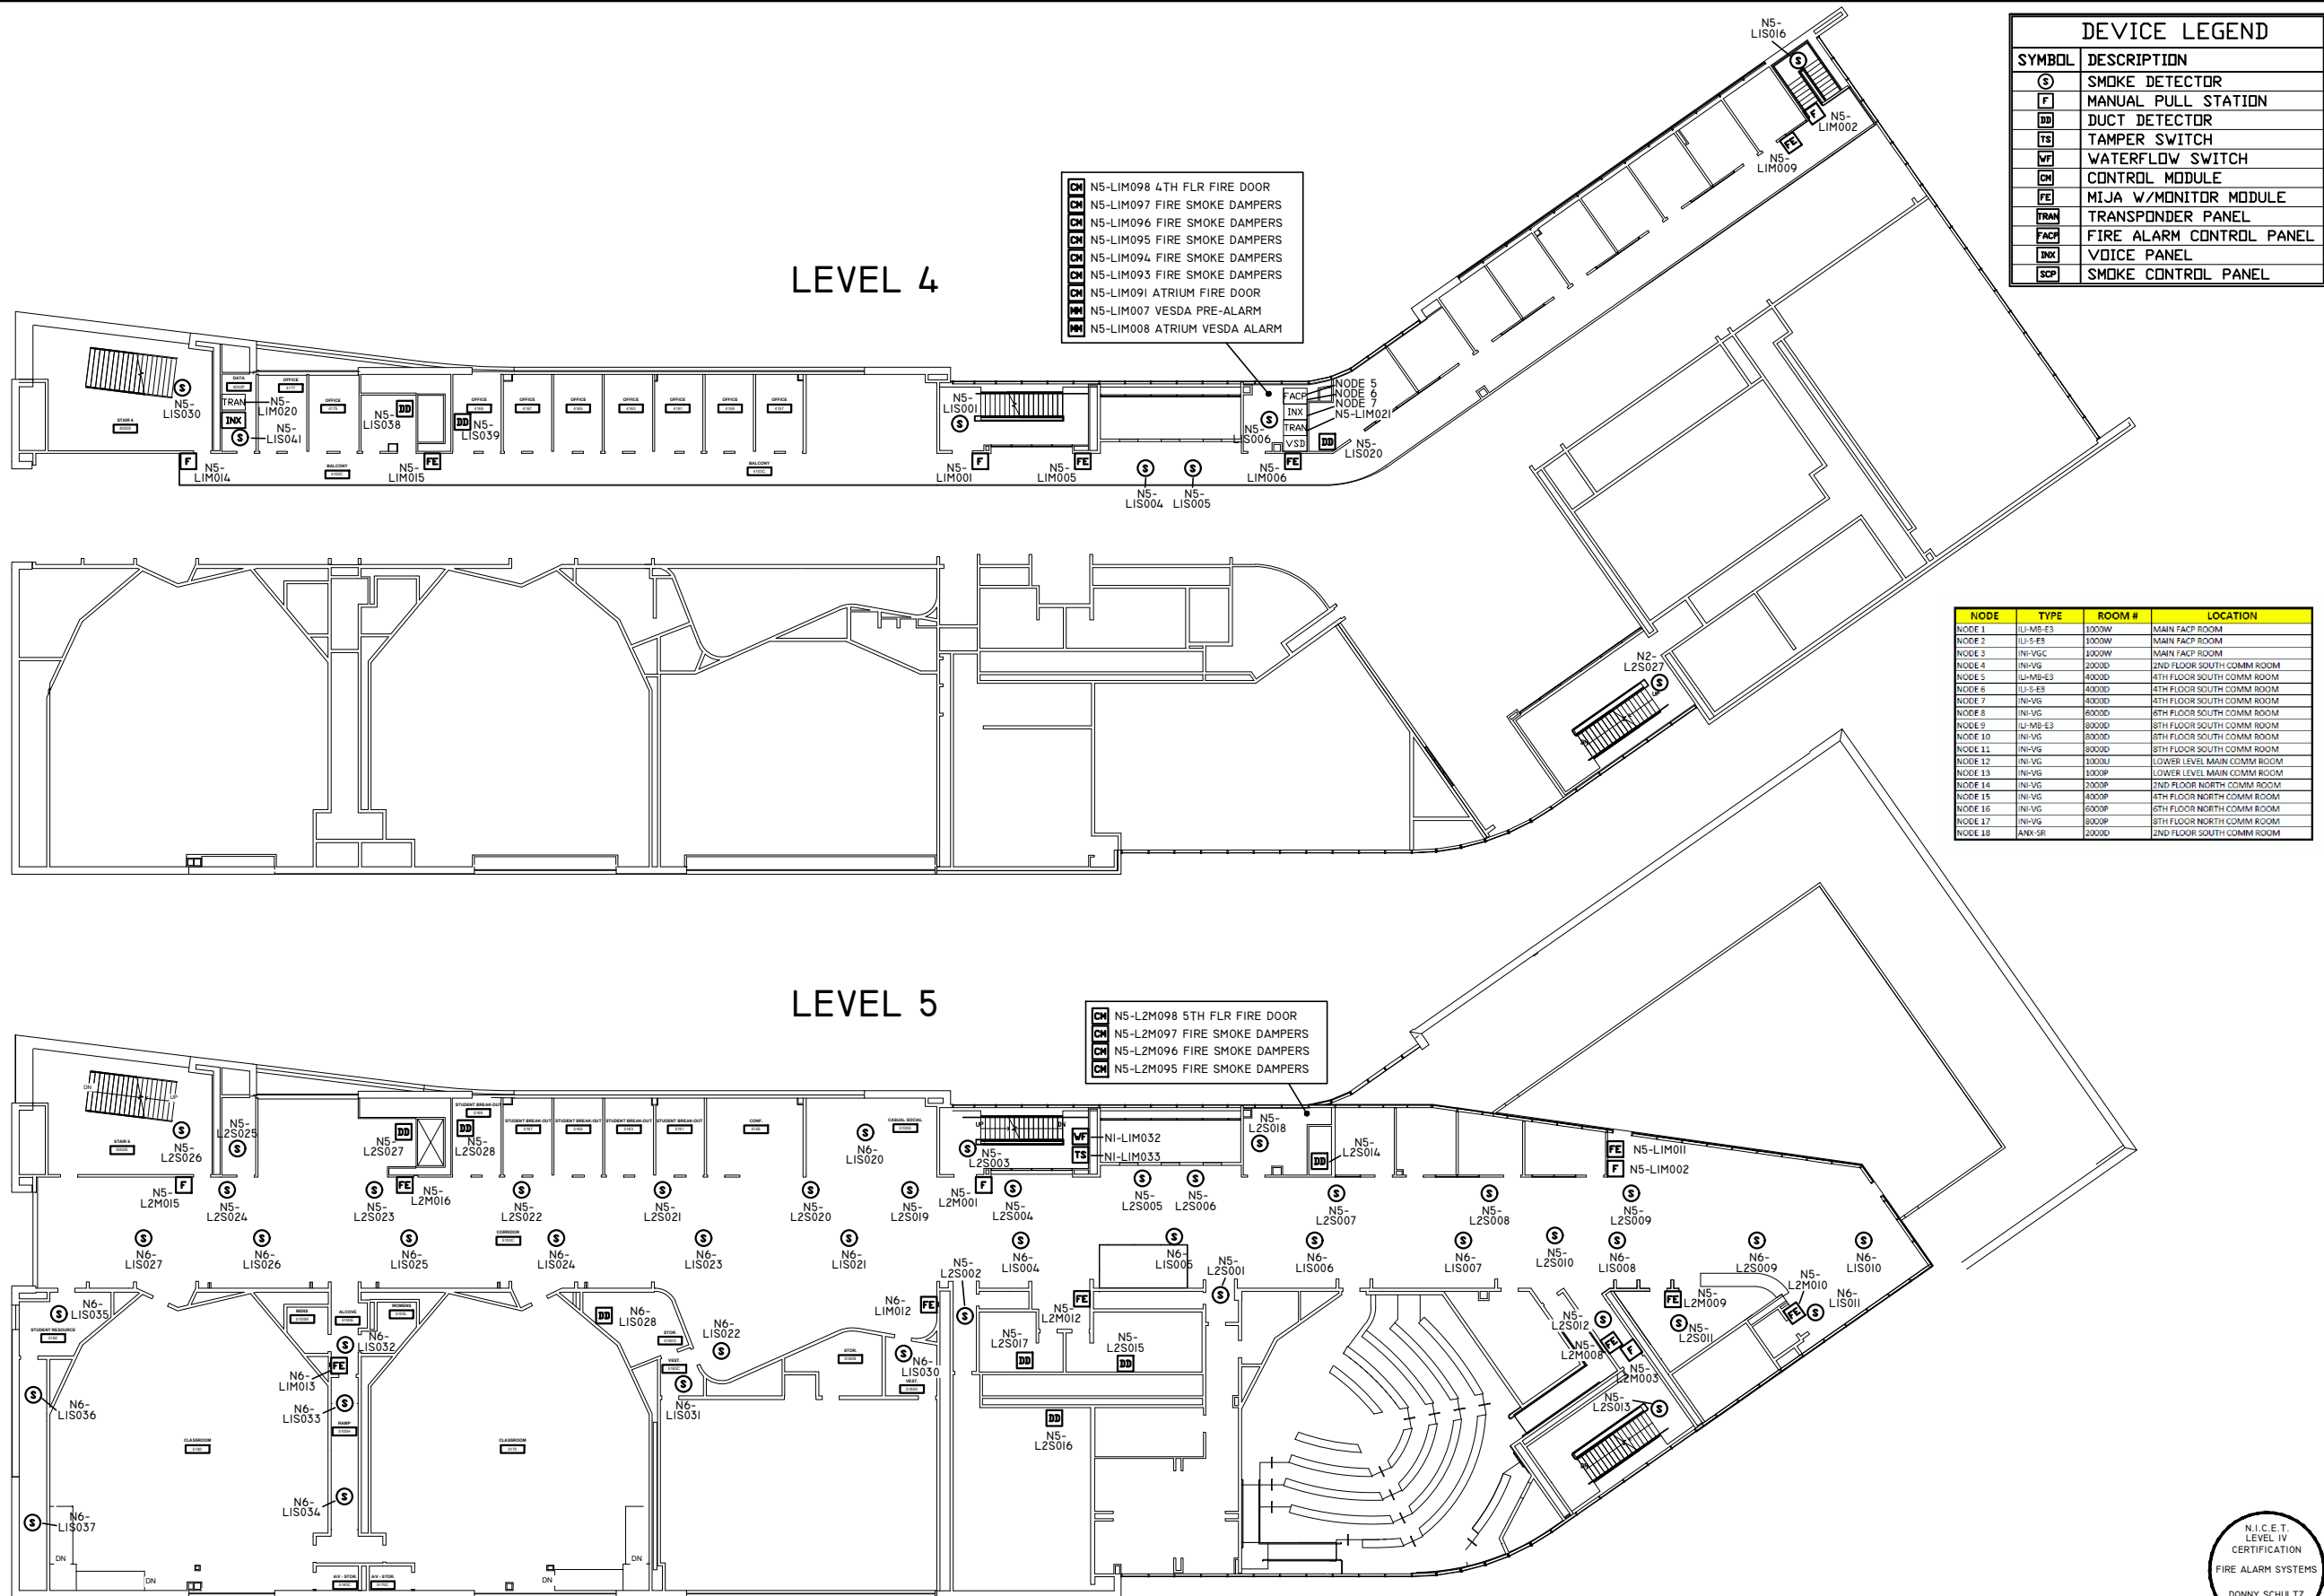


LEVEL 6

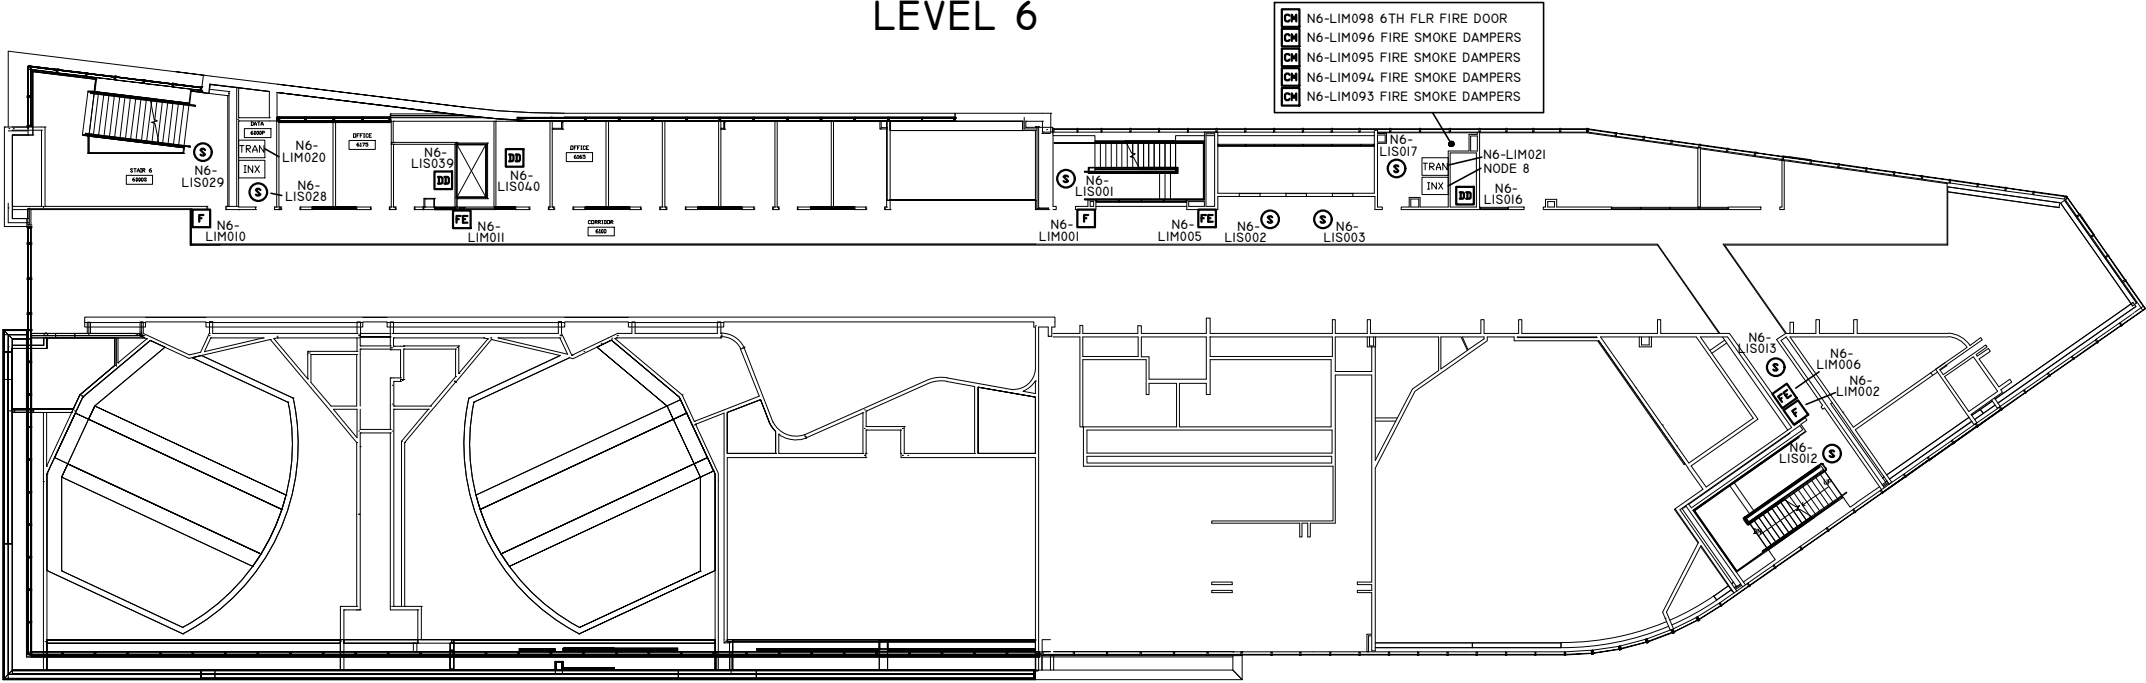

DEVICE LEGEND	
SYMBOL	DESCRIPTION
S	SMOKE DETECTOR
F	MANUAL PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
CM	CONTROL MODULE
FE	MIJA W/MONITOR MODULE
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL
VNX	VOICE PANEL
SCP	SMOKE CONTROL PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
NFS ENGINEERING/DESIGN/PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

LEVEL 7

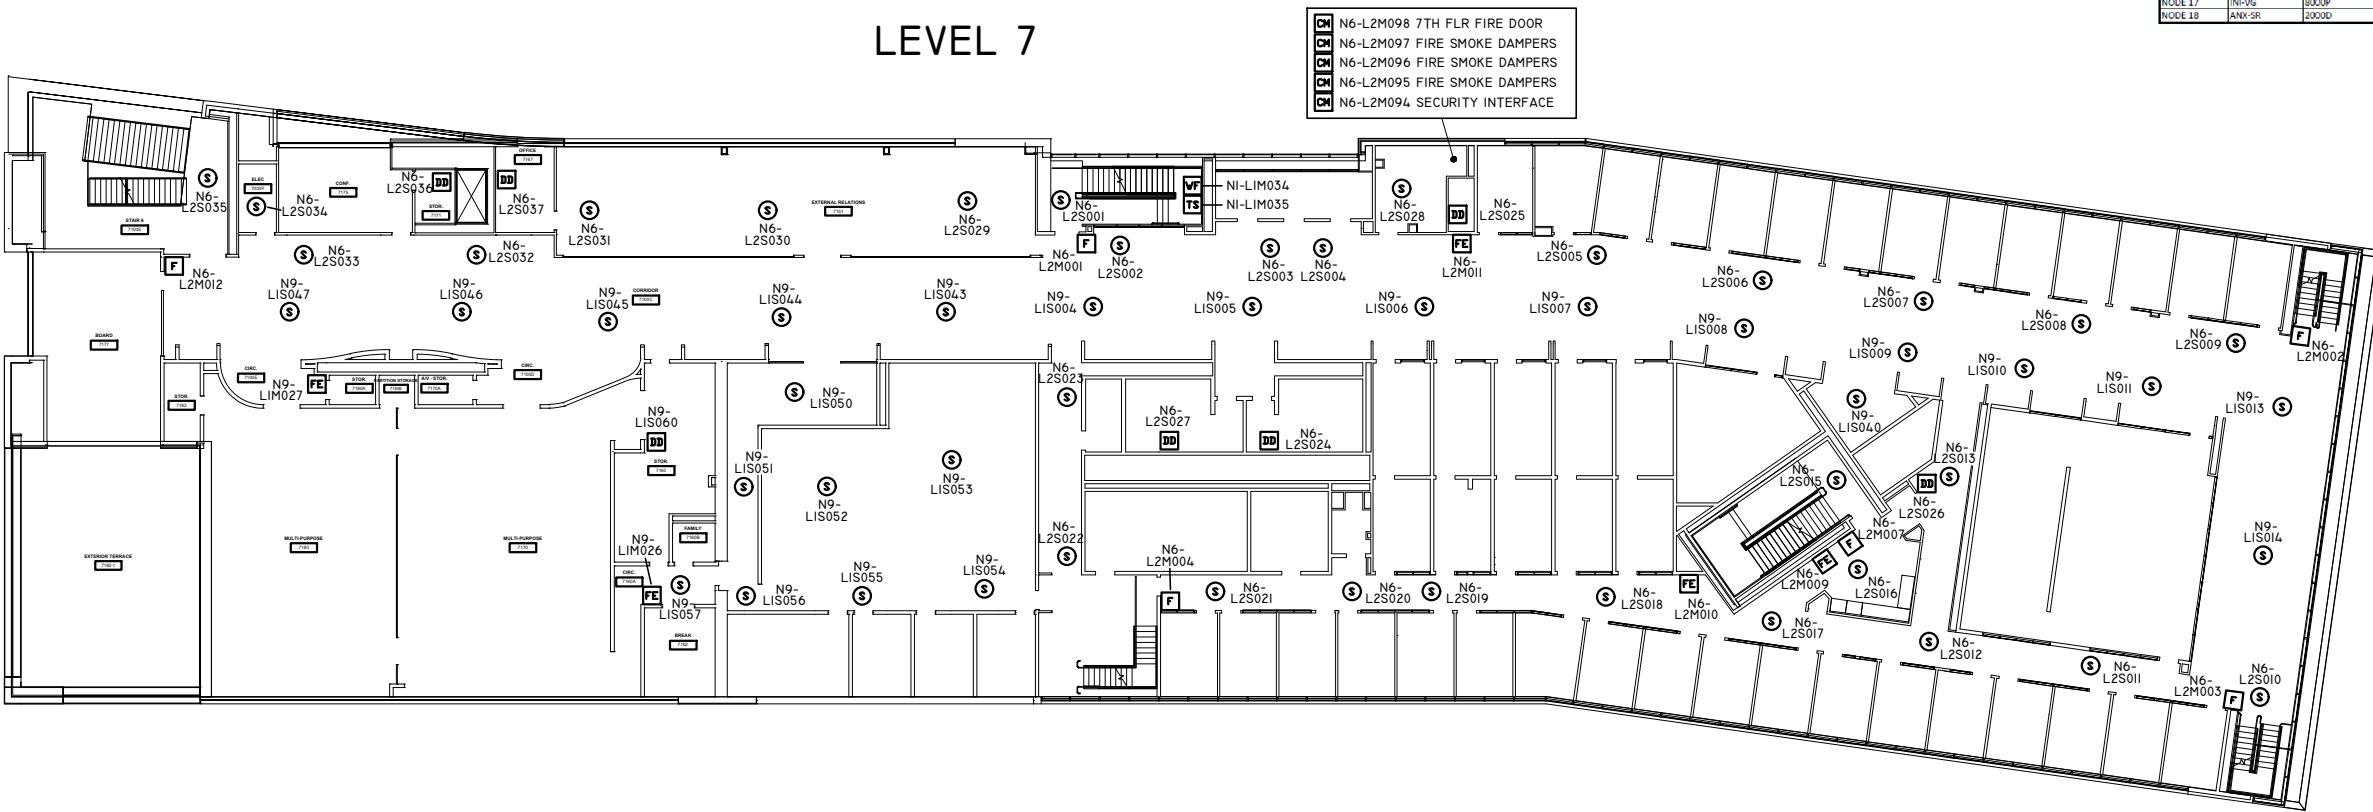

NODE	TYPE	ROOM #	LOCATION
NODE 1	LI-MB-ES	3000W	MAIN FACP ROOM
NODE 2	LI-S-ES	3000W	MAIN FACP ROOM
NODE 3	NI-VGC	3000W	MAIN FACP ROOM
NODE 4	NI-VS	2000D	2ND FLOOR SOUTH COMM ROOM
NODE 5	LI-MB-ES	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 6	LI-S-ES	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 7	NI-VS	4000D	4TH FLOOR SOUTH COMM ROOM
NODE 8	NI-VG	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 9	LI-MB-ES	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 10	NI-VS	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 11	NI-VG	8000D	8TH FLOOR SOUTH COMM ROOM
NODE 12	NI-VG	1000U	LOWER LEVEL MAIN COMM ROOM
NODE 13	NI-VG	1000P	LOWER LEVEL MAIN COMM ROOM
NODE 14	NI-VS	2000P	2ND FLOOR NORTH COMM ROOM
NODE 15	NI-VG	4000P	4TH FLOOR NORTH COMM ROOM
NODE 16	NI-VG	6000P	6TH FLOOR NORTH COMM ROOM
NODE 17	NI-VG	8000P	8TH FLOOR NORTH COMM ROOM
NODE 18	ANX-SR	2000D	2ND FLOOR SOUTH COMM ROOM

UNIVERSITY OF UTAH
DAVID ECCLES SCHOOL OF BUSINESS
LEVELS 6 & 7
1655 CAMPUS CENTER DR.
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 5/3/13
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
DESB FINAL 6 7.DWG

FIRE ALARM SYSTEM
LEVELS 6 & 7
FINAL MAPS

PAGE:
FA-4

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

