




JAMES FLETCHER BUILDING
BASEMENT & 1ST FLOOR
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
OCTOBER 7, 2002
FLETCH1.DWG

LEGEND

- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- MANUAL PULL STATION- MS-2/AMM-2
- ▣ DUCT DETECTOR- DHS00 AC/DC
- ▣ WATERFLOW SWITCH- AMM-4
- ▣ TAMPER SWITCH- AMM-4
- ▣ STROBE/HORN- HMF/STD-P
- ▣ WEATHERPROOF HORN- 450024T4R
- ▣ RELAY- ARB-C
- ▣ REMOTE ANNUNCIATOR- RHFB
- ▣ FIRE ALARM CONTROL PANEL- EN-24
- ▣ TRANSPONDER PANEL- EN-24




NFS
NELSON FIRE SYSTEMS
801-468-8300

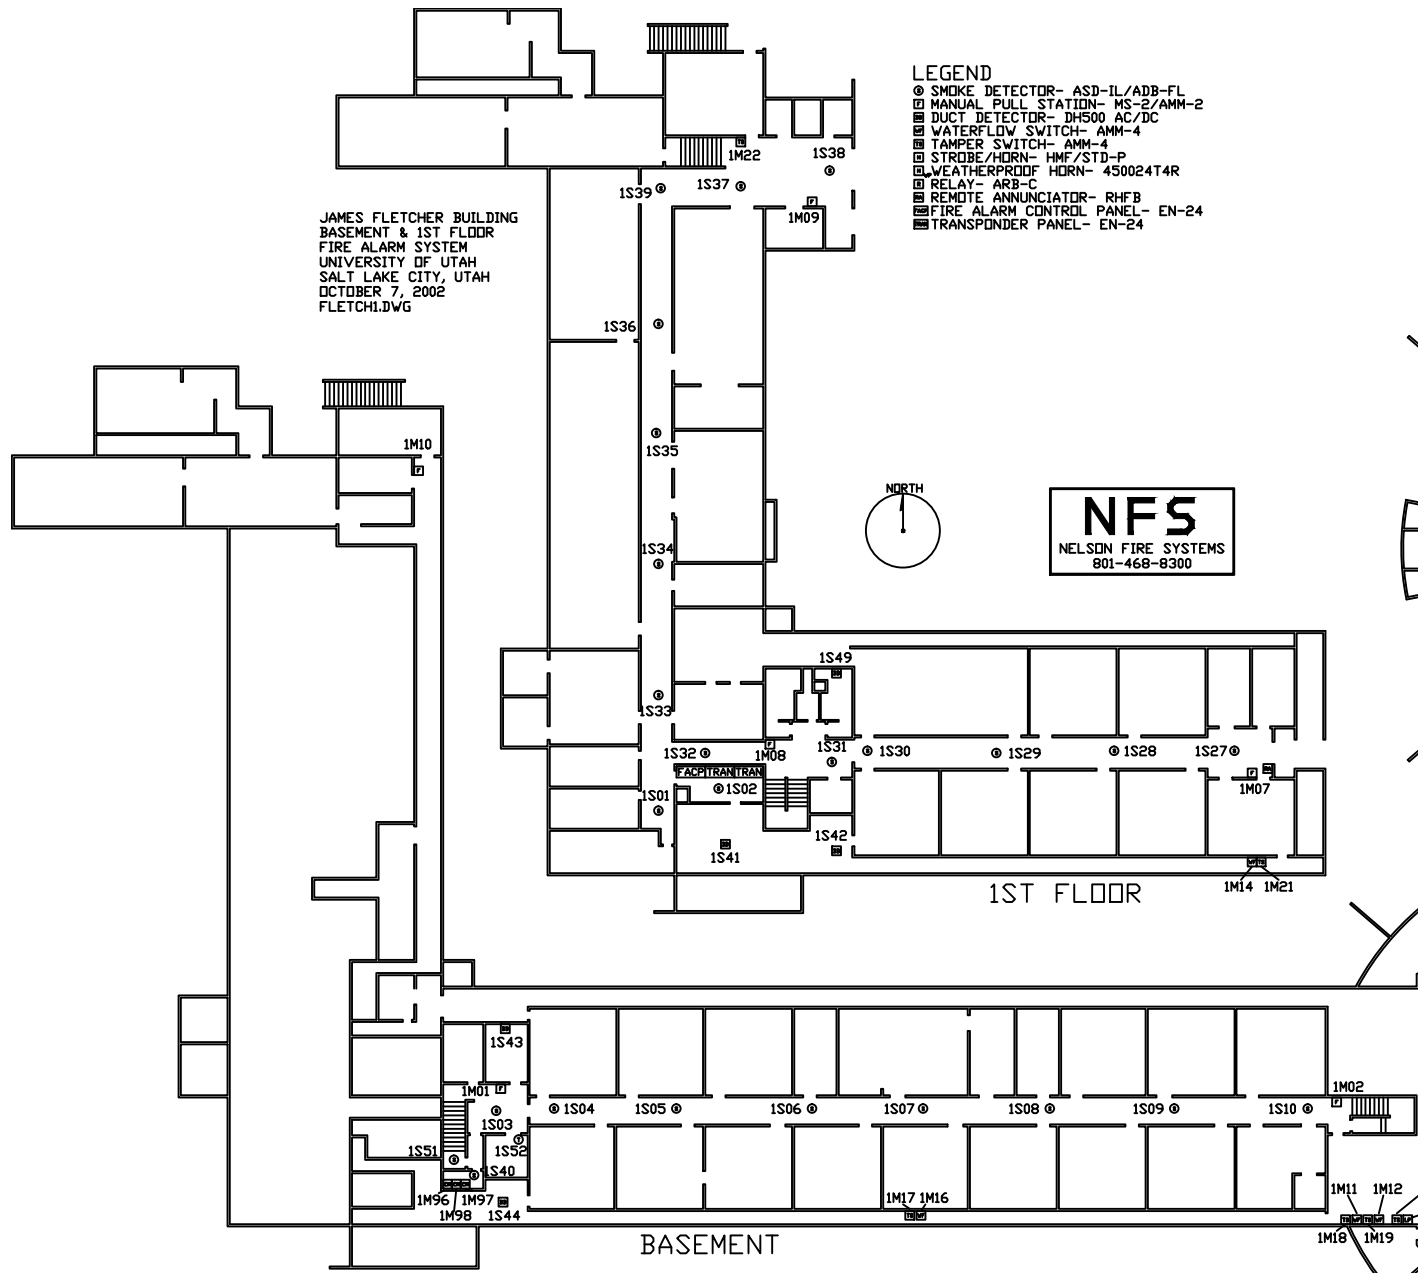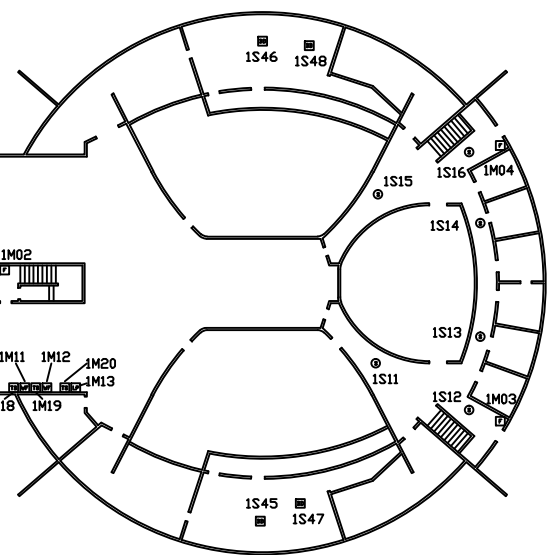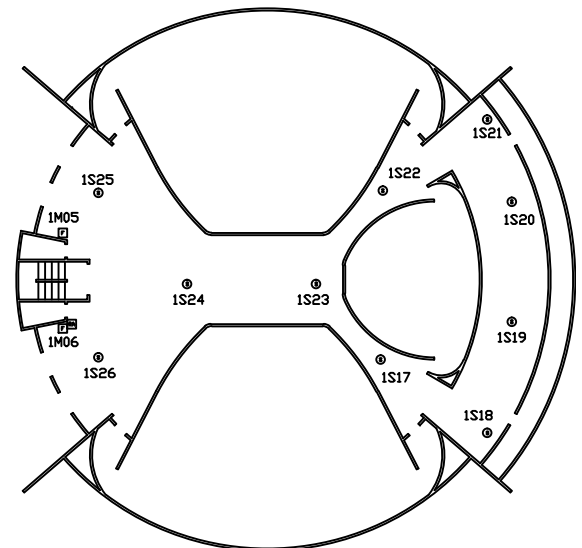


LEGEND

- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- ⊙ HEAT DETECTOR- ATD-RL/ADB-FL
- ⌚ MANUAL PULL STATION- MS-2/AMM-2
- ⌚ DUCT DETECTOR- DH500 AC/DC
- ⌚ WATERFLOW SWITCH- AMM-4
- ⌚ TAMPER SWITCH- AMM-4
- ⌚ STROBE/HORN- HMF/STD-P
- ⌚ MONITOR MODULE- AMM-4


JAMES FLETCHER BUILDING
2ND & 3RD FLOORS
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
JANUARY 22, 2003
FLETCH2.DWG



3RD FLOOR

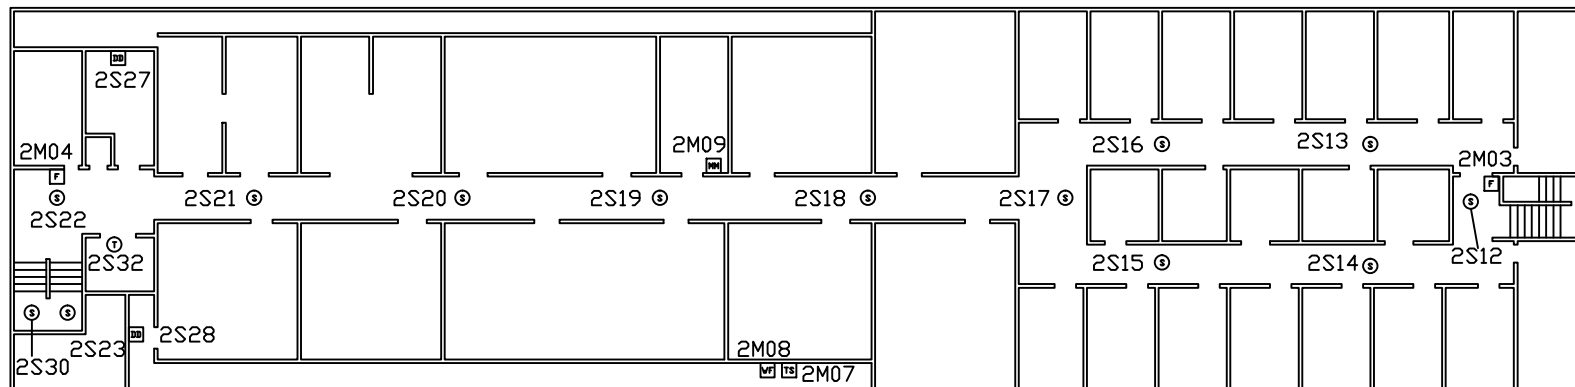

2ND FLOOR

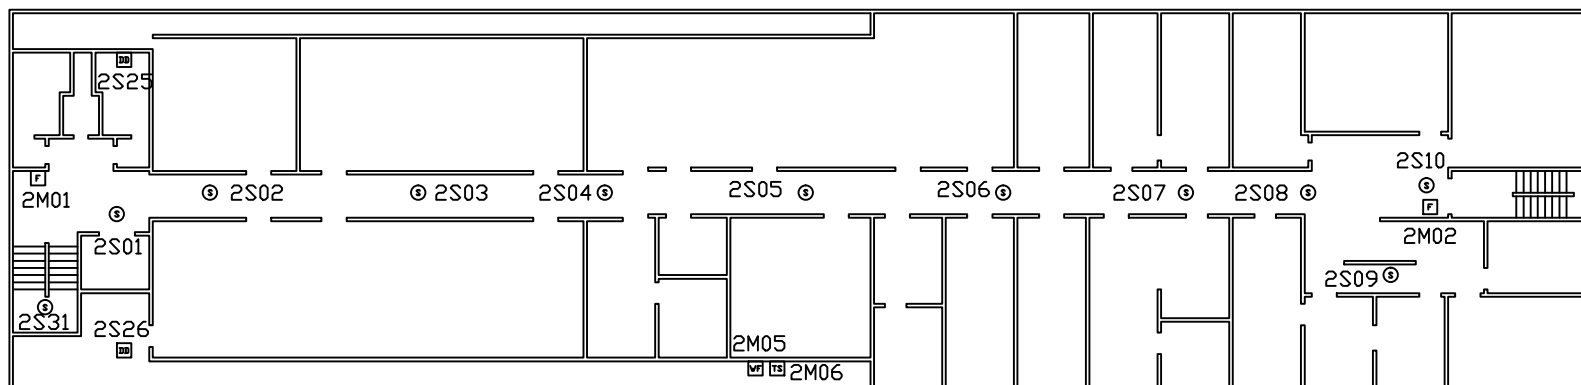

NFS

NELSON FIRE SYSTEMS
801-468-8300