



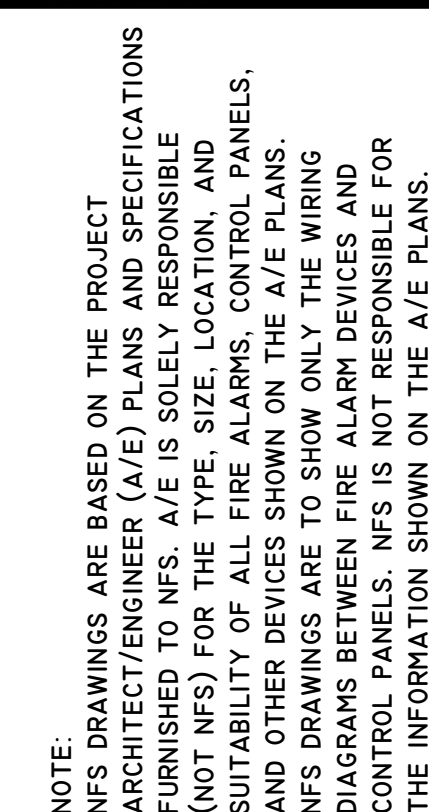


NFS
NELSON FIRE SYSTEMS
801-468-8300

FIRE ALARM SYSTEM
FIRST FLOOR
ADDRESSABLE NUMBE

FA-1-04

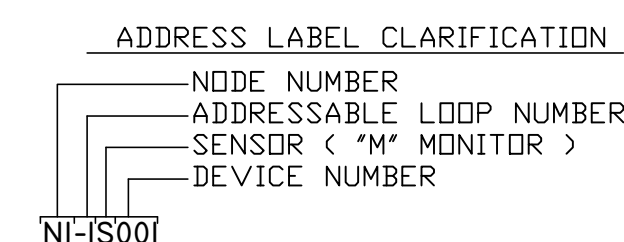

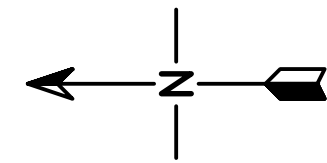

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
MARRIOTT LIBRARY RENOVATION
SECOND FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: ECE
APPROVED BY: DS
DATE: 7/11/2008
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: I
DRAWING NAME:
MARRIOTT LIBRARY 2.DWG


FIRE ALARM SYSTEM
SECOND FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-2-04

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR W/BASE
⊖	THERMAL DETECTOR
⌈	MANUAL PULL STATION
⌈B	DUCT SMOKE DETECTOR
⌈W	WATERFLOW SWITCH MONITOR MODULE
⌈T	TAMPER SWITCH MONITOR MODULE
⌈L	STROBE LIGHT
⌈S	SPEAKER/STROBE
⌈S	WEATHERPROOF SPEAKER
⌈M	MONITOR MODULE
⌈C	CONTROL MODULE
⌈A	REMOTE ANNUNCIATOR ENCLOSURE
⌈FACP	FIRE ALARM CONTROL PANEL
⌈TRAN	TRANSPONDER PANEL

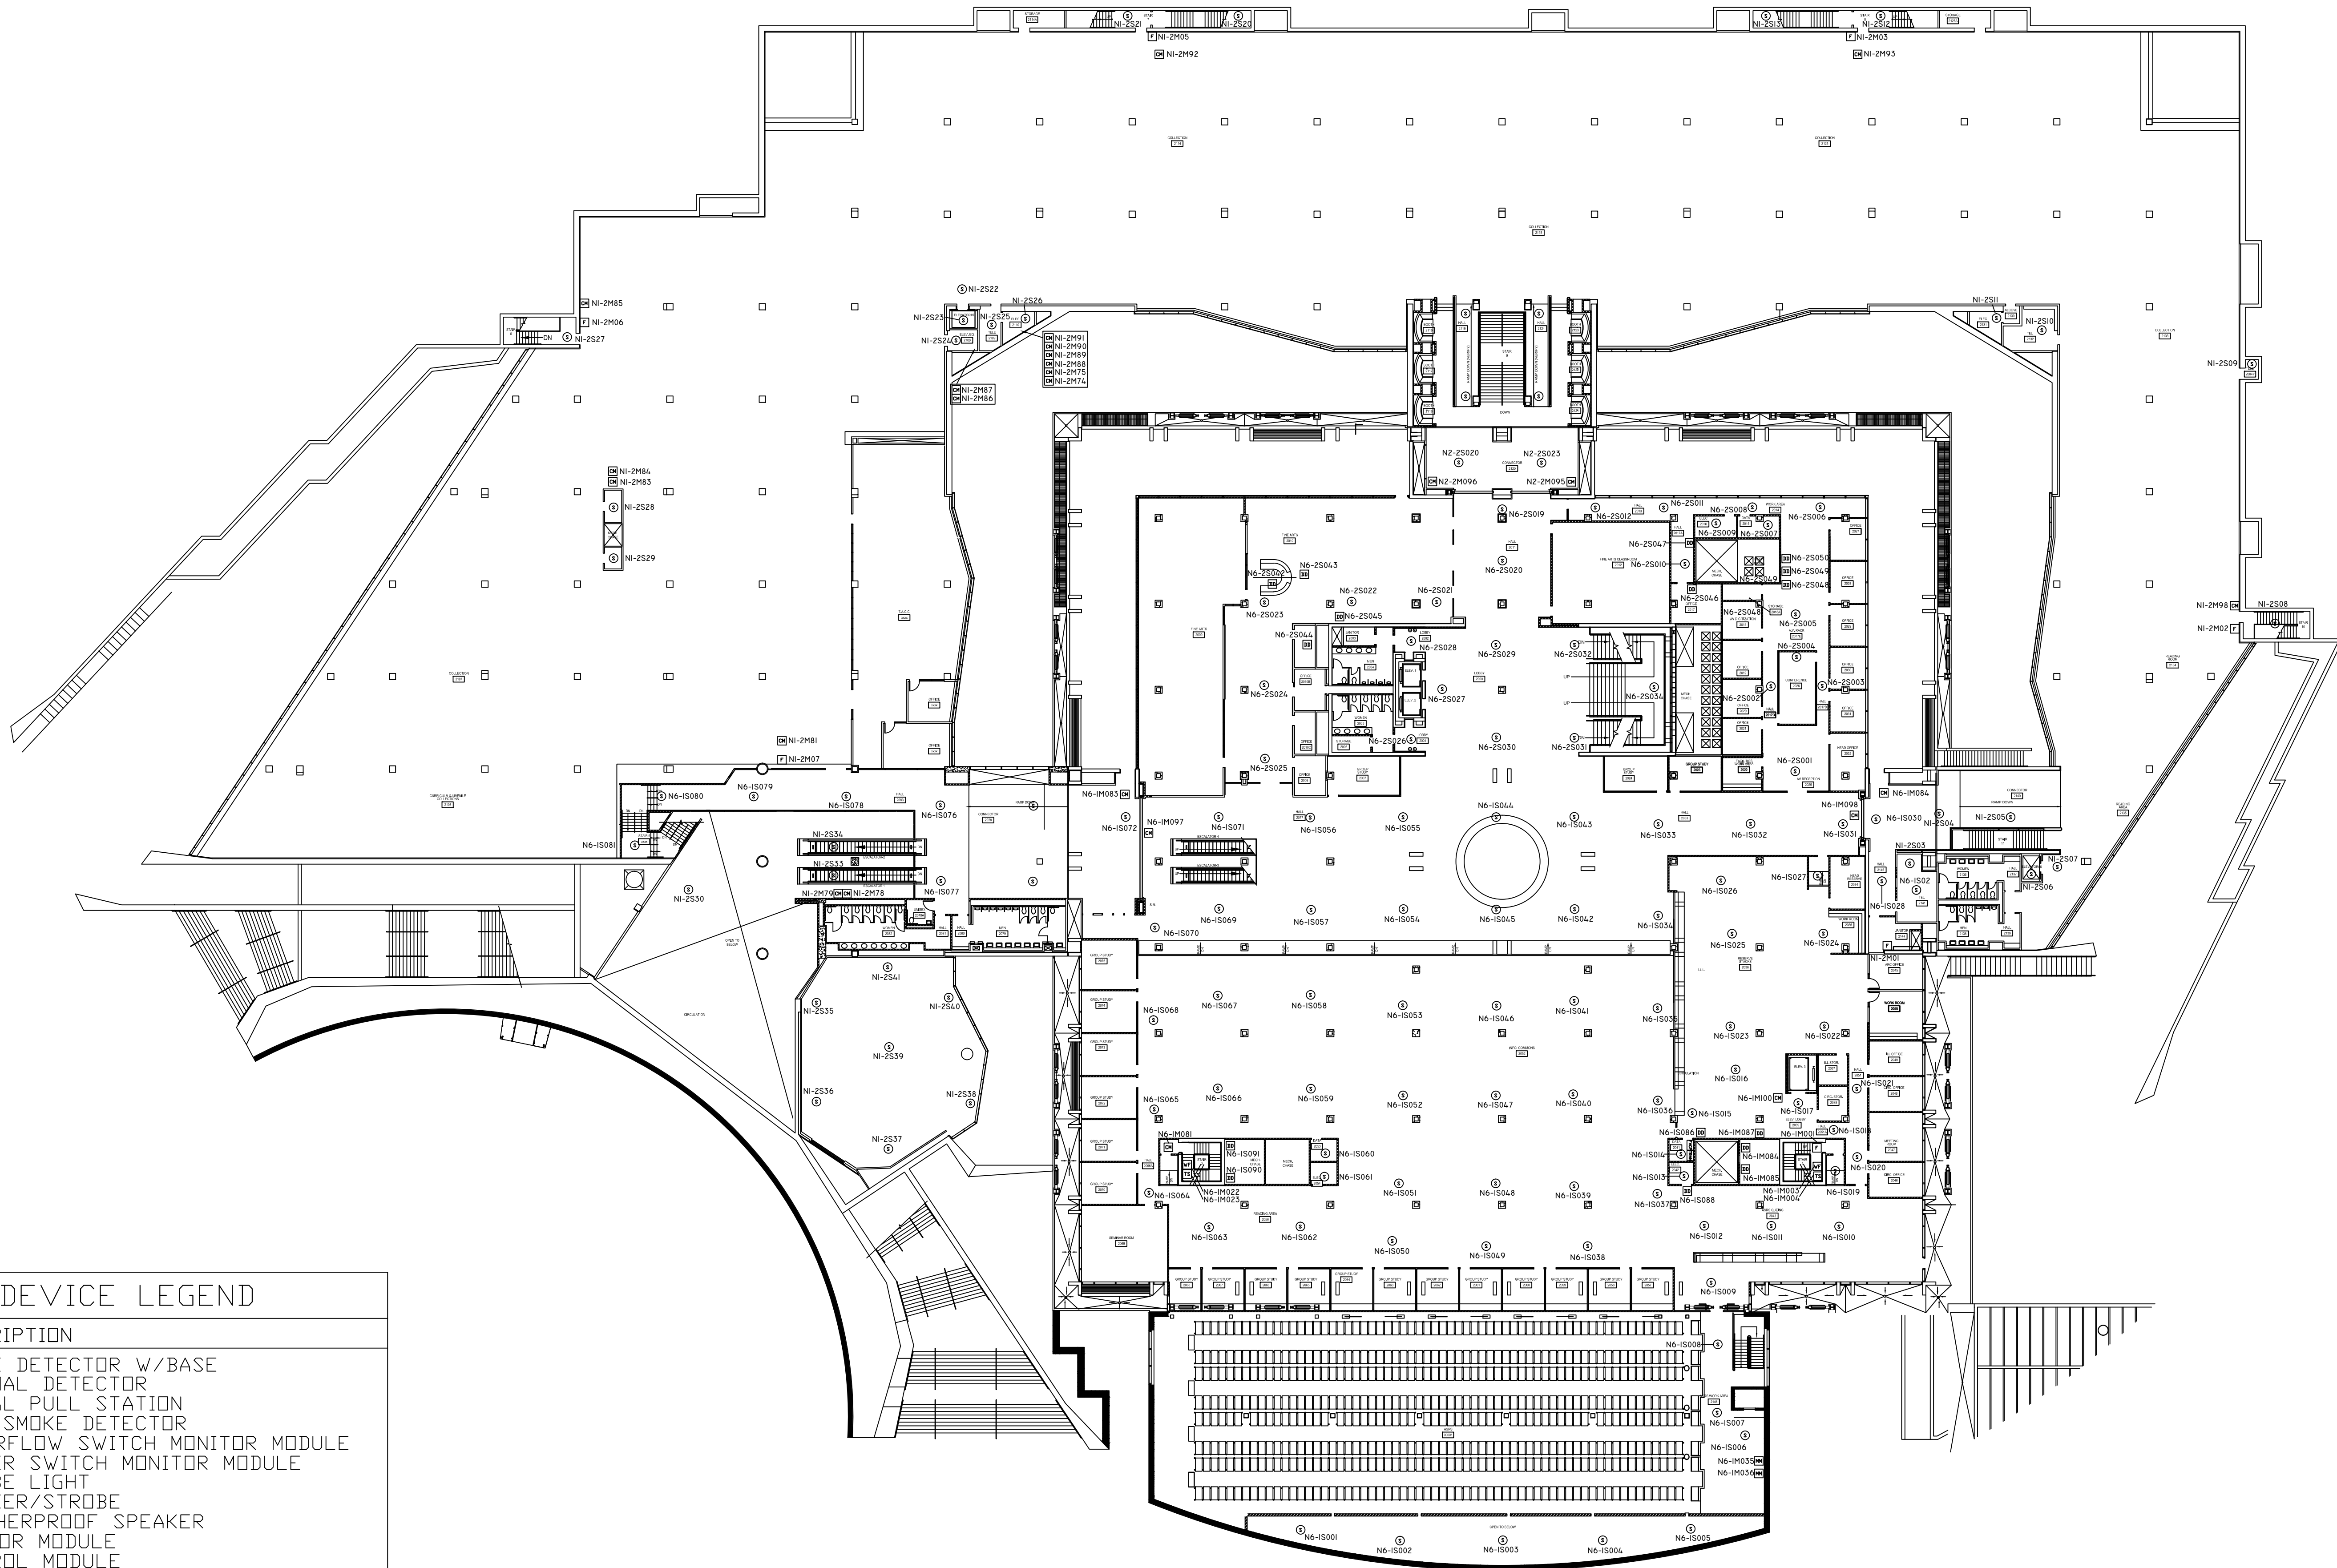

ADDRESS LABEL CLARIFICATION
— NODE NUMBER
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER

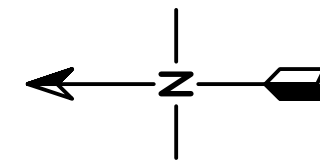

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
MARRIOTT LIBRARY RENOVATION
THIRD FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: DS
DESIGNED BY: ECE
APPROVED BY: DS
DATE: 7/11/2007
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: I
DRAWING NAME:
MARRIOTT LIBRARY 3.DWG

FIRE ALARM SYSTEM

THIRD FLOOR
ADDRESSABLE NUMBERS

PAGE:


FA-3-04

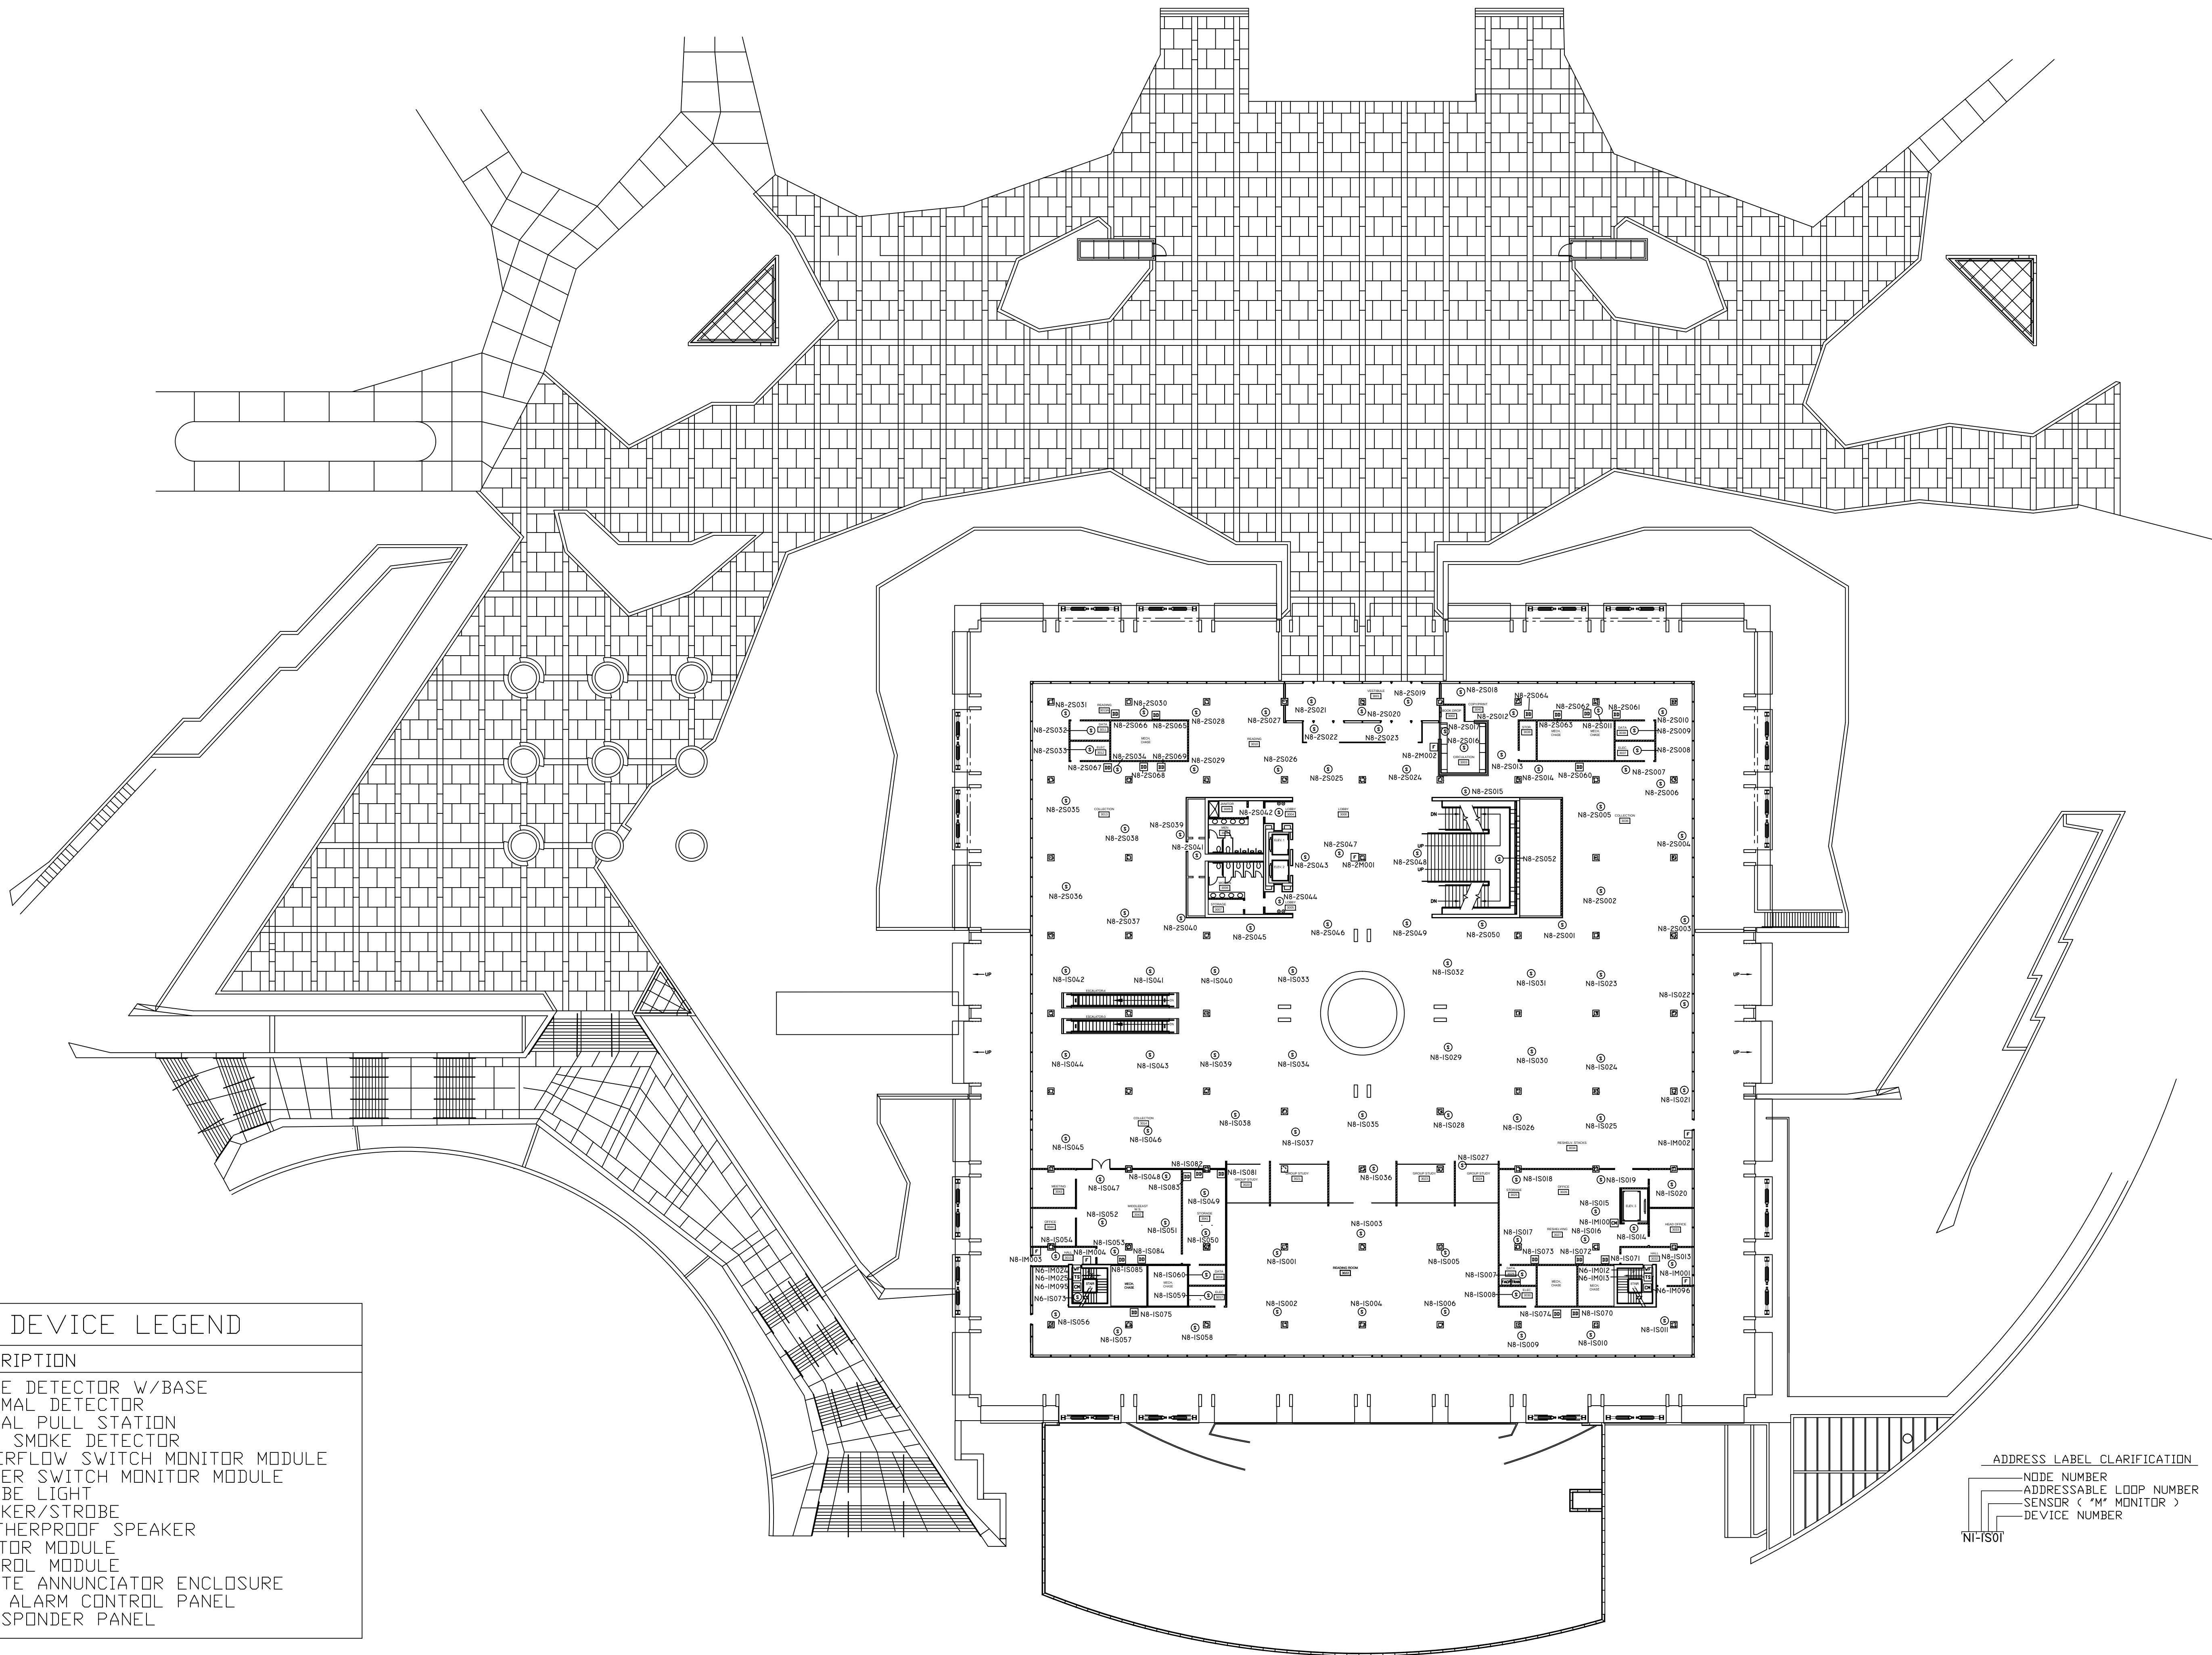

DEVICE LEGEND

SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR W/BASE
○	THERMAL DETECTOR
⌘	MANUAL PULL STATION
Ⓜ	DUCT SMOKE DETECTOR
Ⓜ	WATERFLOW SWITCH MONITOR MODULE
Ⓜ	TAMPER SWITCH MONITOR MODULE
Ⓜ	STROBE LIGHT
Ⓜ	SPEAKER/STROBE
Ⓜ	WEATHERPROOF SPEAKER
Ⓜ	MONITOR MODULE
Ⓜ	CONTROL MODULE
Ⓜ	REMOTE ANNUNCIATOR ENCLOSURE
Ⓜ	FIRE ALARM CONTROL PANEL
Ⓜ	TRANSPONDER PANEL

ADDRESS LABEL CLARIFICATION
NODE NUMBER
ADDRESSABLE LOOP NUMBER
SENSOR ("M" MONITOR)
DEVICE NUMBER

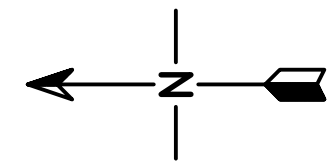

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
MARRIOTT LIBRARY RENOVATION
FOURTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: ECE
APPROVED BY: DS
DATE: 2/16/2009
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: I
DRAWING NAME:
MARRIOTT LIBRARY 4.DWG


FIRE ALARM SYSTEM

FOURTH FLOOR
ADDRESSABLE NUMBERS

PAGE:


FA-4-04

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR W/BASE
Ⓣ	THERMAL DETECTOR
ⓕ	MANUAL PULL STATION
Ⓛ	DUCT SMOKE DETECTOR
Ⓦⓕ	WATERFLOW SWITCH MONITOR MODULE
ⓉⓈ	TAMPER SWITCH MONITOR MODULE
Ⓛ	STROBE LIGHT
ⓈⓈ	SPEAKER/STROBE
Ⓢ	WEATHERPROOF SPEAKER
ⓂⓂ	MONITOR MODULE
ⓐⓂ	CONTROL MODULE
Ⓡⓐ	REMOTE ANNUNCIATOR ENCLOSURE
ⓕⓐⓐⓕ	FIRE ALARM CONTROL PANEL
ⓉⓇⓐⓃ	TRANSPONDER PANEL

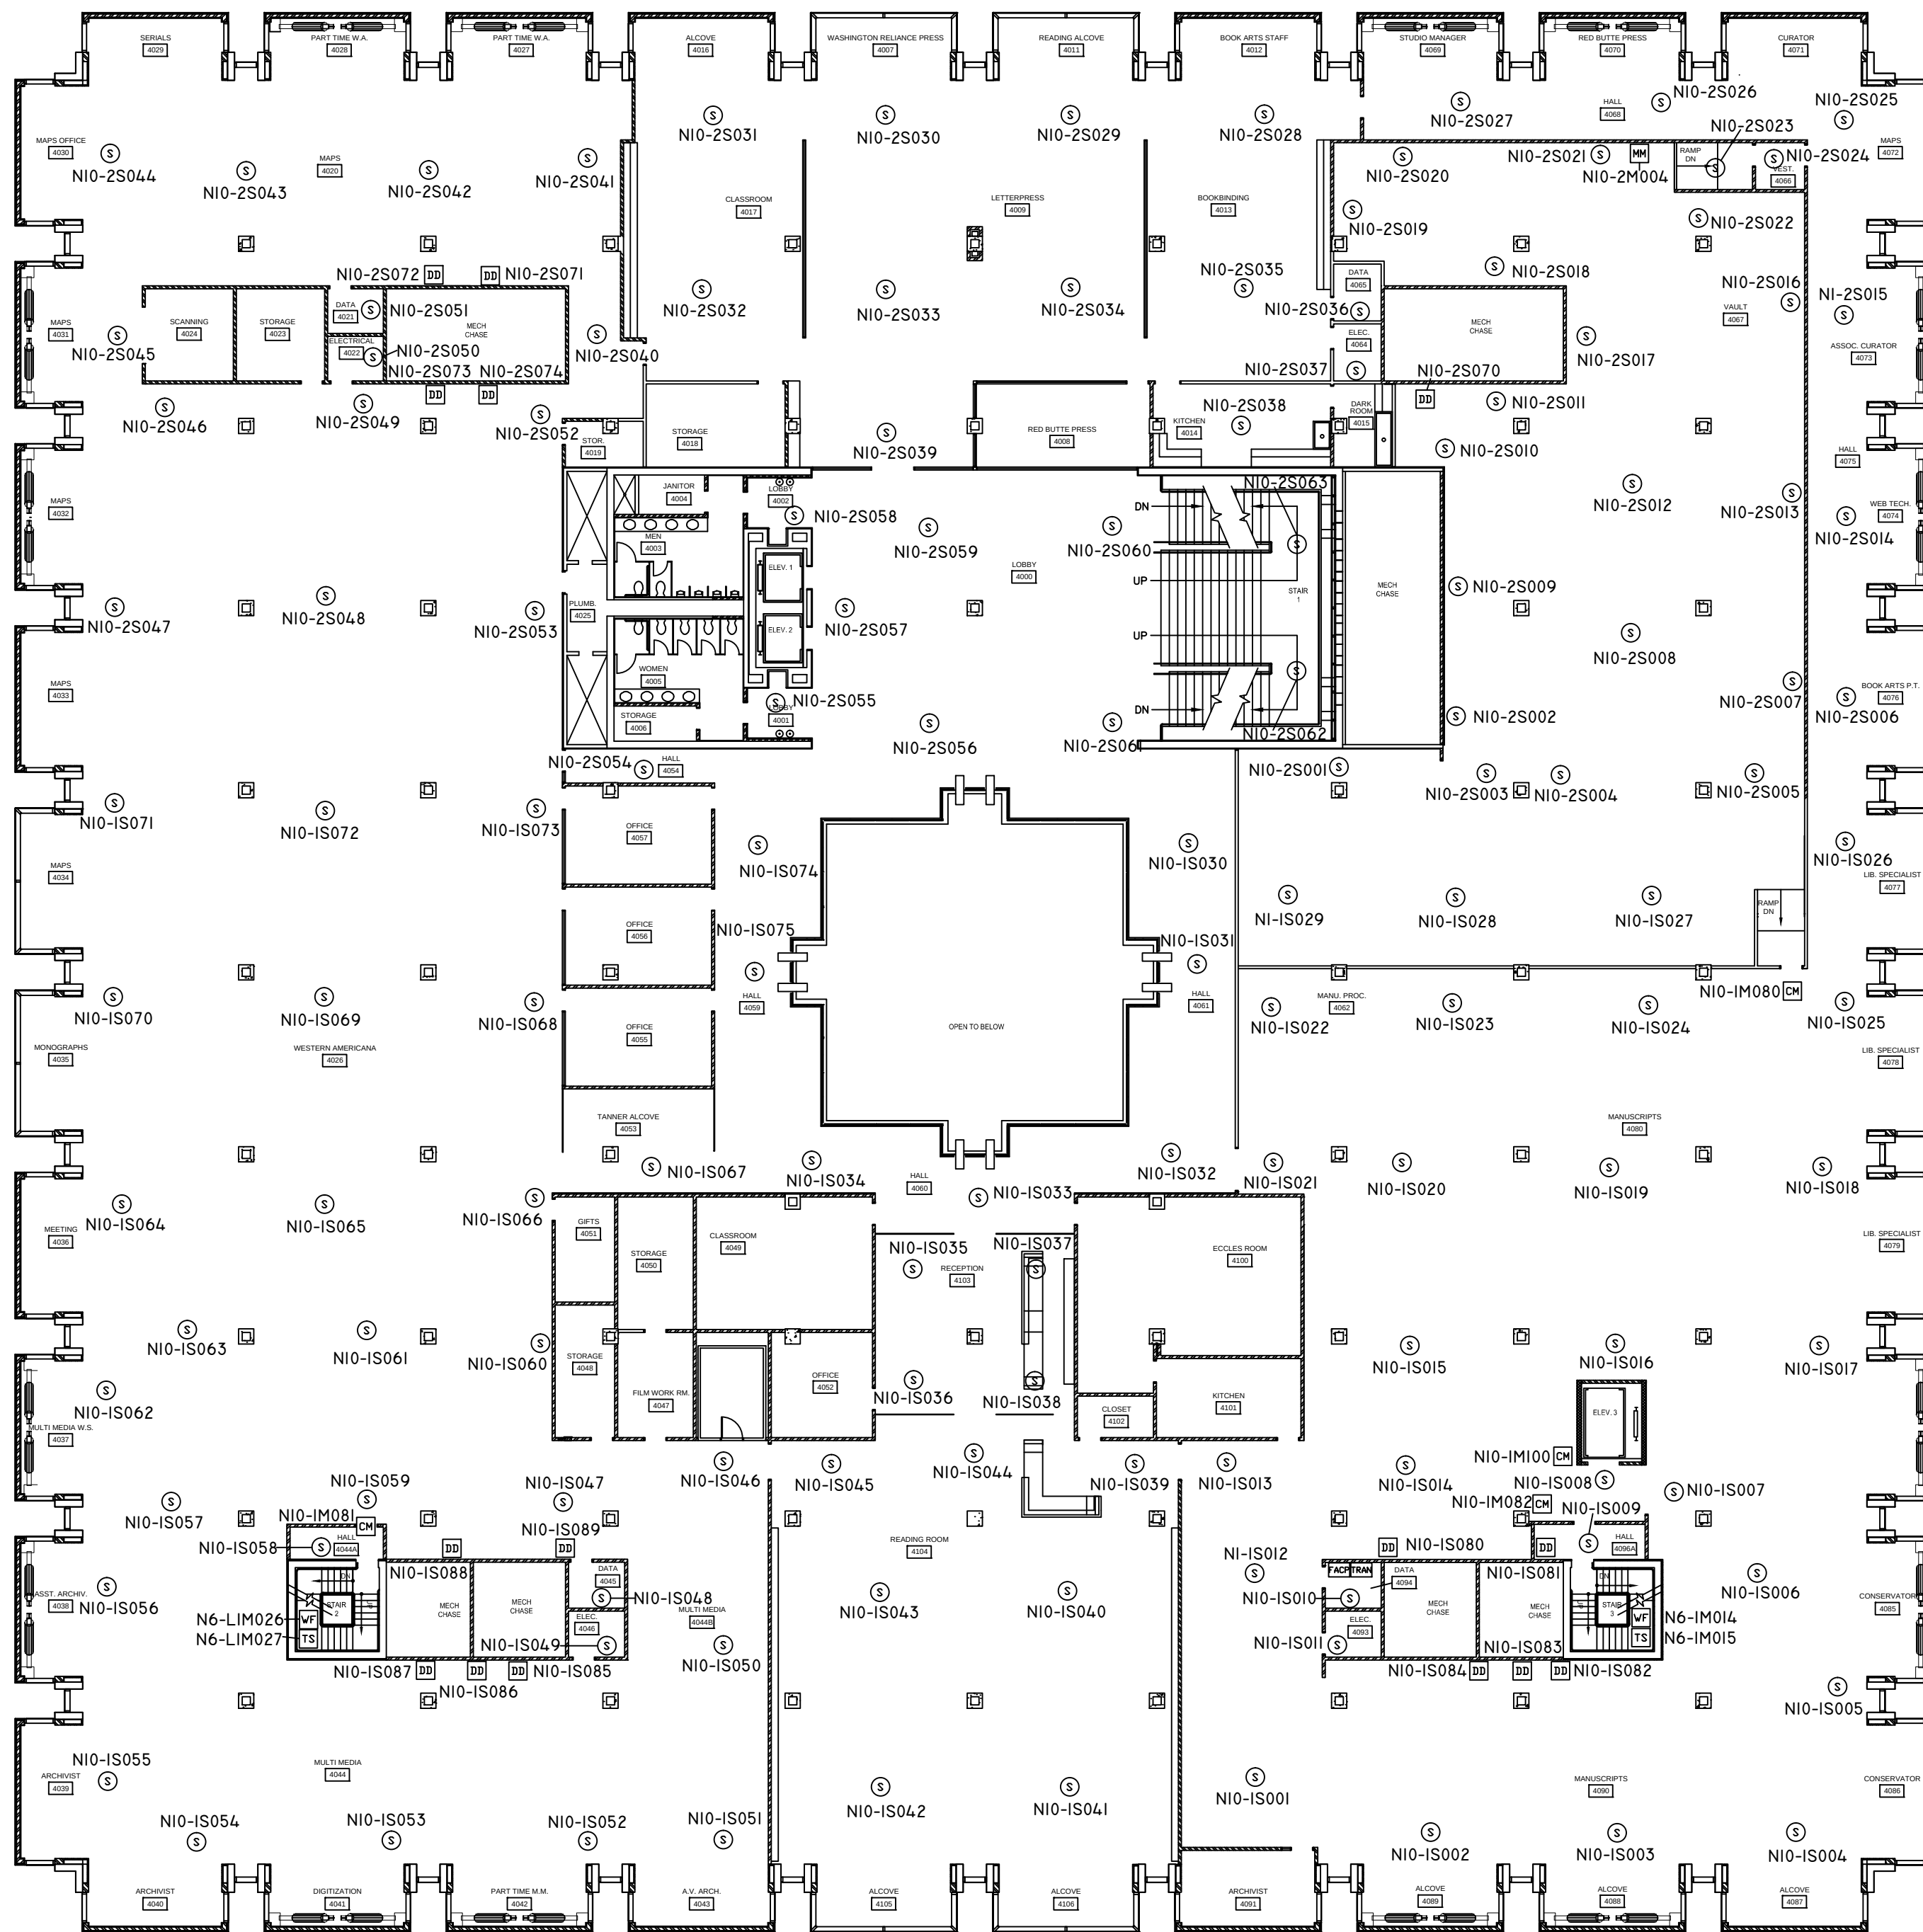

ADDRESS LABEL CLARIFICATION
— NODE NUMBER
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER

NI-IS01

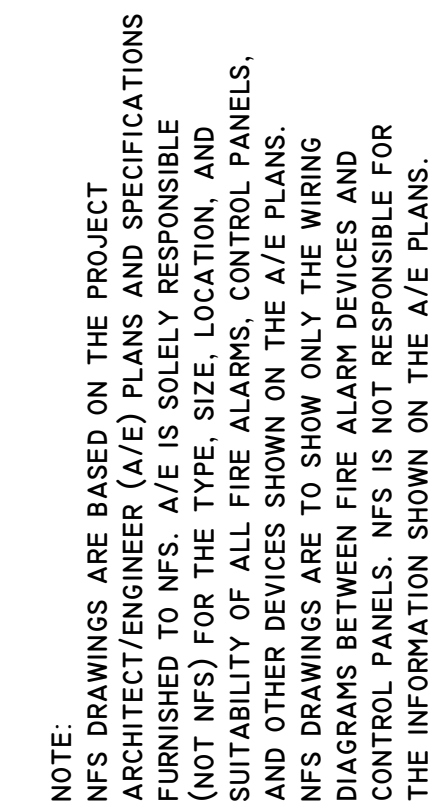

NFS
NELSON FIRE SYSTEMS
801-468-8300


FIRE ALARM SYSTEM
FIFTH FLOOR
ADDRESSABLE NUMBER

FA-5-04


ADDRESS LABEL CLARIFICATION

— NODE NUMBER
— ADDRESSABLE LOOP NUMBER
— SENSOR ('M' MONITOR)
— DEVICE NUMBER


NI-IS01



DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR W/BASE
⊙	THERMAL DETECTOR
⊞	MANUAL PULL STATION
⊞	DUCT SMOKE DETECTOR
⊞	WATERFLOW SWITCH MONITOR MODULE
⊞	TAMPER SWITCH MONITOR MODULE
⊞	STROBE LIGHT
⊞	SPEAKER/STROBE
⊞	WEATHERPROOF SPEAKER
⊞	MONITOR MODULE
⊞	CONTROL MODULE
⊞	REMOTE ANNUNCIATOR ENCLOSURE
⊞	FIRE ALARM CONTROL PANEL
⊞	TRANSPONDER PANEL

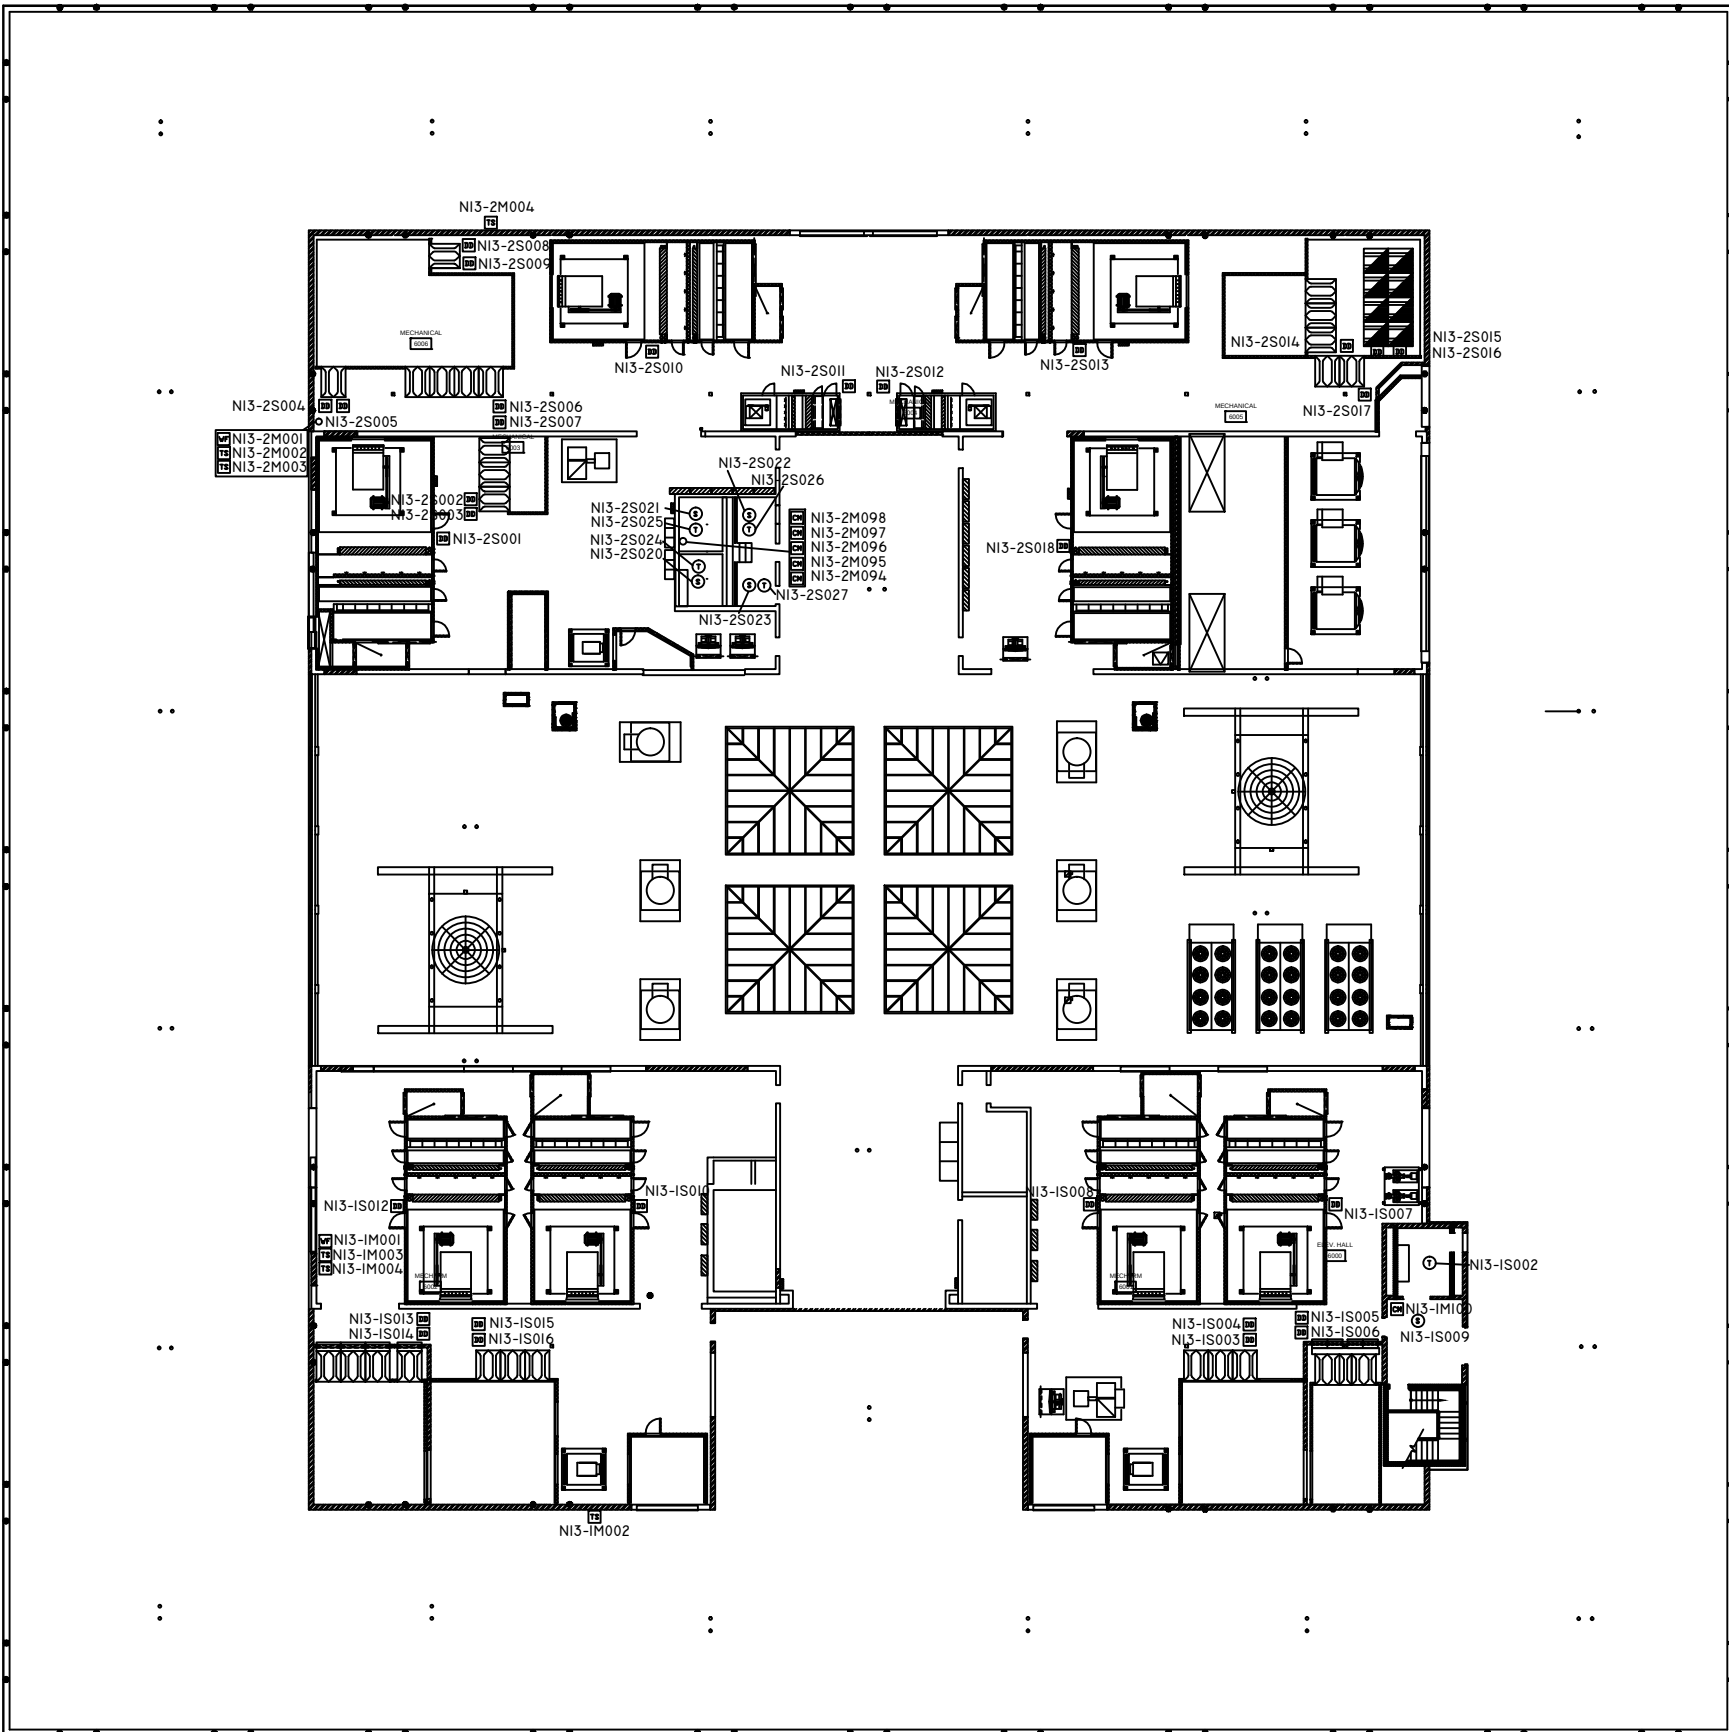

ADDRESS LABEL CLARIFICATION:
— NODE NUMBER
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER



NOTE: DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. THESE DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARM CONTROL PANELS, SPEAKERS, STROBE LIGHTS, AND OTHER FIRE ALARM DEVICES. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING INFORMATION FOR THE FIRE ALARM SYSTEM. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
MARIOTT LIBRARY RENOVATION
PENTHOUSE LEVEL
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: ECE
APPROVED BY: DS
DATE: 7/11/2008
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: 1
DRAWING NAME:
MARIOTT LIBRARY PENT.DWG

FIRE ALARM SYSTEM
PENTHOUSE LEVEL
ADDRESSABLE NUMBERS

PAGE:
FA-P-04