



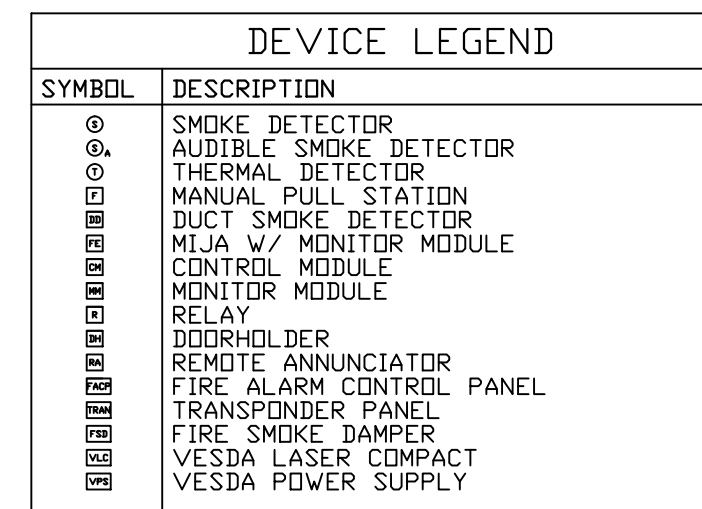

DEVICE LEGEND	
SYMBOL	DESCRIPTION
①	SMOKE DETECTOR
①A	AUDIBLE SMOKE DETECTOR
①	THERMAL DETECTOR
①	MANUAL PULL STATION
①B	DUCT SMOKE DETECTOR
①C	MIA W/ MONITOR MODULE
①D	CONTROL MODULE
①E	MONITOR MODULE
①F	RELAY
①G	DOORHOLDER
①H	REMOTE ANNUNCIATOR
①I	FIRE ALARM CONTROL PANEL
①J	TRANSPONDER PANEL
①K	FIRE SMOKE DAMPER
①L	VESDA LASER COMPACT
①M	VESDA POWER SUPPLY

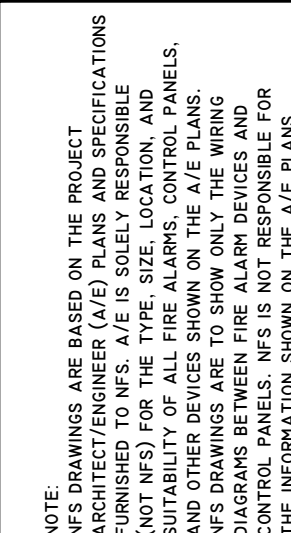

NOTE: NF'S DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NF'S. A/E IS SOLELY RESPONSIBLE FOR THE ACCURACY OF THE A/E, SIZES, LOCATIONS, PANELS, NOTATIONS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NF'S DRAWINGS ARE TO SHOW ONLY THE WIRING CONNECTIONS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NF'S IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HONORS HOUSING
BASEMENT
1901 E SOUTH CAMPUS DR
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	7/16/2012
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	
HONORS BASEMENT FINAL.DWG	

FIRE ALARM SYSTEM

DEVICE ADDRESS

PAGE:


FA-B

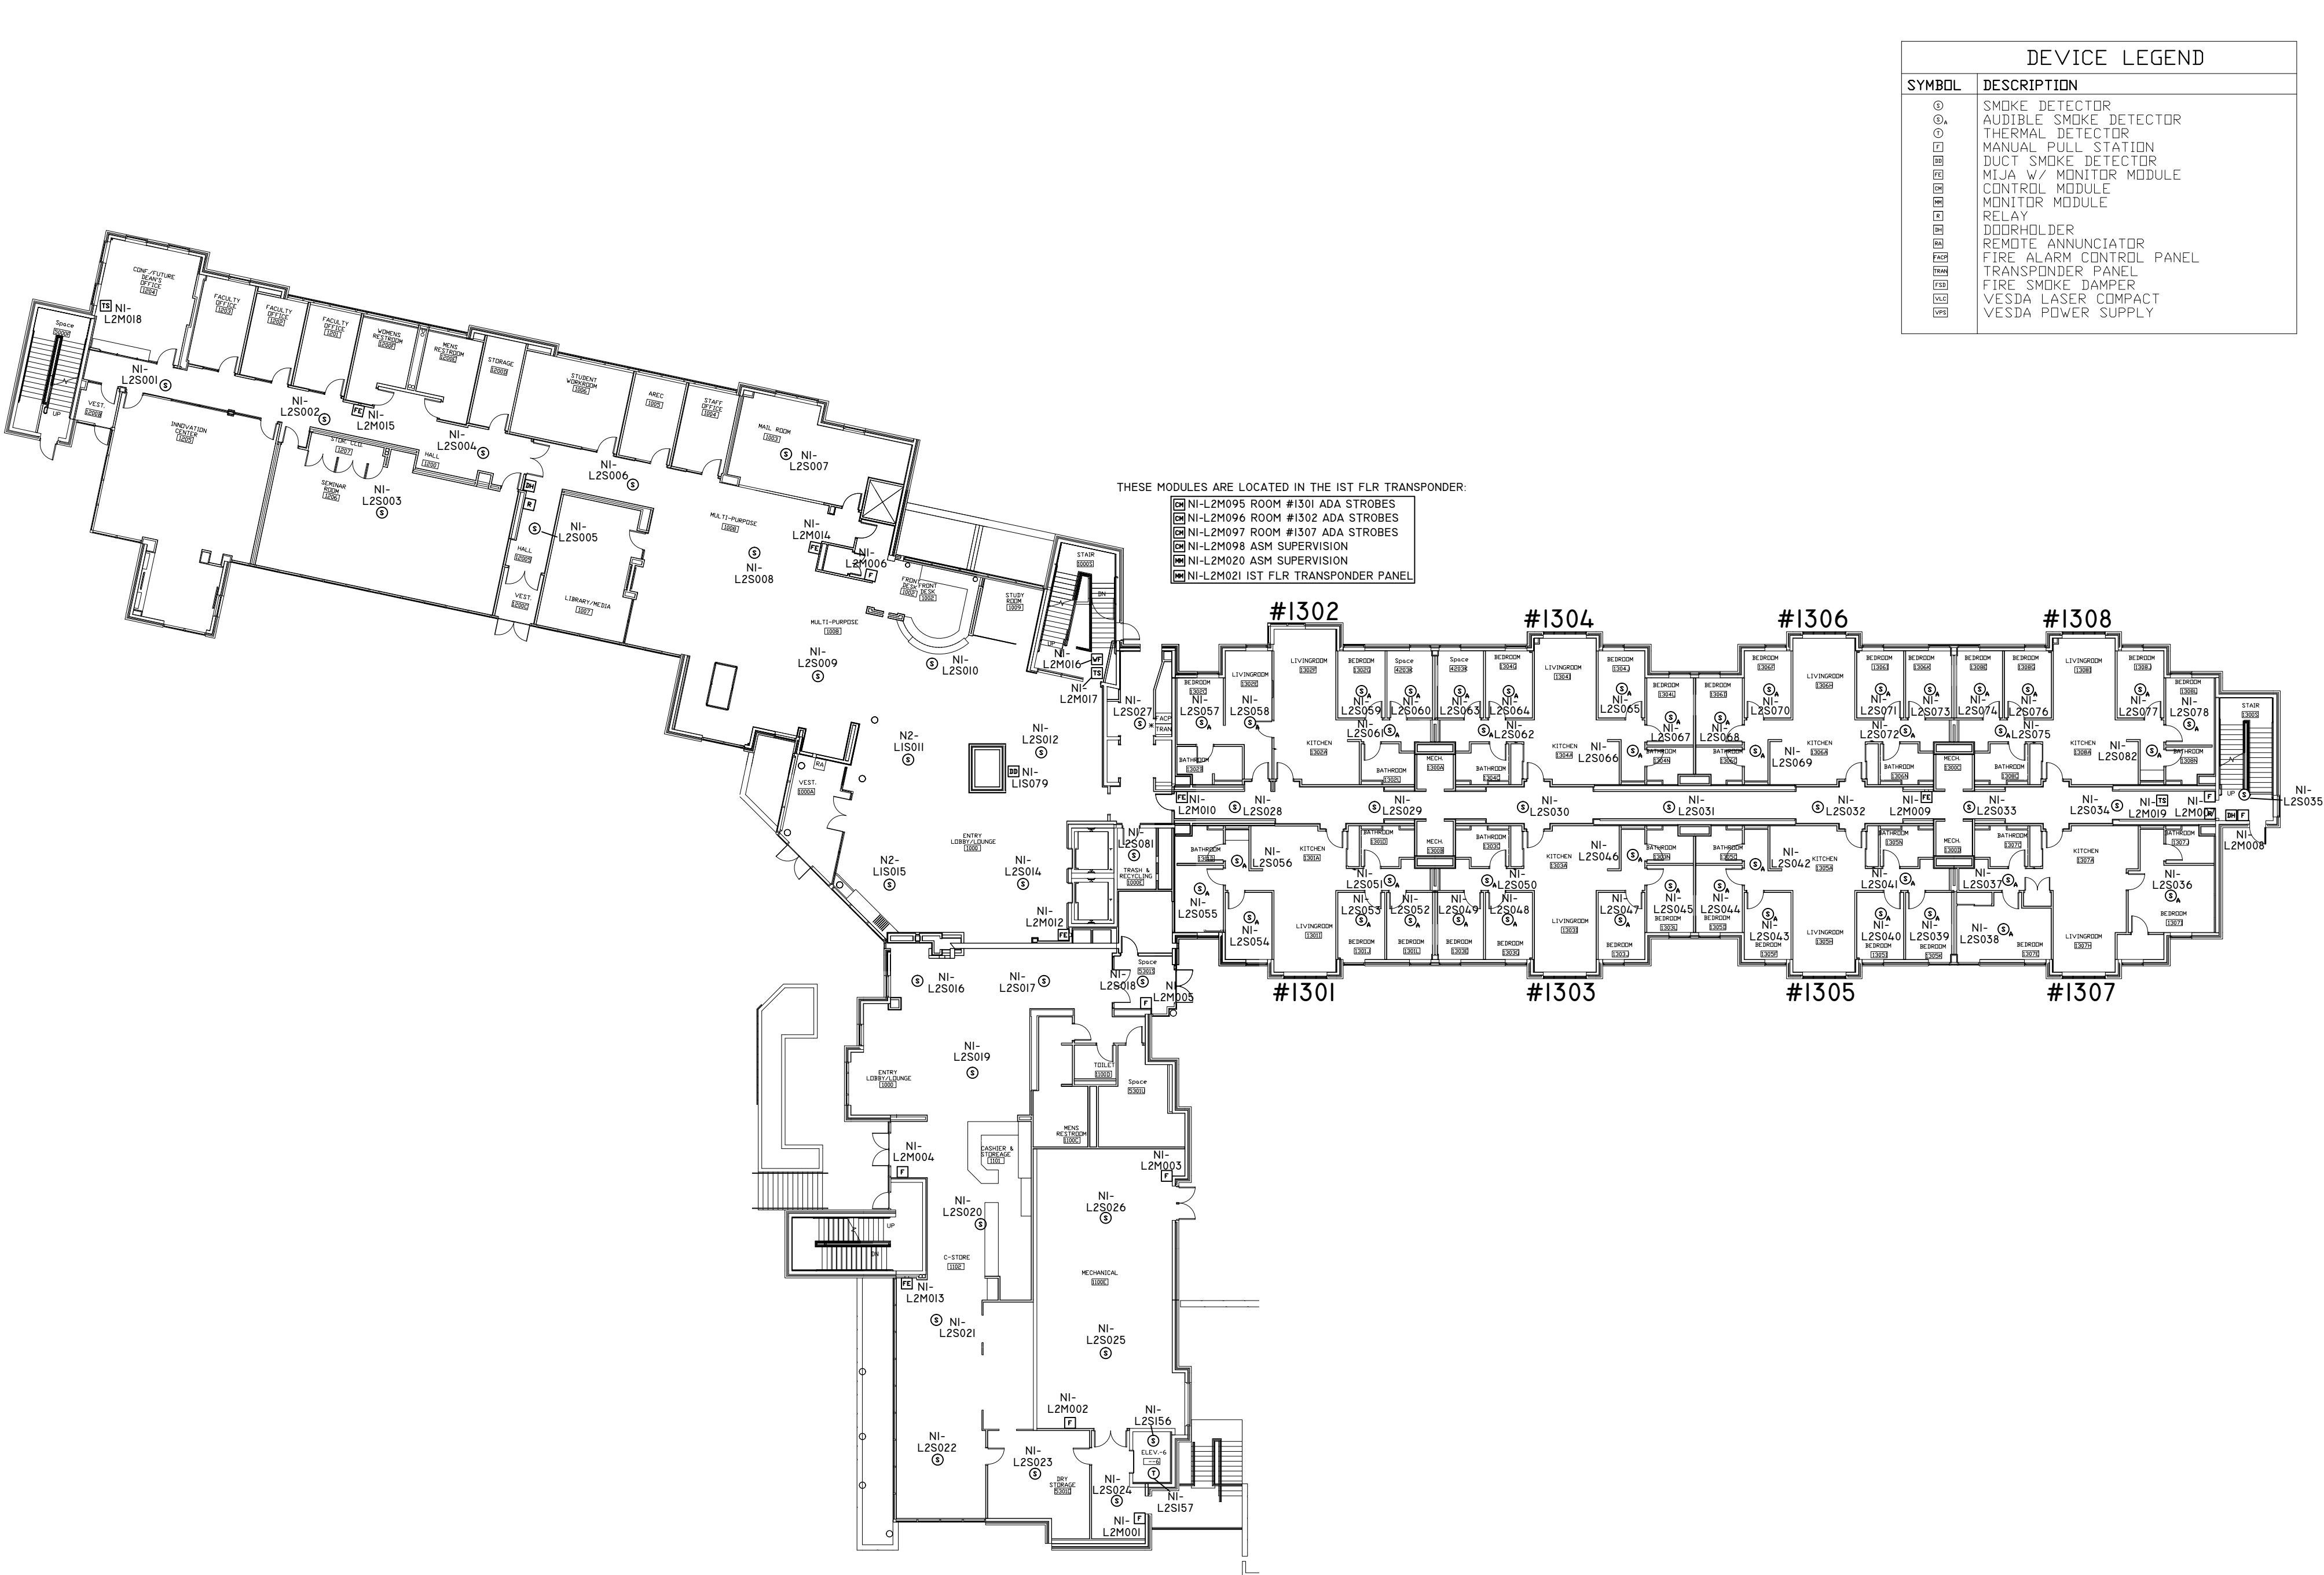

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	AUDIBLE SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	MIJA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊙	MONITOR MODULE
⊙	RELAY
⊙	DOORHOLDER
⊙	REMOTE ANNUNCIATOR
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊙	VESDA LASER COMPACT
⊙	VESDA POWER SUPPLY

THESE MODULES ARE LOCATED IN THE 1ST FLR TRANSPONDER:

- NI-L2M095 ROOM #1301 ADA STROBES
- NI-L2M096 ROOM #1302 ADA STROBES
- NI-L2M097 ROOM #1307 ADA STROBES
- NI-L2M098 ASM SUPERVISION
- NI-L2M020 ASM SUPERVISION
- NI-L2M021 1ST FLR TRANSPONDER PANEL



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT'S/ENGINEER'S (A/E) PLANS. NFS IS NOT RESPONSIBLE FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HONORS HOUSING
LEVEL 1
1901 E SOUTH CAMPUS DR
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	JUG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	9/7/2012
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	HONORS LEVEL 1 FINAL.DWG

FIRE ALARM SYSTEM


DEVICE ADDRESS

PAGE:

FA-I

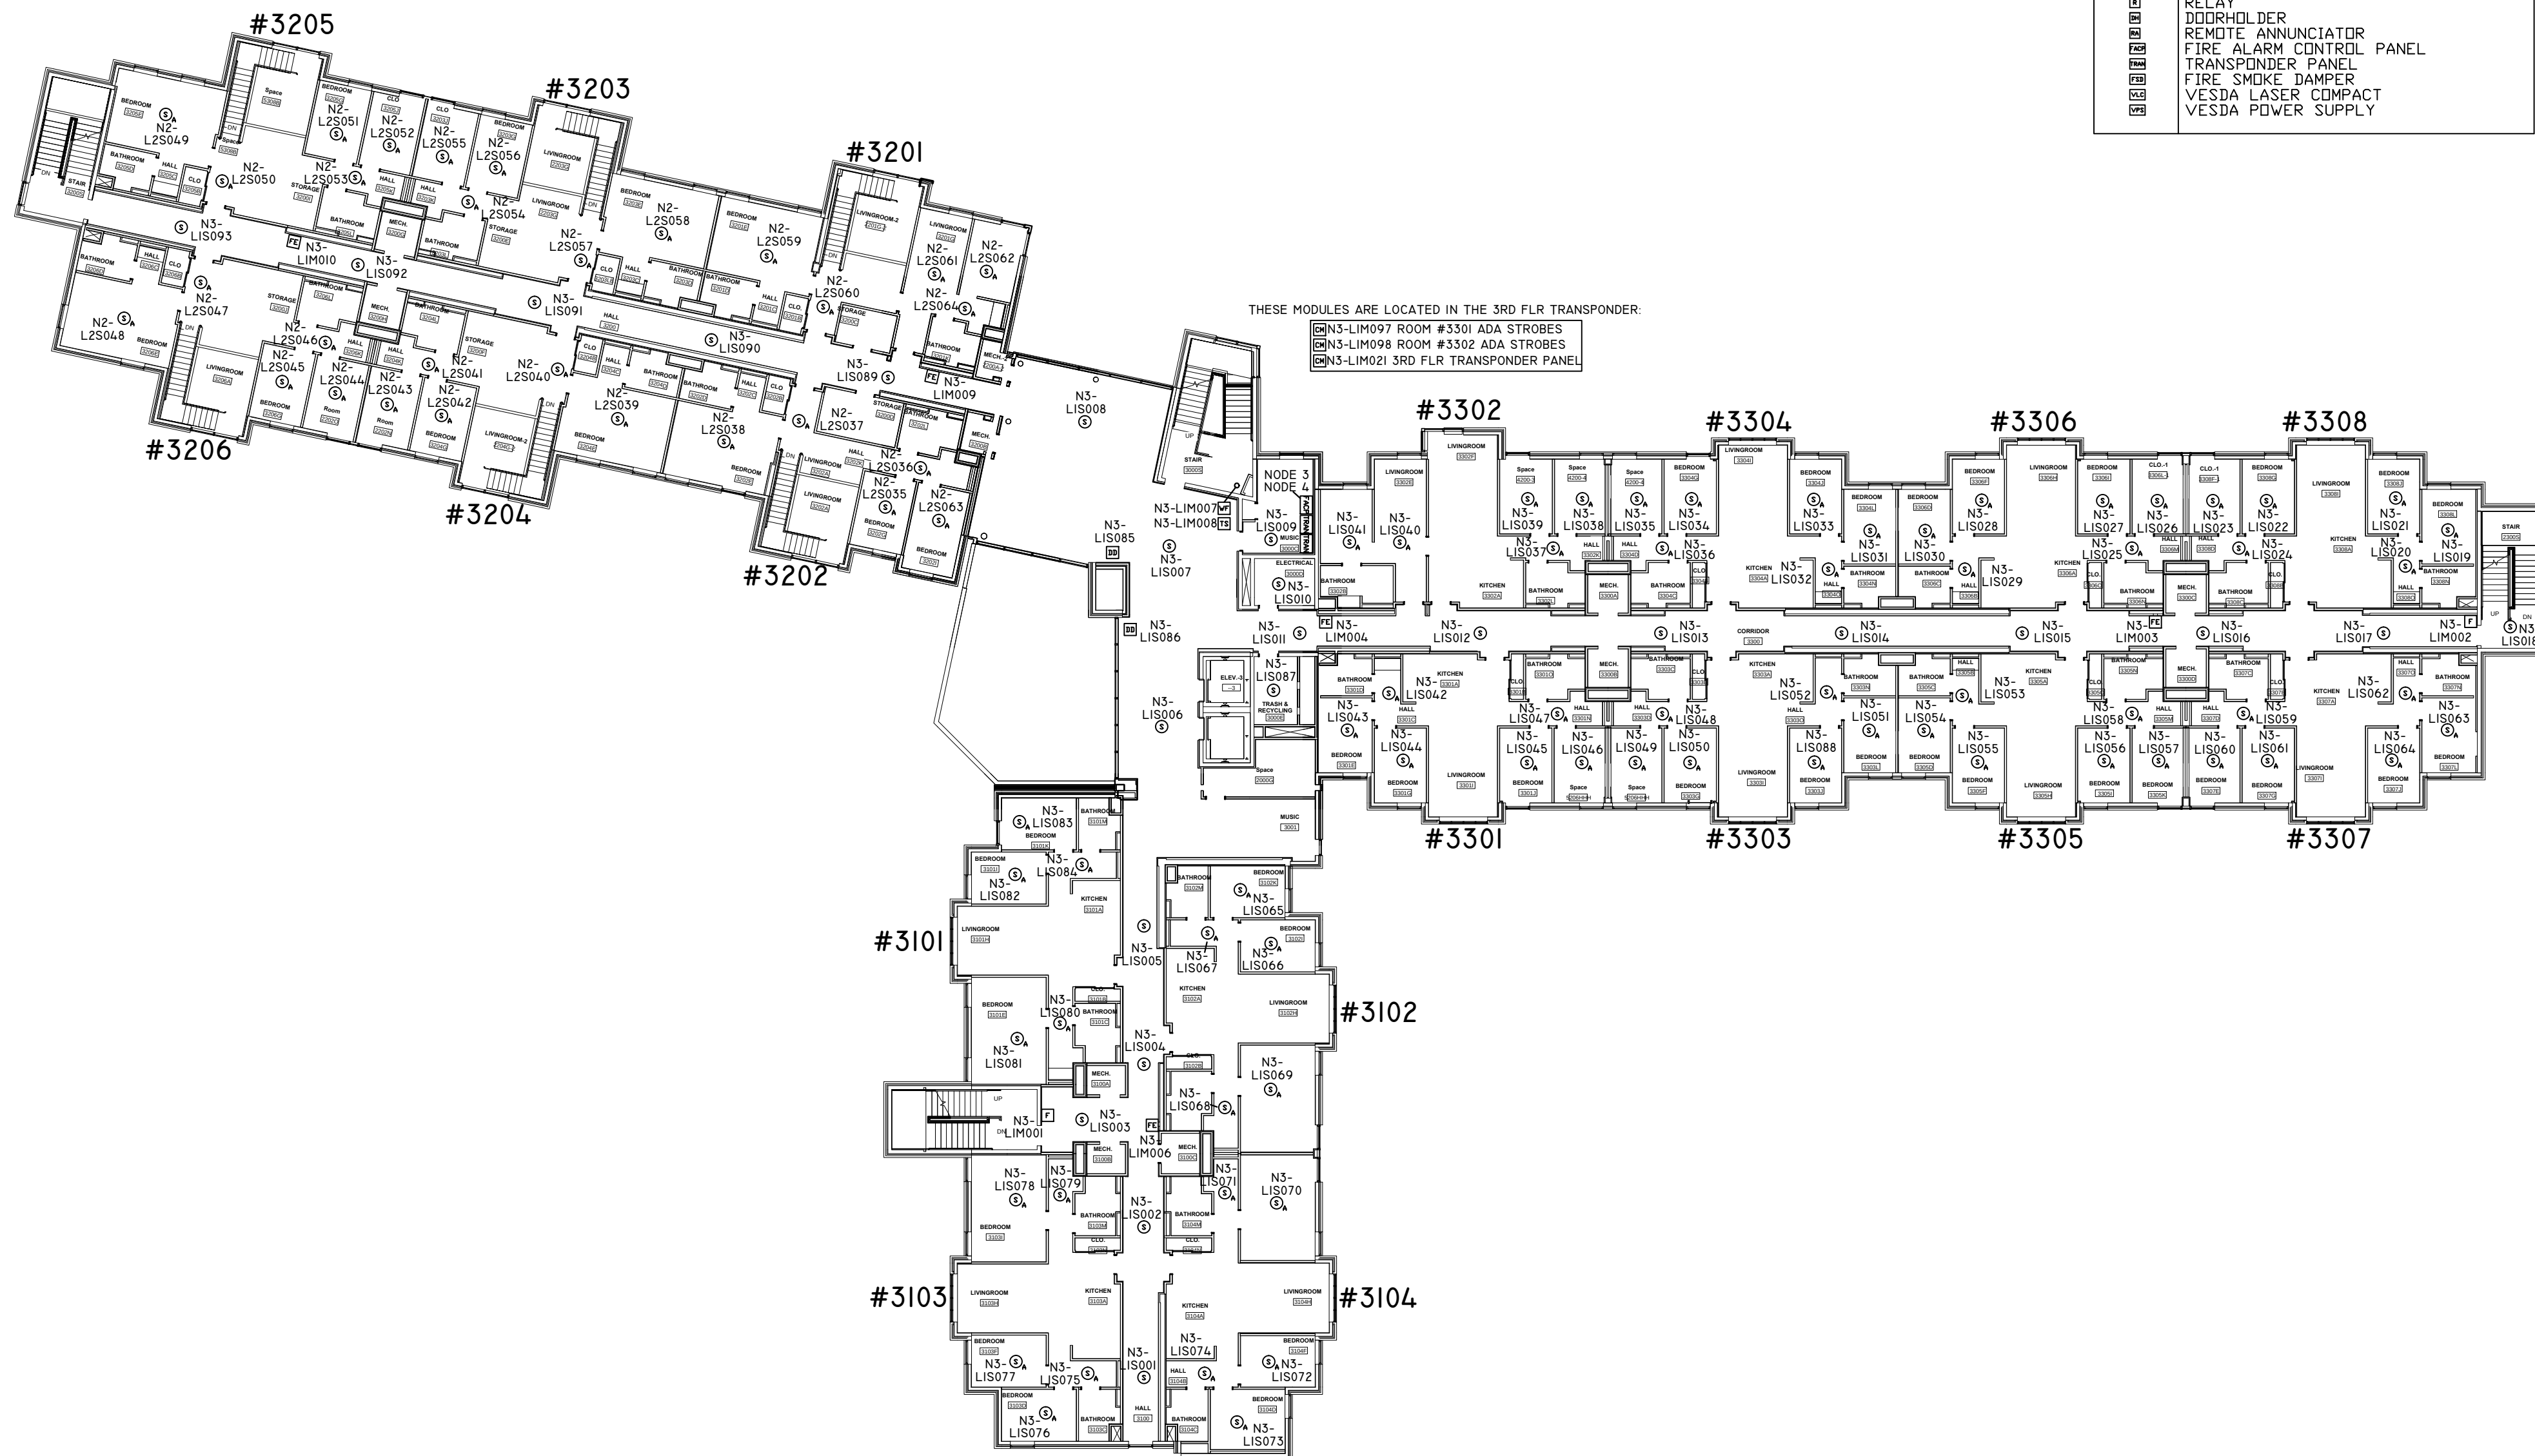

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	AUDIBLE SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	MIJA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊙	MONITOR MODULE
⊙	RELAY
⊙	DOORHOLD RELAY
⊙	REMOTE ANNUNCIATOR
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊙	VESDA LASER COMPACT
⊙	VESDA POWER SUPPLY



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT'S (A/E) SCHEDULES AND SPECIFICATIONS. NFS IS NOT RESPONSIBLE FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
HONORS HOUSING
LEVEL 3
1901 E SOUTH CAMPUS DR
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS
NORFOLK FIRE SYSTEMS
801-468-8300


DRAWN BY:	JUG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	7/16/2012
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	HONORS LEVEL 3 FINAL.DWG

FIRE ALARM SYSTEM
DEVICE ADDRESS

PAGE:
FA-3

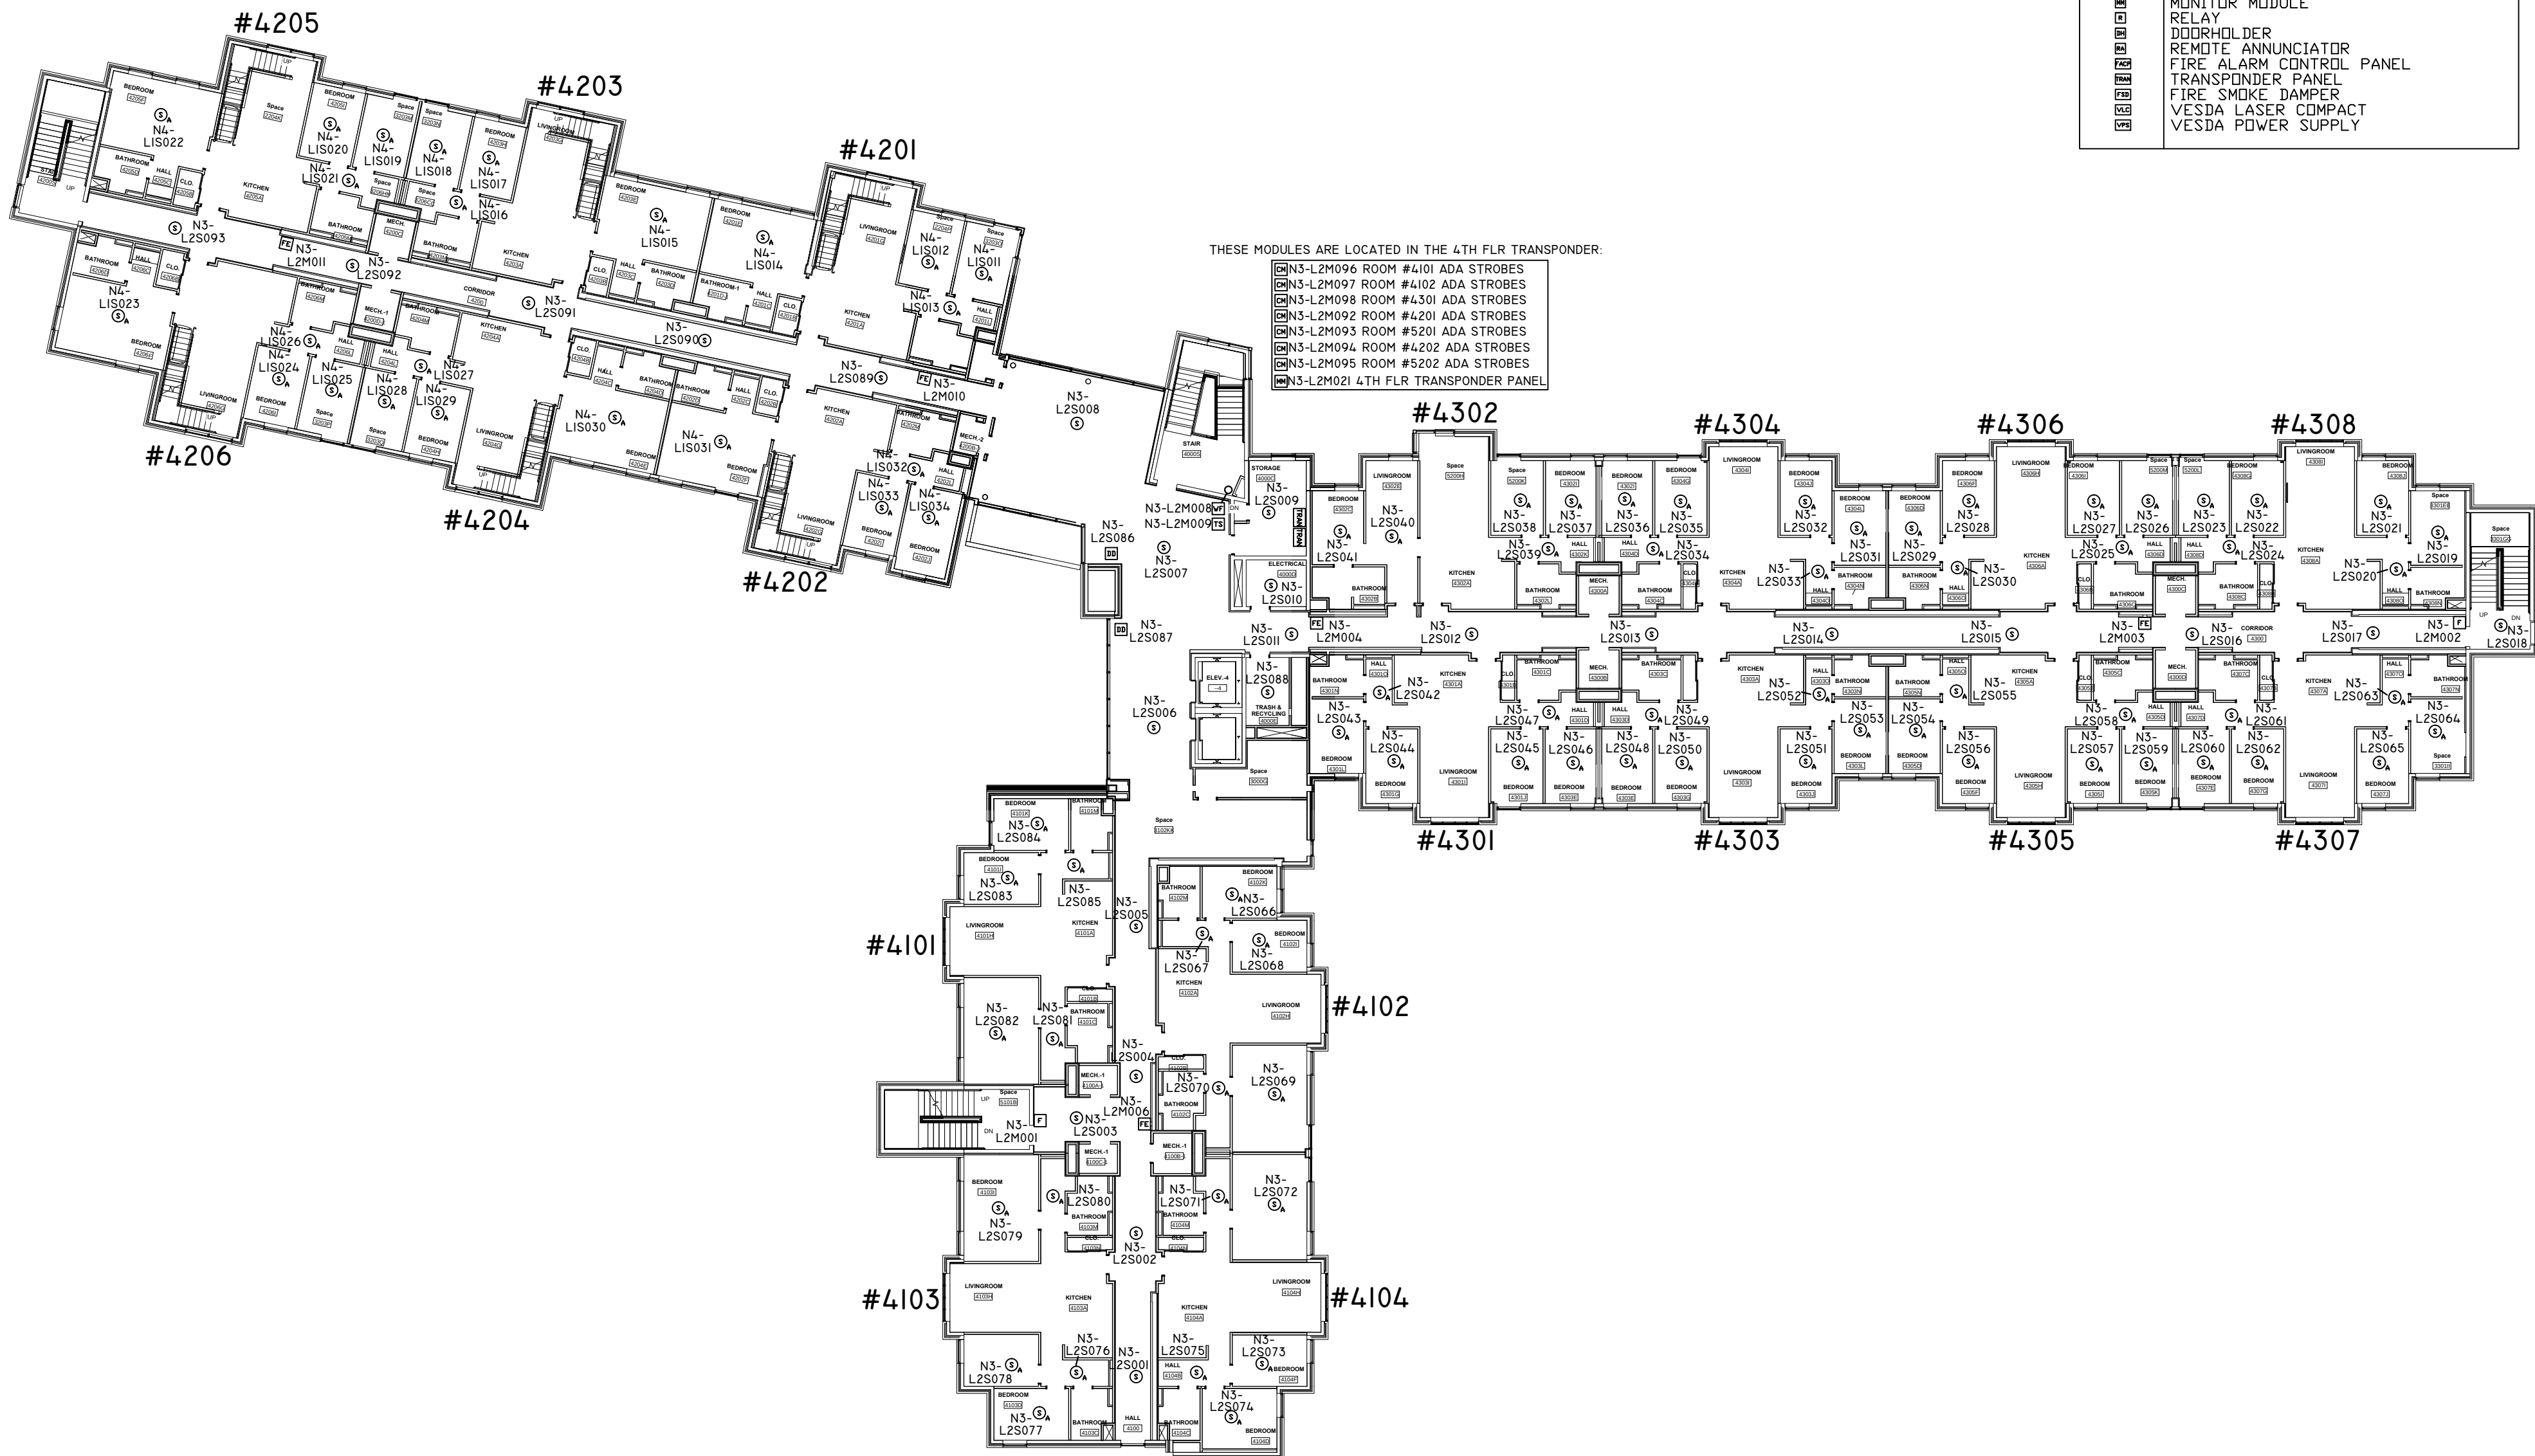

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	AUDIBLE SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	MIJA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊙	MONITOR MODULE
⊙	RELAY
⊙	DOORHOLD RELAY
⊙	REMOTE ANNUNCIATOR
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊙	VESDA LASER COMPACT
⊙	VESDA POWER SUPPLY



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS. NFS IS NOT RESPONSIBLE FOR THE TYPE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
HONORS HOUSING
LEVEL 4
1901 E SOUTH CAMPUS DR
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS
NORLAND FIRE SYSTEMS
801-468-8300


DRAWN BY:	JUG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	7/16/2012
SCALE:	N.T.S
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	HONORS LEVEL 4 FINAL.DWG

FIRE ALARM SYSTEM
DEVICE ADDRESS

PAGE:
FA-4

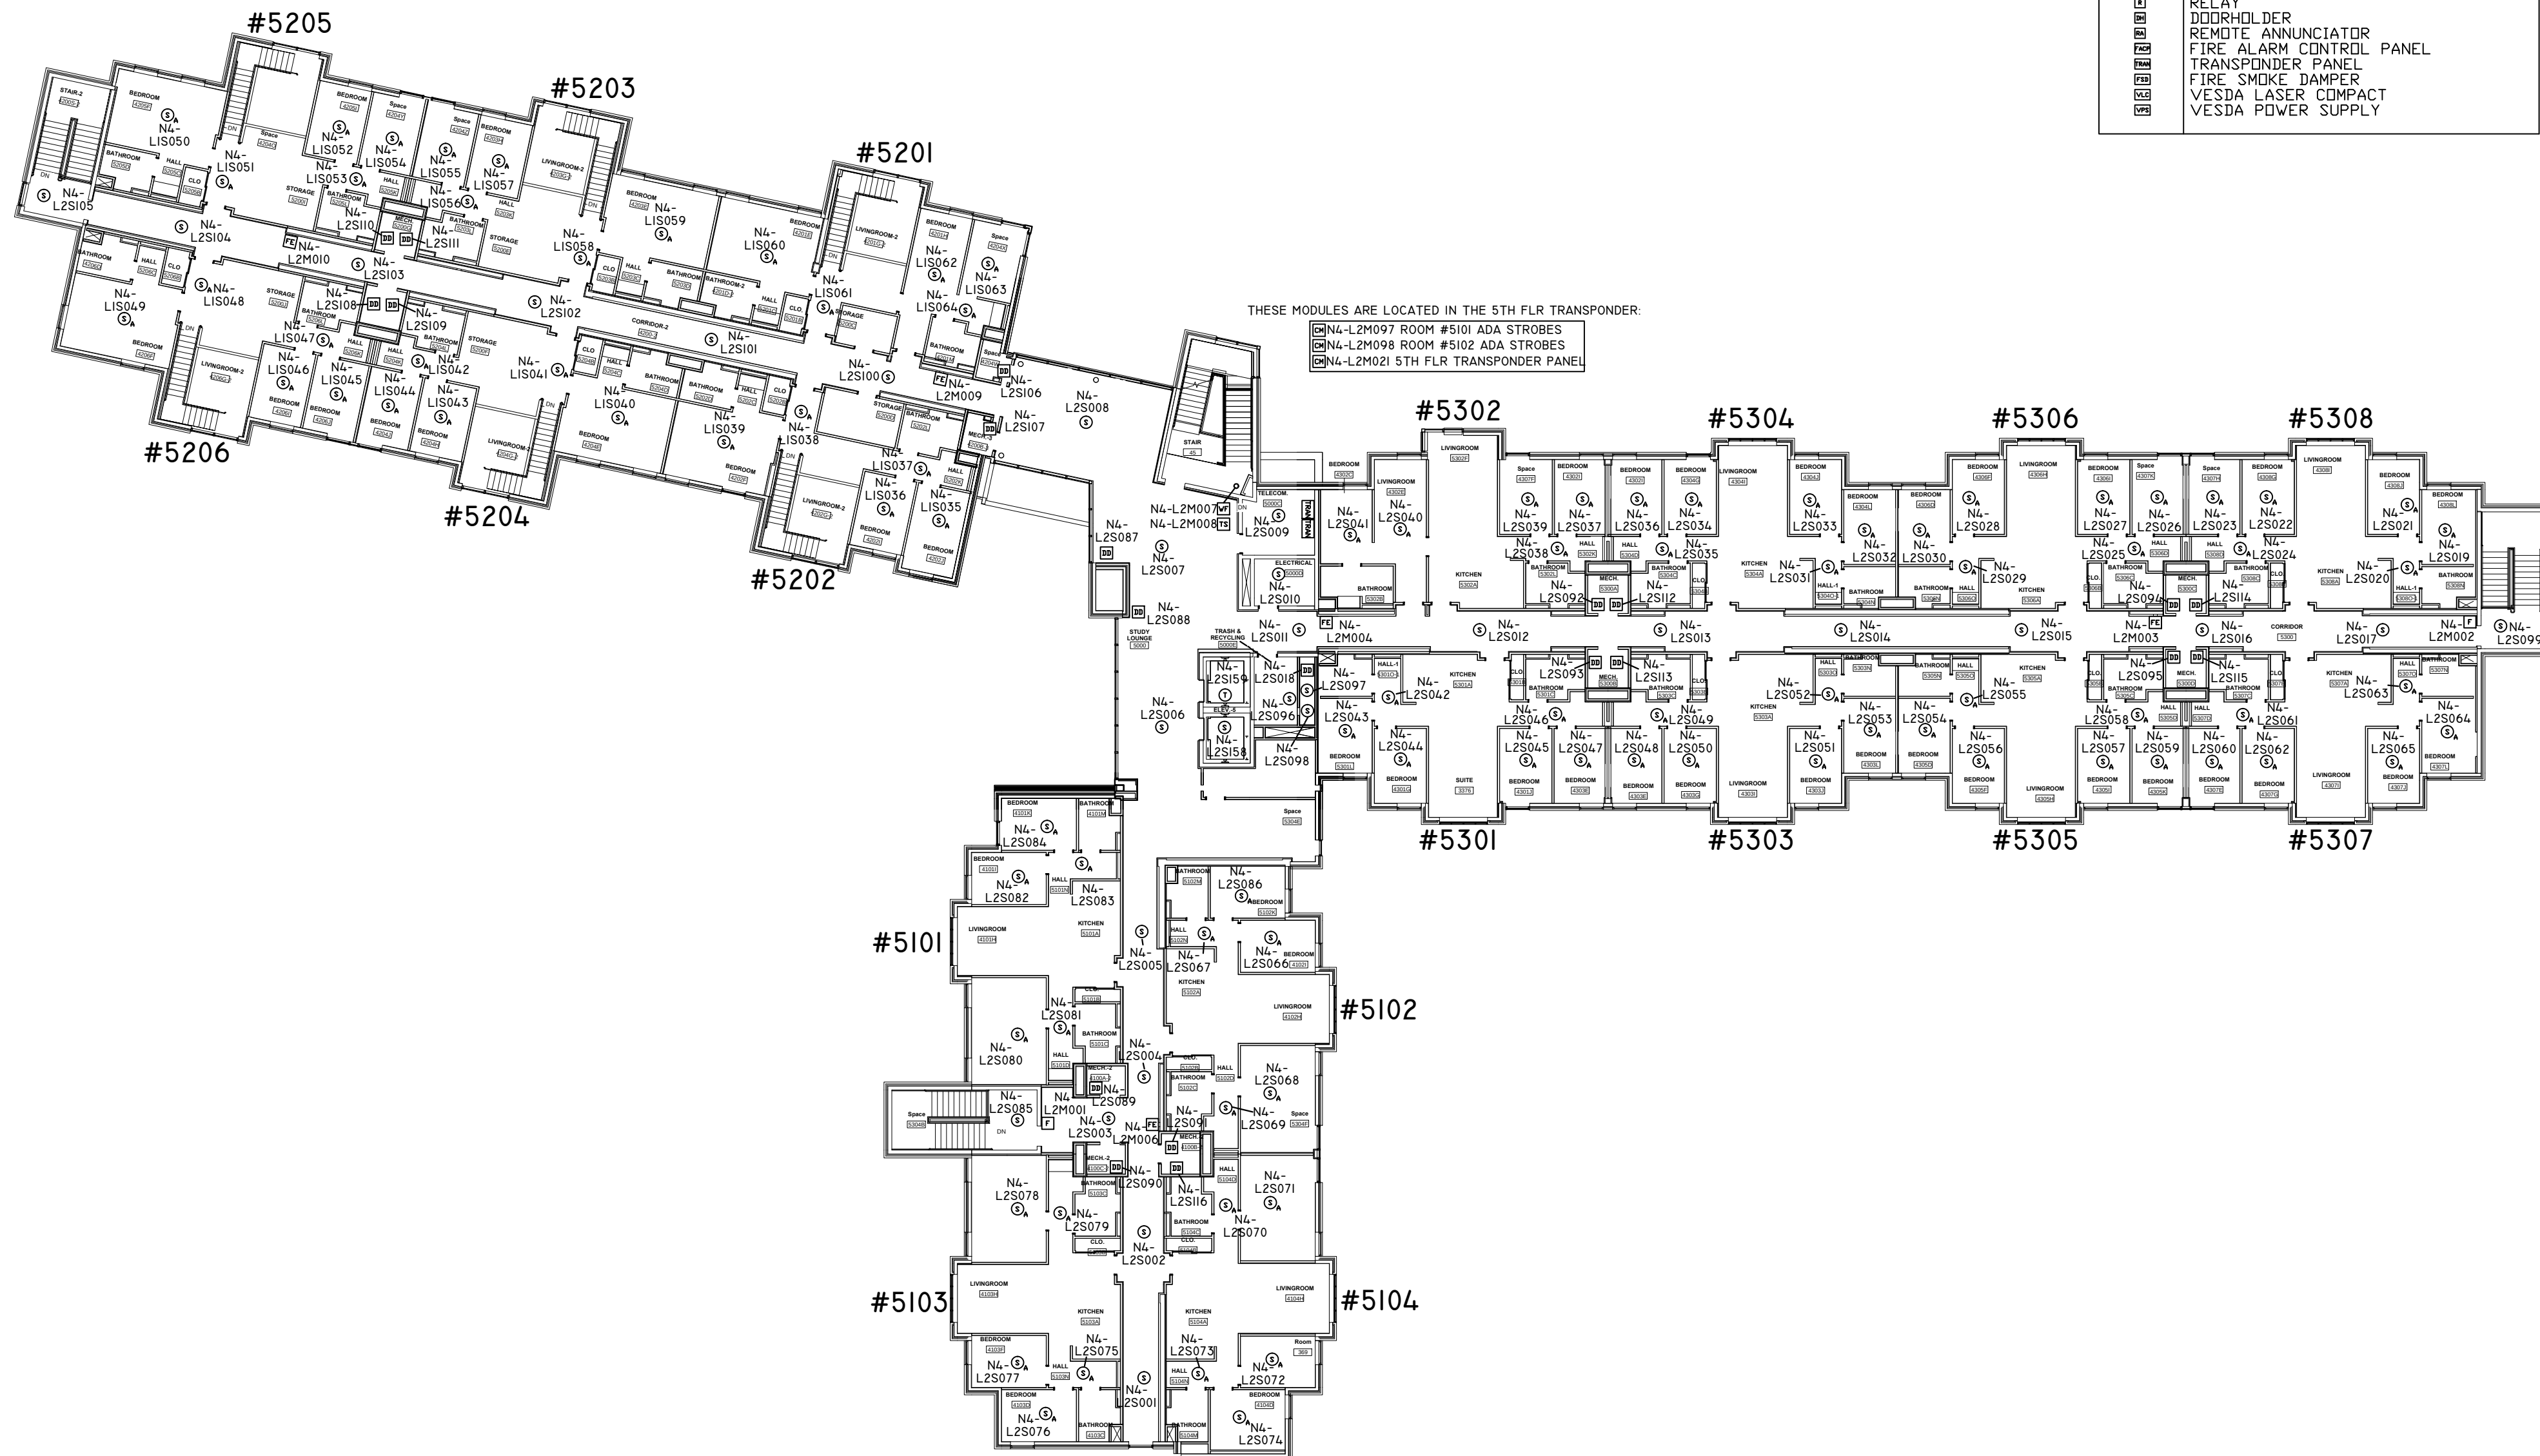

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙ _A	AUDIBLE SMOKE DETECTOR
⊙ _T	THERMAL DETECTOR
⊠	MANUAL PULL STATION
⊠ _D	DUCT SMOKE DETECTOR
⊠ _M	MIJA W/ MONITOR MODULE
⊠ _C	CONTROL MODULE
⊠ _M	MONITOR MODULE
⊠ _R	RELAY
⊠ _D	DOORHOLDER
⊠ _A	REMOTE ANNUNCIATOR
⊠ _F	FIRE ALARM CONTROL PANEL
⊠ _T	TRANSPONDER PANEL
⊠ _S	FIRE SMOKE DAMPER
⊠ _V	VESDA LASER COMPACT
⊠ _P	VESDA POWER SUPPLY



NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT'S AND ENGINEER'S (A/E) RESPONSIBILITY FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HONORS HOUSING
LEVEL 5
1901 E SOUTH CAMPUS DR
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JUG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	7/16/2012
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	HONORS LEVEL 5 FINAL.DWG

FIRE ALARM SYSTEM
DEVICE ADDRESS

PAGE:
FA-5