


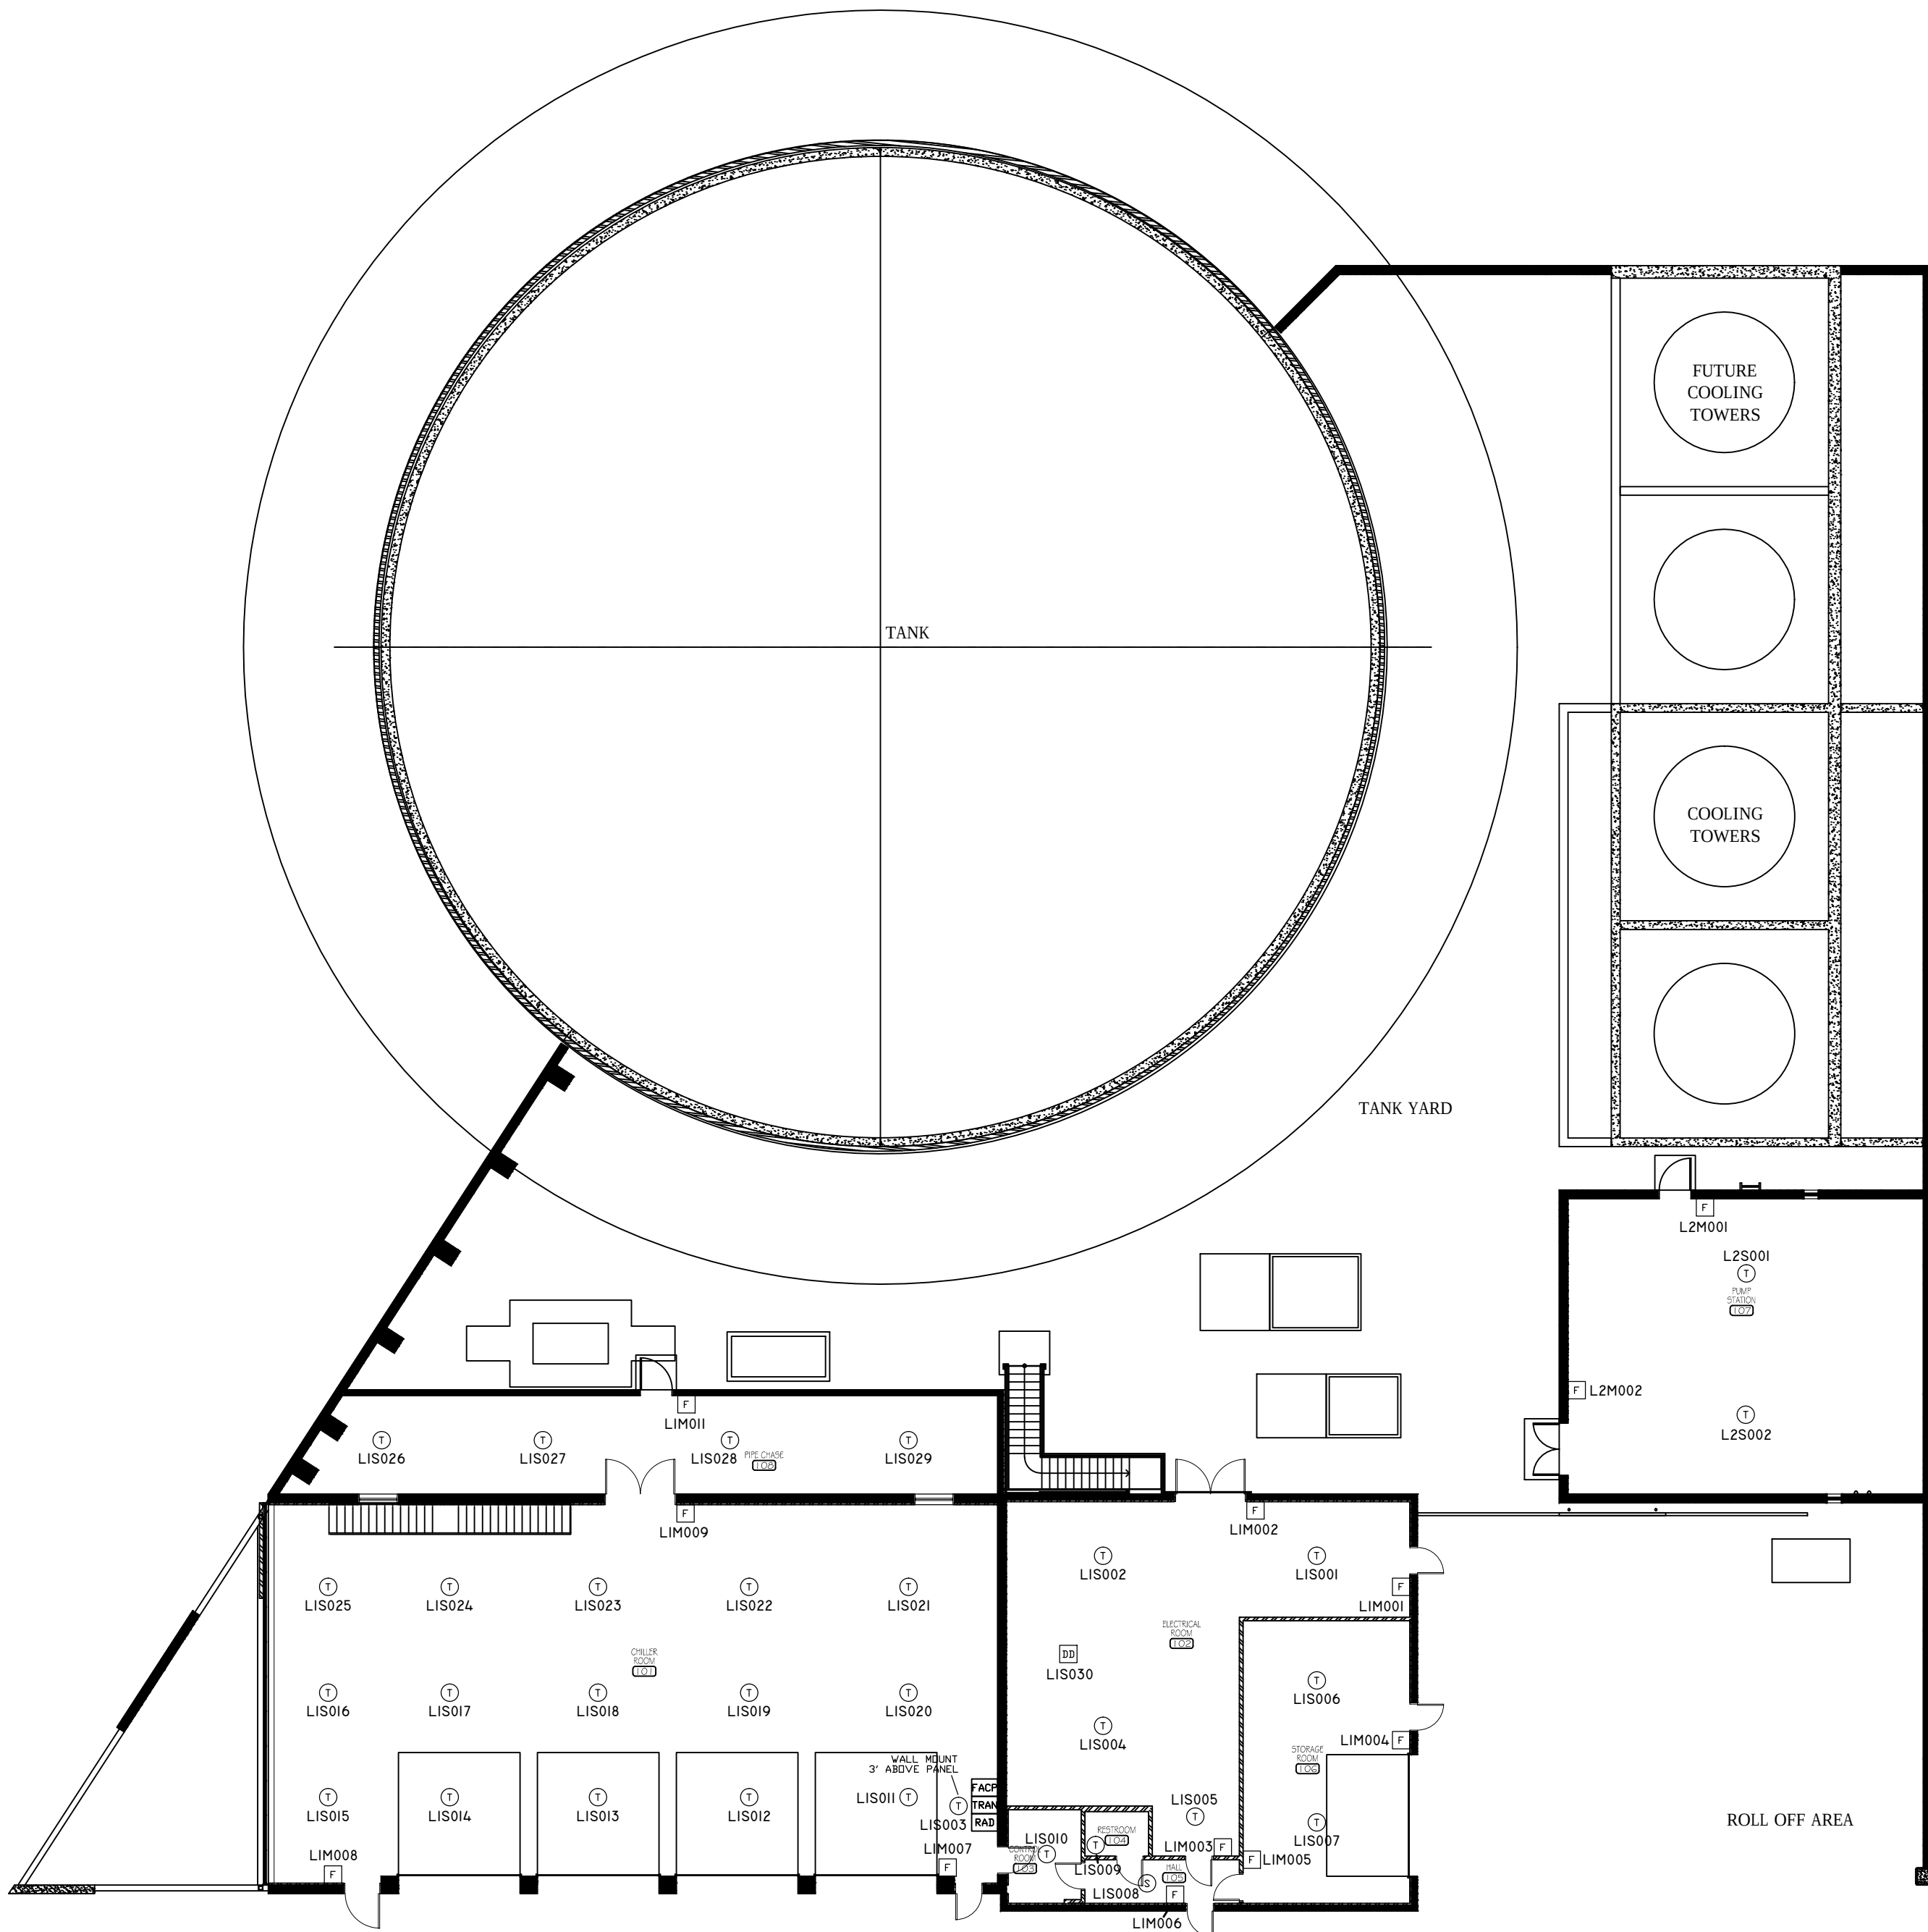


DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊕	HEAT DETECTOR
⊞	MANUAL PULL STATION
⊠	HORN/STROBE
⊞	WEATHERPROOF HORN
⊞	STROBE LIGHT
⊞	DUCT DETECTOR
⊞	RELAY
⊞	FIRE ALARM CONTROL PANEL
⊞	TRANSPONDER PANEL
⊞	RADIONICS MONITORING PANEL

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE LOOP	1 PAIR #14 TWISTED
B	STROBE/HORN CIRCUIT	2 #14'S
C	FAN/DAMPER RELAY CIRCUIT	2 #14'S
D	24 VDC AUX POWER	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #14 TWISTED
F	120 VAC POWER WITH GROUND	3 #12'S
G	INTERCONNECT WIRING	7 PAIR #14'S (2 MUST BE TWISTED)
H	SPARE LOOP	2 #14'S

SYSTEM NOTES:

- ① TO FACP
- ② TO TRANSPONDER
- ③ TO 120 VAC W/ GROUND
- ④ TO HVAC FOR FAN SHUTDOWN

*SEE RISER FOR PANEL WIRING DETAILS.



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

CHILLED WATER PLANT
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
SALT LAKE CITY, UTAH

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	DPS
APPROVED BY:	DPS
DATE:	1/19/11
SCALE:	1/16" = 1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	CHILLED WATER PLANT.DWG


FIRE ALARM SYSTEM

NUMBERS


PAGE:

FA-I-03


N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

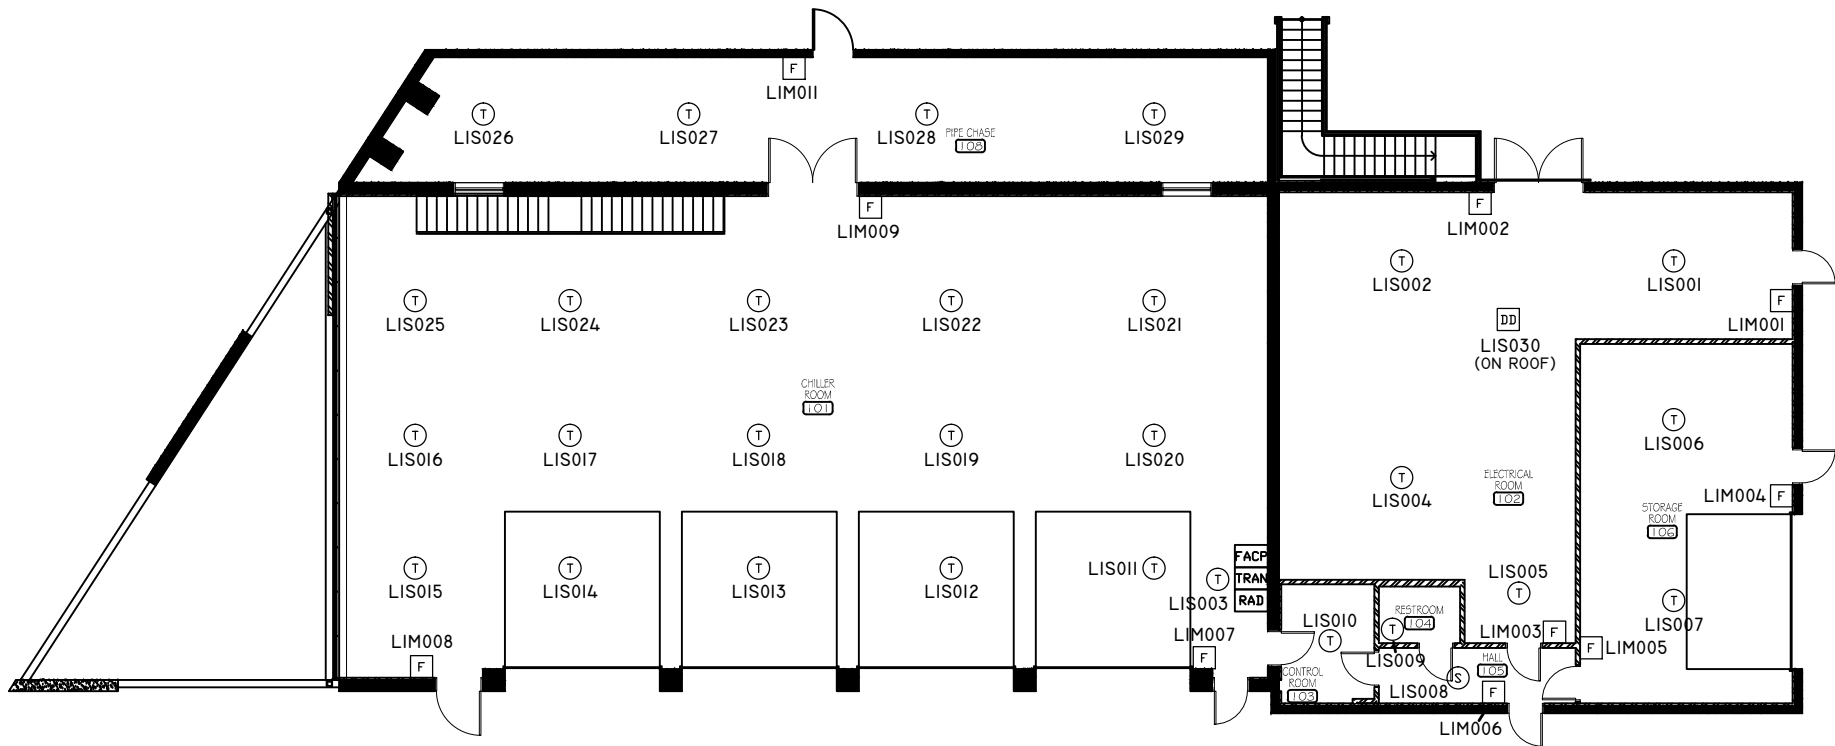

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	HEAT DETECTOR
ⓕ	MANUAL PULL STATION
ⓓⓓ	DUCT DETECTOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
RAD	RADIONICS MONITORING PANEL

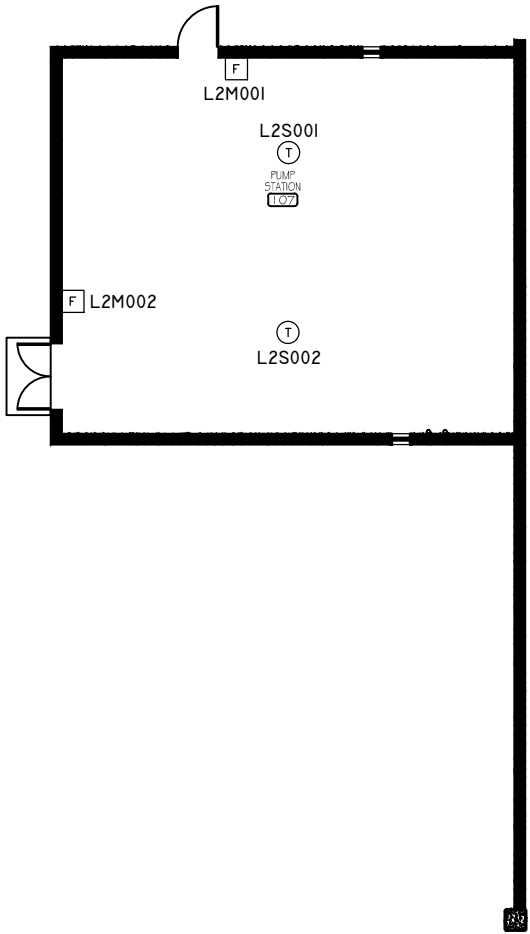

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

CHILLED WATER PLANT
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
SALT LAKE CITY, UTAH

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 7/18/2011
SCALE: 1/16" = 1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
CHILLED WATER PLANT1.DWG

FIRE ALARM SYSTEM

NUMBERS

PAGE:

NFS