




_____ NODE ADDRESSABLE
 _____ ADDRESSABLE LOOP NUMBER
 _____ SENSOR ('M' MONITOR)
 _____ DEVICE NUMBER
 'N1-L1S001'

PAGE:

FA-I-01

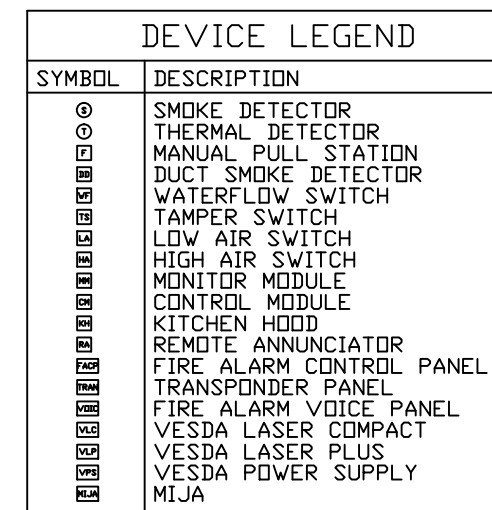

NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SORENSEN MOLECULAR BIOTECHNOLOGY
BUILDING USTAR
UNIVERSITY OF UTAH
LEVEL 2 & LEVEL 3
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEM
801-468-8300

DRAWN BY:	TCT
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	11/11/14
SCALE:	1/16"=1'-0"
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	
USTARLEVEL2.DWG	

FIRE ALARM SYSTEM

PAGE:

FA-2-3-01

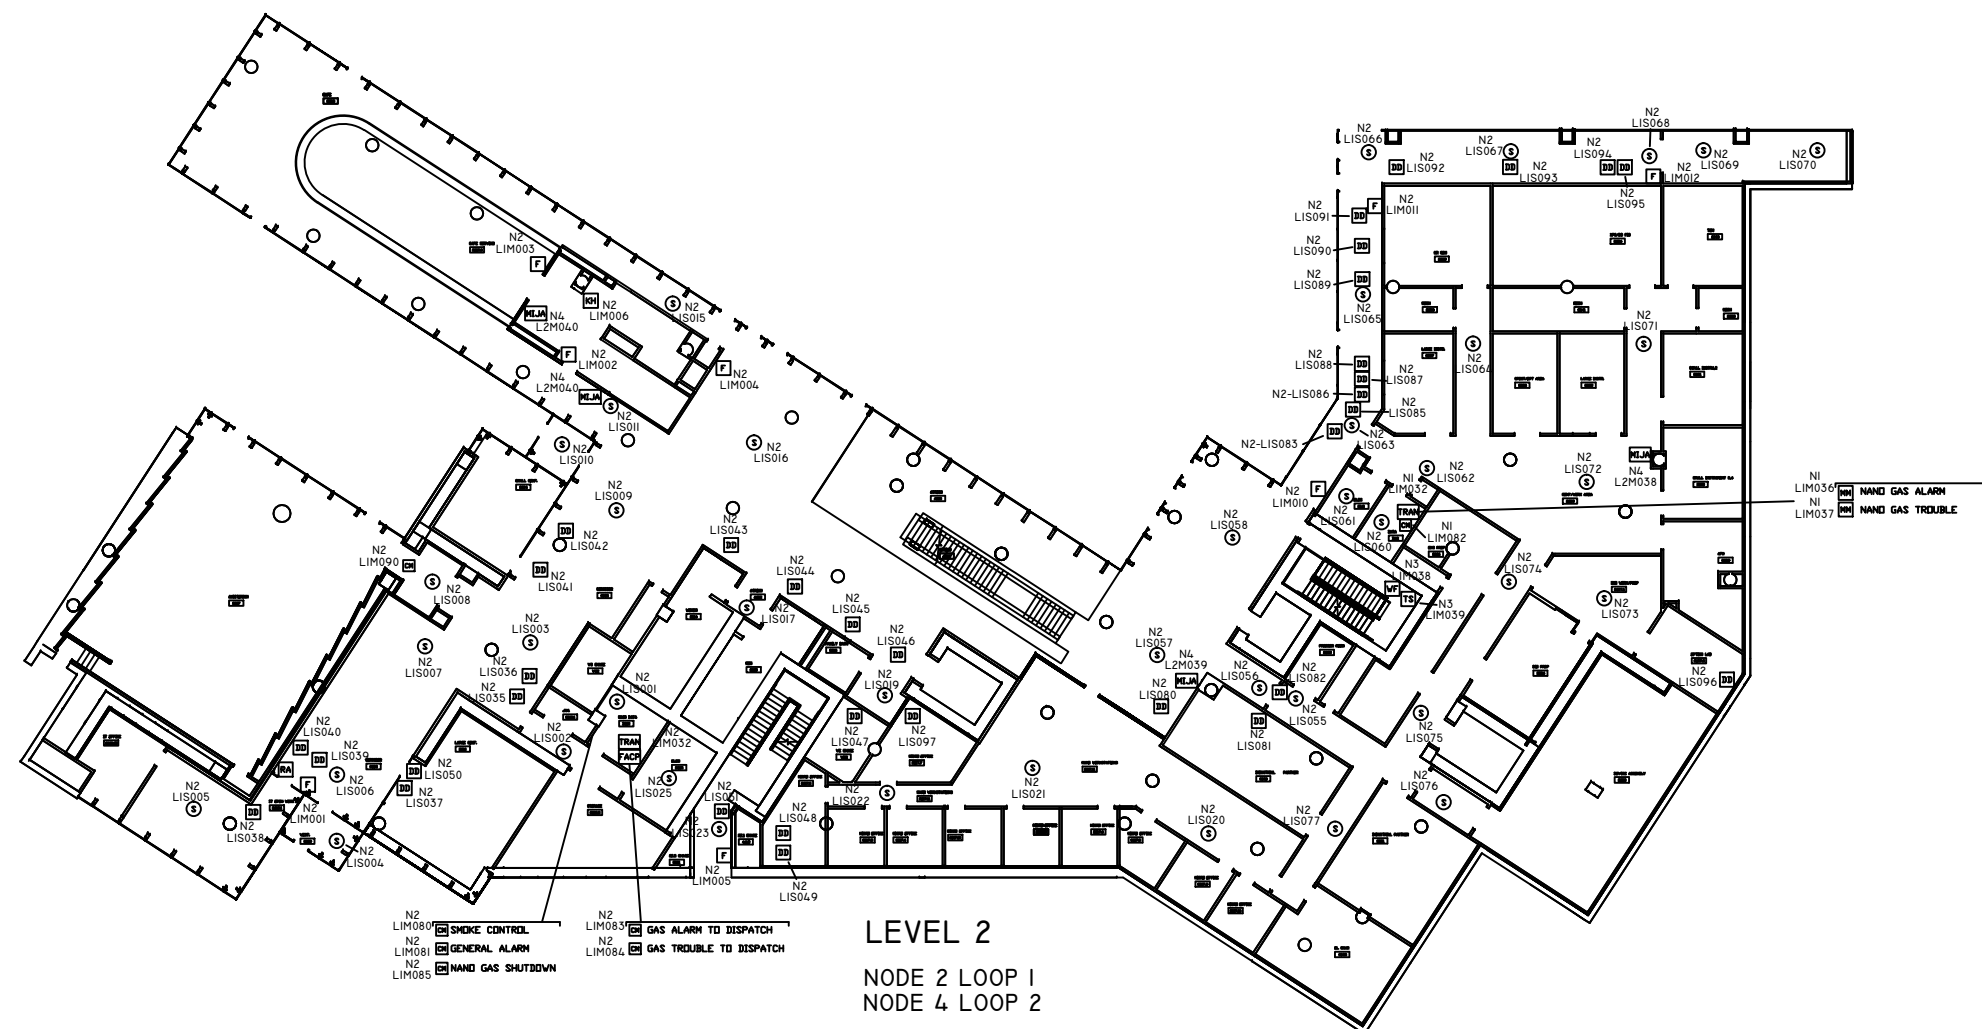

ADDRESS LABEL CLARIFICATION

_____ NODE ADDRESSABLE
 _____ ADDRESSABLE LOOP NUMBER
 _____ SENSOR ('M' MONITOR)
 _____ DEVICE NUMBER
 N1-1S001

