




WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE LOOP	1 PAIR #14'S TWISTED
B	STROBE/HORN CIRCUIT	2 #14'S
C	120 VAC POWER W/GROUND	3 #12'S
D	INTERCONNECT WIRING	7 PAIR # 14'S (2 MUST BE TWISTED)
E	CAMPUS MONITORING WIRES	2 CAT-5E CABLES
F	FAN/DAMPER/DOOR RELAY CIRCUIT	2 #14'S
G	FAN SHUTDOWN WIRES	2 #14'S
H		

PLAN NOTES:

- ① TO MAIN FACP
- ② TO 1ST FLOOR TRANSPONDER
- ③ TO 2ND FLOOR TRANSPONDER
- ④ TO 120 VAC WITH GROUND
- ⑤ TO CAMPUS NETWORK SWITCH
- ⑥ TO HVAC FOR SHUTDOWN
- ⑦ UP TO MEZZANINE
- ⑧ DOWN TO BELOW

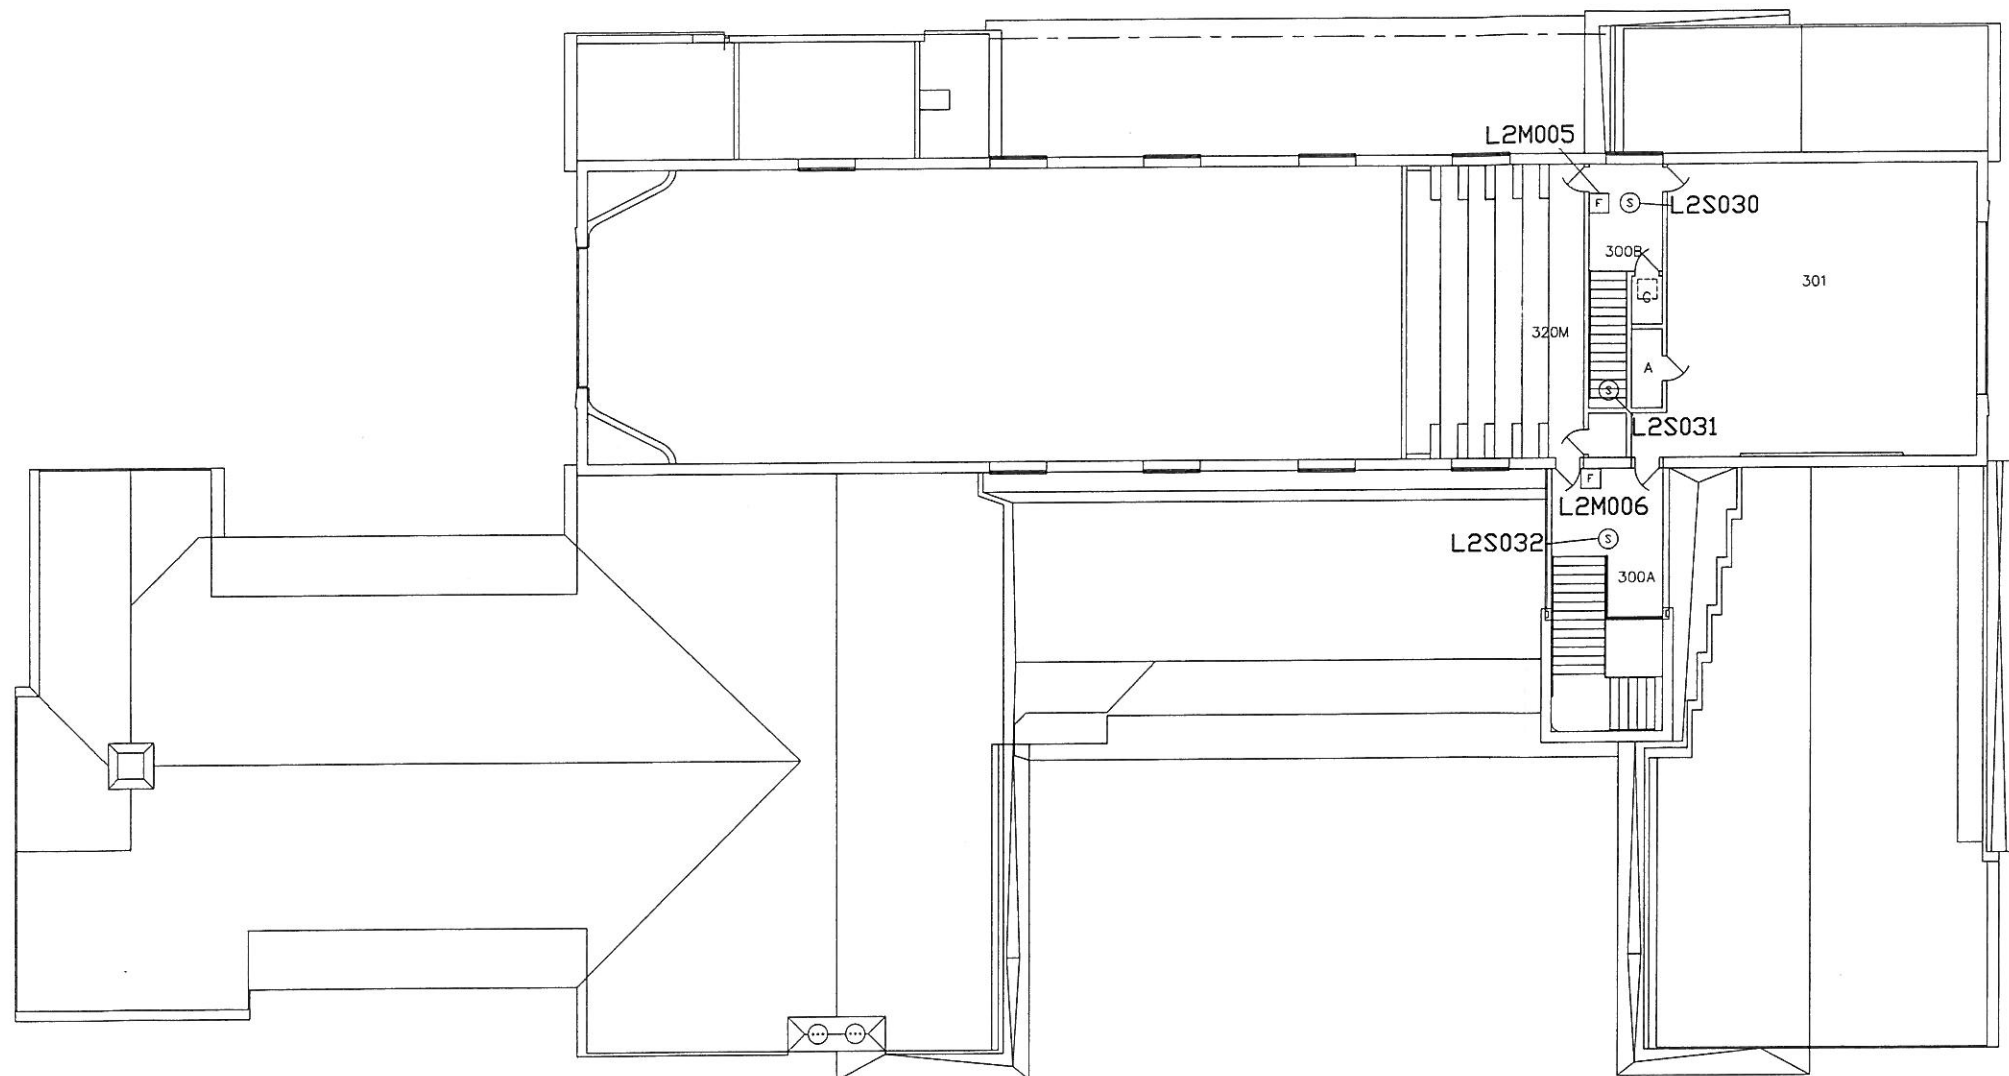

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

WEST INSTITUTE
UNIVERSITY OF UTAH
THIRD LEVEL
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 11/2/2006
SCALE: N.T.S.
PROJECT NO: 0170-12623
REV NO: 1
DRAWING NAME:
WEST INSTITUTE 3.DWG

FIRE ALARM SYSTEM
THIRD LEVEL
ADDRESSABLE NUMBERS

PAGE:
FA-3-01

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE LOOP	1 PAIR #14'S TWISTED
B	STROBE/HORN CIRCUIT	2 #14'S
C	120 VAC POWER W/GROUND	3 #12'S
D	INTERCONNECT WIRING	7 PAIR # 14'S (2 MUST BE TWISTED)
E	CAMPUS MONITORING WIRES	2 CAT-5E CABLES
F	FAN/DAMPER/DOOR RELAY CIRCUIT	2 #14'S
G	FAN SHUTDOWN WIRES	2 #14'S
H		

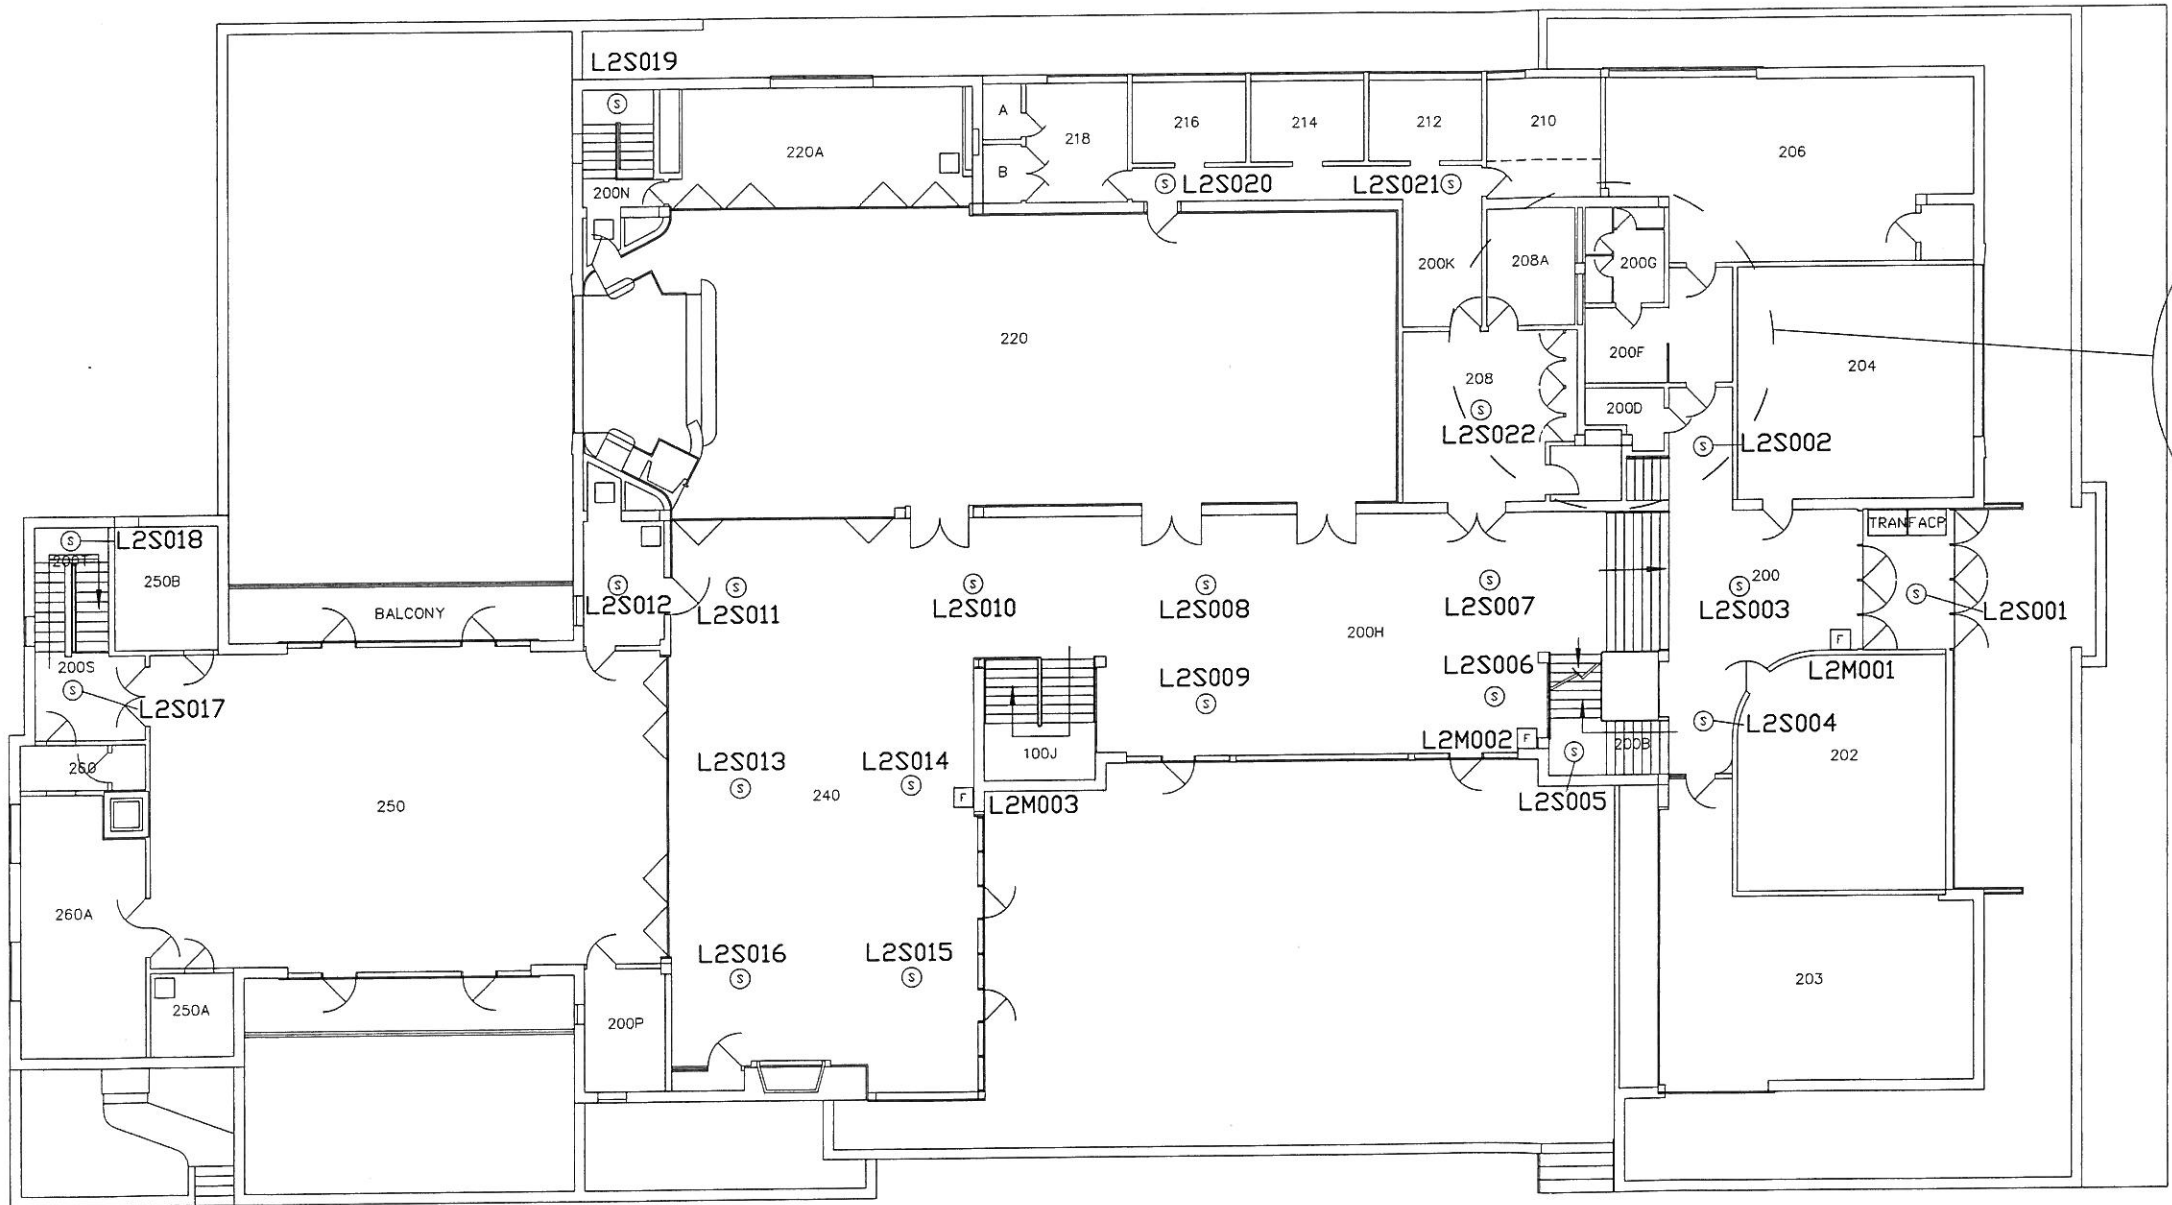

PLAN NOTES:

- ① TO MAIN FACP
- ② TO 1ST FLOOR TRANSPONDER
- ③ TO 2ND FLOOR TRANSPONDER
- ④ TO 120 VAC WITH GROUND
- ⑤ TO CAMPUS NETWORK SWITCH
- ⑥ TO HVAC FOR SHUTDOWN
- ⑦ UP TO MEZZANINE
- ⑧ DOWN TO BELOW

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

WEST INSTITUTE
UNIVERSITY OF UTAH
SECOND LEVEL
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 11/2/2006
SCALE: N.T.S.
PROJECT NO: 0170-12623
REV NO: 1
DRAWING NAME:
WEST INSTITUTE 2.DWG

FIRE ALARM SYSTEM
SECOND LEVEL
ADDRESSABLE NUMBERS


PAGE:
FA-2-03

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

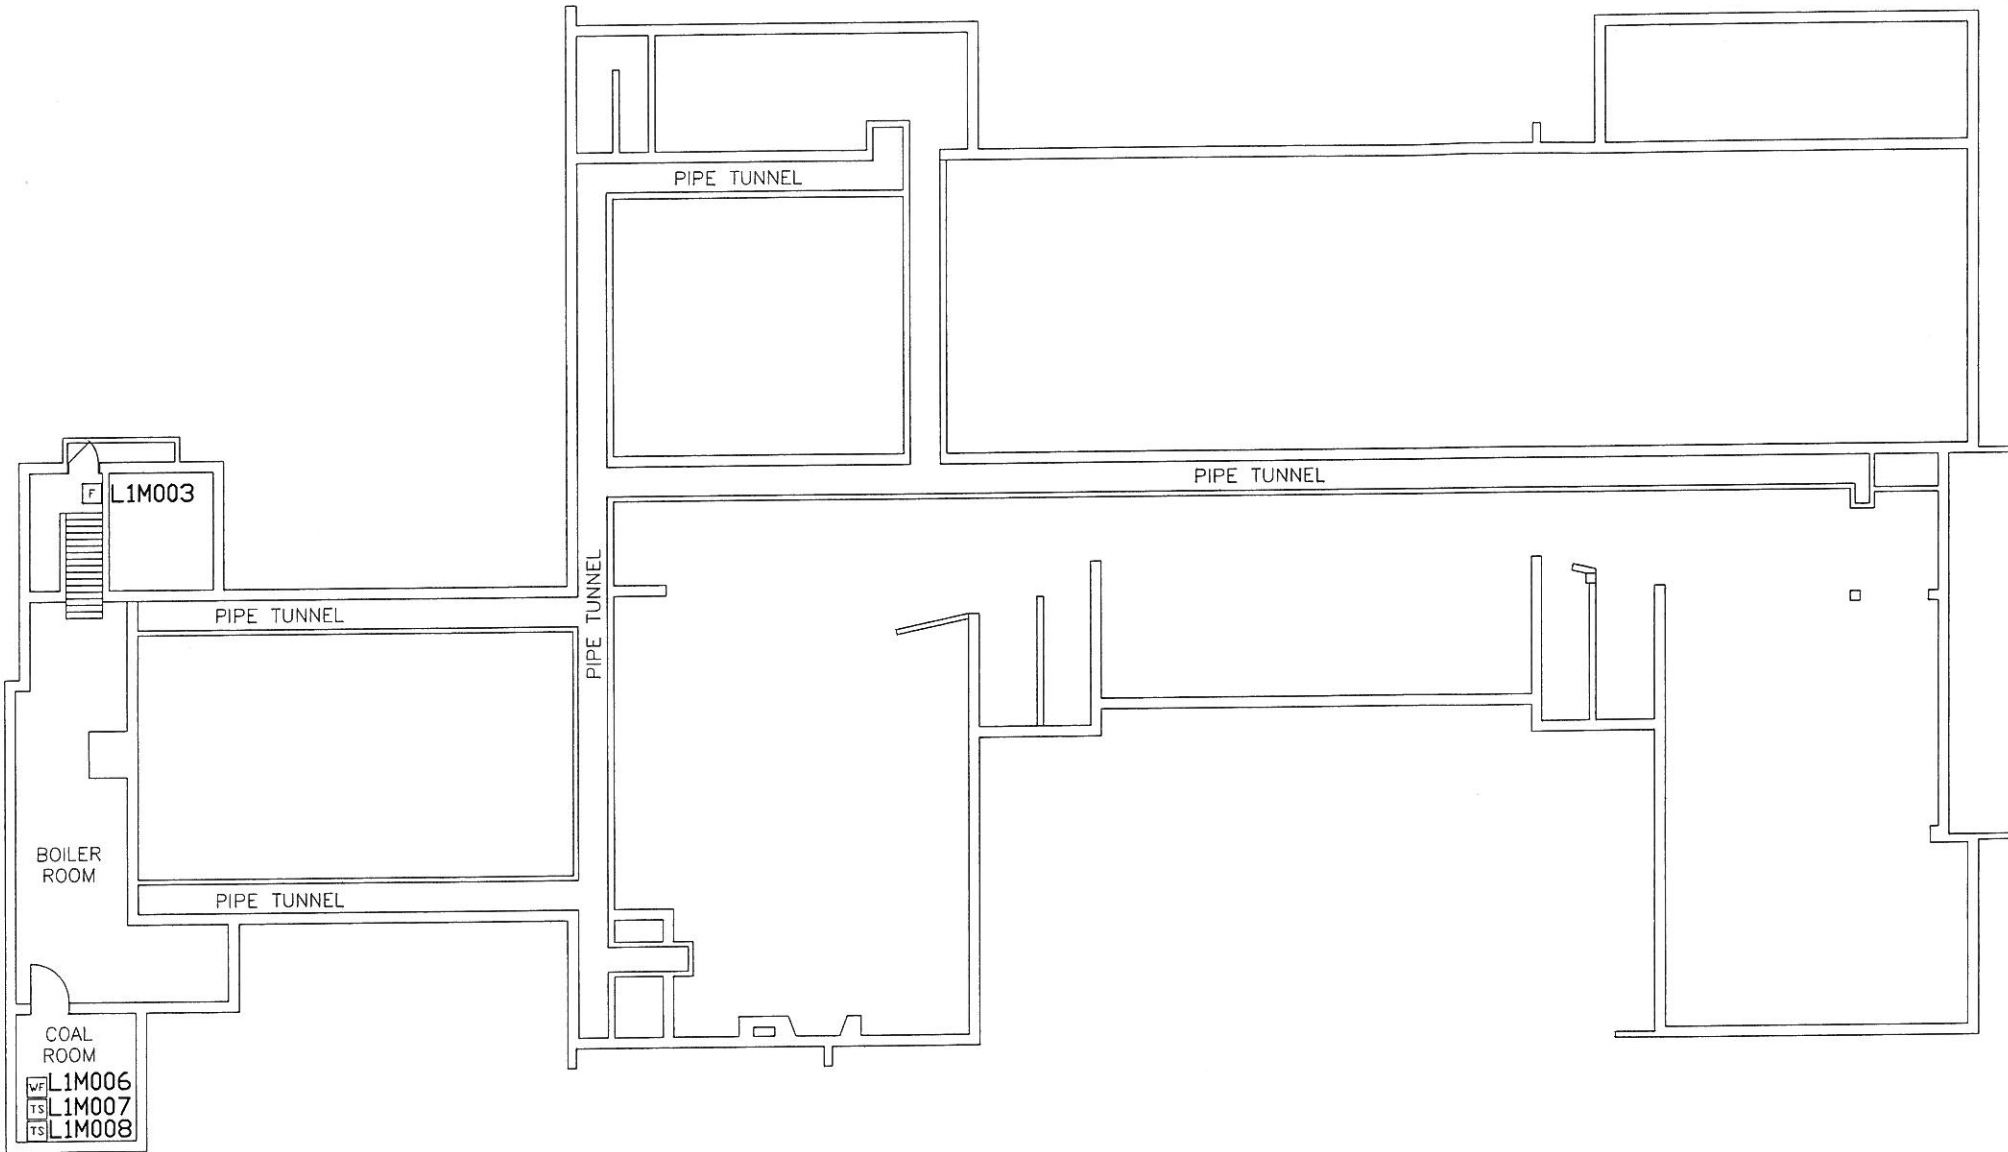

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE LOOP	1 PAIR #14'S TWISTED
B	STROBE/HORN CIRCUIT	2 #14'S
C	120 VAC POWER W/GROUND	3 #12'S
D	INTERCONNECT WIRING	7 PAIR # 14'S (2 MUST BE TWISTED)
E	CAMPUS MONITORING WIRES	2 CAT-5E CABLES
F		
G		
H		

- PLAN NOTES:
- ① TO MAIN FACP
 - ② TO 1ST FLOOR TRANSPONDER
 - ③ TO 2ND FLOOR TRANSPONDER
 - ④ TO 120 VAC WITH GROUND
 - ⑤ TO CAMPUS NETWORK SWITCH



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

WEST INSTITUTE
UNIVERSITY OF UTAH
BASEMENT LEVEL
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	10/26/2006
SCALE:	N.T.S.
PROJECT NO:	0170-12623
REV NO:	1
DRAWING NAME:	WEST INSTITUTE BSMT.DWG

FIRE ALARM SYSTEM
BASEMENT
ADDRESSABLE NUMBERS

PAGE:
FA-B-03

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396