


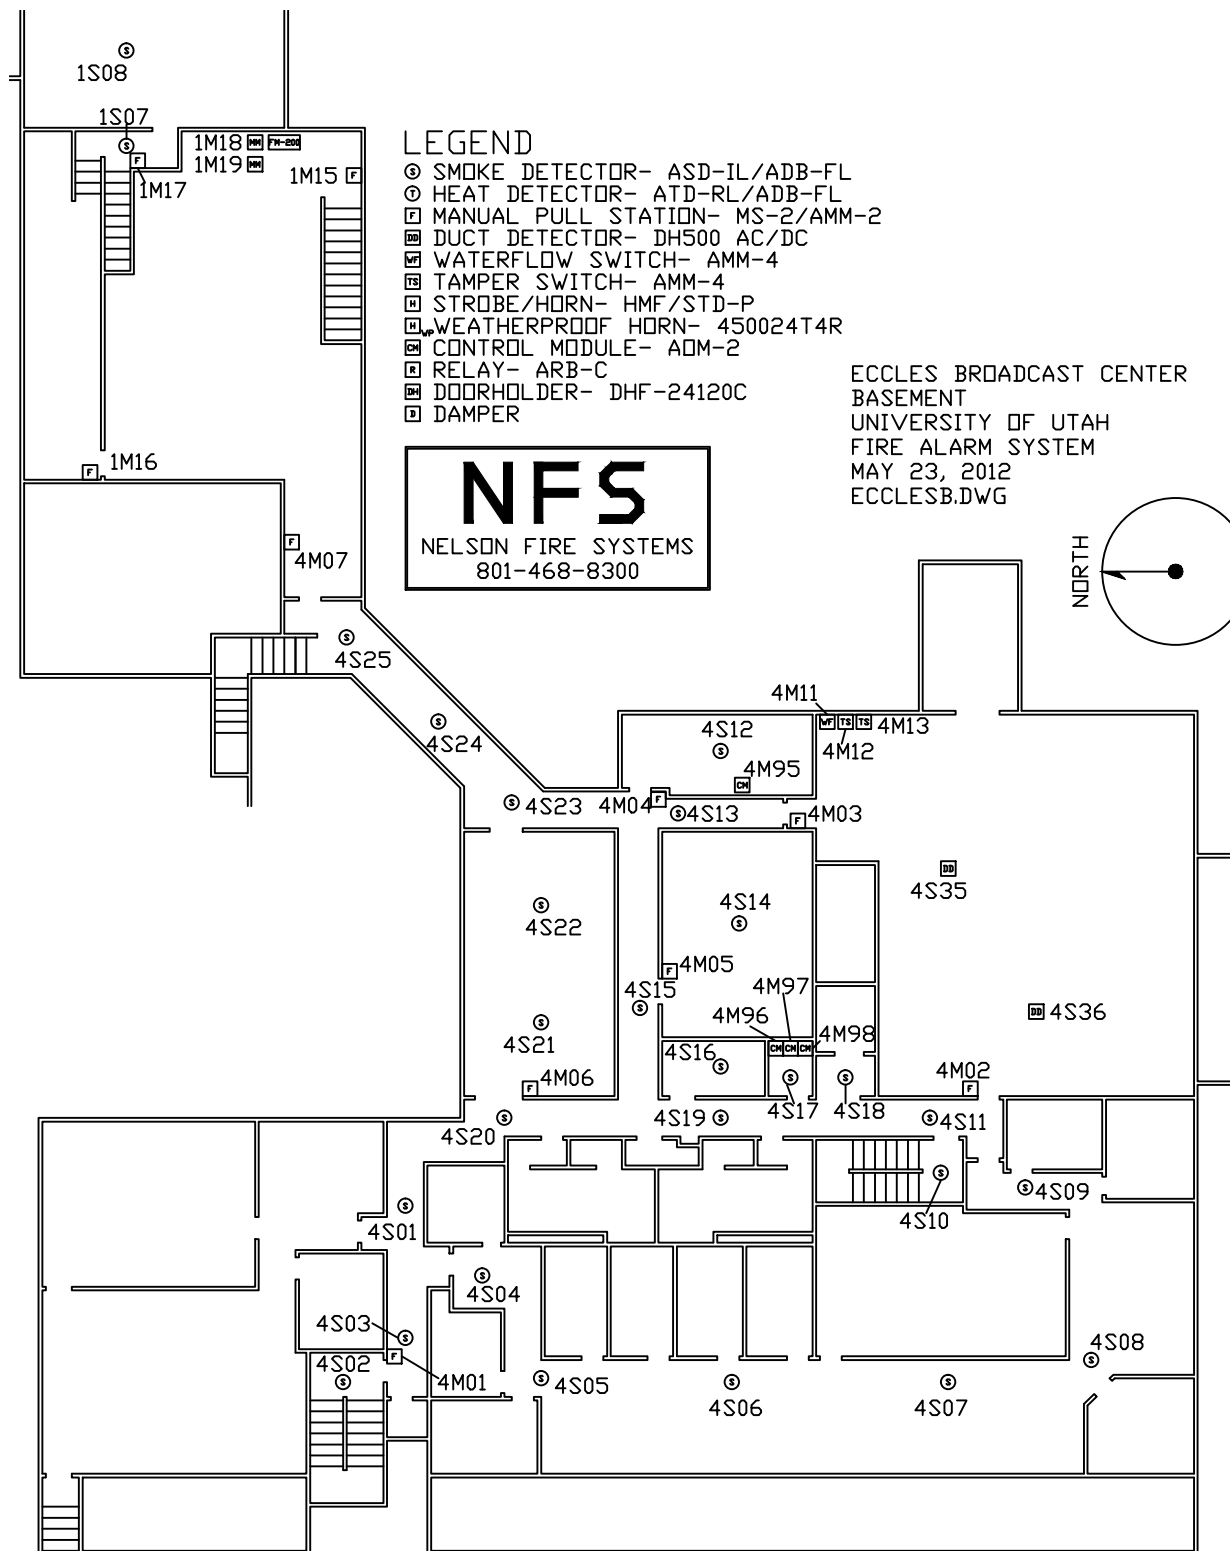



# NFS


NELSON FIRE SYSTEMS  
801-468-8300

ECCELS BROADCAST BUILDING  
1ST FLOOR  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
JUNE 1, 2012  
ECCELS1.DWG

## LEGEND


- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- ⊙ HEAT DETECTOR- ATD-RL/ADB-FL
- MANUAL PULL STATION- MS-2/AMM-2
- DUCT DETECTOR- DH500 AC/DC
- WATERFLOW SWITCH- AMM-4
- TAMPER SWITCH- AMM-4
- STROBE/HORN- HMF/STD-P
- WEATHERPROOF HORN- 450024T4R
- STROBE- STD/4F-P
- MONITOR MODULE- AMM-4
- CONTROL MODULE- ADM-2
- RELAY- ARB-C
- DOORHOLDER- DHF-24120C
- REMOTE ANNUNCIATOR- RHFB
- FIRE ALARM CONTROL PANEL- EN-24
- TRANSPONDER PANEL- EN-24

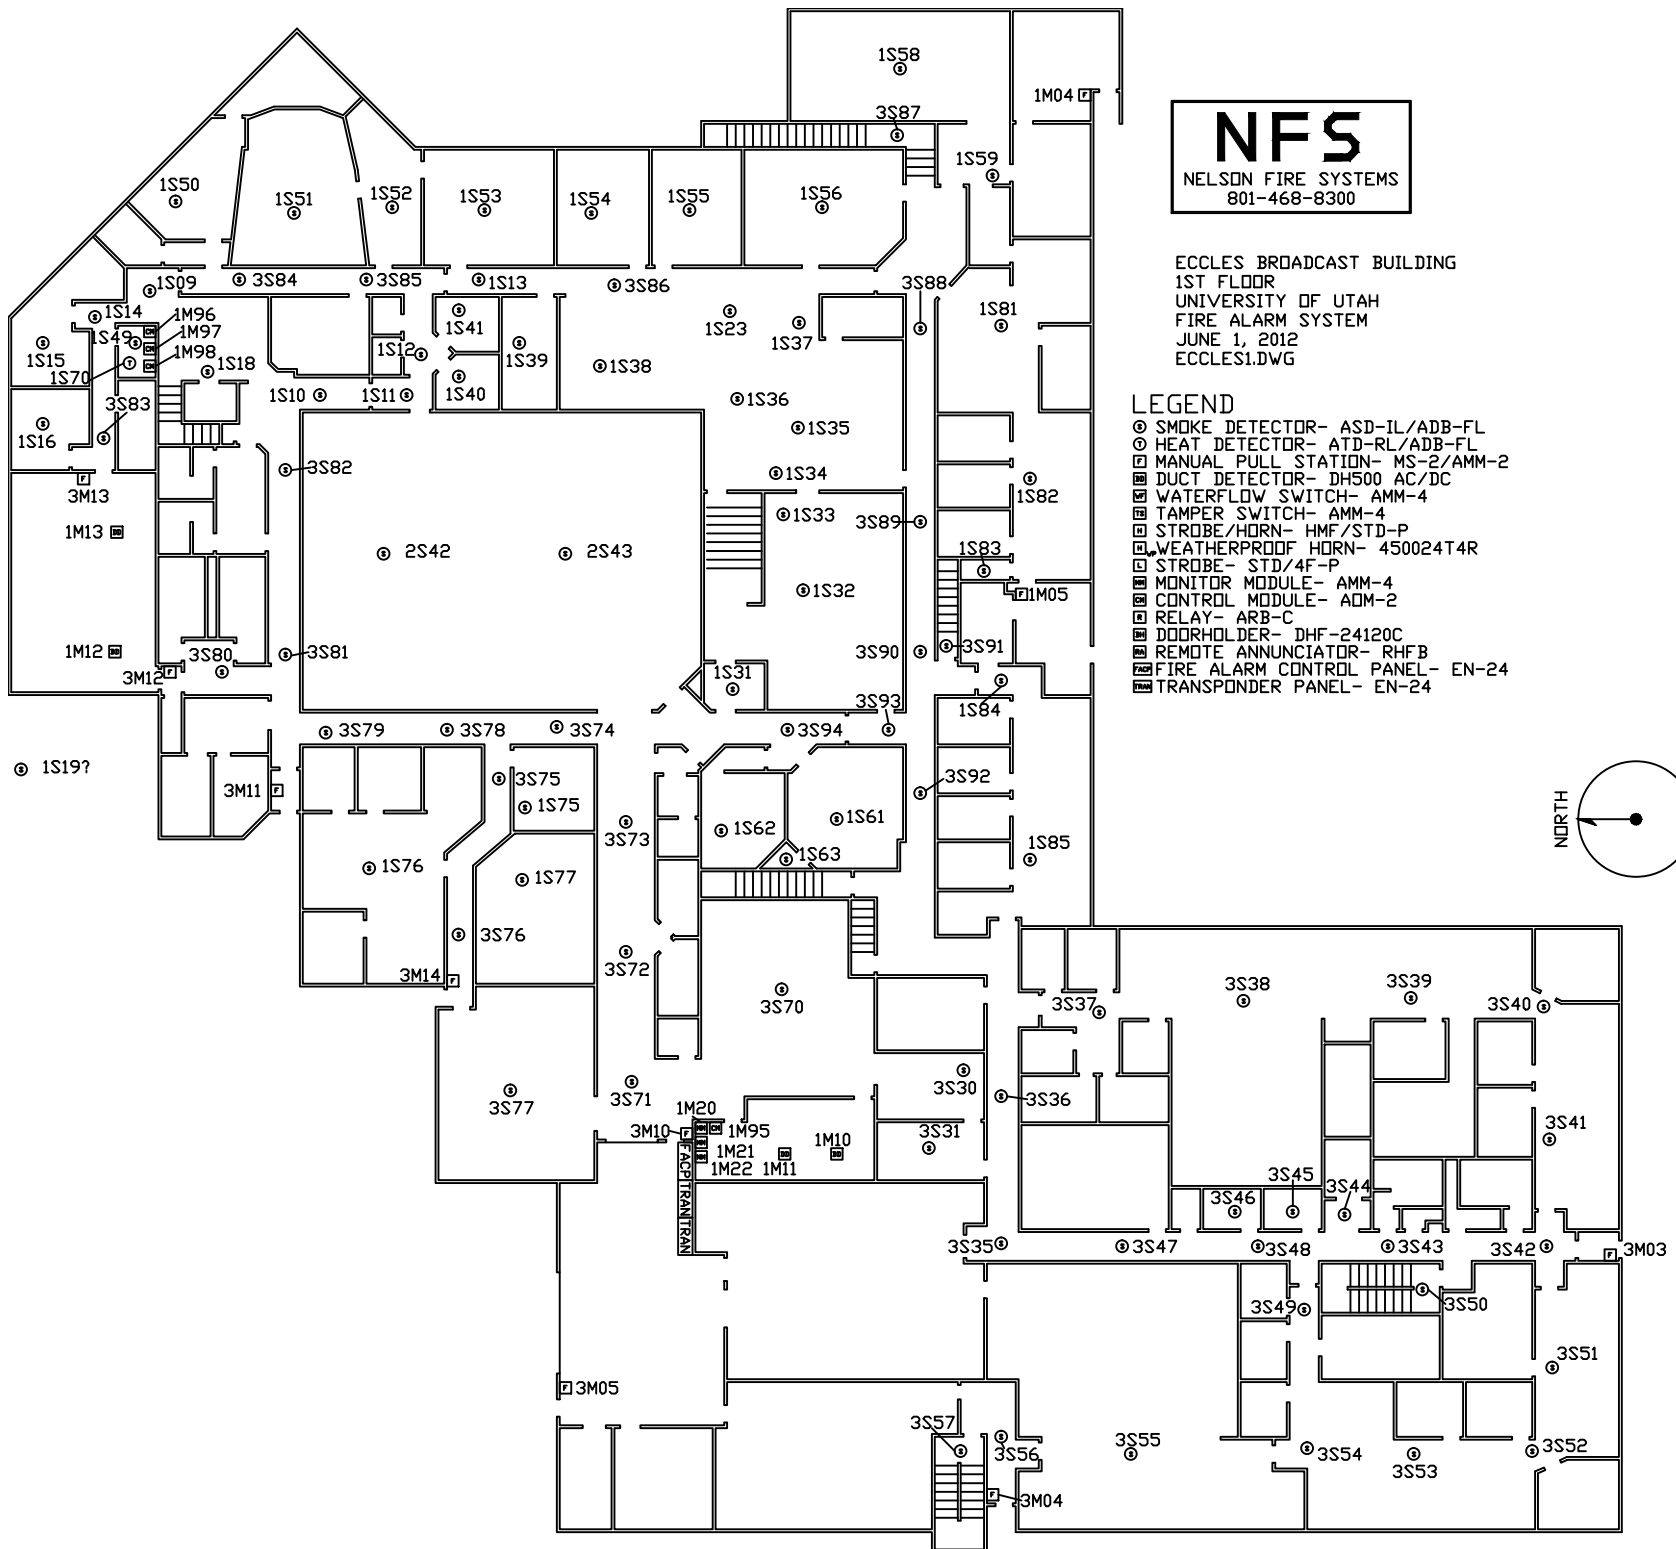

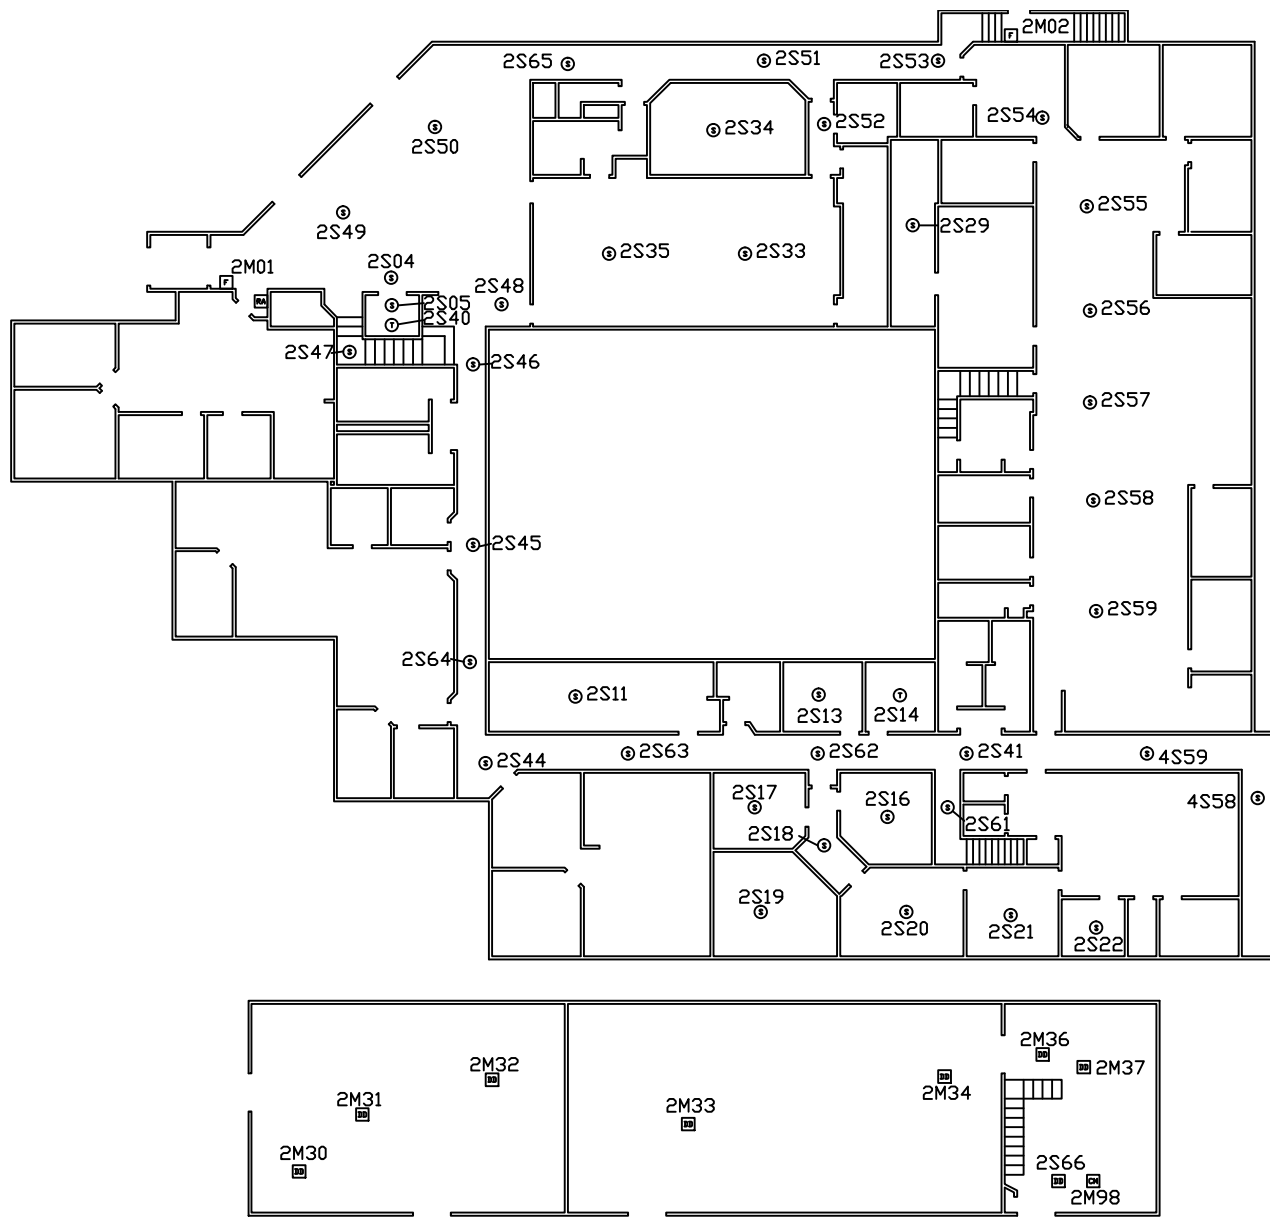

PENTHOUSE

ECCLES BROADCAST BUILDING  
2ND FLOOR  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
JUNE 1, 2012  
ECCLES2.DWG



### LEGEND

- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- ⊙ HEAT DETECTOR- ATD-RL/ADB-FL
- ⊠ MANUAL PULL STATION- MS-2/AMM-2
- ⊠ DUCT DETECTOR- DH500 AC/DC
- ⊠ WATERFLOW SWITCH- AMM-4
- ⊠ TAMPER SWITCH- AMM-4
- ⊠ STROBE/HORN- HMF/STD-P
- ⊠ WEATHERPROOF HORN- 450024T4R
- ⊠ STROBE- STD/4F-P
- ⊠ CONTROL MODULE- ADM-2
- ⊠ RELAY- ARB-C
- ⊠ DOORHOLDER- DHF-24120C
- ⊠ REMOTE ANNUNCIATOR- RHFB

