

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
FIRE ALARM SYSTEM

INDEX OF DRAWINGS

PAGE	SHEET NO.	DESCRIPTION	
1	FA-C-01	PROJECT COVER SHEET / INDEX OF DRAWINGS	NELSON FIRE SYSTEMS
2	FA-R-01	FIRE ALARM BUILDING RISER DIAGRAM / MATRIX	NELSON FIRE SYSTEMS
3	FA-1-01	TENNIS COURT- ADDRESSABLE/RELAY CIRCUITS	NELSON FIRE SYSTEMS
4	FA-1-02	TENNIS COURT- NOTIFICATION CIRCUITS	NELSON FIRE SYSTEMS
5	FA-1-03	TENNIS COURT- ADDRESSABLE NUMBERS	NELSON FIRE SYSTEMS

DEVICE SCHEDULE

SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENTS
Ⓢ	SMOKE DETECTOR W/BASE	ASD-PL2F/B210LP	3/0 MUD RING
Ⓣ	HEAT DETECTOR W/BASE	ATD-RL2F/B210LP	3/0 MUD RING
ⓕ	MANUAL PULL STATION	MS-7AF	1 GANG MUD RING ON 2-1/8" DEEP BOX
ⓕ _{VP}	WEATHERPROOF MANUAL PULL STATION	MS-7LDB	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
ⓔ	ENGAGE FIRE EXTINGUISHER MONITORING	EVM W/AMM-2F	4 SQ. 2-1/8" MINIMUM AND SINGLE GANG MUD RING
Ⓛ	STROBE ONLY	SW	4 SQ. 2-1/8" MINIMUM W/ SINGLE GANG MUD RING
ⓗ _{VP}	WEATHERPROOF HORN/STROBE	P2RK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
ⓕ _{CU}	FIRE ALARM CONTROL UNIT	E3 SERIES	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. NFS IS NOT RESPONSIBLE FOR THE ACCURACY OF THE A/E PLANS (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM





NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 9/29/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
TENNIS COVER.DWG


FIRE ALARM SYSTEM
COVER SHEET

PAGE:
FA-C-01




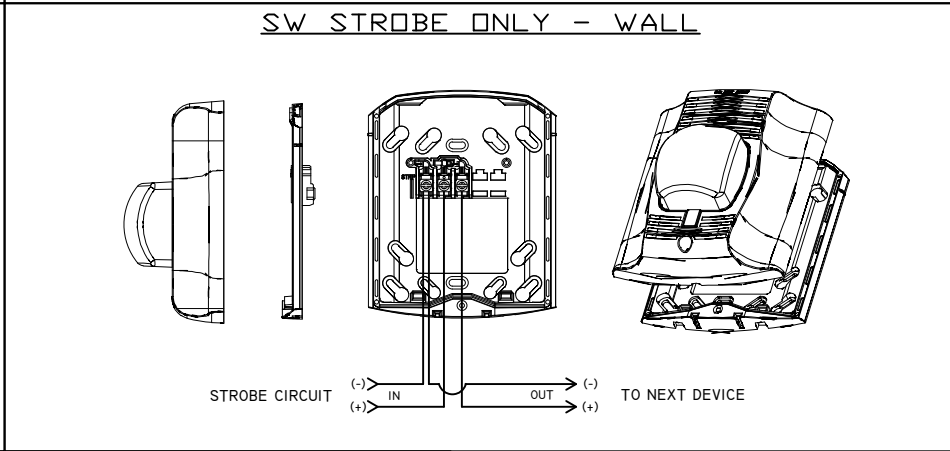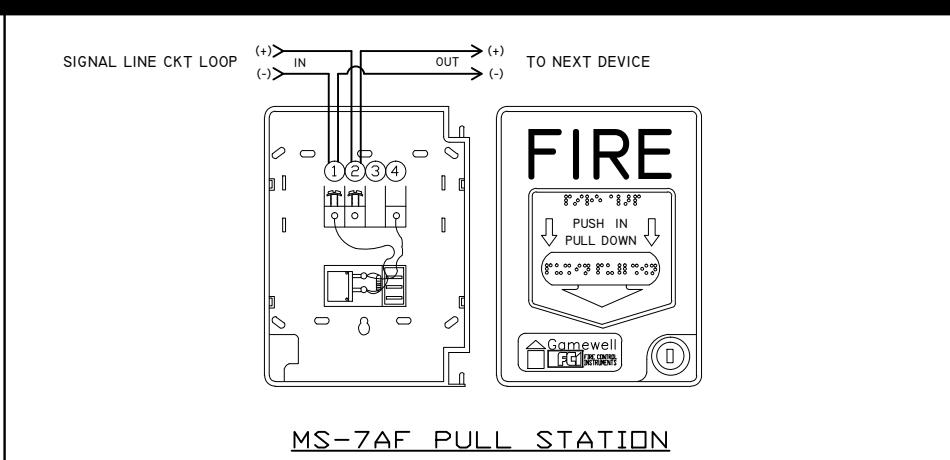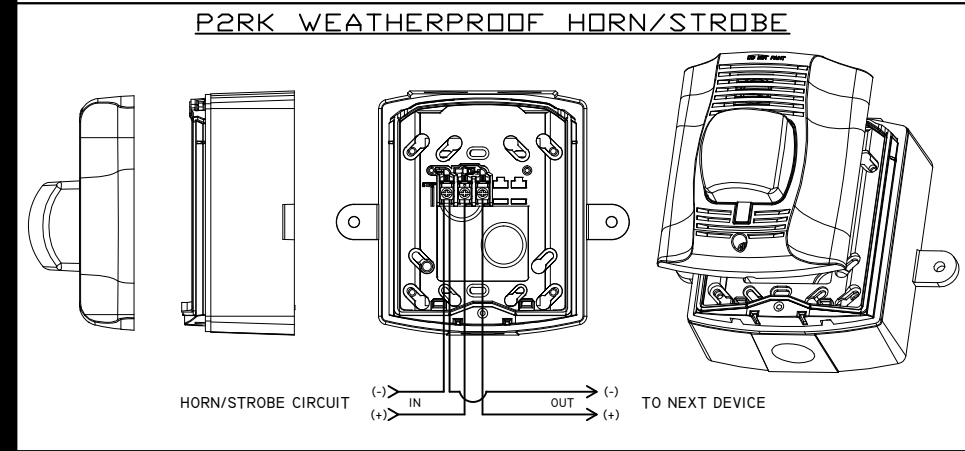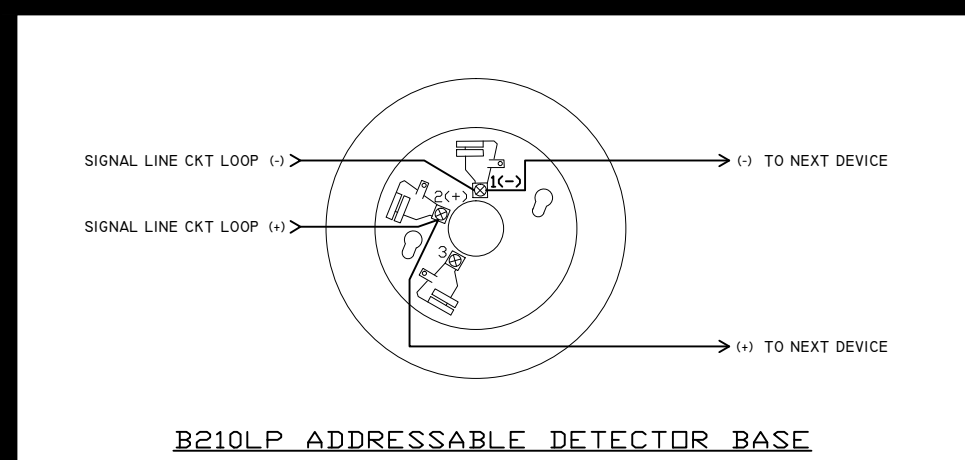

FIRE ALARM INPUT/OUTPUT MATRIX	SYSTEM OUTPUTS															
	FACU ANNUNCIATION				NOTIFICATION				FIRE SAFETY CONTROL				AUX. SIGNALS		REPORTING	
ALARM SIGNAL TO FIRE ALARM DISPLAY																
SUPERVISORY SIGNAL TO FIRE ALARM DISPLAY																
TROUBLE SIGNAL TO FIRE ALARM DISPLAY																
TENNIS COURT HORN/STROBES																
TENNIS COURT- SMOKE DETECTORS																
TENNIS COURT- HEAT DETECTORS																
TENNIS COURT- PULL STATIONS																
ENGAGE FIRE EXTINGUISHERS																
LOSS OF POWER ANY PANEL OR NAC																
LOW BATTERY CONDITIONS																
OPEN CIRCUIT CONDITIONS																
GROUND FAULTS																

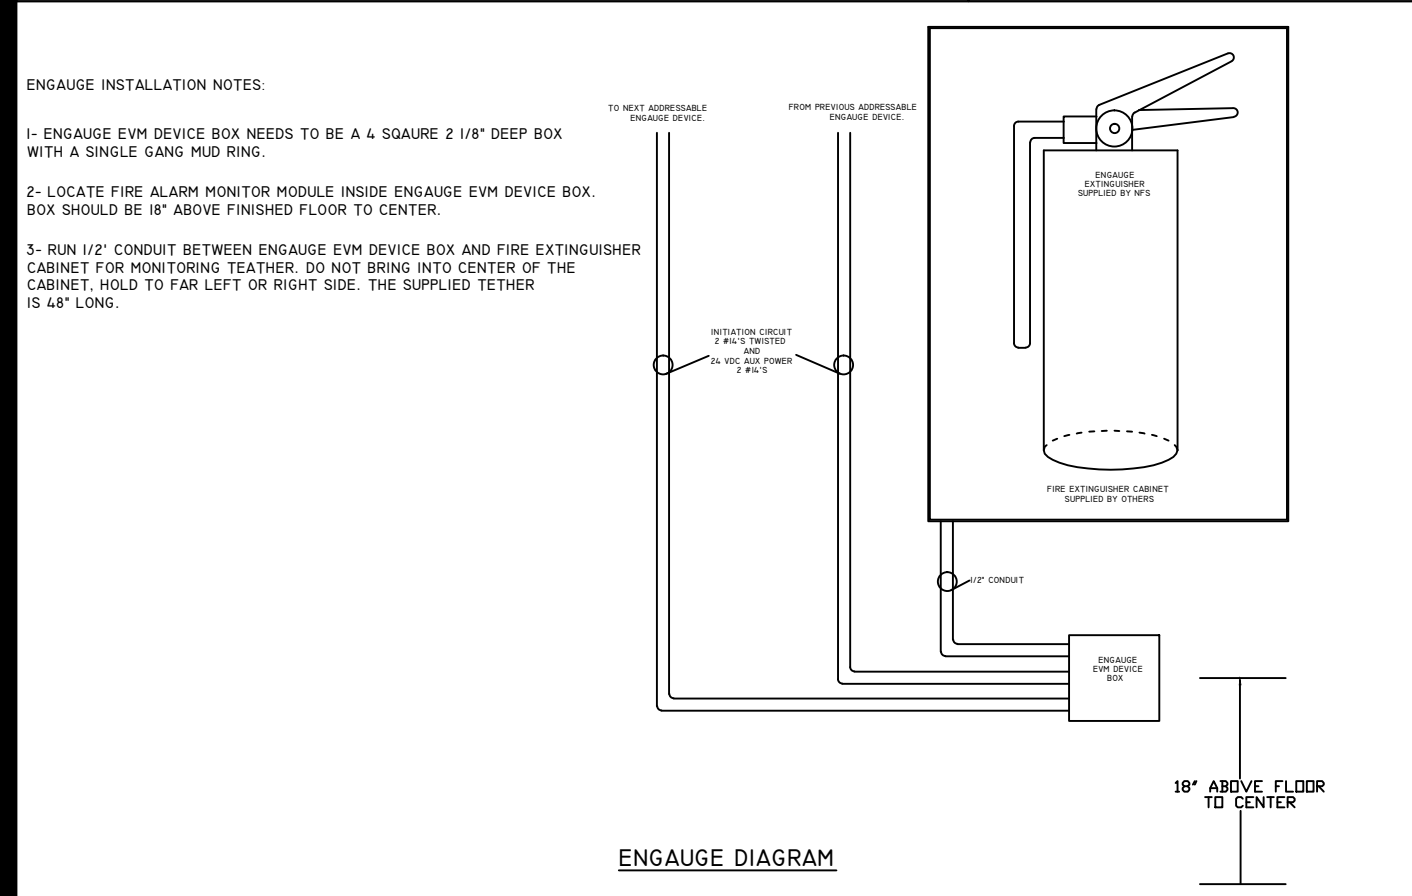

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	HEAT DETECTOR
ⓕ	MANUAL PULL STATION
ⓂⓂ	MONITOR MODULE
ⓕⓔ	ENGAGE FIRE EXTINGUISHER
ⓗⓈ	HORN/STROBE
Ⓛ	STROBE ONLY
ⓕⓐ⓬Ⓤ	FIRE ALARM CONTROL UNIT
ⓌⓅ	WEATHERPROOF DEVICE

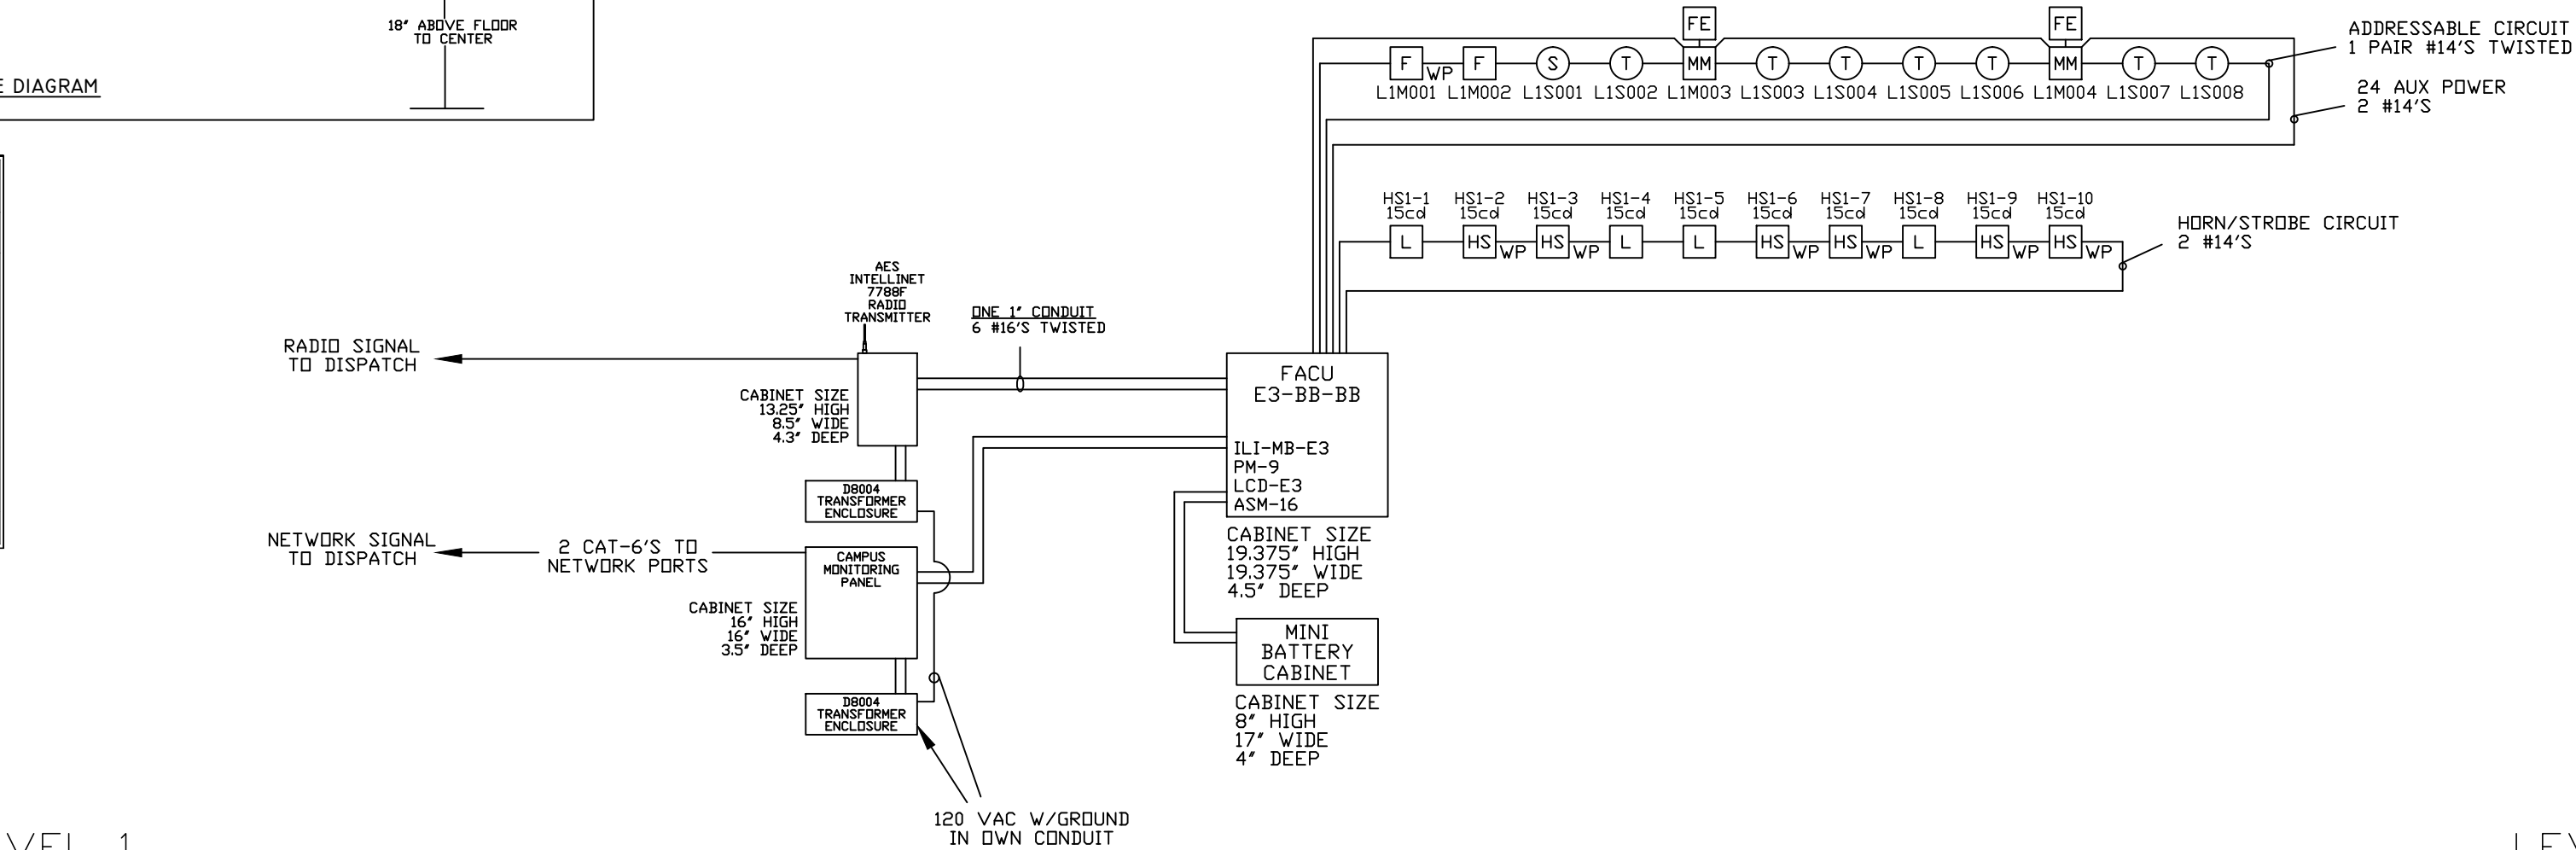

LEVEL 1

LEVEL 1

DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUIT

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
SPECIFICATIONS (NFS) AND THE
FURNISHED TO NFS. NFS IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
FIRE ALARM RISER DIAGRAM / MATRIX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 9/29/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME: TENNIS RISER.DWG

FIRE ALARM SYSTEM
RISER DIAGRAM

PAGE:
FA-R-01

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
RUSTY SELIN
#32414

SYSTEM NOTES:

◊ TO FACU

REVISION NOTES:

▲ ADDED TO MEET CODE (9/29/14)

▲ DELETED DEVICE (9/29/14)

WIRE SCHEDULE

SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND

SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
MM	MONITOR MODULE
FE	ENGAGE FIRE EXTINGUISHER
HS	HORN/STROBE
L	STROBE ONLY
FACU	FIRE ALARM CONTROL UNIT
WP	WEATHERPROOF DEVICE

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 9/29/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
TENNIS COMPLEX.DWG

FIRE ALARM SYSTEM
COURT LEVEL
INITIATION

PAGE:
FA-I-01



0' 5' 10' 15' 25' 50'
SCALE

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. NFS IS NOT RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF THE A/E PLANS. NFS IS NOT RESPONSIBLE FOR THE SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SYSTEM NOTES:

◇ TO FACU

REVISION NOTES:

△ ADDED TO MEET CODE (9/29/14)

△ DELETED DEVICE (9/29/14)

WIRE SCHEDULE

SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND

SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
MM	MONITOR MODULE
FE	ENGAGE FIRE EXTINGUISHER
HS	HORN/STROBE
L	STROBE ONLY
FACU	FIRE ALARM CONTROL UNIT
WP	WEATHERPROOF DEVICE

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 9/29/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
TENNIS COMPLEX.DWG

FIRE ALARM SYSTEM
COURT LEVEL
NOTIFICATION

PAGE:

FA-I-02



0' 5' 10' 15' 25' 50'
SCALE

SYSTEM NOTES:

◊ TO FACU

REVISION NOTES:

▲ ADDED TO MEET CODE (9/29/14)

▲ DELETED DEVICE (9/29/14)

WIRE SCHEDULE

SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND

SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
MM	MONITOR MODULE
FE	ENGAGE FIRE EXTINGUISHER
HS	HORN/STROBE
L	STROBE ONLY
FACU	FIRE ALARM CONTROL UNIT
WP	WEATHERPROOF DEVICE

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

UNIVERSITY OF UTAH
OUTDOOR TENNIS COMPLEX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 9/29/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
TENNIS COMPLEX.DWG

FIRE ALARM SYSTEM
COURT LEVEL
NUMBERS

PAGE:

FA-I-03



0' 5' 10' 15' 25' 50'
SCALE