
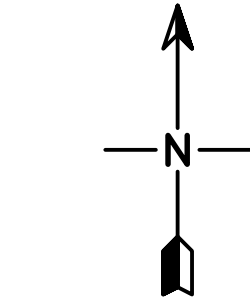


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ	HEAT DETECTOR
F	MANUAL PULL STATION
DD	DUCT DETECTOR
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	ENGAGE FIRE EXTINGUISHER
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

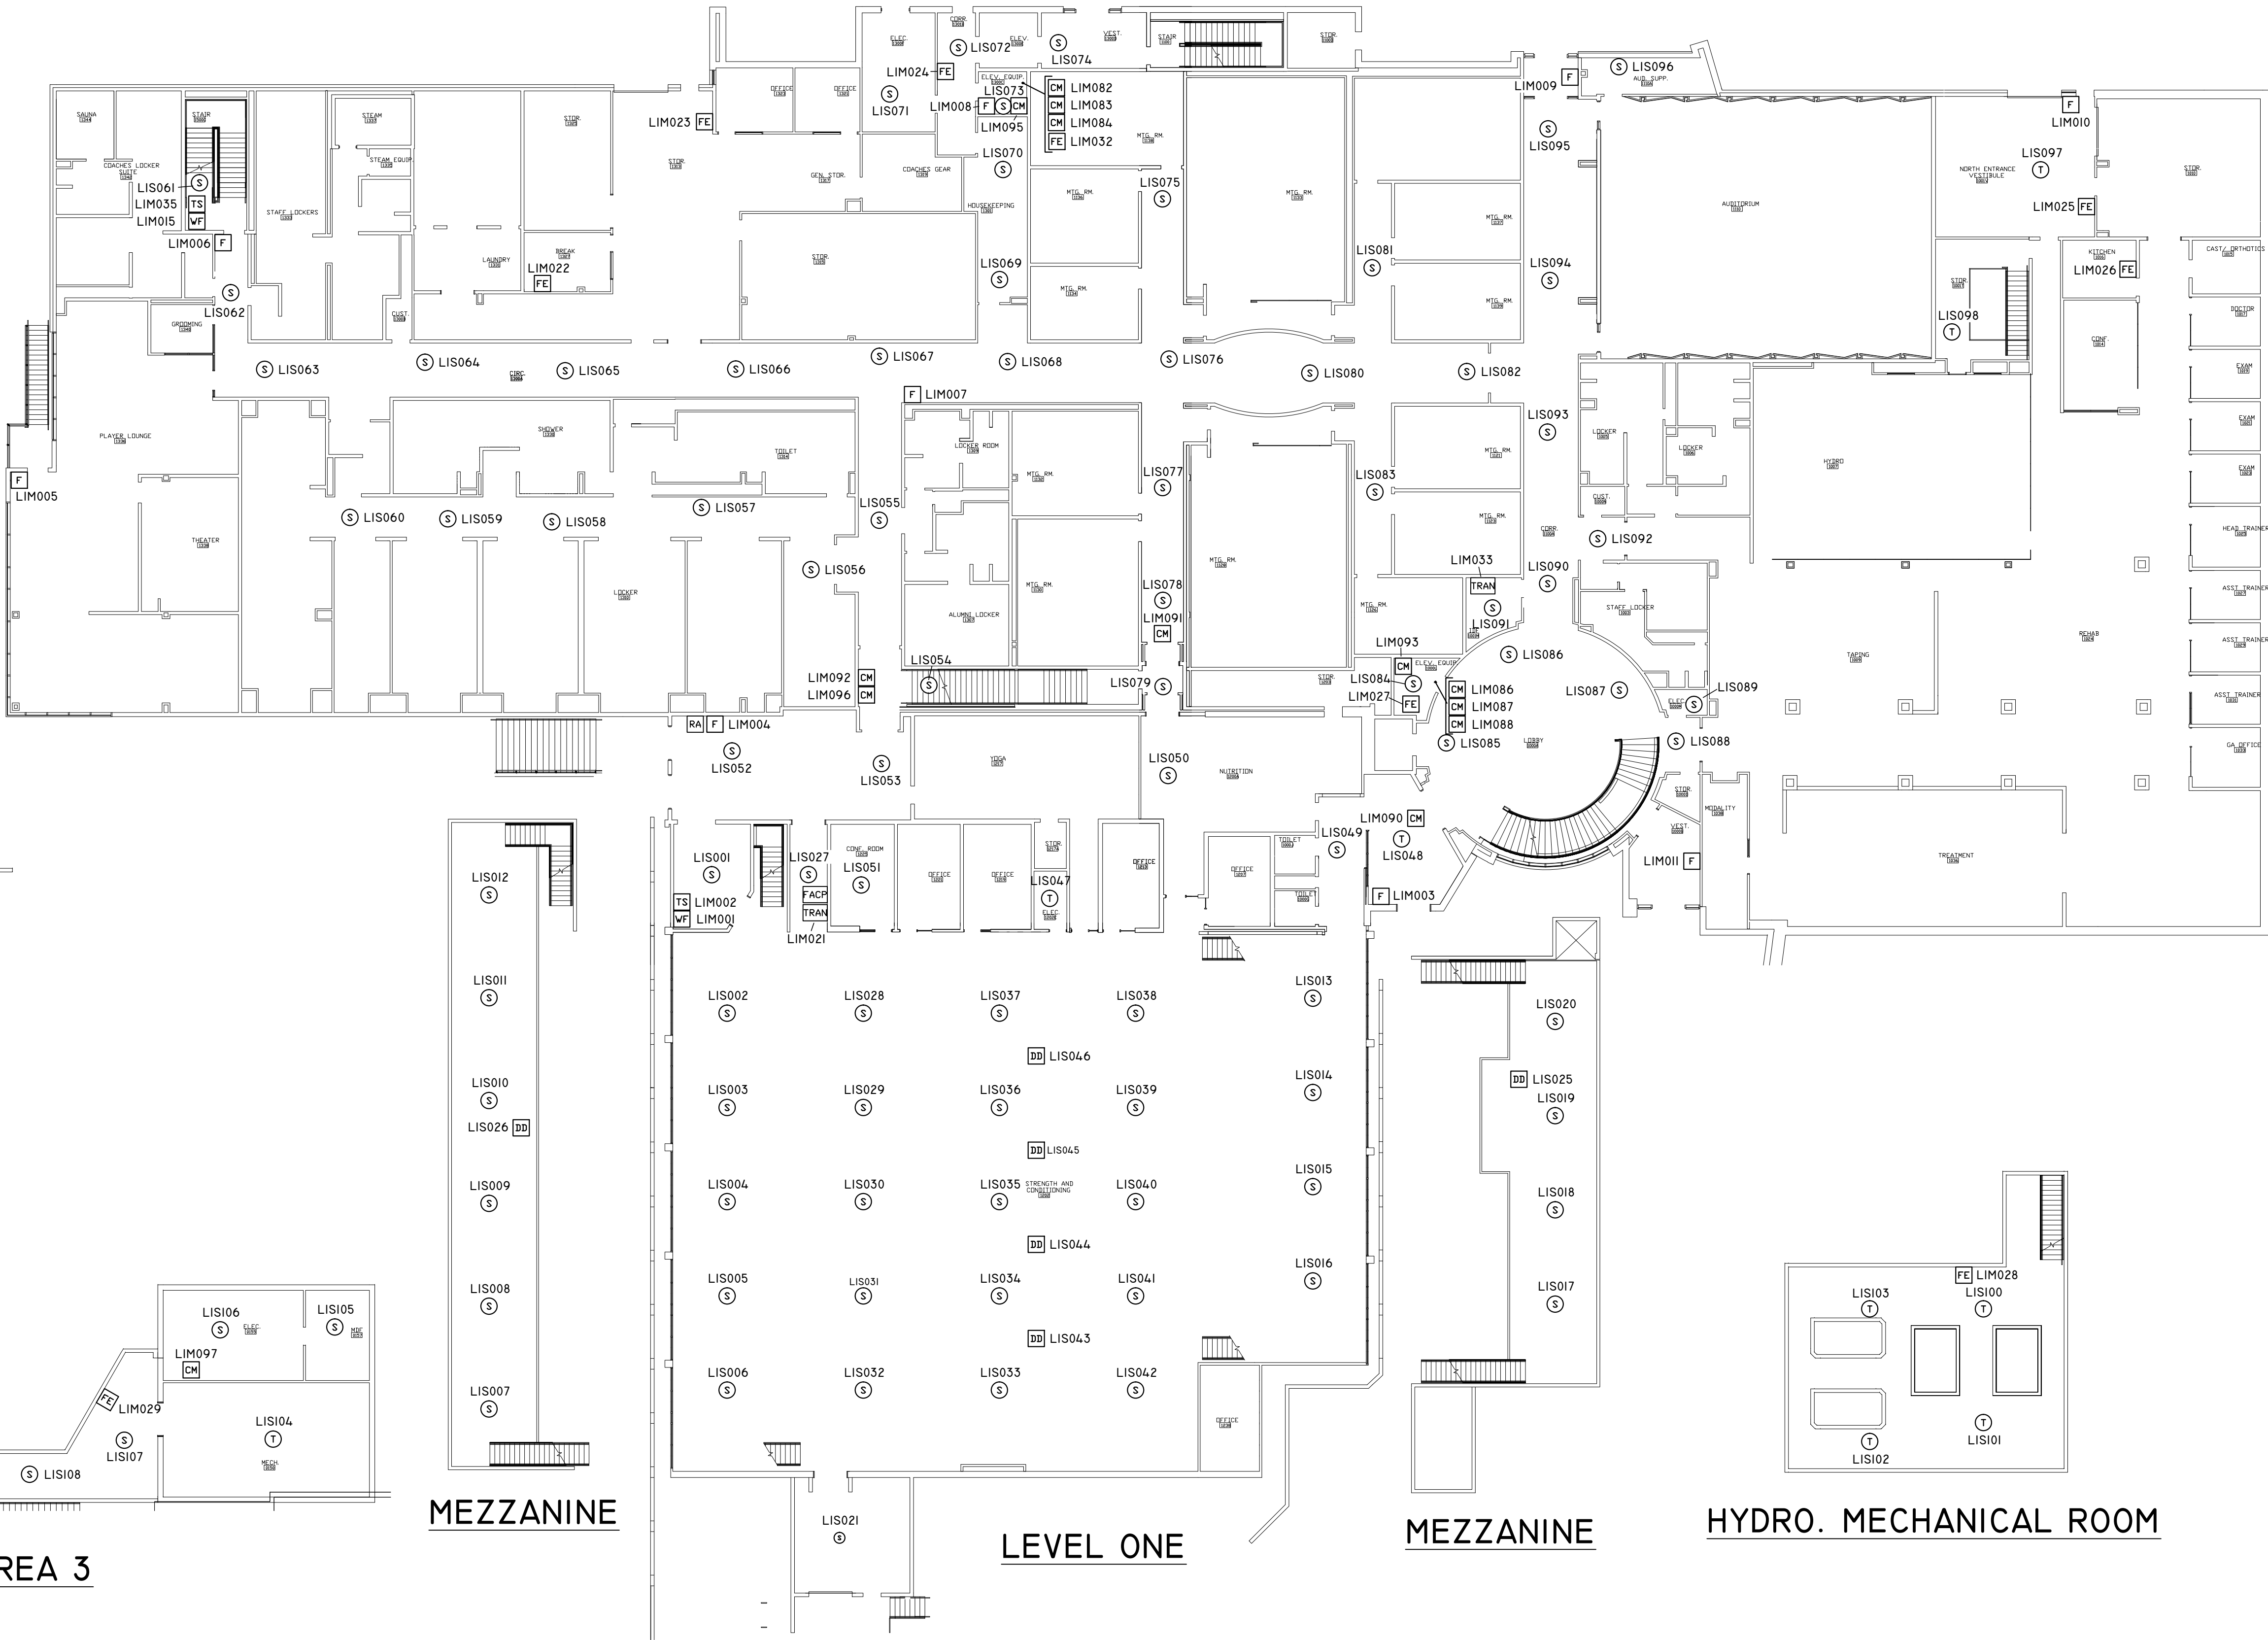

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL ONE & FIELD LEVEL
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: J.J.G.
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 7/31/2013
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
FOOTBALL CENTER | FM.DWG

FIRE ALARM SYSTEM


LEVEL ONE
FINAL MAP

PAGE:


FA-I

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ	HEAT DETECTOR
F	MANUAL PULL STATION
DD	DUCT DETECTOR
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	ENGAGE FIRE EXTINGUISHER
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

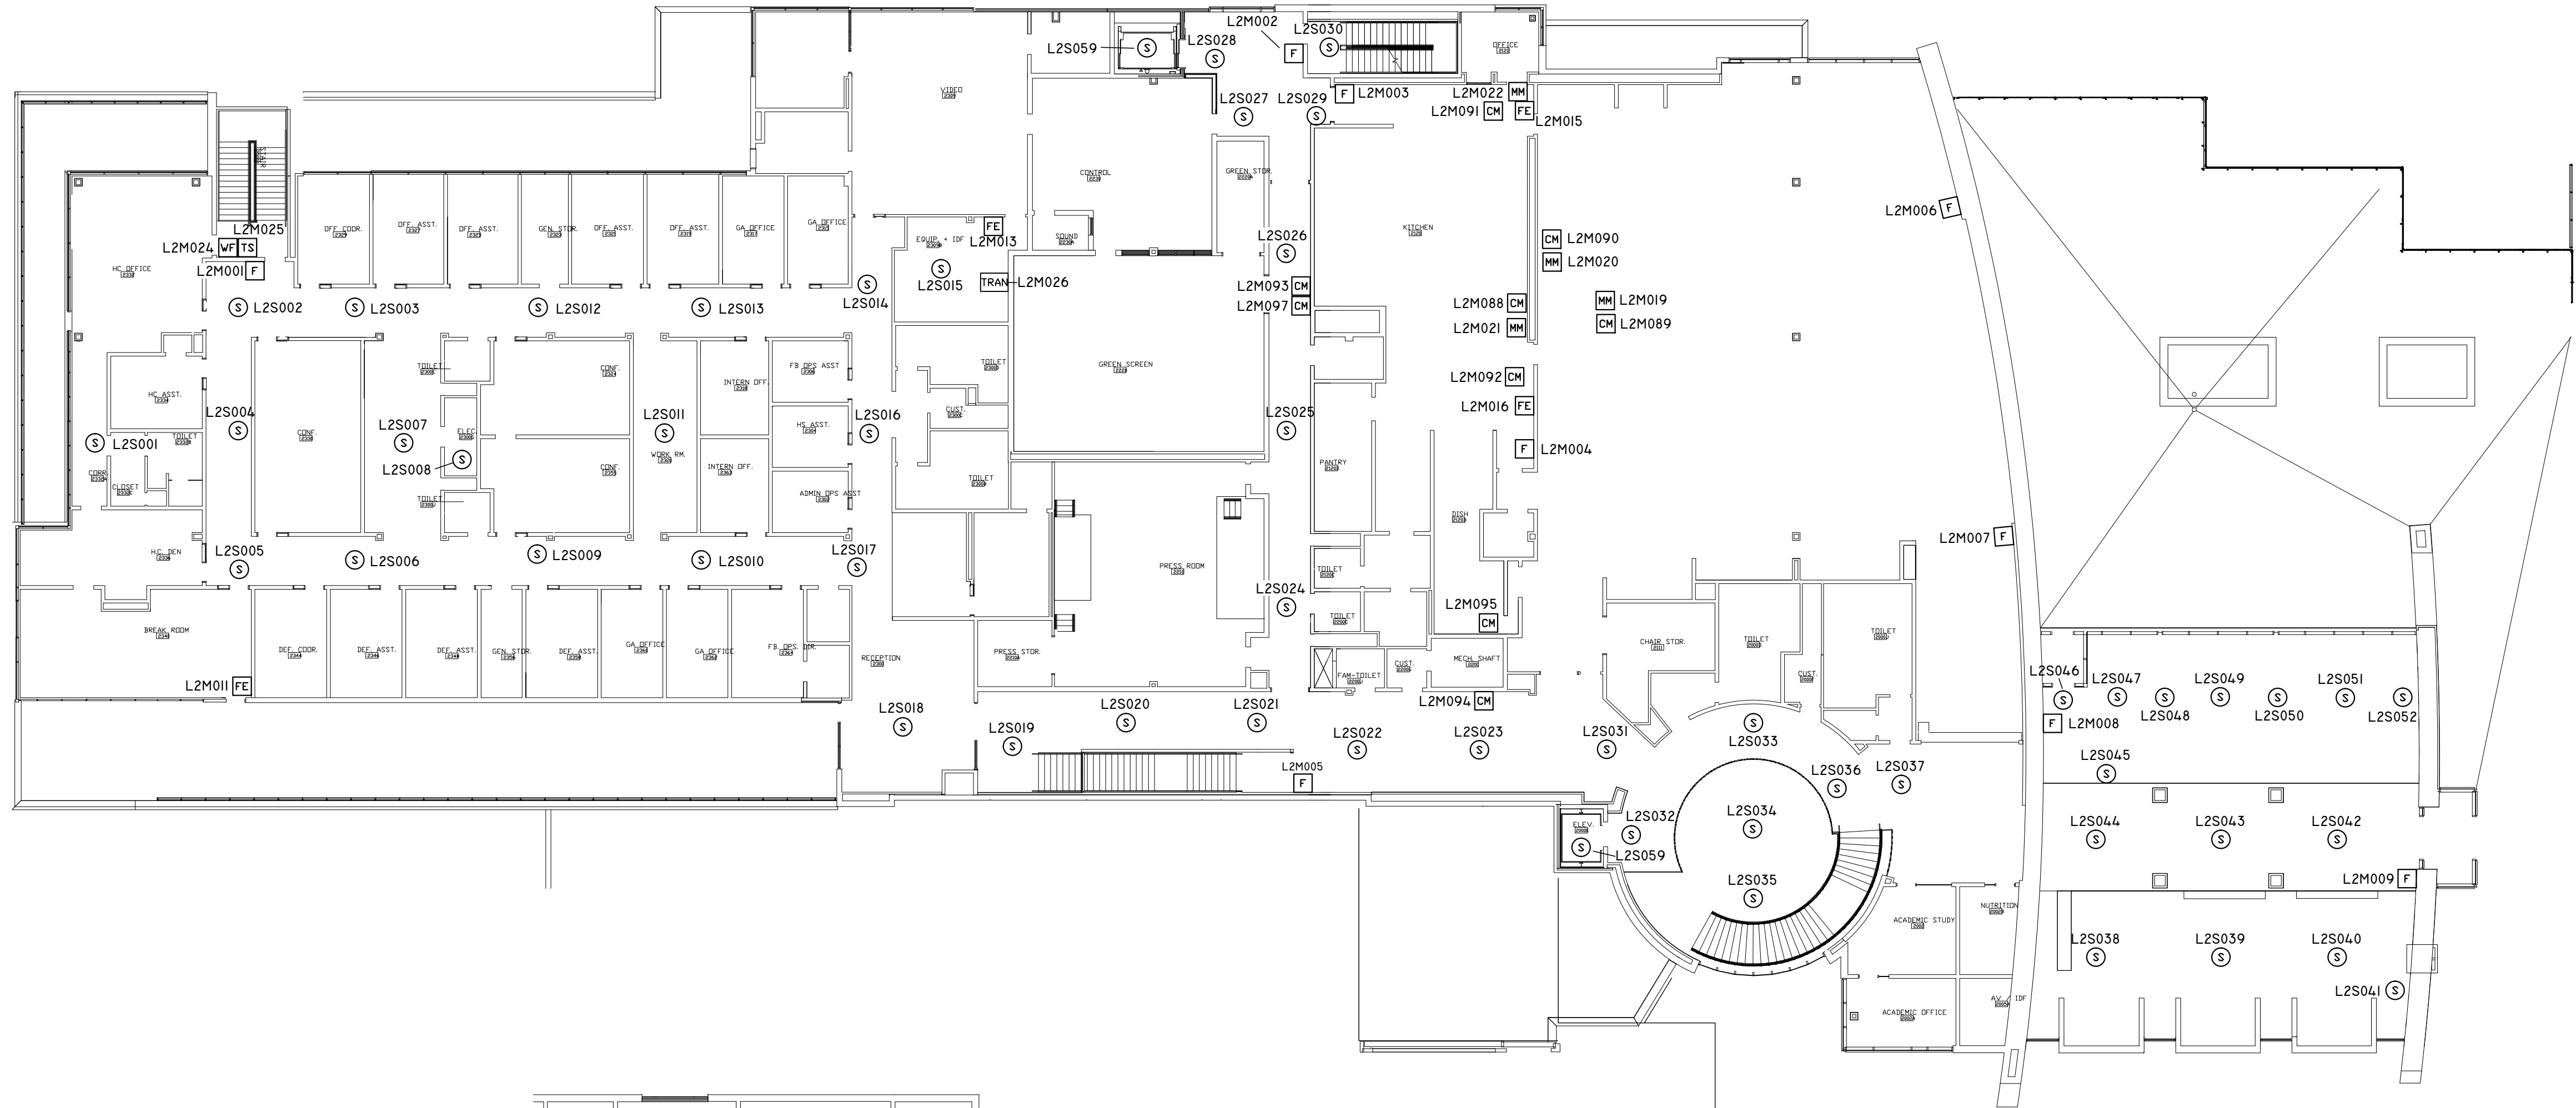

LEVEL TWO

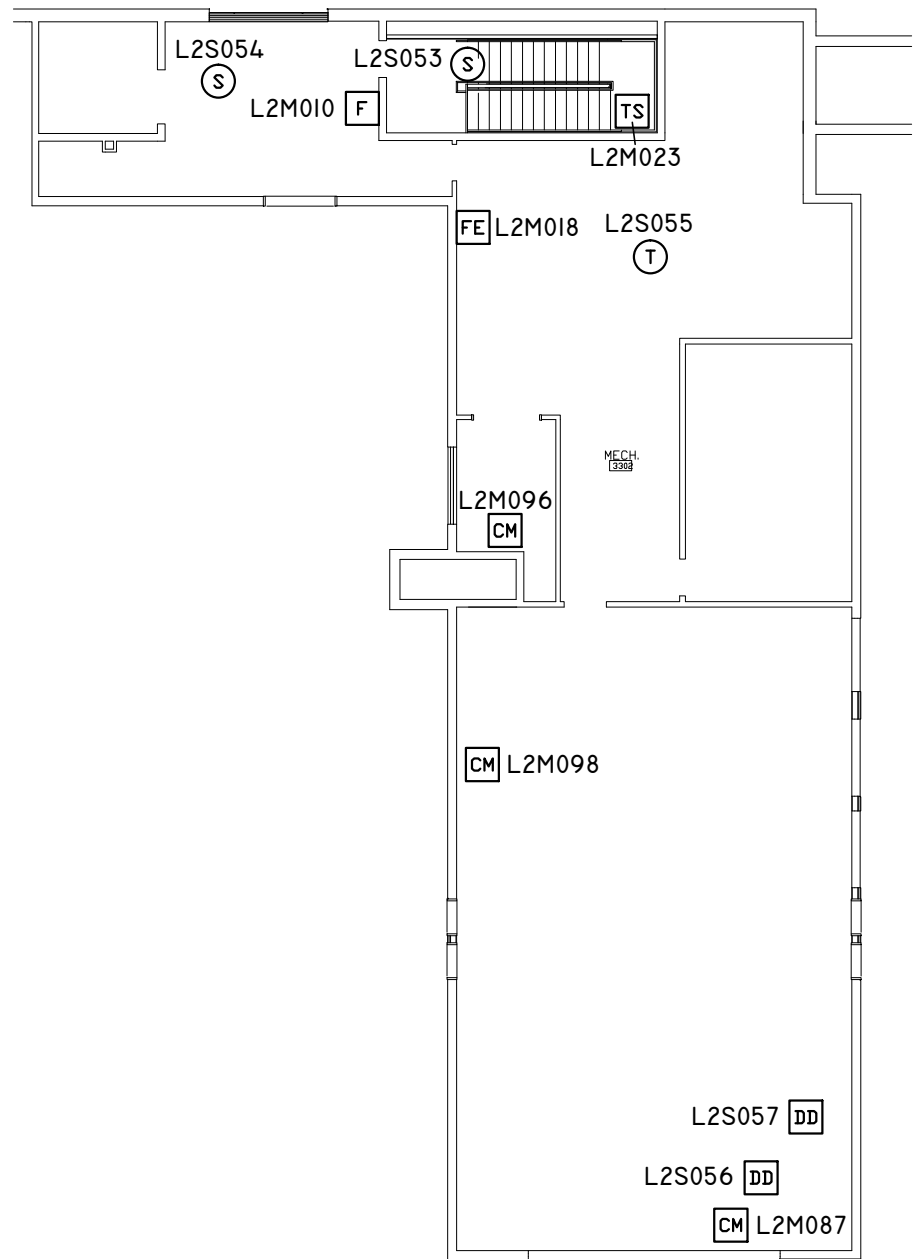

ROOF LEVEL

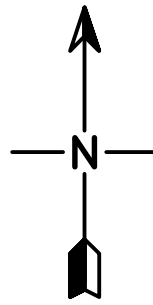

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. NFS IS NOT RESPONSIBLE FOR THE
ACCURACY OF THE A/E PLANS. NFS IS NOT RESPONSIBLE FOR THE
SUITABILITY OF THE FIRE ALARM SYSTEM CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL TWO & ROOF
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JGG
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 7/31/2013
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
FOOTBALL CENTER I FM.DWG

FIRE ALARM SYSTEM
LEVEL TWO
FINAL MAP

PAGE:

FA-2



UNIVERSITY OF UTAH
THE FOOTBALL CENTER
FIRE ALARM SYSTEM

INDEX OF DRAWINGS

PAGE	SHEET NO.	DESCRIPTION	
1	FA-C-01	PROJECT COVER SHEET-INDEX OF DRAWINGS	NELSON FIRE SYSTEMS
2	FA-R-01	FIRE ALARM RISER-INPUT/OUTPUT MATRIX-DEVICE DETAILS	NELSON FIRE SYSTEMS
3	FA-1-01	LEVEL ONE & FIELD LEVEL- INITIATION CIRCUITS	NELSON FIRE SYSTEMS
4	FA-1-02	LEVEL ONE & FIELD LEVEL- NOTIFICATION CIRCUITS	NELSON FIRE SYSTEMS
5	FA-2-01	LEVEL TWO & ROOF- INITIATION CIRCUITS	NELSON FIRE SYSTEMS
6	FA-2-02	LEVEL TWO & ROOF- NOTIFICATION CIRCUITS	NELSON FIRE SYSTEMS

DEVICE LEGEND			
SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENTS
Ⓢ	SMOKE DETECTOR W/BASE	ASD-PL2F/B210LP	3/0 MUD RING
Ⓣ	HEAT DETECTOR W/BASE	ATD-RL2F/B210LP	3/0 MUD RING
Ⓣ	MANUAL PULL STATION	MS-7AF	1 GANG MUD RING ON 2-1/8" DEEP BOX
Ⓣ	DUCT SMOKE DETECTOR	DNR	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
Ⓦ	WATERFLOW SWITCH	AMM-4F	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓣ	TAMPER SWITCH	AMM-4F	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓣ	HORN/STROBE	P2W	1 GANG MUD RING ON 2-1/8" DEEP BOX
Ⓣ _{CLG}	CEILING HORN/STROBE	PC2W	1 GANG MUD RING ON 2-1/8" DEEP BOX
Ⓣ _{VP}	WEATHERPROOF HORN/STROBE	P2RK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
Ⓛ	STROBE ONLY	SW	1 GANG MUD RING ON 2-1/8" DEEP BOX
Ⓛ _{CLG}	CEILING STROBE ONLY	SCW	1 GANG MUD RING ON 2-1/8" DEEP BOX
Ⓜ	MONITOR MODULE	AMM-4F/AMM-2F	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓢ	CONTROL MODULE	ADM-2RF	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓡ	RELAY	PR-1	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓢ	ENGAGE FIRE EXTINGUISHER	EVM/AMM-2F	4 SQ. 2-1/8" MINIMUM W/ 2 GANG MUD RING
Ⓡ	REMOTE ANNUNCIATOR	LCD-E3/E3-BB-BA	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
Ⓢ	FIRE ALARM CONTROL PANEL	EXISTING E3 SERIES	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
Ⓢ	TRANSPONDER PANEL	SBB-D4	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
COVER SHEET
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 2/14/13
SCALE: (ARCH EI) N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
FOOTBALL COVER.DWG

FIRE ALARM SYSTEM

PAGE:

FA-C-01


N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

ROOF LEVEL


LEVEL 2

LEVEL 1

FIELD LEVEL

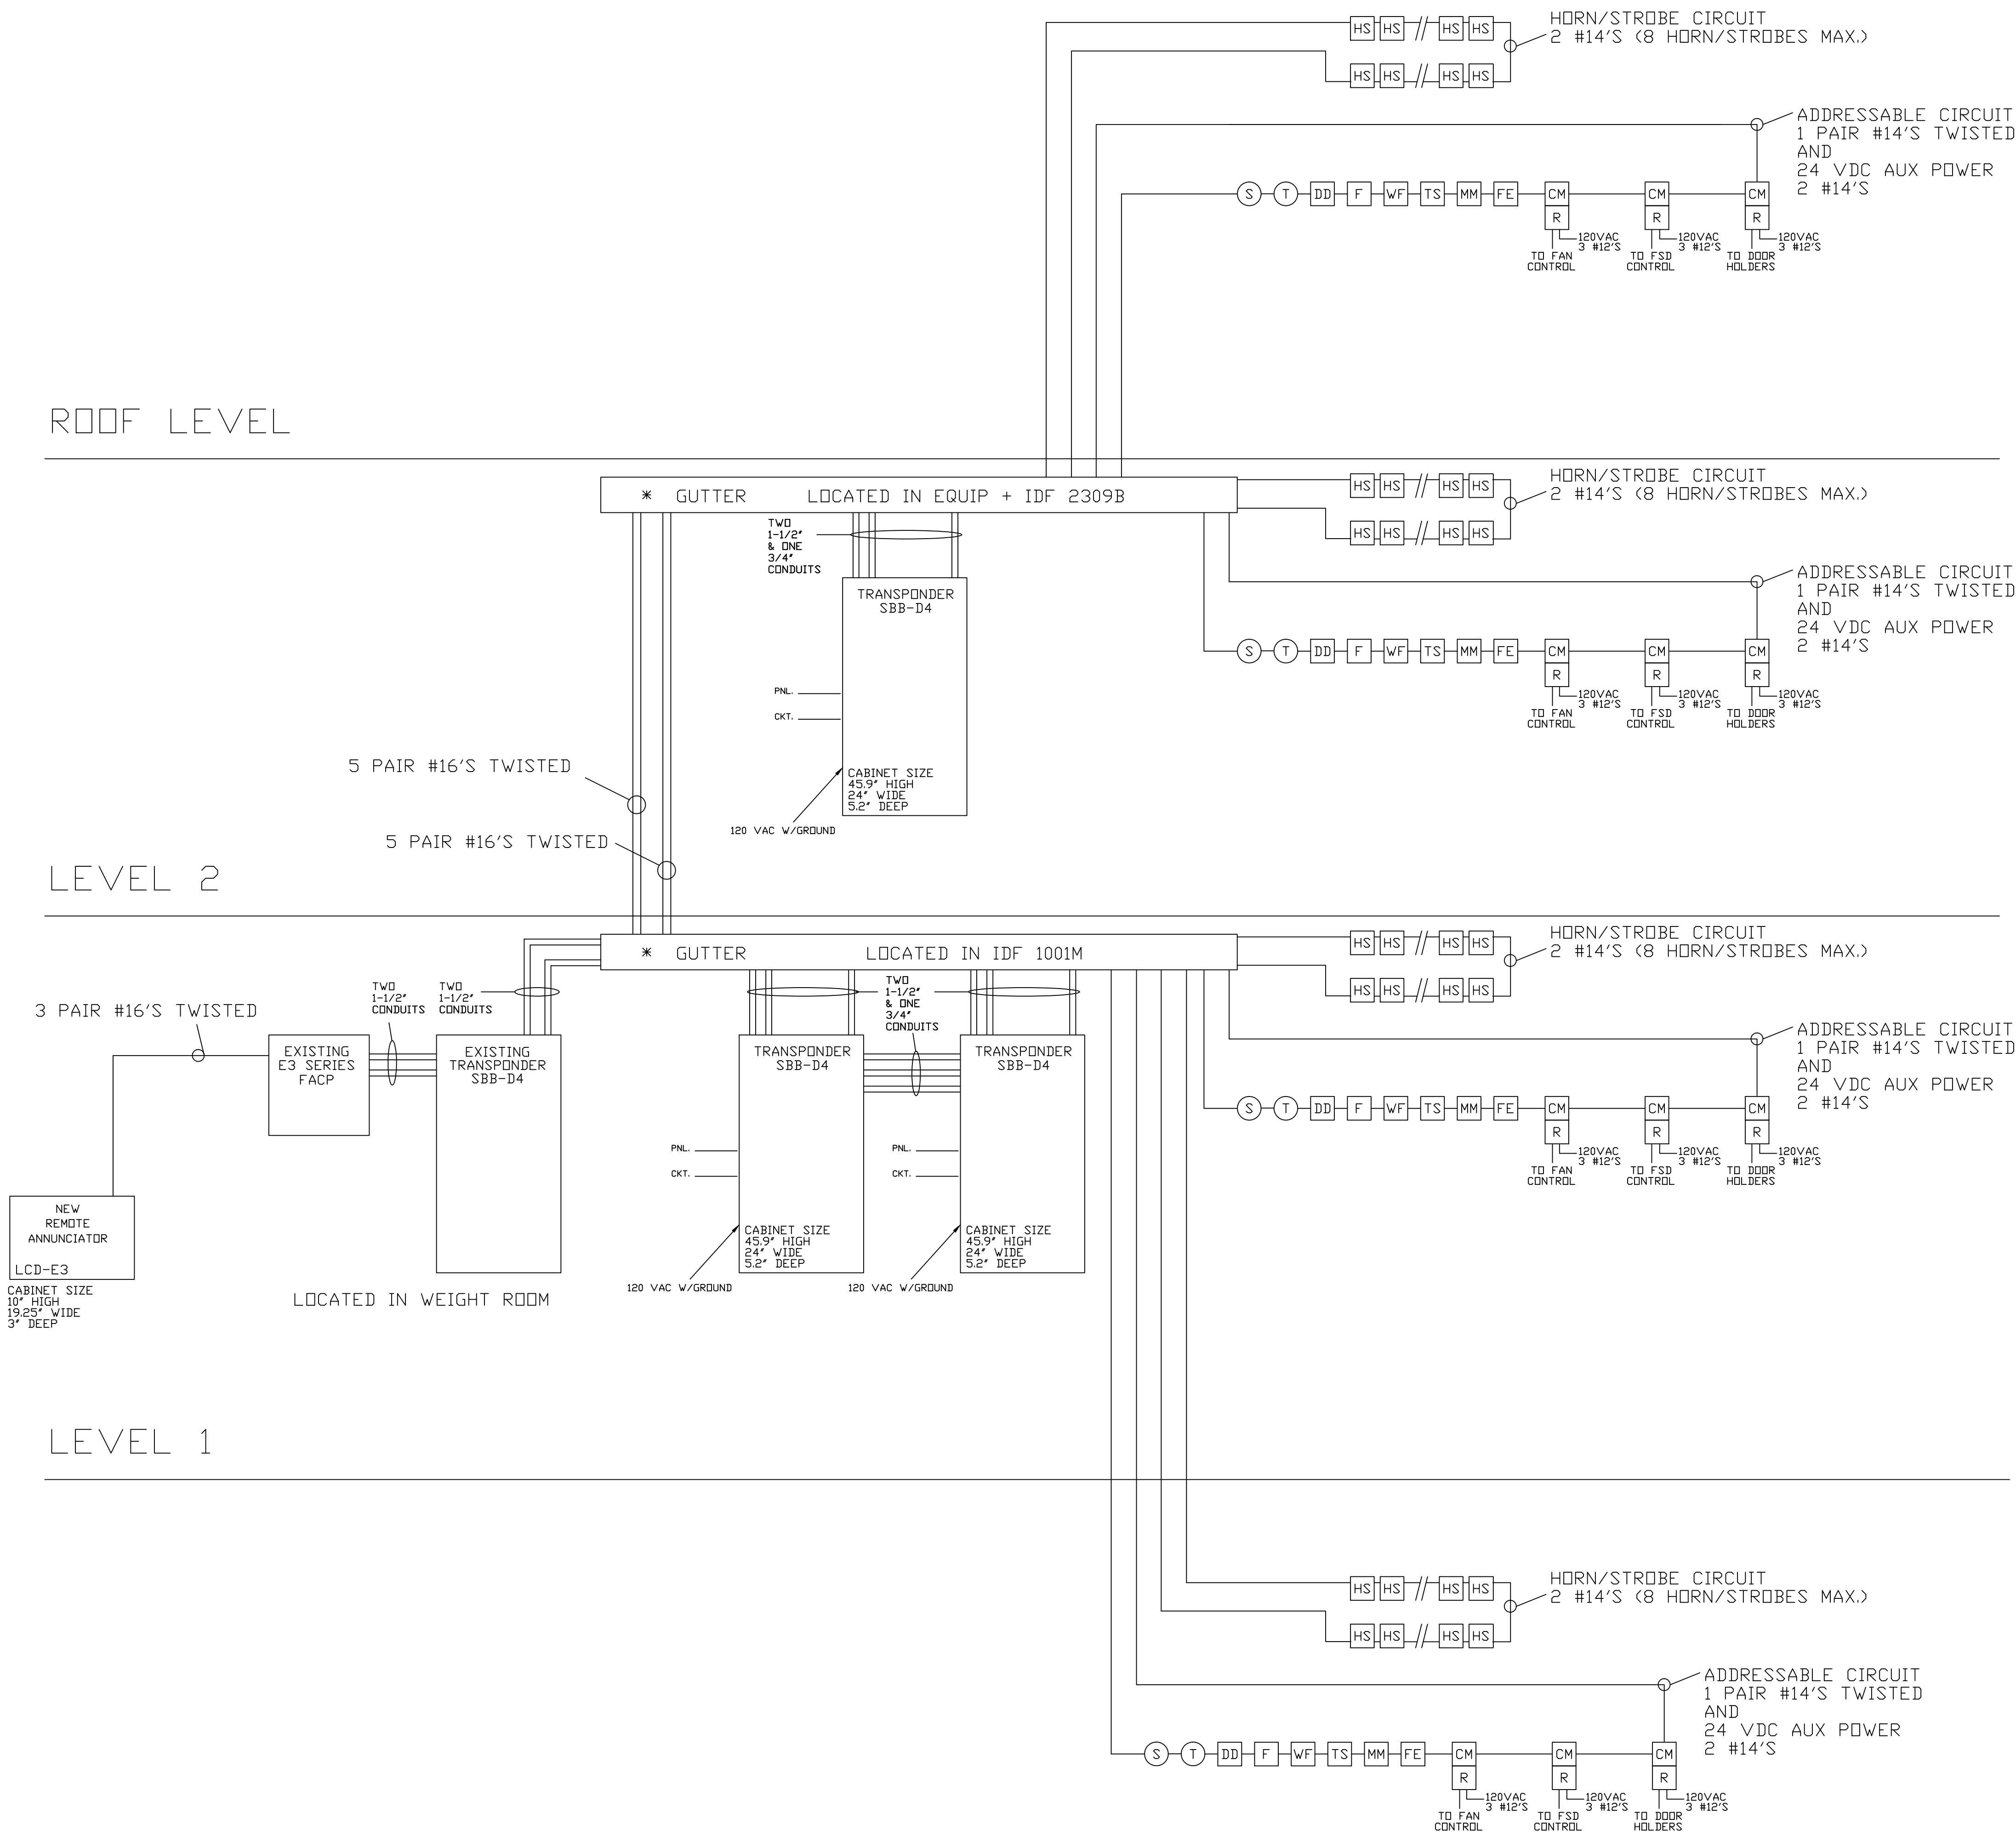

FIRE ALARM INPUT/OUTPUT MATRIX	SYSTEM OUTPUTS															
	FACP ANNUNCIATION		NOTIFICATION				FIRE SAFETY CONTROL				AUX. SIGNALS		REPORTING			
SYSTEM INPUTS	ALARM SIGNAL TO MONITORING COMPANY	TROUBLE SIGNAL TO MONITORING COMPANY	FIELD LEVEL HORN/STROBES	LEVEL 1 HORN/STROBES	LEVEL 2 HORN/STROBES	ROOF LEVEL HORN/STROBES	ELEVATOR PRIMARY RECALL	ELEVATOR ALTERNATE RECALL	ELEVATOR SHUNT TRIP	HVAC SHUT-DOWN	FIRE SMOKE DAMPERS	RELEASE MAGNETIC DOOR HOLDERS	REPORT TO PRINTER	REPORT TO MASTER FIRE ALARM PANEL		
BASEMENT ELEVATOR DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
BASEMENT SMOKE DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
BASEMENT HEAT DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
BASEMENT PULL STATIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
BASEMENT MAIN WATERFLOW	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
BASEMENT MAIN TAMPER	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 1 ELEVATOR DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 1 SMOKE DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 1 PULL STATIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 1 WATERFLOW	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 1 TAMPER	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 2 ELEVATOR DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 2 SMOKE DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LEVEL 2 PULL STATIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ROOF ELEVATOR DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ROOF SMOKE DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ROOF PULL STATIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ROOF DUCT DETECTORS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ELEVATOR MACHINE ROOM HEAT DETECTOR	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
ELEVATOR MACHINE SMOKE DETECTOR	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LOSS OF POWER ANY PANEL OR NAC	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
LOW BATTERY CONDITIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
OPEN CIRCUIT CONDITIONS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
GROUND FAULTS	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●

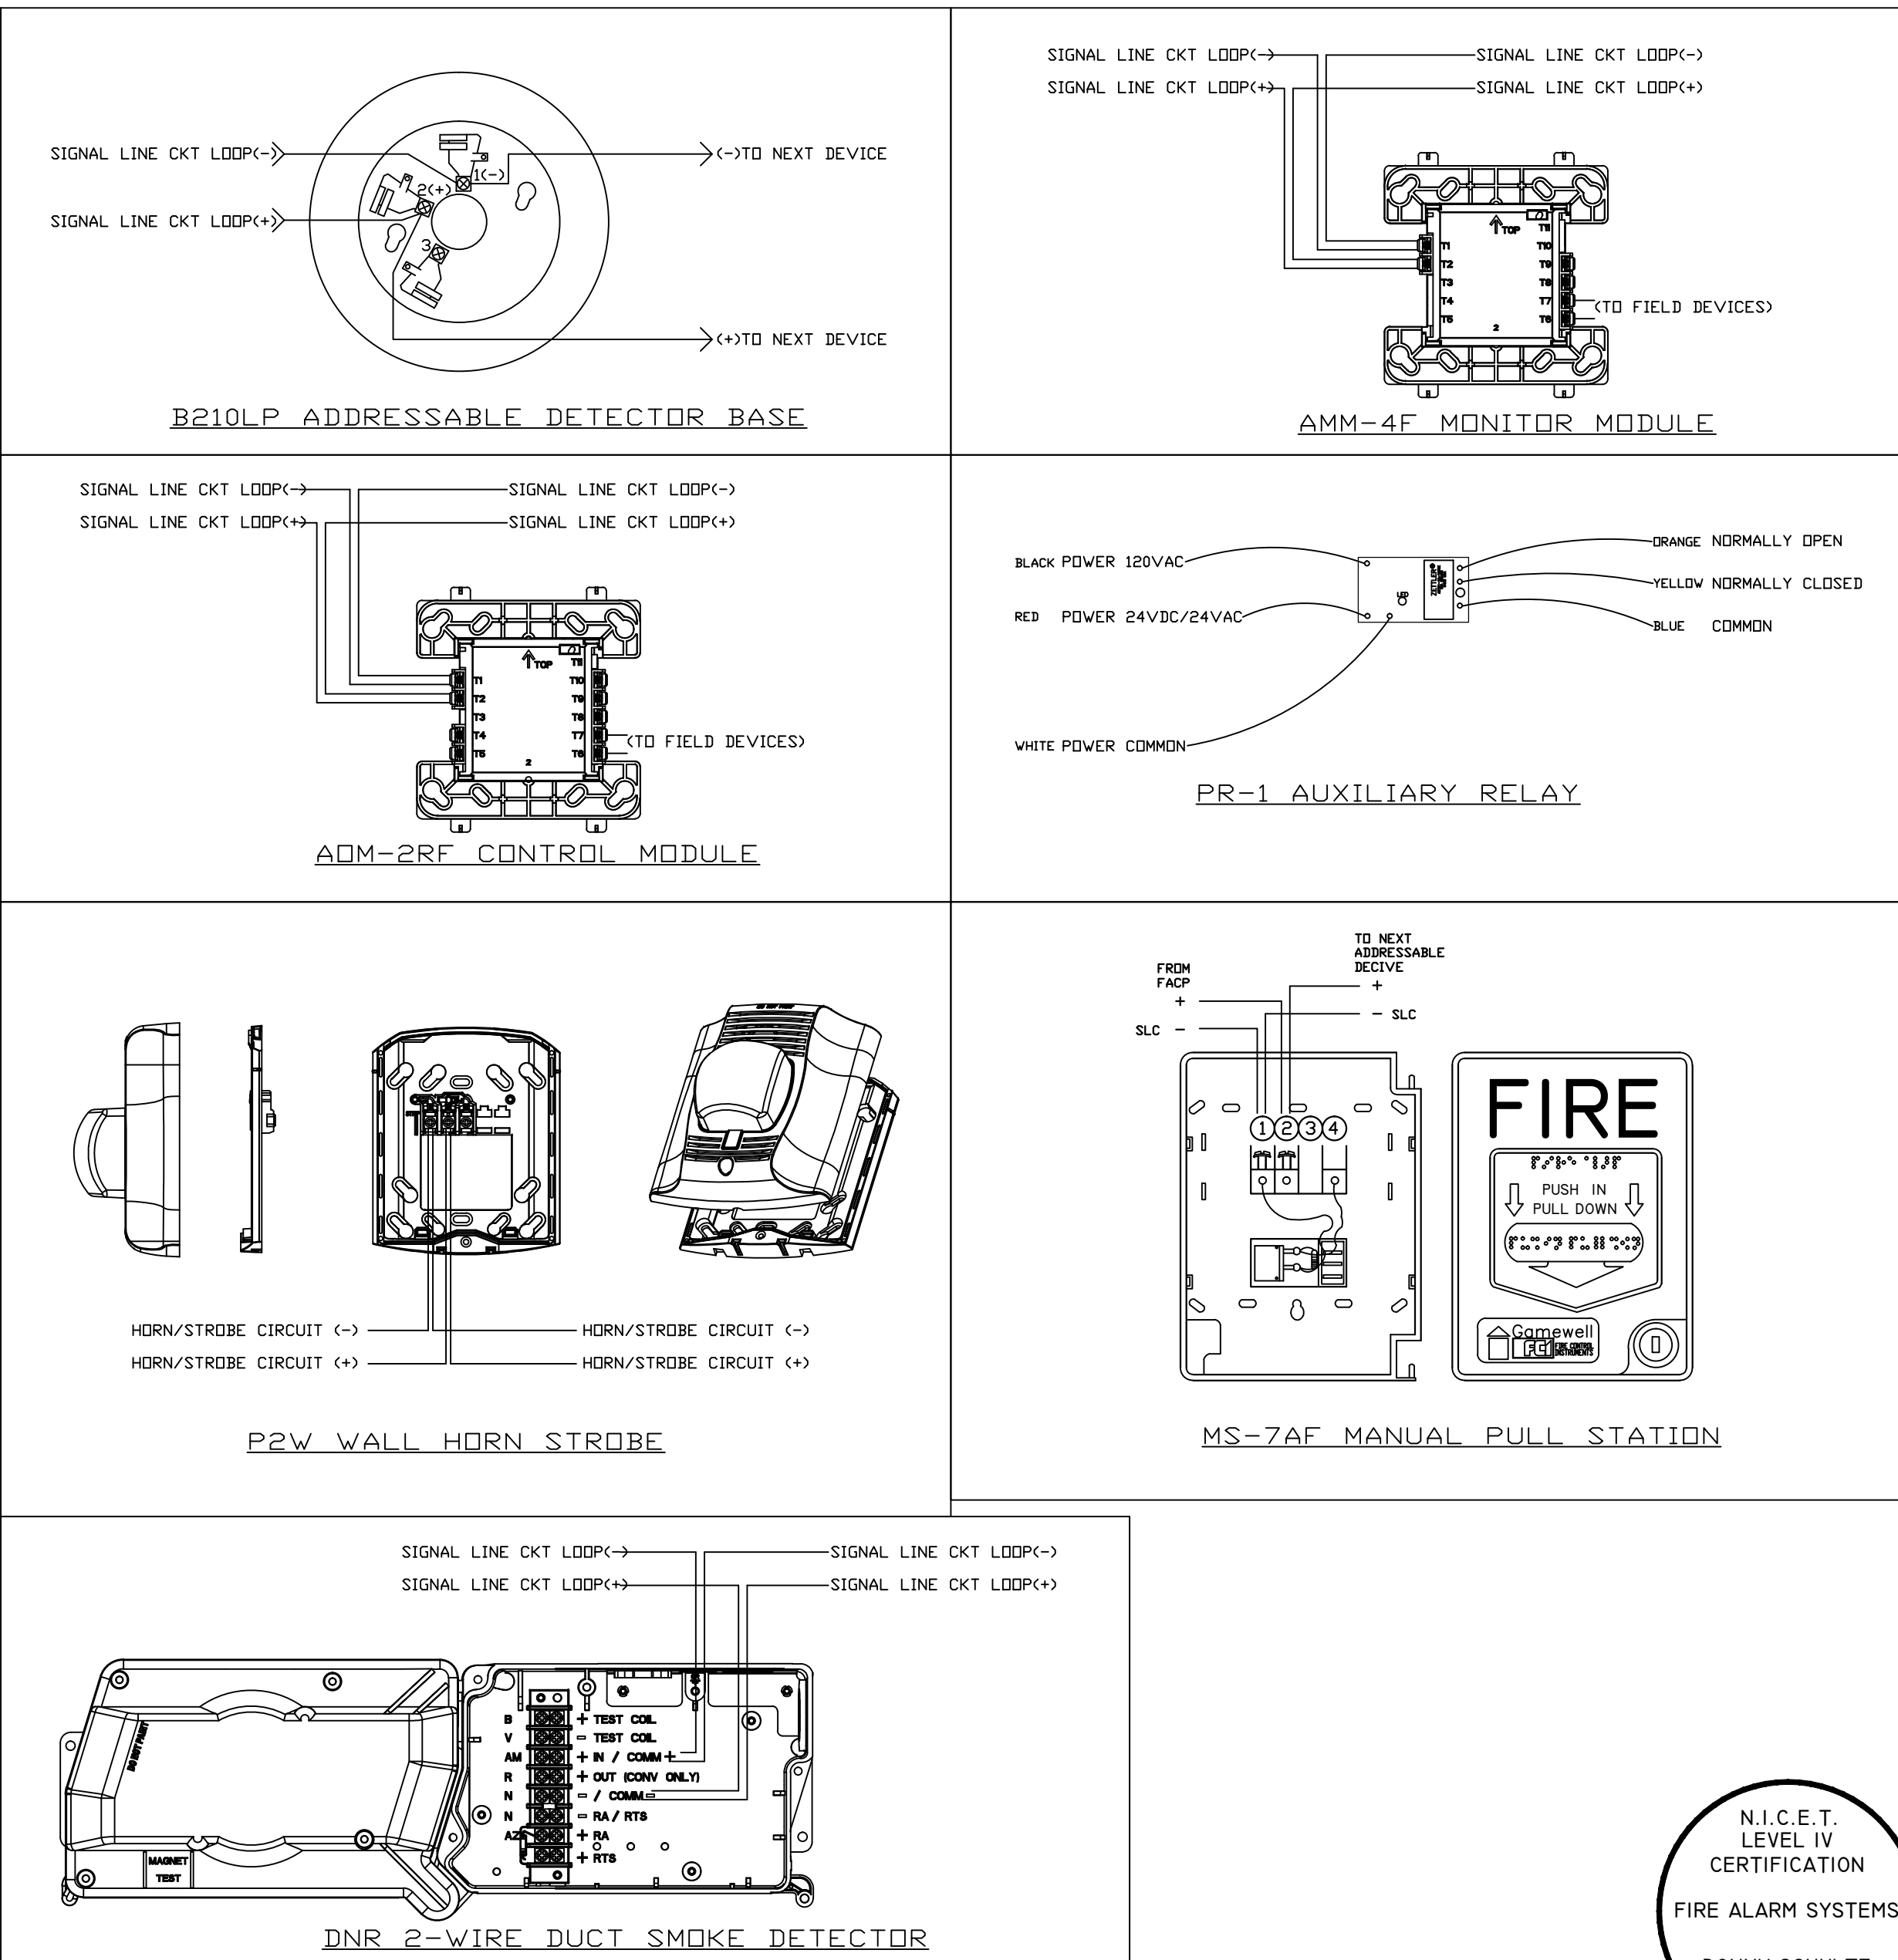

* GUTTERS SUPPLIED BY OTHERS



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND INSTALLATION OF ALL FIRE ALARMS, CONTROL PANELS, AND AUXILIARY DEVICES SHOWN ON THESE PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
TYPICAL BUILDING RISER
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 2/14/13
SCALE: NTS
PROJECT NO: XXXX
REV NO: I
DRAWING NAME: FOOTBALL CENTER RISER.DWG

FIRE ALARM SYSTEM
BUILDING RISER

PAGE:
FA-R-01

REVISION NOTES:
△ ADDED TO MEET CODE (7/29/12)
△ OMITTED PER RICHARD WHITE (2/13/13)
△ REVISED PER RICHARD WHITE (2/13/13)

SYSTEM NOTES:
◇ TO MAIN FACP
◇ TO LEVEL ONE TRANSPONDER IN IDF 1001M
◇ TIE TO EXISTING HORN/STROBE CIRCUIT
◇ FOR FIRE/SMOKE DAMPERS
◇ FOR DOORHOLDERS
◇ TIE TO NEAREST EXISTING ADDRESSABLE DEVICE
◇ REPLACE EXISTING SMOKE DETECTORS IN THE 2-STORY SECTION OF STRENGTH AND CONDITIONING
◇ TYPE K EXTINGUISHER

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	RELAY CIRCUIT	2 #14'S
D	24 VDC AUX POWER	2 #14'S
E	120 VAC W/GROUND	3 #12'S
F	REMOTE ANNUNCIATOR	3 PAIR #16'S TWISTED

* -REFER TO RISER FA-R-01 FOR INTERCONNECT DETAILS

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	HEAT DETECTOR
⊠	MANUAL PULL STATION
⊠	DUCT DETECTOR
⊠	WATERFLOW SWITCH
⊠	TAMPER SWITCH
⊠	HORN/STROBE
⊠	CEILING HORN/STROBE
⊠	WEATHERPROOF HORN/STROBE
⊠	STROBE ONLY
⊠	CEILING STROBE ONLY
⊠	MONITOR MODULE
⊠	CONTROL MODULE
⊠	RELAY
⊠	ENGAGE FIRE EXTINGUISHER
⊠	REMOTE ANNUNCIATOR
⊠	FIRE ALARM CONTROL PANEL
⊠	TRANSPONDER PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, SMOKE ALARMS, AND SMOKE DETECTORS SHOWN ON THE A/E PLANS. NFS DRAWINGS USE THE WIRING AND INTERCONNECT DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL ONE & FIELD LEVEL
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: JJG
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 2/14/13
SCALE: (ARCH E1) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
FOOTBALL CENTER I.DWG

FIRE ALARM SYSTEM

LEVEL ONE
ADDRESSABLE

PAGE:

FA-I-01

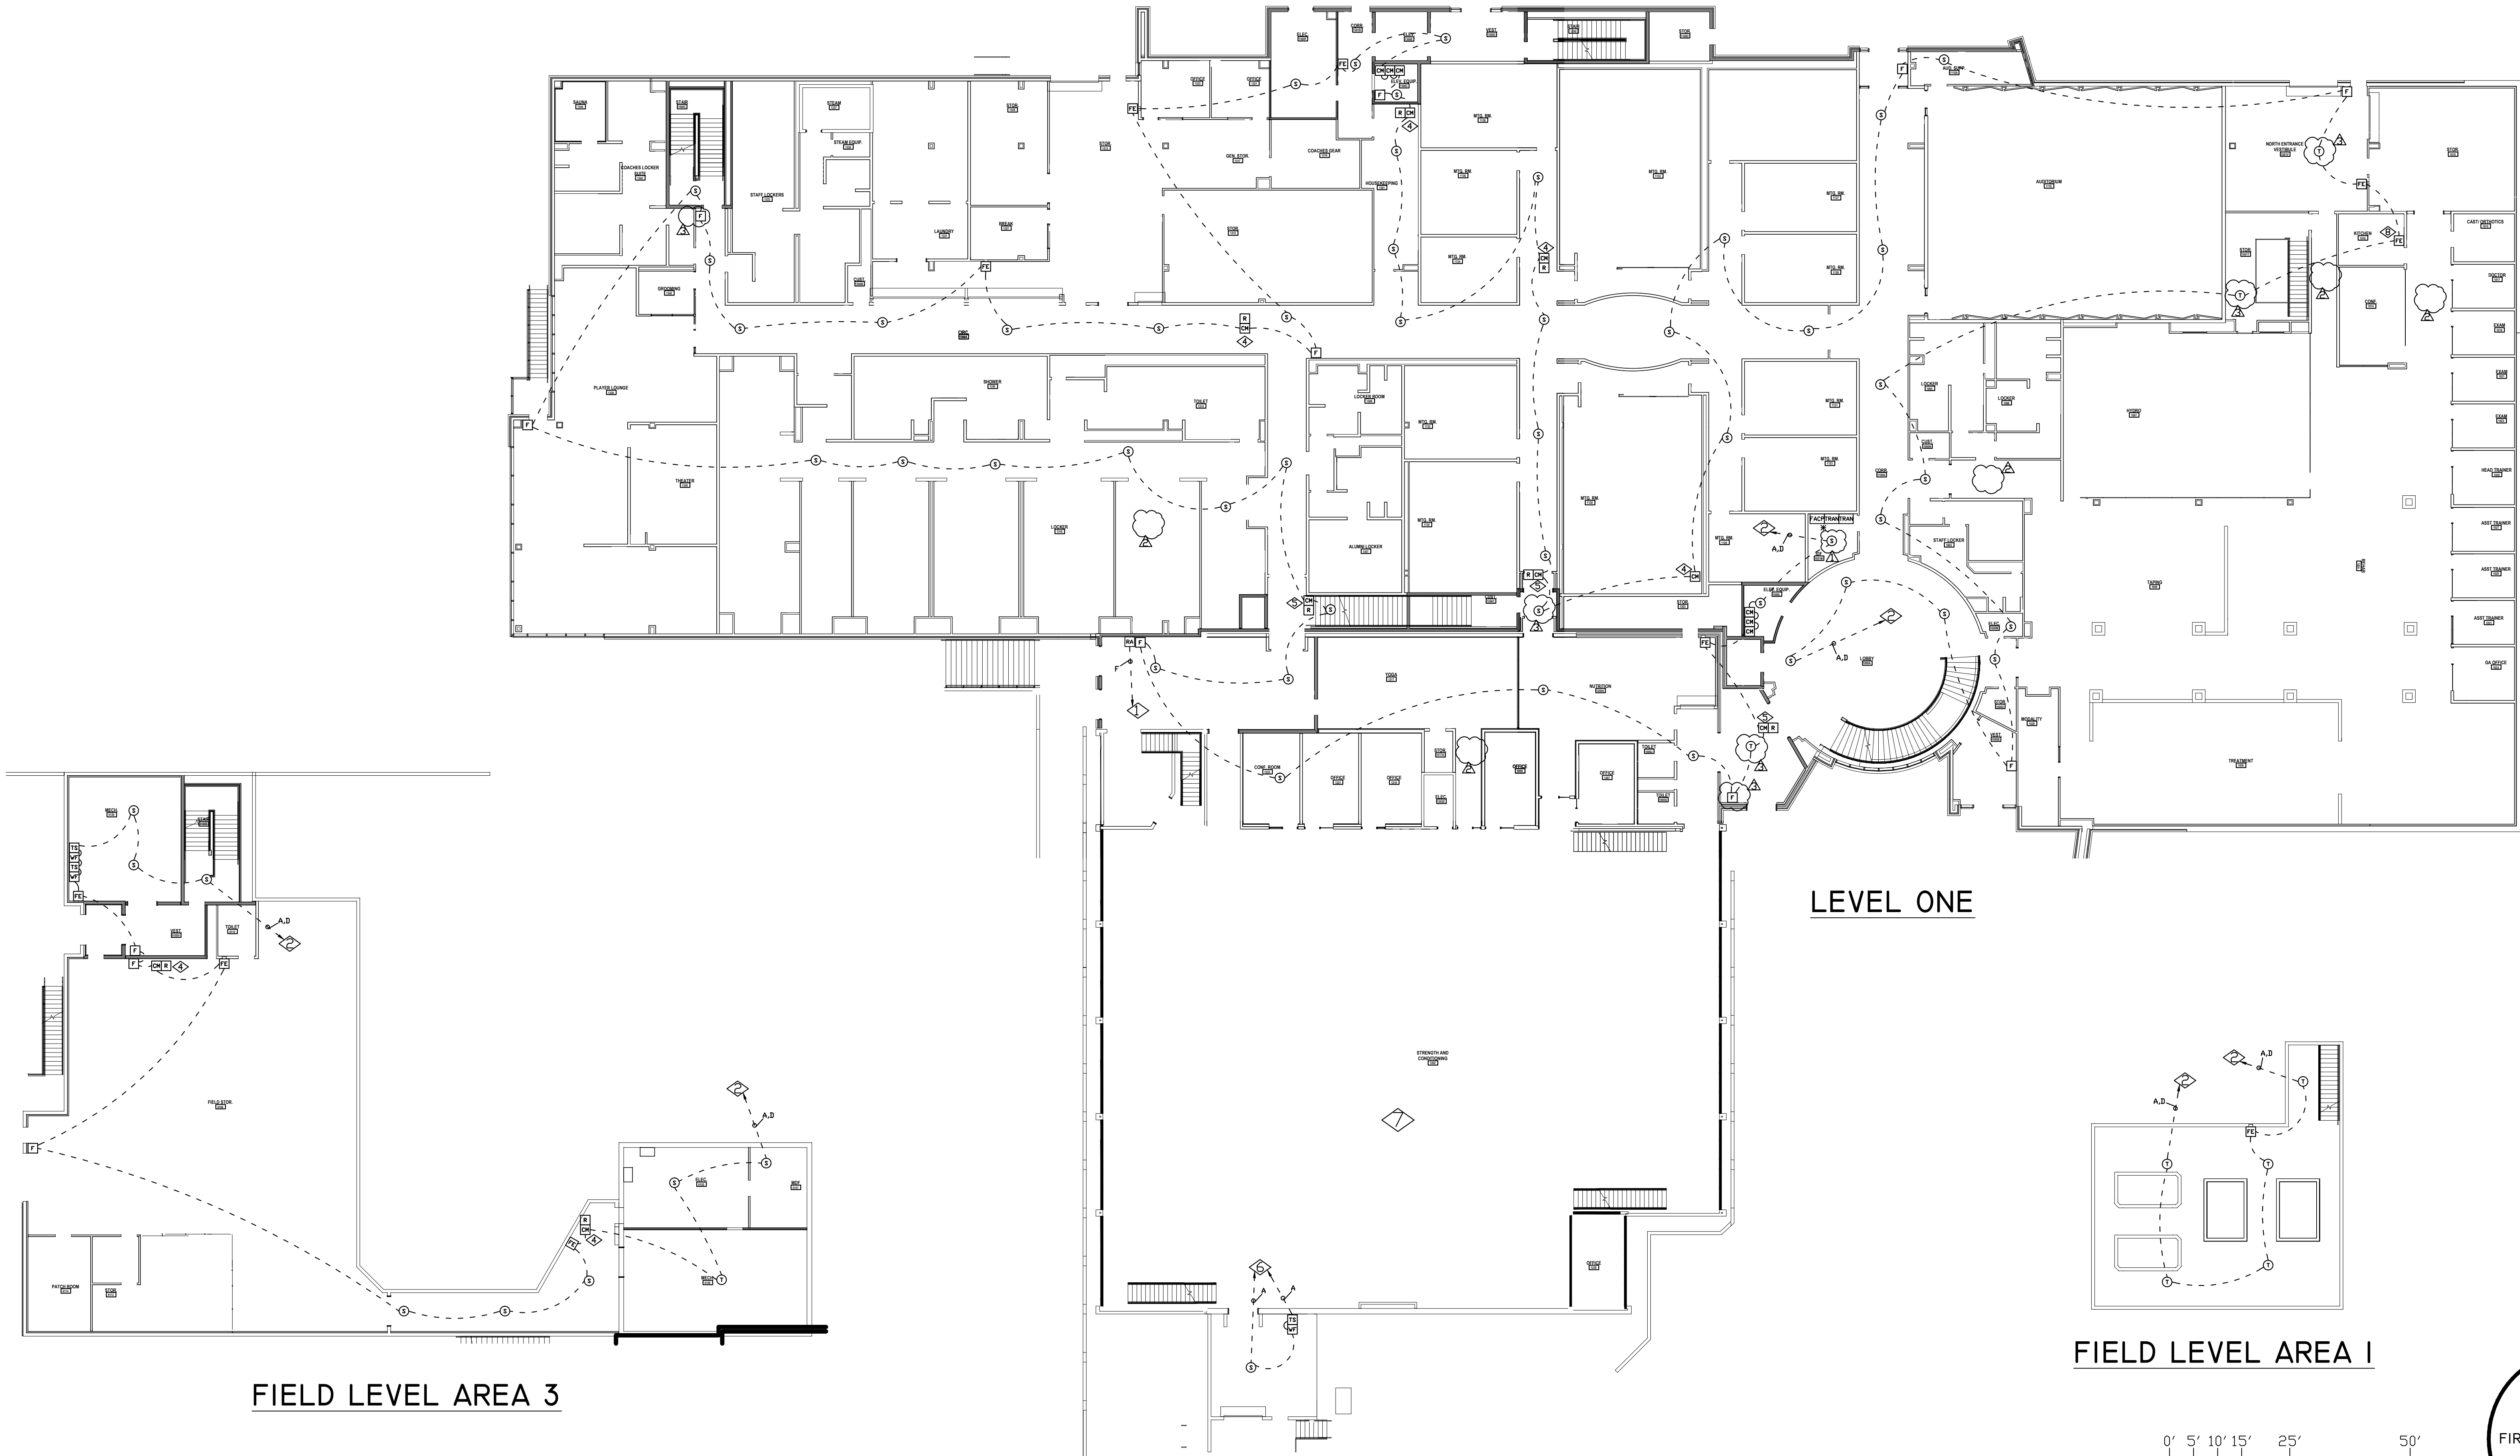

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

REVISION NOTES:
△ ADDED TO MEET CODE (7/29/12)
△ OMITTED PER RICHARD WHITE (2/13/13)
△ REVISED PER RICHARD WHITE (2/13/13)

SYSTEM NOTES:
◇ TO MAIN FACP
◇ TO LEVEL ONE TRANSPONDER IN IDF 1001M
◇ TIE TO EXISTING HORN/STROBE CIRCUIT
◇ FOR FIRE/SMOKE DAMPERS
◇ FOR DOORHOLDERS
◇ TIE TO NEAREST EXISTING ADDRESSABLE DEVICE
◇ REPLACE EXISTING SMOKE DETECTORS IN THE 2-STORY SECTION OF STRENGTH AND CONDITIONING
◇ TYPE K EXTINGUISHER

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	RELAY CIRCUIT	2 #14'S
D	24 VDC AUX POWER	2 #14'S
E	120 VAC W/GROUND	3 #12'S
F	REMOTE ANNUNCIATOR	3 PAIR #16'S TWISTED

* -REFER TO RISER FA-R-01 FOR INTERCONNECT DETAILS

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	HEAT DETECTOR
□	MANUAL PULL STATION
□	DUCT DETECTOR
□	WATERFLOW SWITCH
□	TAMPER SWITCH
□	HORN/STROBE
□	CEILING HORN/STROBE
□	WEATHERPROOF HORN/STROBE
□	STROBE ONLY
□	CEILING STROBE ONLY
□	MONITOR MODULE
□	CONTROL MODULE
□	RELAY
□	ENGAGE FIRE EXTINGUISHER
□	REMOTE ANNUNCIATOR
□	FIRE ALARM CONTROL PANEL
□	TRANSPONDER PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, SMOKE DETECTORS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS USE ONLY THE WIRE SCHEDULE AND DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL ONE & FIELD LEVEL
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 2/14/13
SCALE: (ARCH E1) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:


FOOTBALL CENTER I.DWG

FIRE ALARM SYSTEM


LEVEL ONE
NOTIFICATION

PAGE:

FA-I-02

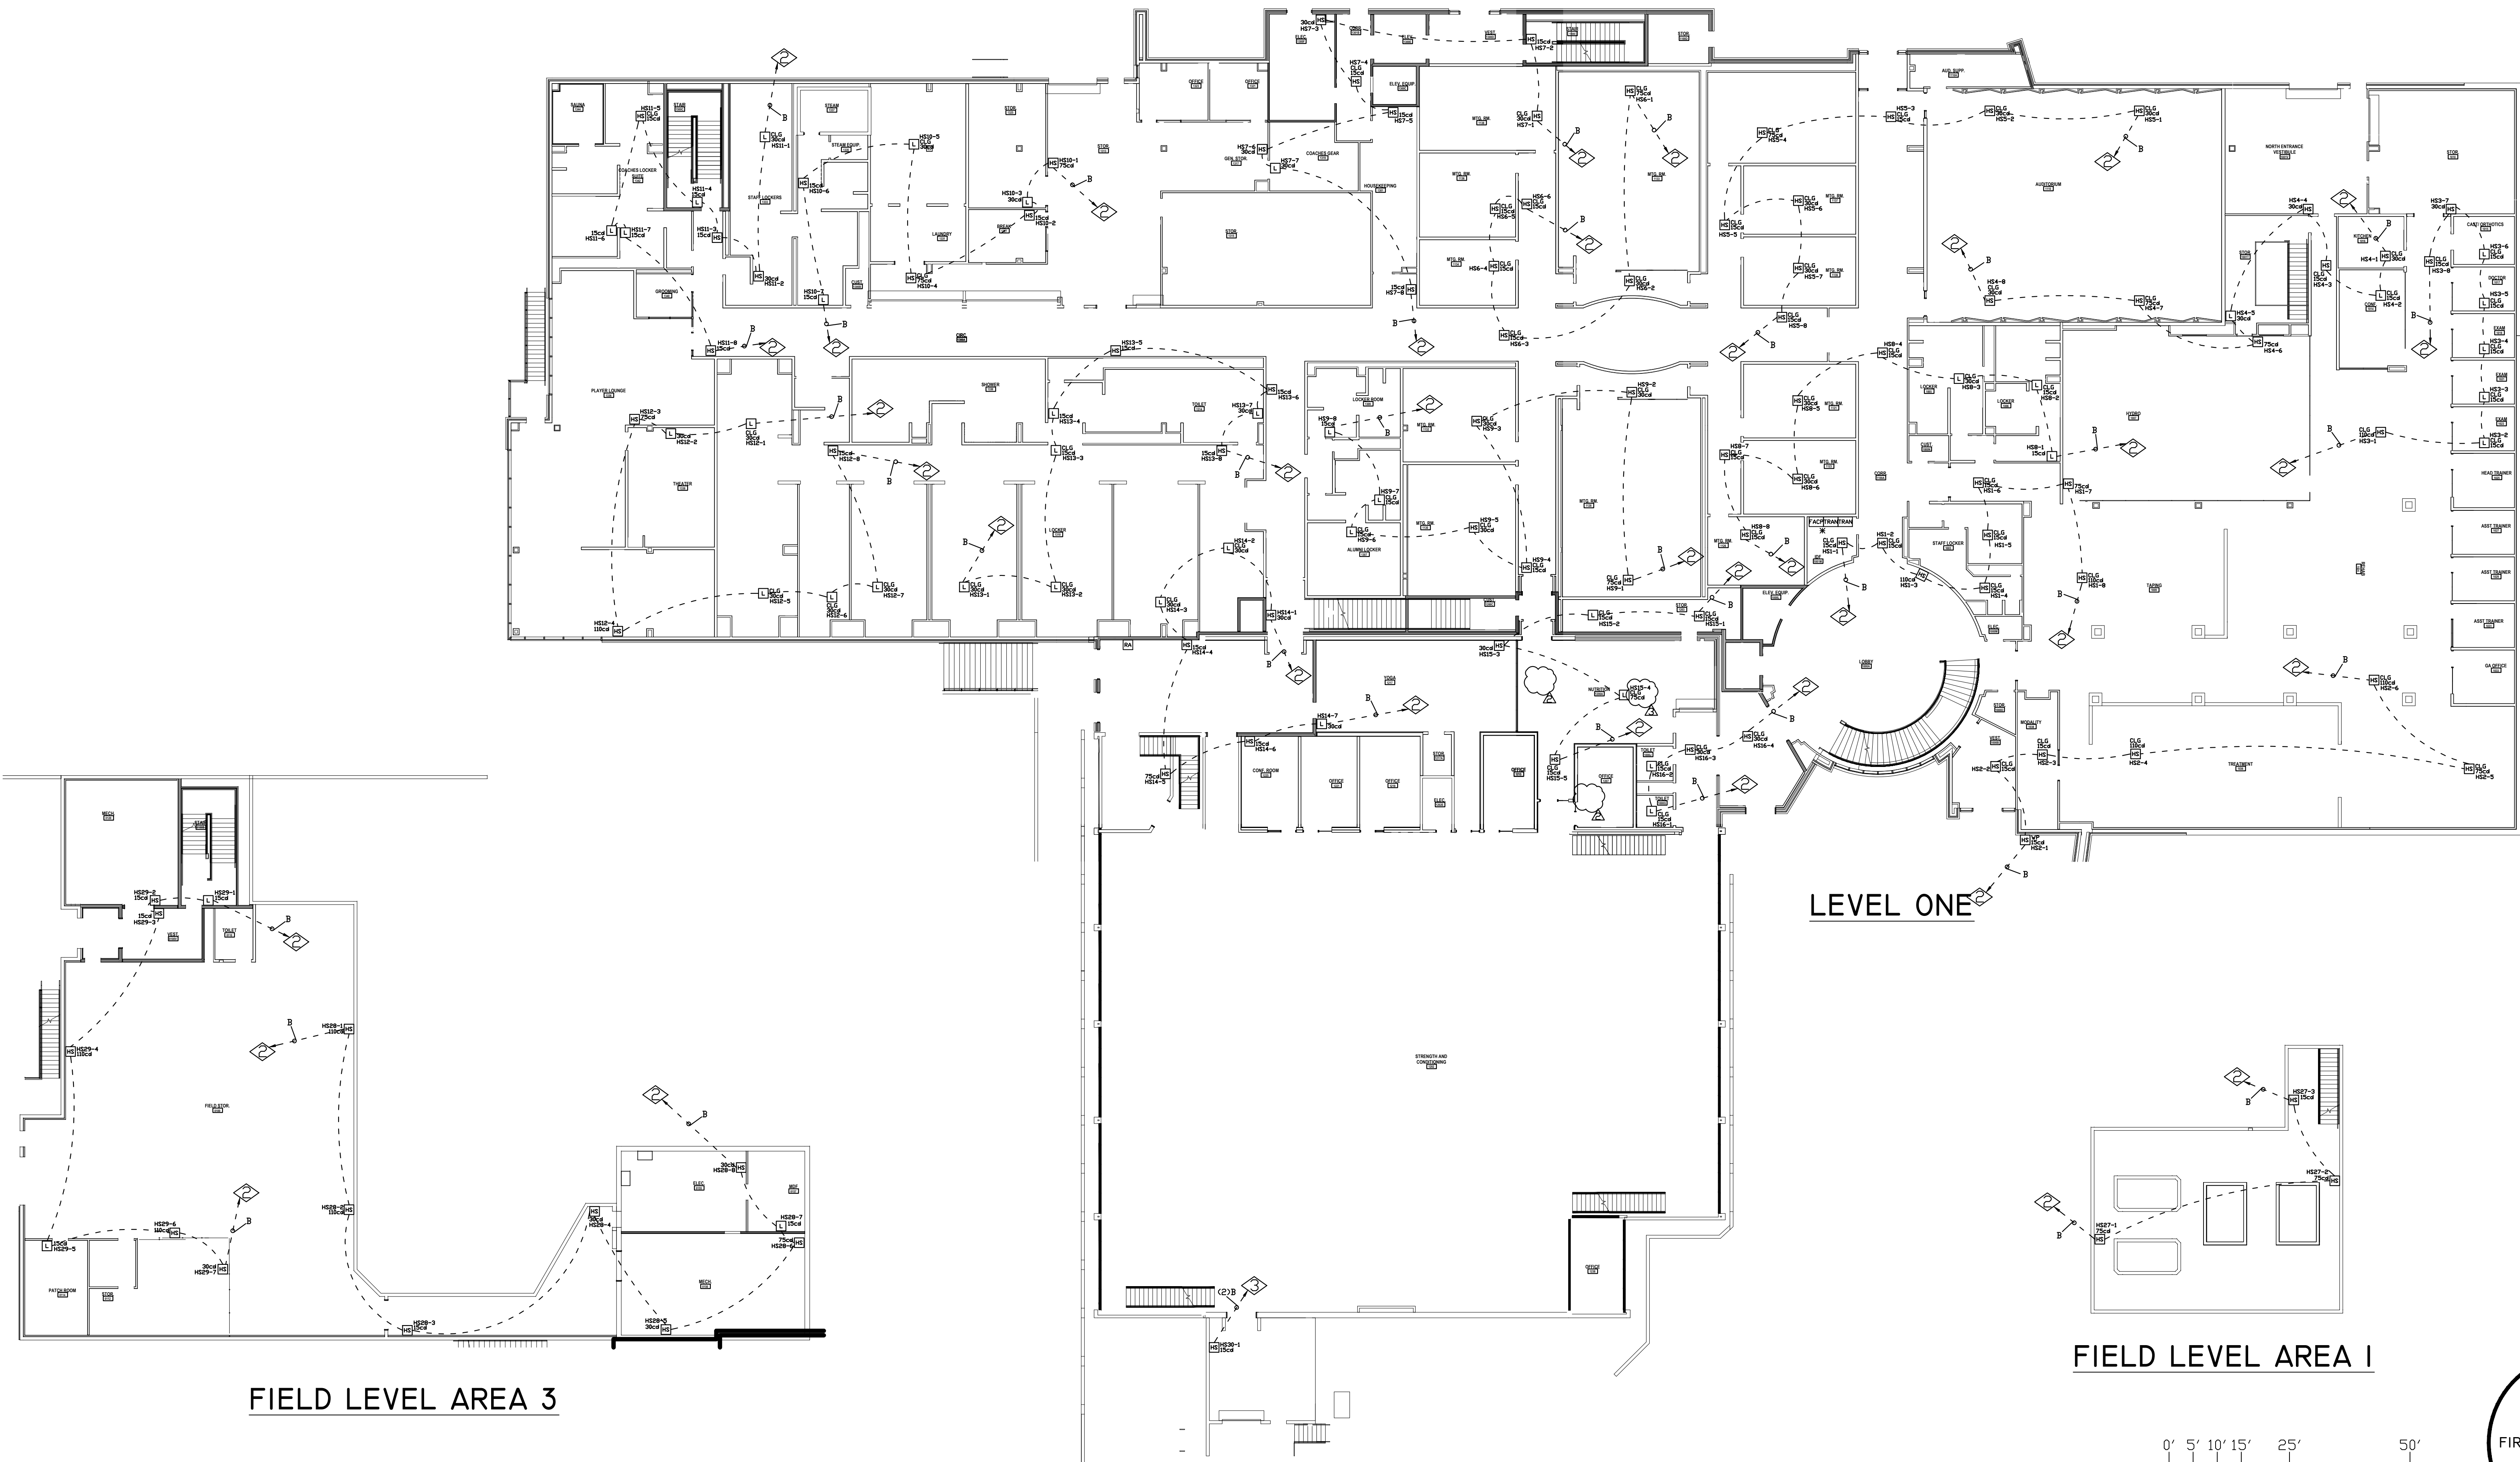

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

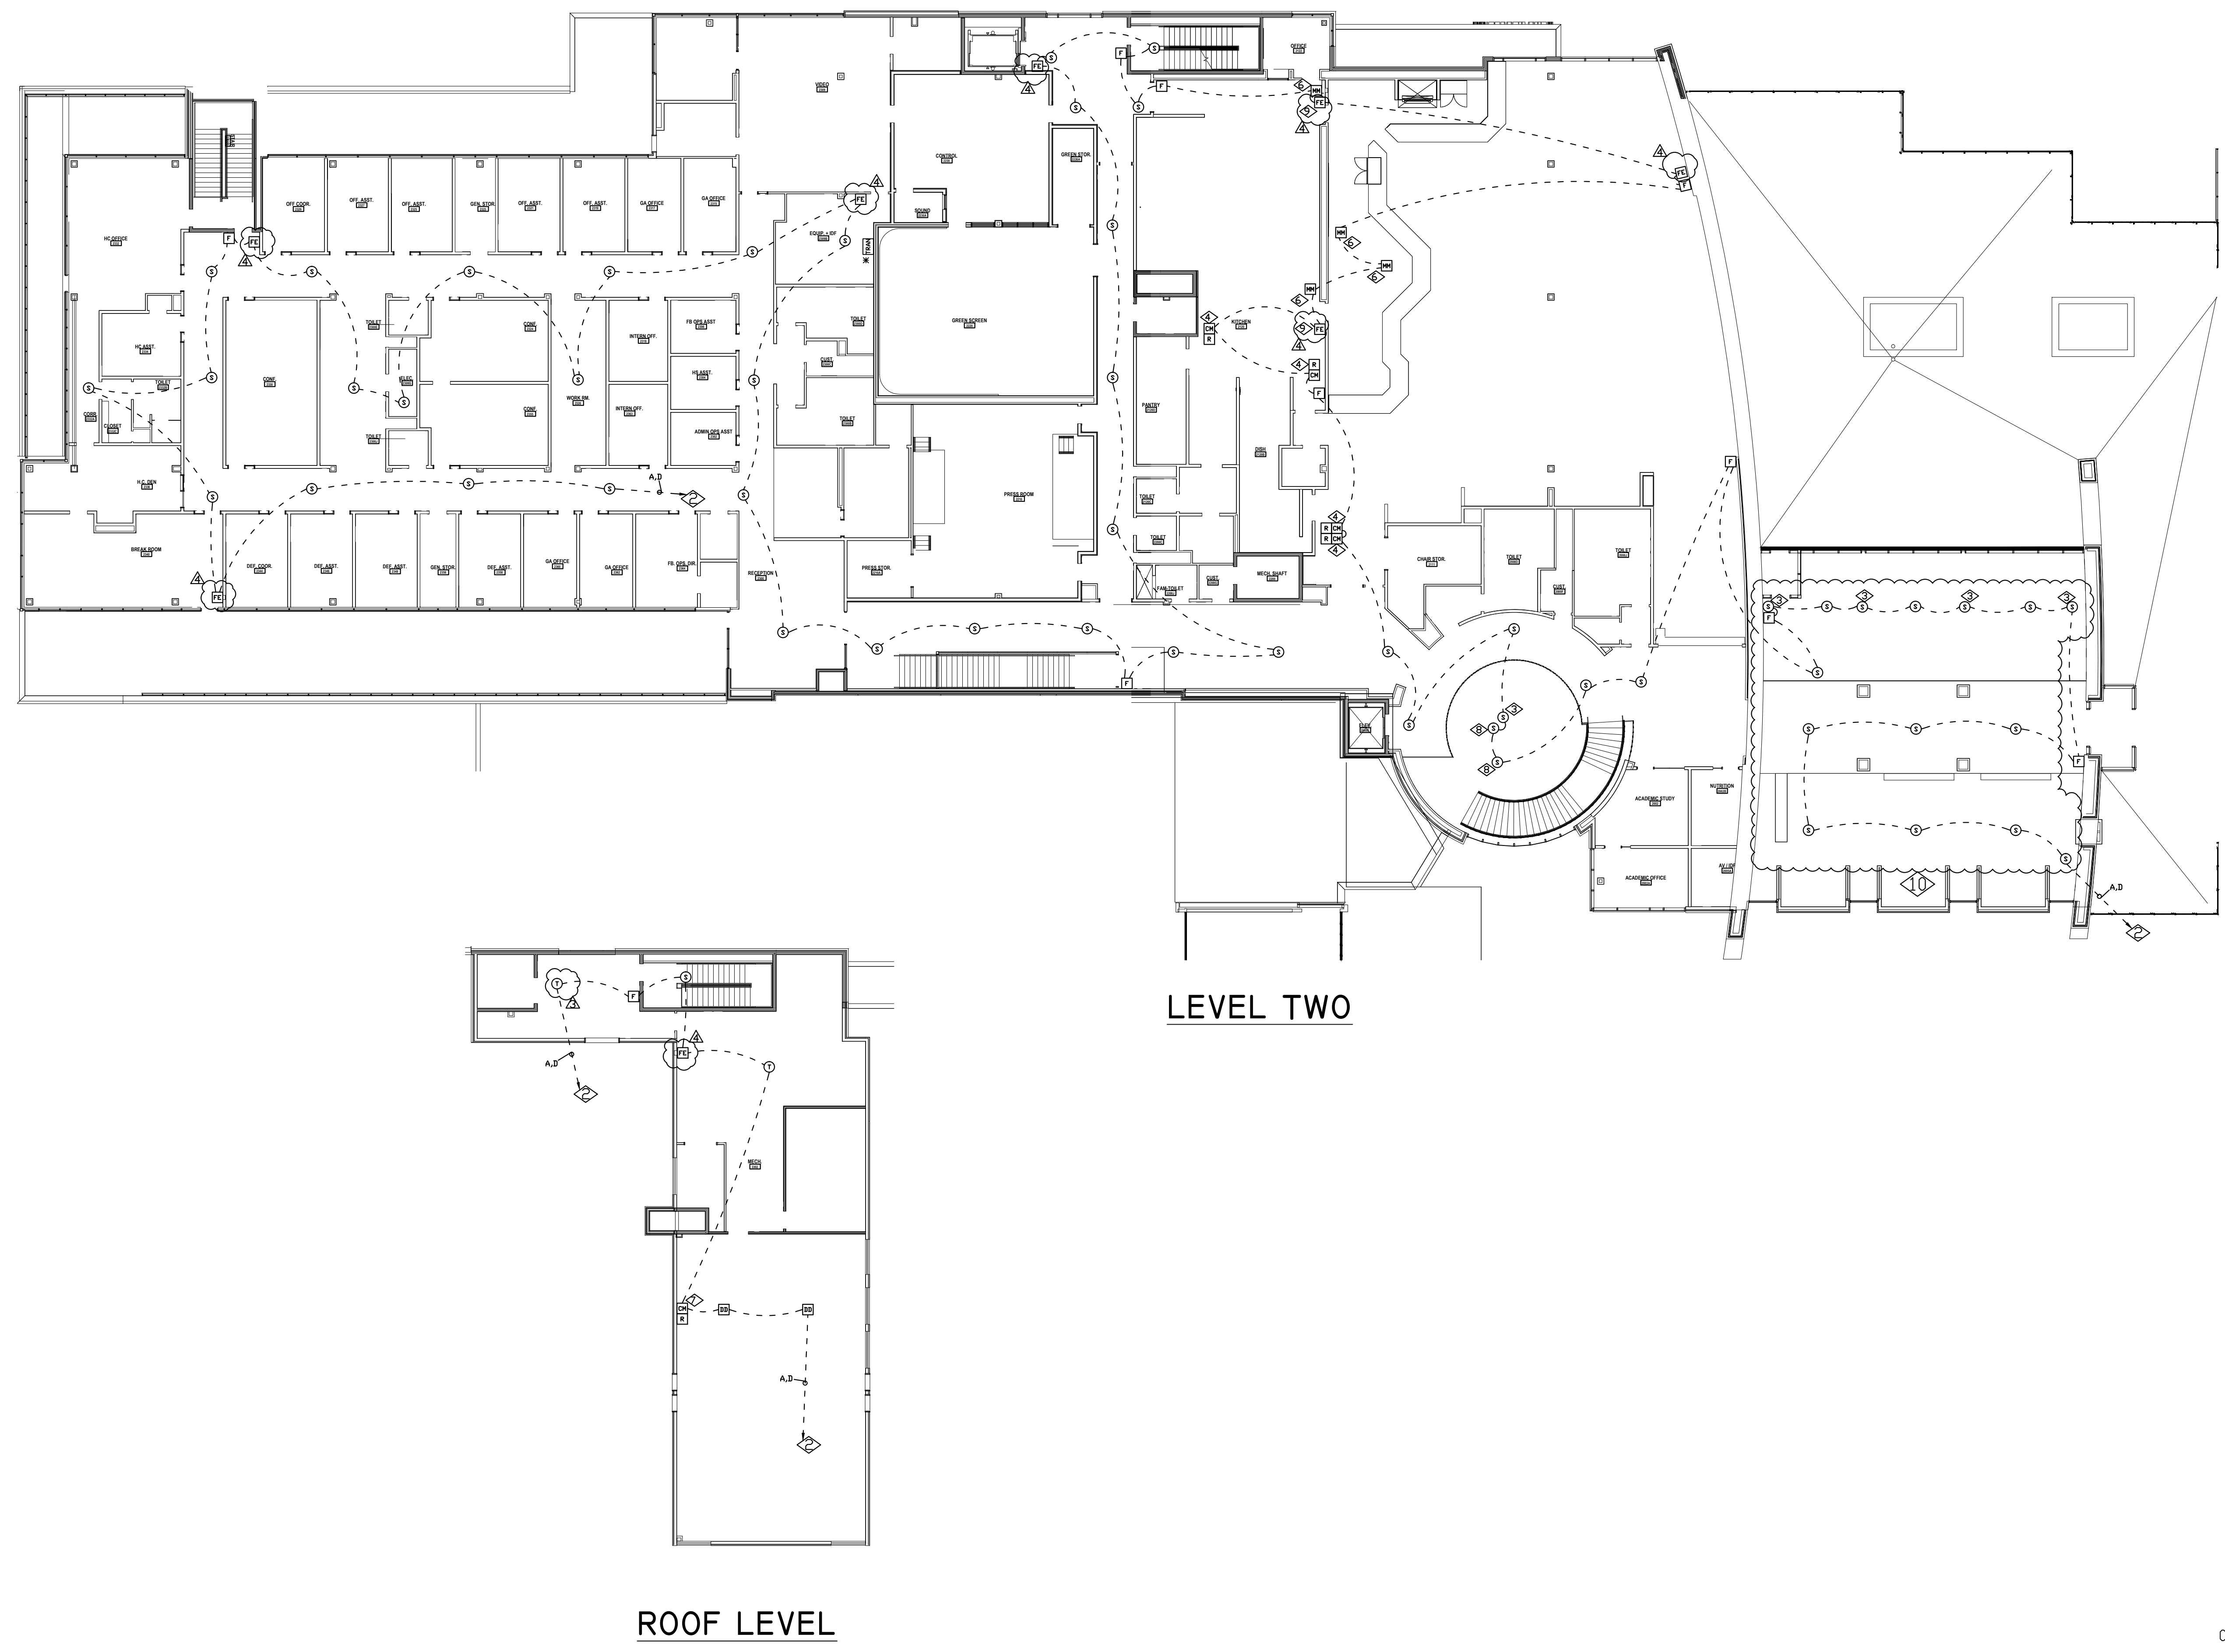

- REVISION NOTES:
- △ ADDED TO MEET CODE (7/29/12)
 - △ OMITTED PER RICHARD WHITE (2/13/13)
 - △ REVISED PER RICHARD WHITE (2/13/13)
 - △ ADDED EN-GAUGE EQUIPPED FIRE EXTINGUISHERS (2/13/13)

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	RELAY CIRCUIT	2 #14'S
D	24 VDC AUX POWER	2 #14'S
E	120 VAC W/GROUND	3 #12'S

* =REFER TO RISER FA-R-01 FOR INTERCONNECT DETAILS

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	HEAT DETECTOR
⊠	MANUAL PULL STATION
⊠	DUCT DETECTOR
⊠	WATERFLOW SWITCH
⊠	TAMPER SWITCH
⊠	HORN/STROBE
⊠	CEILING HORN/STROBE
⊠	WEATHERPROOF HORN/STROBE
⊠	STROBE ONLY
⊠	CEILING STROBE ONLY
⊠	MONITOR MODULE
⊠	CONTROL MODULE
⊠	RELAY
⊠	DOORHOLDER
⊠	ENGAGE FIRE EXTINGUISHER
⊠	REMOTE ANNUNCIATOR
⊠	FIRE ALARM CONTROL PANEL
⊠	TRANSPONDER PANEL

- SYSTEM NOTES:
- ◇ TO MAIN FACP
 - ◇ TO LEVEL TWO TRANSPONDER IN EQUIP+IDF 2309B
 - ◇ LOCATED IN SKYLIGHT. CONFIRM PLACEMENT AT ROUGH IN
 - ◇ FOR FIRE/SMOKE DAMPERS
 - ◇ FOR DOORHOLDERS
 - ◇ FOR KITCHEN ANSUL SYSTEM
 - ◇ TO FAN SHUTDOWN
 - ◇ CONFIRM PLACEMENT AT ROUGH IN
 - ◇ TYPE K EXTINGUISHER
 - ◇ CONFIRM SMOKE DETECTION SPACING AND PLACEMENT AGAINST REFLECTED CEILING PLAN.

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, DETECTORS, AND DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS USE THE WIRING AND INTERCONNECT DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL TWO & ROOF
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: JJC
DESIGNED BY: XXXX
CHECKED BY: DPS
DATE: 2/14/13
SCALE: (ARCH EI) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
FOOTBALL CENTER 2.DWG

FIRE ALARM SYSTEM
LEVEL TWO
ADDRESSABLE

PAGE:
FA-2-01

N.I.C.E.T.
LEVEL IV
CERTIFICATION
DONNY SCHULTZ
#104396

0' 5' 10' 15' 25' 50'
SCALE

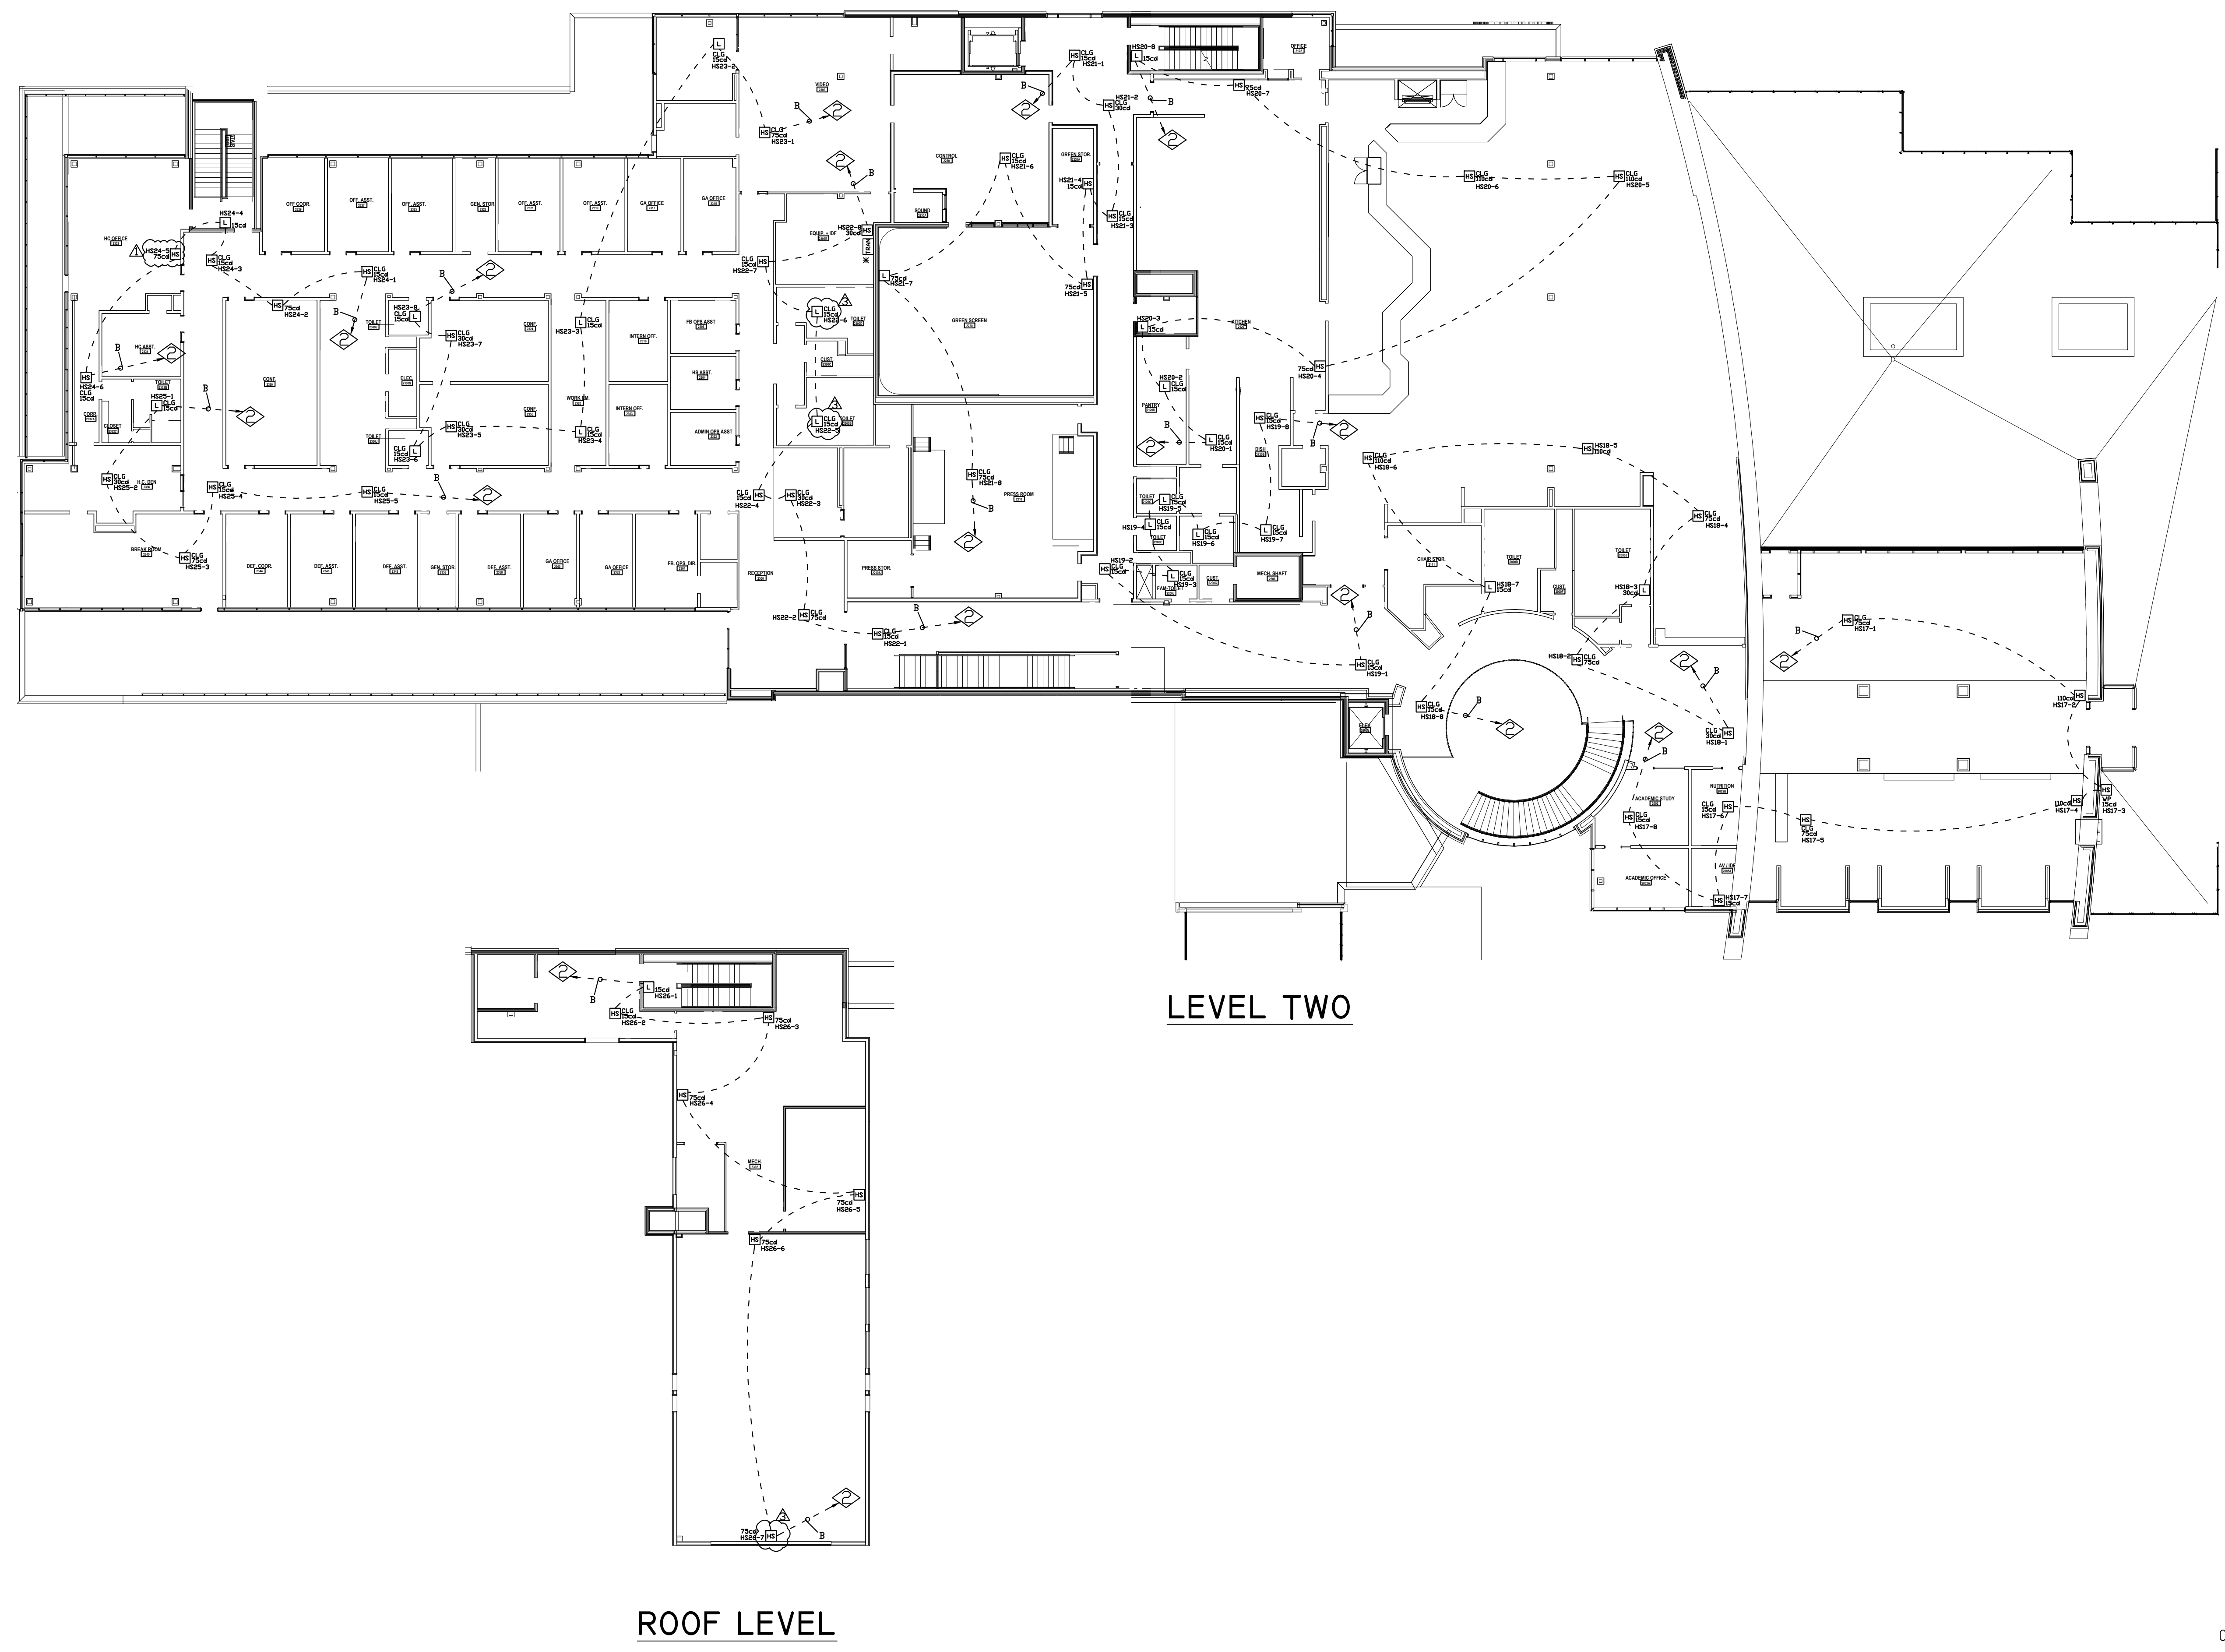


REVISION NOTES:
△ ADDED TO MEET CODE (7/29/12)
△ OMITTED PER RICHARD WHITE (2/13/13)
△ REVISED PER RICHARD WHITE (2/13/13)
△ ADDED EN-GAUGE EQUIPPED
FIRE EXTINGUISHERS (2/13/13)

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	RELAY CIRCUIT	2 #14'S
D	24 VDC AUX POWER	2 #14'S
E	120 VAC W/GROUND	3 #12'S

* =REFER TO RISER FA-R-01 FOR INTERCONNECT DETAILS

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	HEAT DETECTOR
⊞	MANUAL PULL STATION
⊞	DUCT DETECTOR
⊞	WATERFLOW SWITCH
⊞	TAMPER SWITCH
⊞	HORN/STROBE
⊞	CEILING HORN/STROBE
⊞	WEATHERPROOF HORN/STROBE
⊞	STROBE ONLY
⊞	CEILING STROBE ONLY
⊞	MONITOR MODULE
⊞	CONTROL MODULE
⊞	RELAY
⊞	DOORHOLDER
⊞	ENGAGE FIRE EXTINGUISHER
⊞	REMOTE ANNUNCIATOR
⊞	FIRE ALARM CONTROL PANEL
⊞	TRANSPONDER PANEL

- SYSTEM NOTES:
- ◇ TO MAIN FACP
 - ◇ TO LEVEL TWO TRANSPONDER IN EQUIP+IDF 2309B
 - ◇ LOCATED IN SKYLIGHT. CONFIRM PLACEMENT AT ROUGH IN
 - ◇ FOR FIRE/SMOKE DAMPERS
 - ◇ FOR DOORHOLDERS
 - ◇ FOR KITCHEN ANSUL SYSTEM
 - ◇ TO FAN SHUTDOWN
 - ◇ CONFIRM PLACEMENT AT ROUGH IN
 - ◇ TYPE K EXTINGUISHER
 - ◇ CONFIRM SMOKE DETECTION SPACING AND PLACEMENT AGAINST REFLECTED CEILING PLAN.

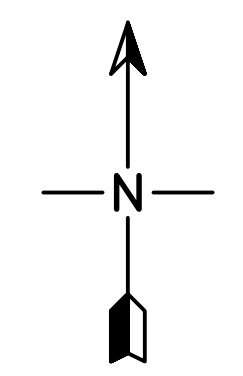

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, DEVICES, AND SYSTEMS SHOWN ON THE A/E PLANS. NFS DRAWINGS USE THE WIRING AND INTERCONNECT DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
THE FOOTBALL CENTER
LEVEL TWO & ROOF
800 WEST UNIVERSITY PARKWAY
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
CHECKED BY:	DPS
DATE:	2/14/13
SCALE:	(ARCH EI) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	FOOTBALL CENTER 2.DWG

FIRE ALARM SYSTEM
LEVEL TWO
NOTIFICATION

PAGE:
FA-2-02

N.I.C.E.T.
LEVEL IV
CERTIFICATION
DONNY SCHULTZ
#104396

