



MEZZANINE

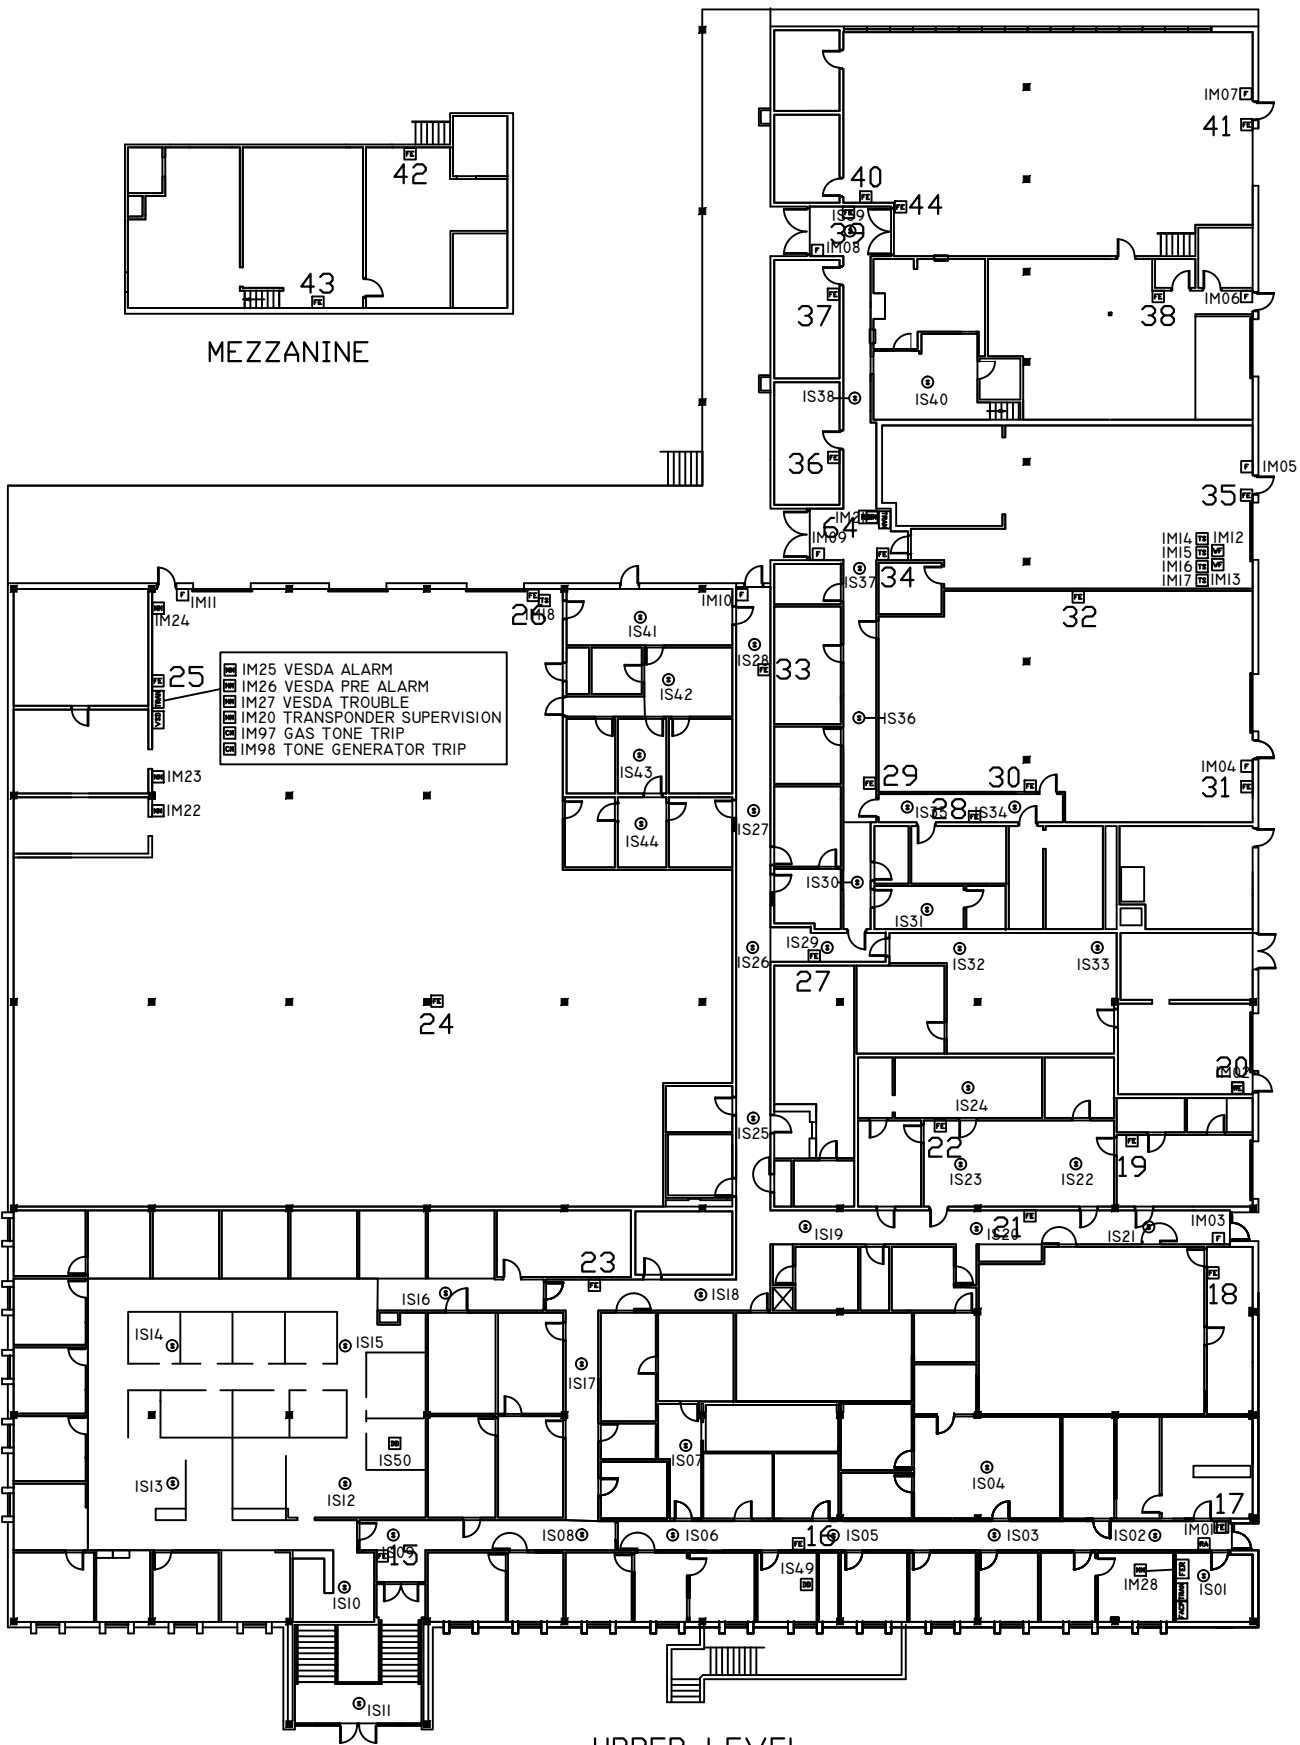


UPPER LEVEL

ADDRESS LABEL CLARIFICATION
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊞	MANUAL PULL STATION
⊞	DUCT SMOKE DETECTOR
⊞	WATERFLOW SWITCH MONITOR MODULE
⊞	TAMPER SWITCH MONITOR MODULE
⊞	MONITOR MODULE
⊞	CONTROL MODULE
⊞	FIRE EXTINGUISHER WITH EN-GAUGE
⊞	FIRE EXTINGUISHER RECEIVER
⊞	REMOTE ANNUNCIATOR
⊞	FIRE ALARM CONTROL PANEL
⊞	TRANSPONDER PANEL
⊞	VESDA PANEL
⊞	FIRE EXTINGUISHER REPEATER

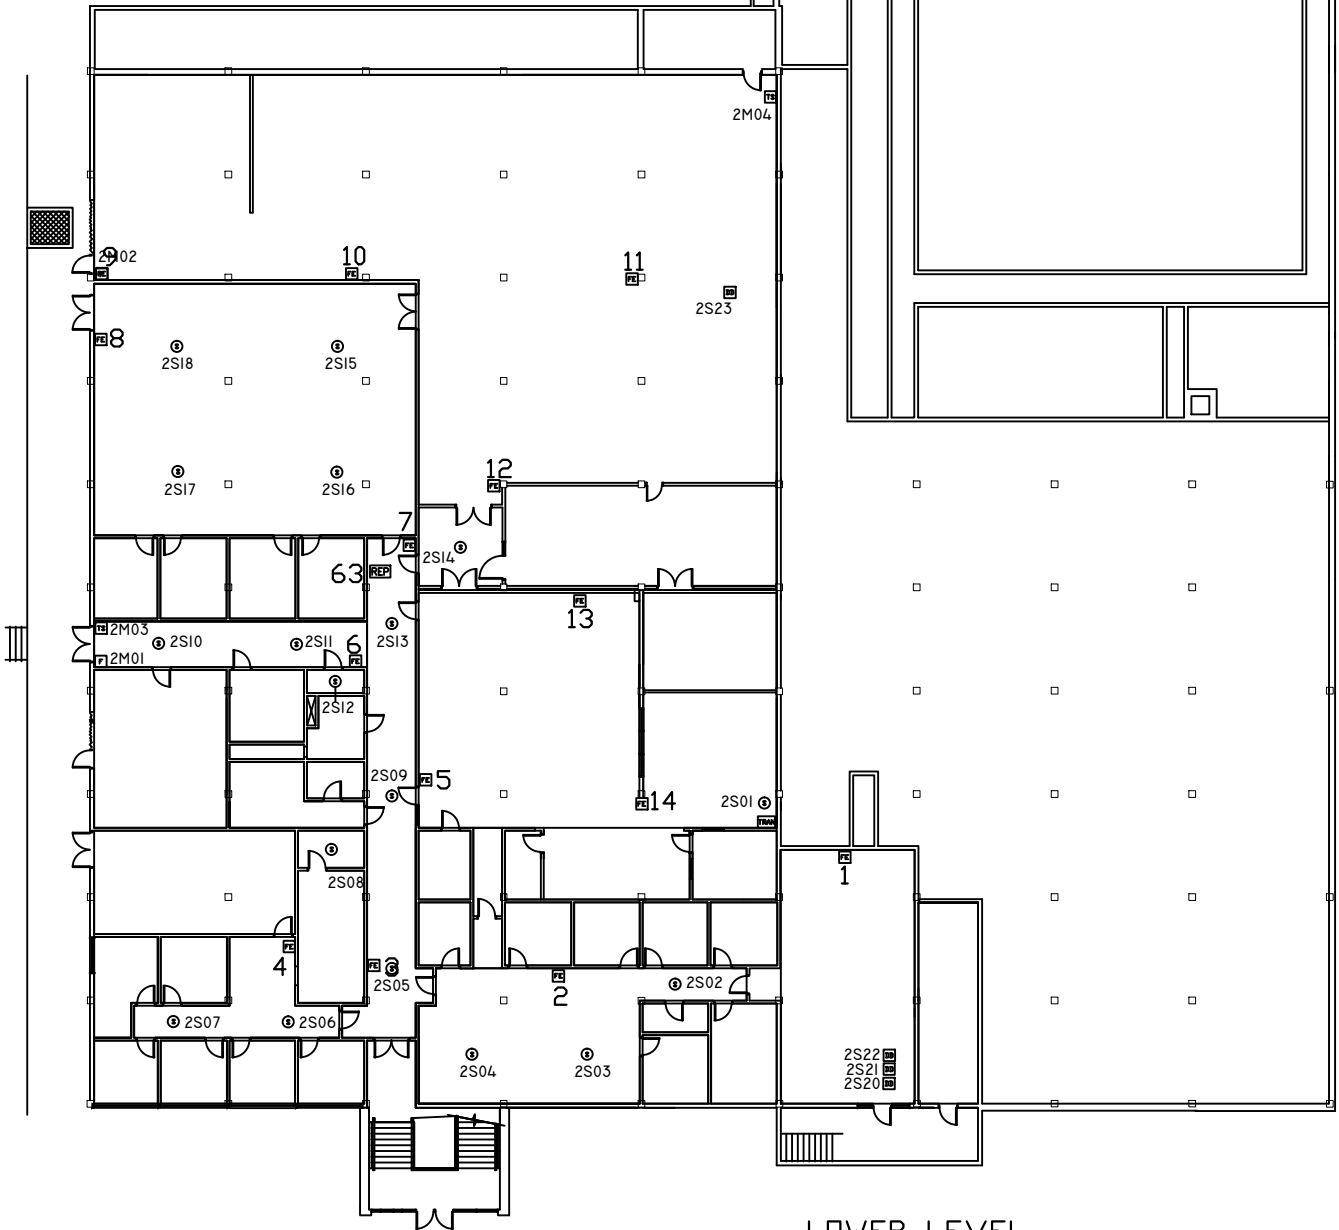

LOWER LEVEL



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

V. RANDALL TURPIN
UNIVERSITY SERVICES BUILDING
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	6/5/2007
SCALE:	N.T.S.
PROJECT NO:	0350-12690
REV NO:	I
DRAWING NAME:	BLDG350UPPERLOWER.DWG

FIRE ALARM SYSTEM
FIRE EXTINGUISHERS

NFS