
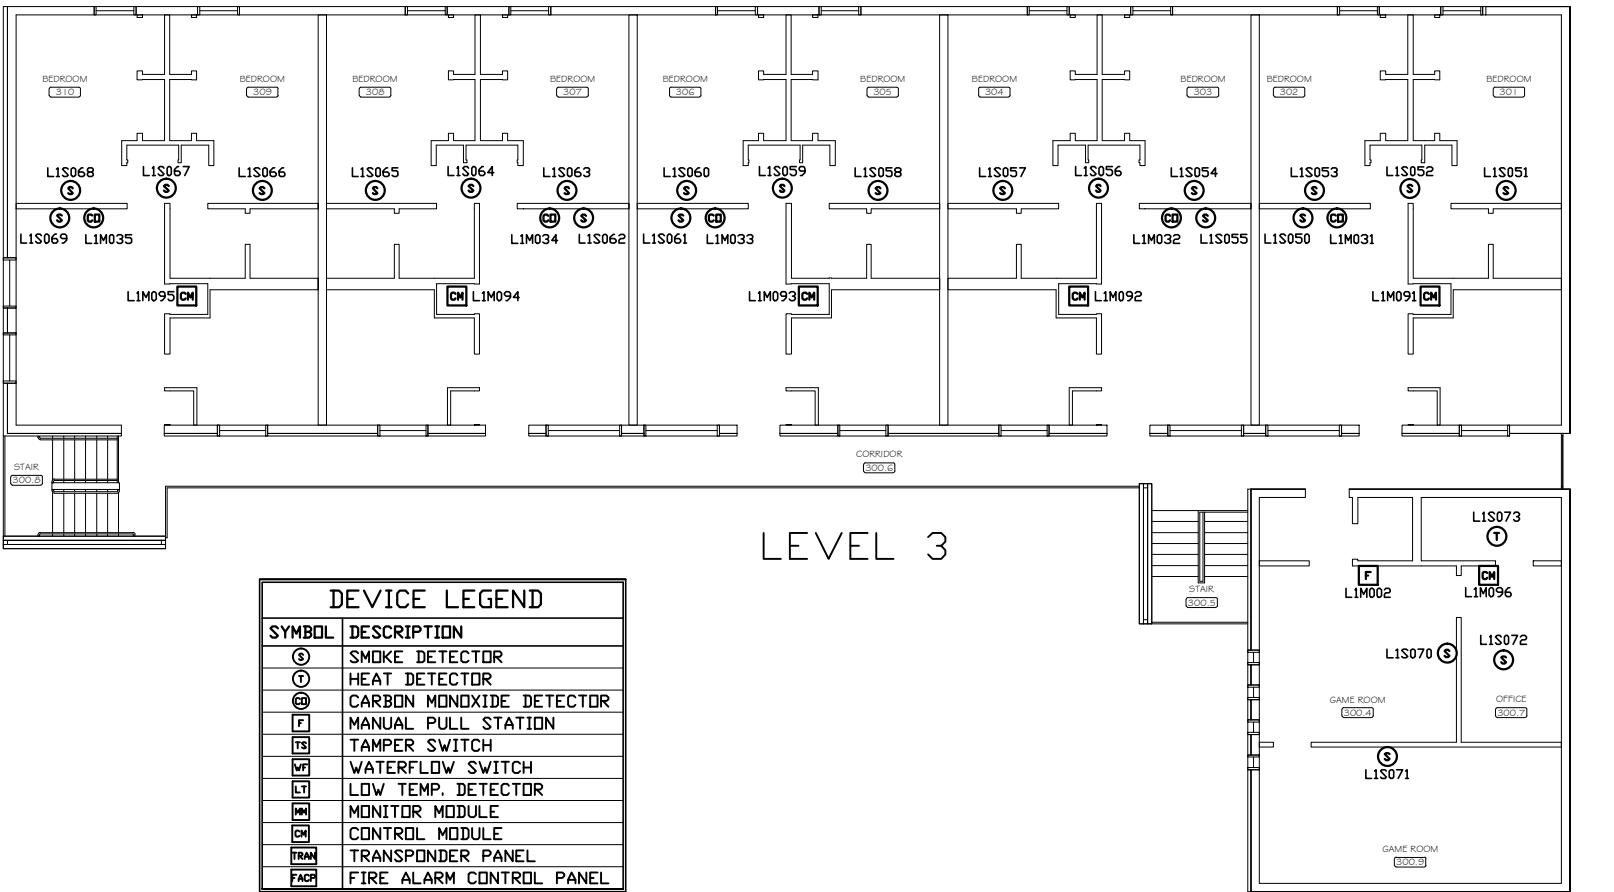
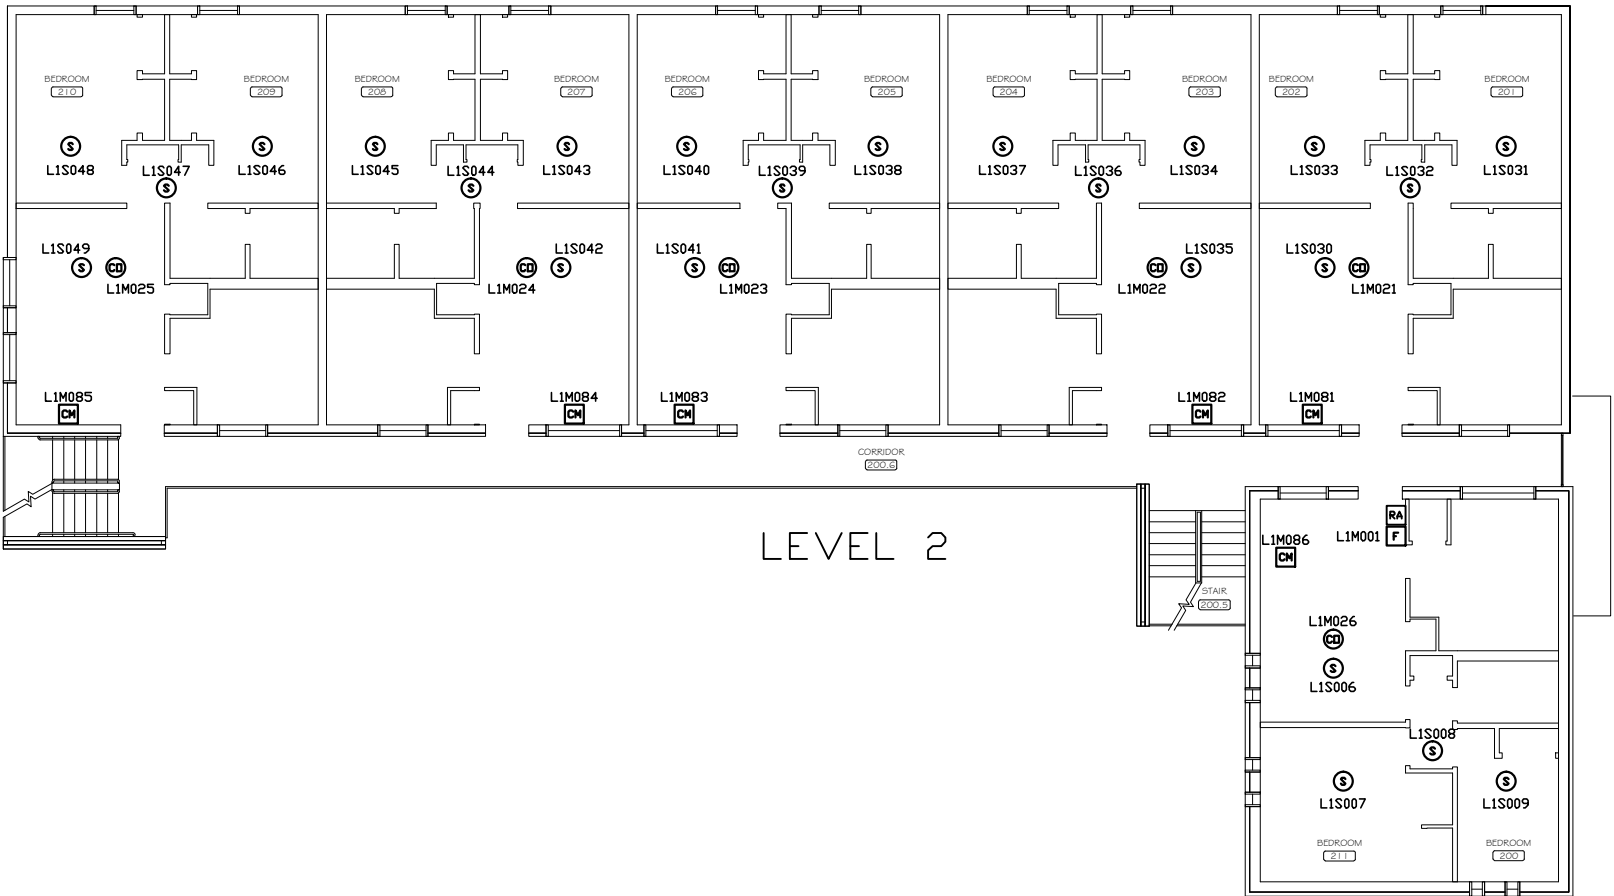


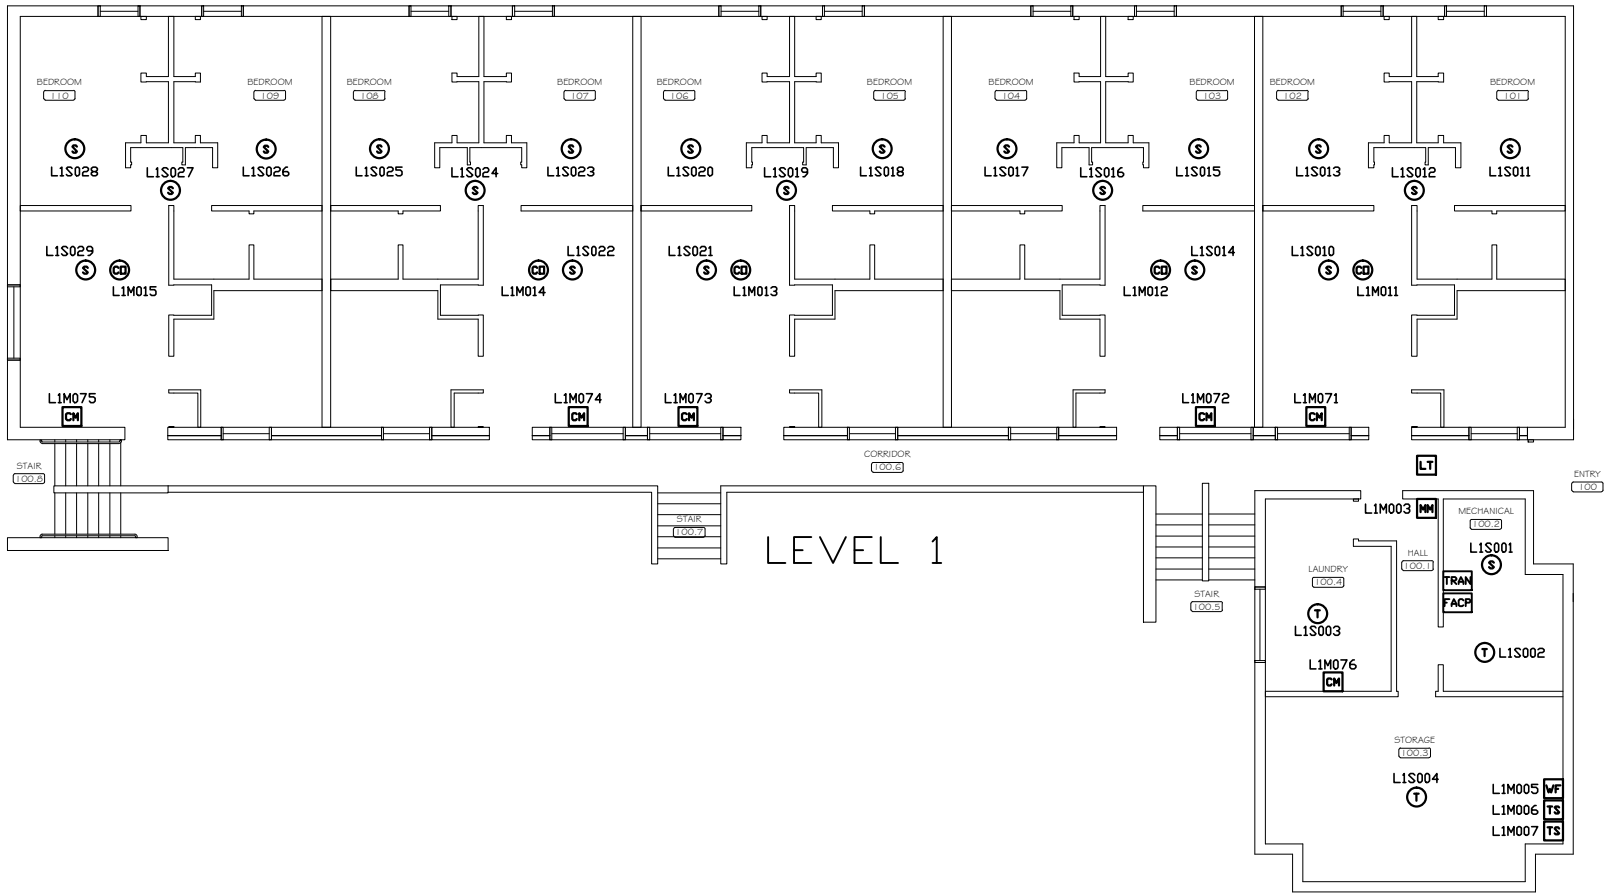

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T)	HEAT DETECTOR
(CD)	CARBON MONOXIDE DETECTOR
(F)	MANUAL PULL STATION
(TS)	TAMPER SWITCH
(WF)	WATERFLOW SWITCH
(LT)	LOW TEMP. DETECTOR
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(TRAN)	TRANSPONDER PANEL
(FACP)	FIRE ALARM CONTROL PANEL

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

PAGE:
FA-1

FINAL MAP

FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

UNIVERSITY OF UTAH
DOWNTOWN COMMONS
43 SOUTH 400 EAST
SALT LAKE CITY, UTAH 84111
FIRE ALARM SYSTEM

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

