


SYSTEM NOTES:
◇ TO MCPC TRANSPONDER ON LEVEL P1
◇ TO UUPC TRANSPONDER ON LEVEL P1
◇ 120 VAC WITH GROUND

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S

* SEE RISER FOR INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
CM	CONTROL MODULE
FE	MIJA W/MONITOR MODULE
SS	SPEAKER/STROBE
SS CLG	CEILING MOUNT SPEAKER/STROBE
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL

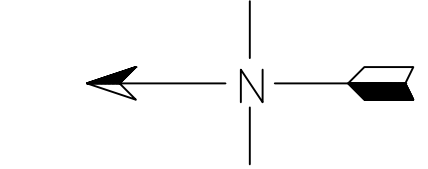

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
NFS ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
AMBULATORY CARE PARKING STRUCTURE
LEVEL P1
MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84113
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: AK
DESIGNED BY: SPECTRUM
APPROVED BY: DPS
DATE: 11/20/12
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
PARKING PI.DWG

FIRE ALARM SYSTEM
LEVEL P1
NOT FOR CONSTRUCTION

PAGE:
FA-PI-08

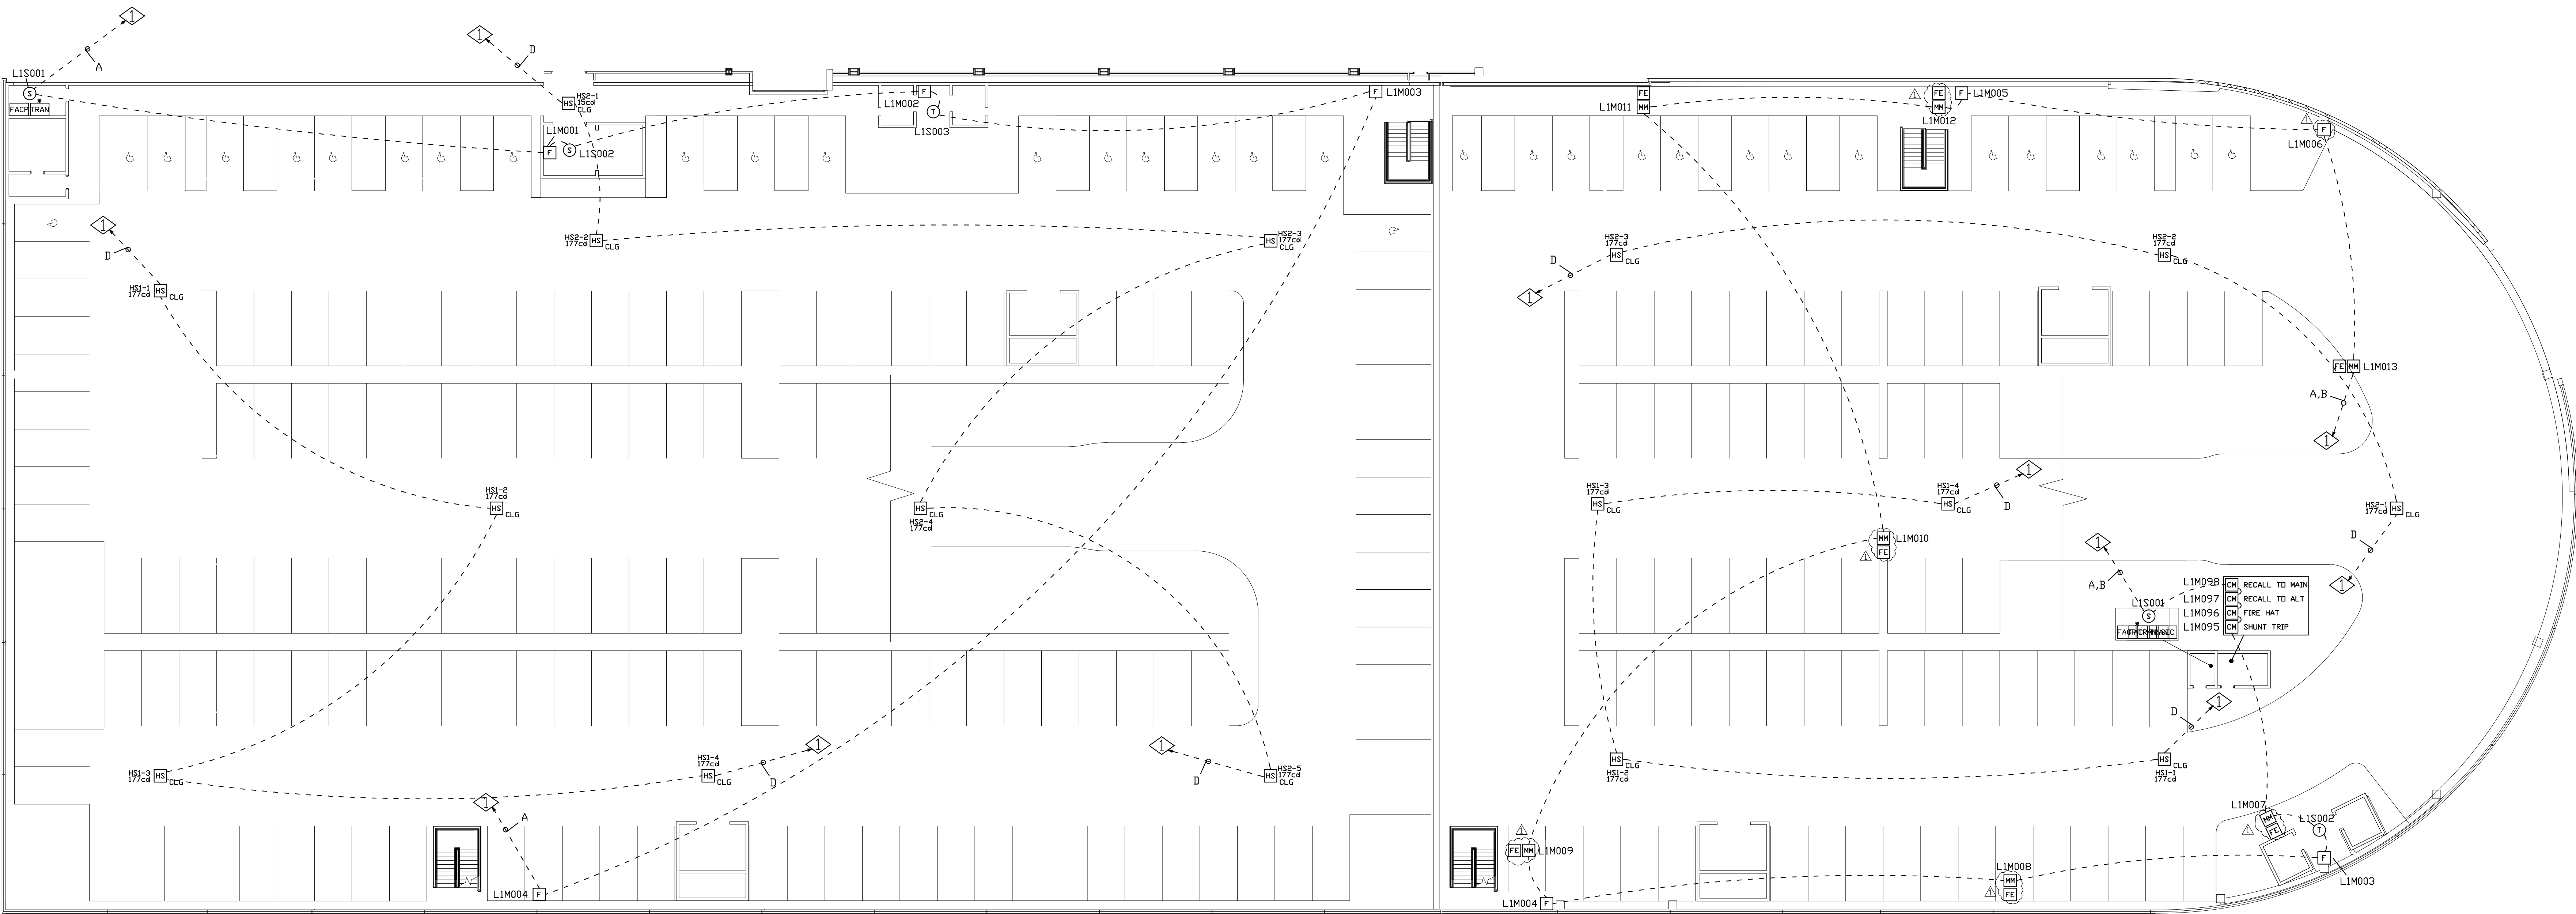

0' 5' 10' 15' 25' 50'
SCALE



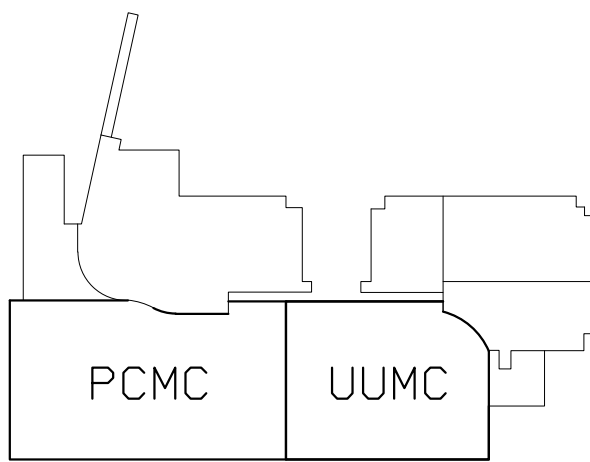


N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396


- ① TO MCPC TRANSPONDER ON LEVEL P1
- ② TO UUPC TRANSPONDER ON LEVEL P1
- ③ 120 VAC WITH GROUND

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T)	HEAT DETECTOR
[F]	MANUAL PULL STATION
[TS]	TAMPER SWITCH
[WF]	WATERFLOW SWITCH
[CM]	CONTROL MODULE
[FE]	MIJA W/MONITOR MODULE
[SS]	SPEAKER/STROBE
[SS] _{CLG}	CEILING MOUNT SPEAKER/STROBE
[TRAN]	TRANSPONDER PANEL
[FACP]	FIRE ALARM CONTROL PANEL

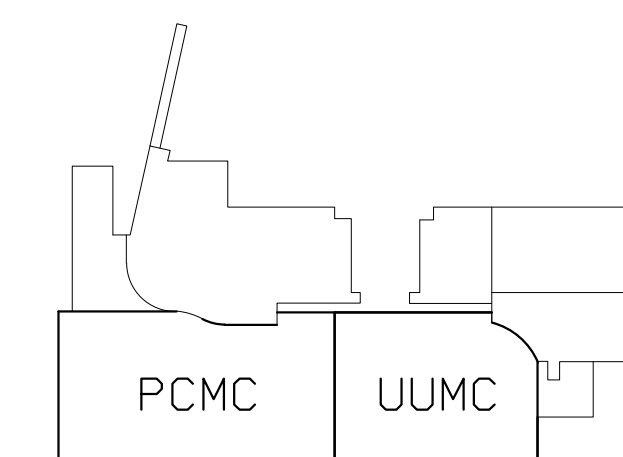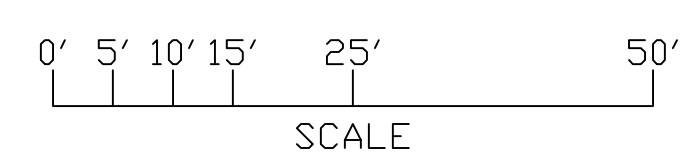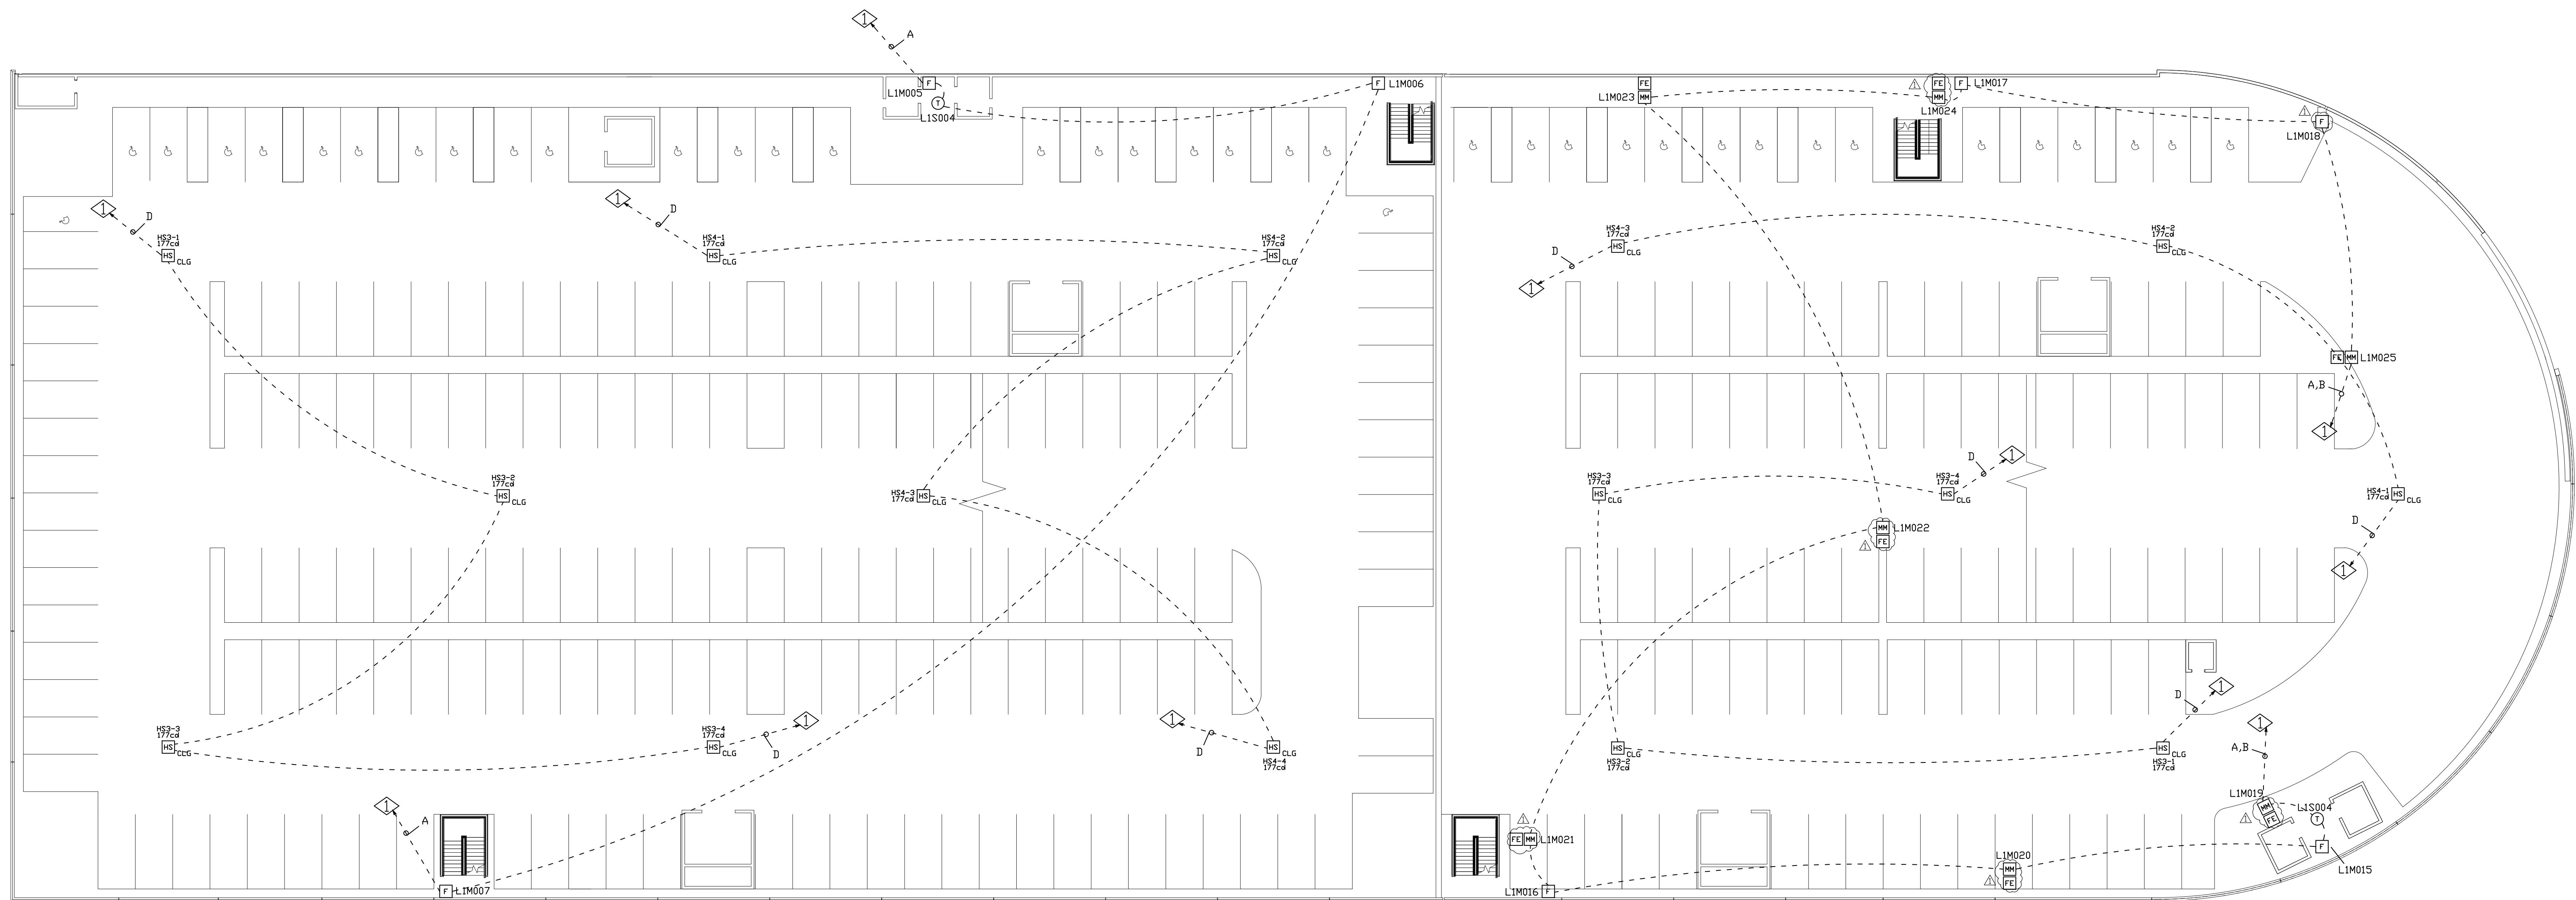

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

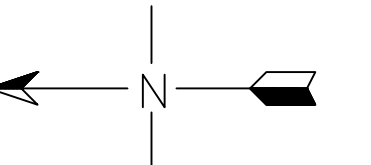

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
AMBULATORY CARE PARKING STRUCTURE
LEVEL P2
MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84113
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	SPECTRUM
APPROVED BY:	DPS
DATE:	11/20/12
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	PARKING P2.DWG

FIRE ALARM SYSTEM

FVFI P?

CONTINUATION

PAGE:


FA-P2-08

SYSTEM NOTES:
◇ TO MCPC TRANSPONDER ON LEVEL P1
◇ TO UUPC TRANSPONDER ON LEVEL P1
◇ 120 VAC WITH GROUND

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S

* SEE RISER FOR INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
CM	CONTROL MODULE
FE	MIJA W/MONITOR MODULE
SS	SPEAKER/STROBE
SS CLG	CEILING MOUNT SPEAKER/STROBE
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL

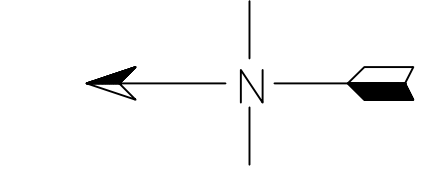

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
AMBULATORY CARE PARKING STRUCTURE
LEVEL P3
MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84113
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: AK
DESIGNED BY: SPECTRUM
APPROVED BY: DPS
DATE: 11/20/12
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
PARKING P3.DWG

FIRE ALARM SYSTEM
LEVEL P3
NOT FOR CONSTRUCTION

PAGE:
FA-P3-08

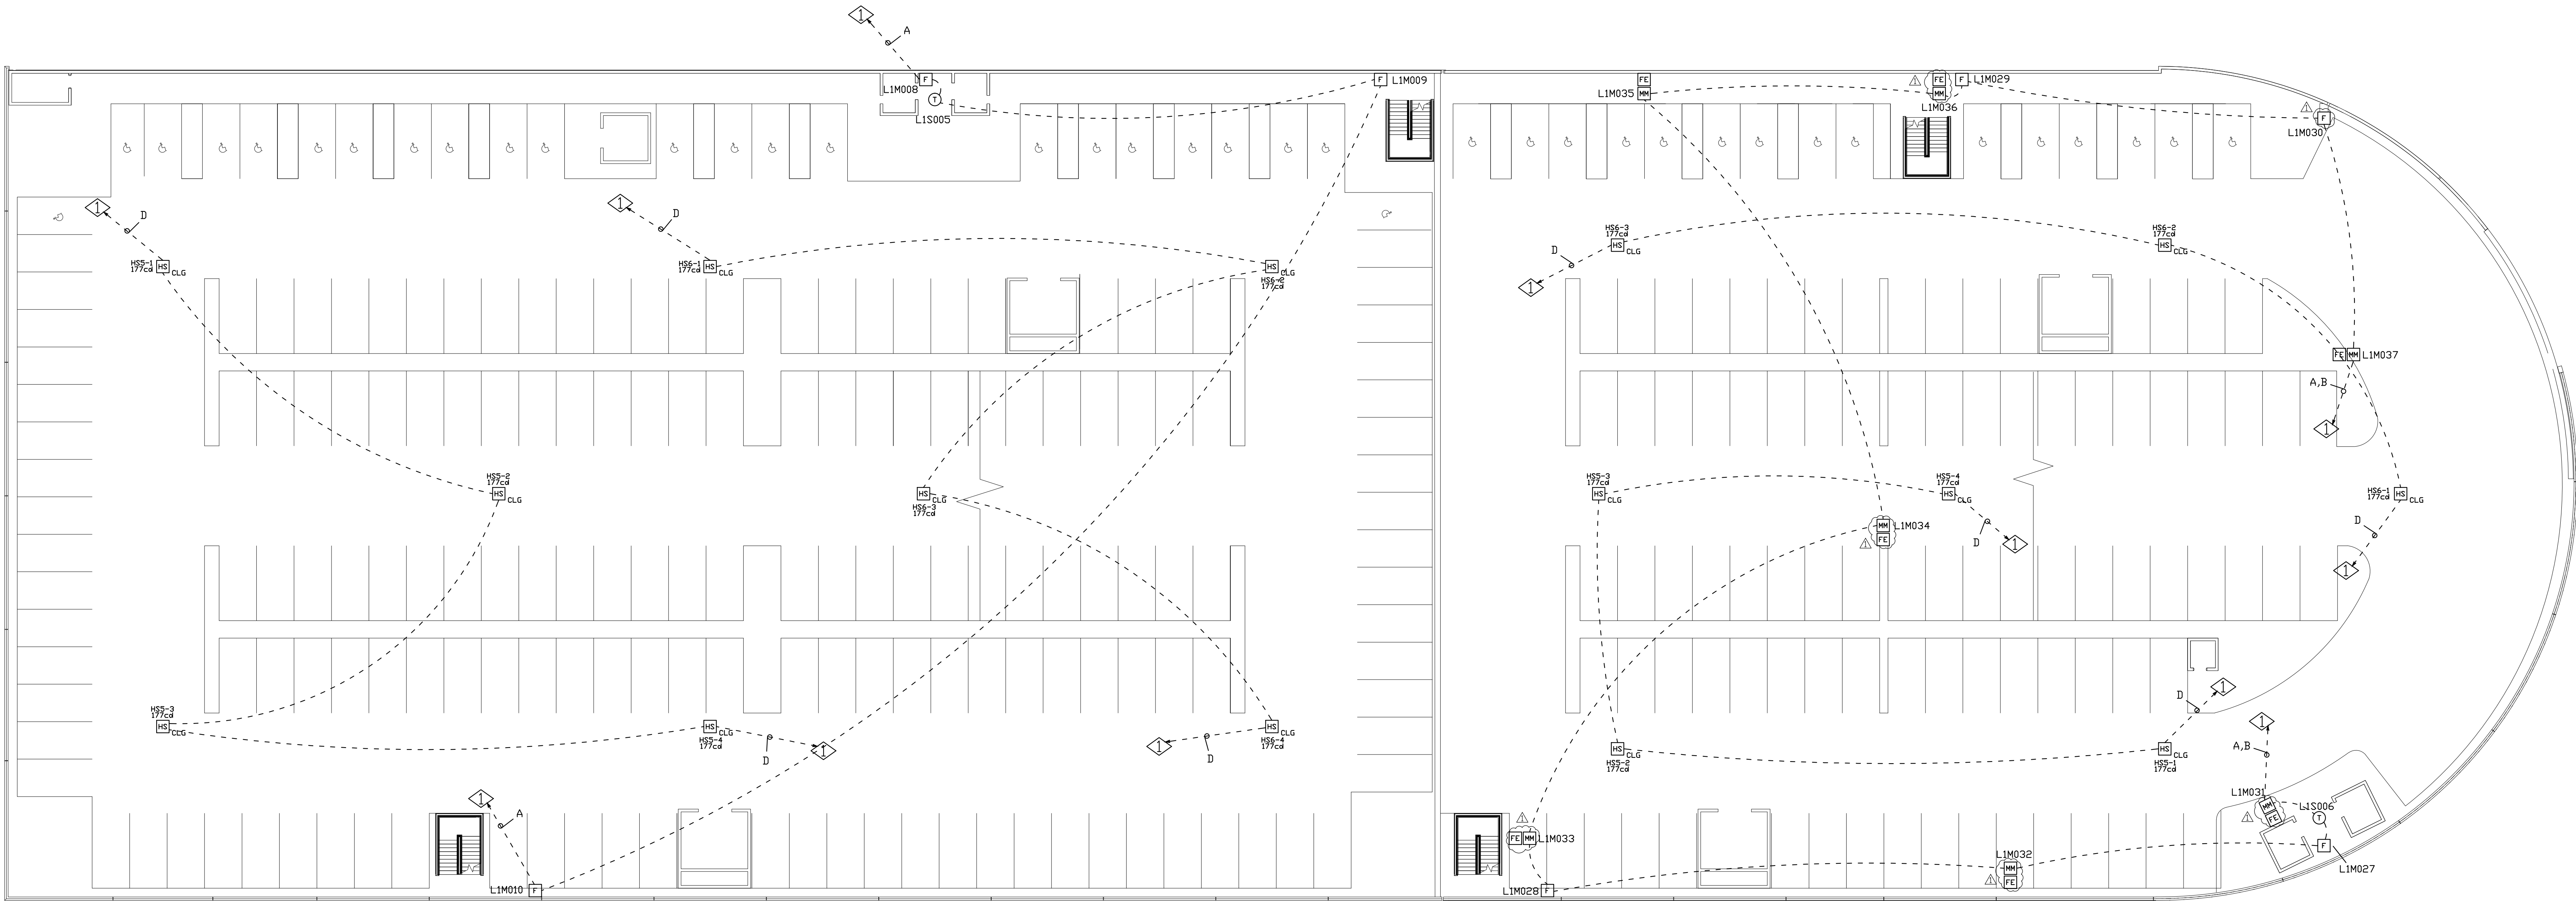

0' 5' 10' 15' 25' 50'
SCALE

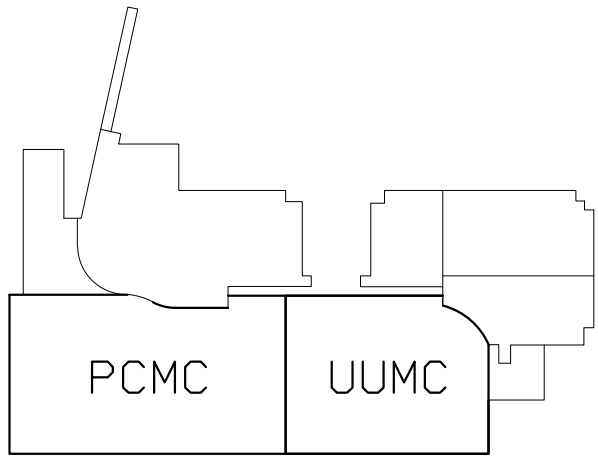

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396


SYSTEM NOTES:

- ◇ TO MCPC TRANSPONDER ON LEVEL P1
- ◇ TO UUPC TRANSPONDER ON LEVEL P1
- ◇ 120 VAC WITH GROUND

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S

* SEE RISER FOR INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
F	MANUAL PULL STATION
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
CM	CONTROL MODULE
FE	MIJA W/MONITOR MODULE
SS	SPEAKER/STROBE
SS CLG	CEILING MOUNT SPEAKER/STROBE
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL

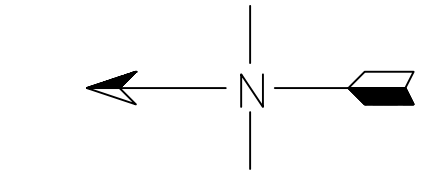

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
NFS DETECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
AMBULATORY CARE PARKING STRUCTURE
LEVEL P4
MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84113
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: AK
DESIGNED BY: SPECTRUM
APPROVED BY: DPS
DATE: 11/20/12
SCALE: (ARCH E1) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
PARKING P4.DWG

FIRE ALARM SYSTEM
LEVEL P4
NON-UNIFORM

PAGE:
FA-P4-08

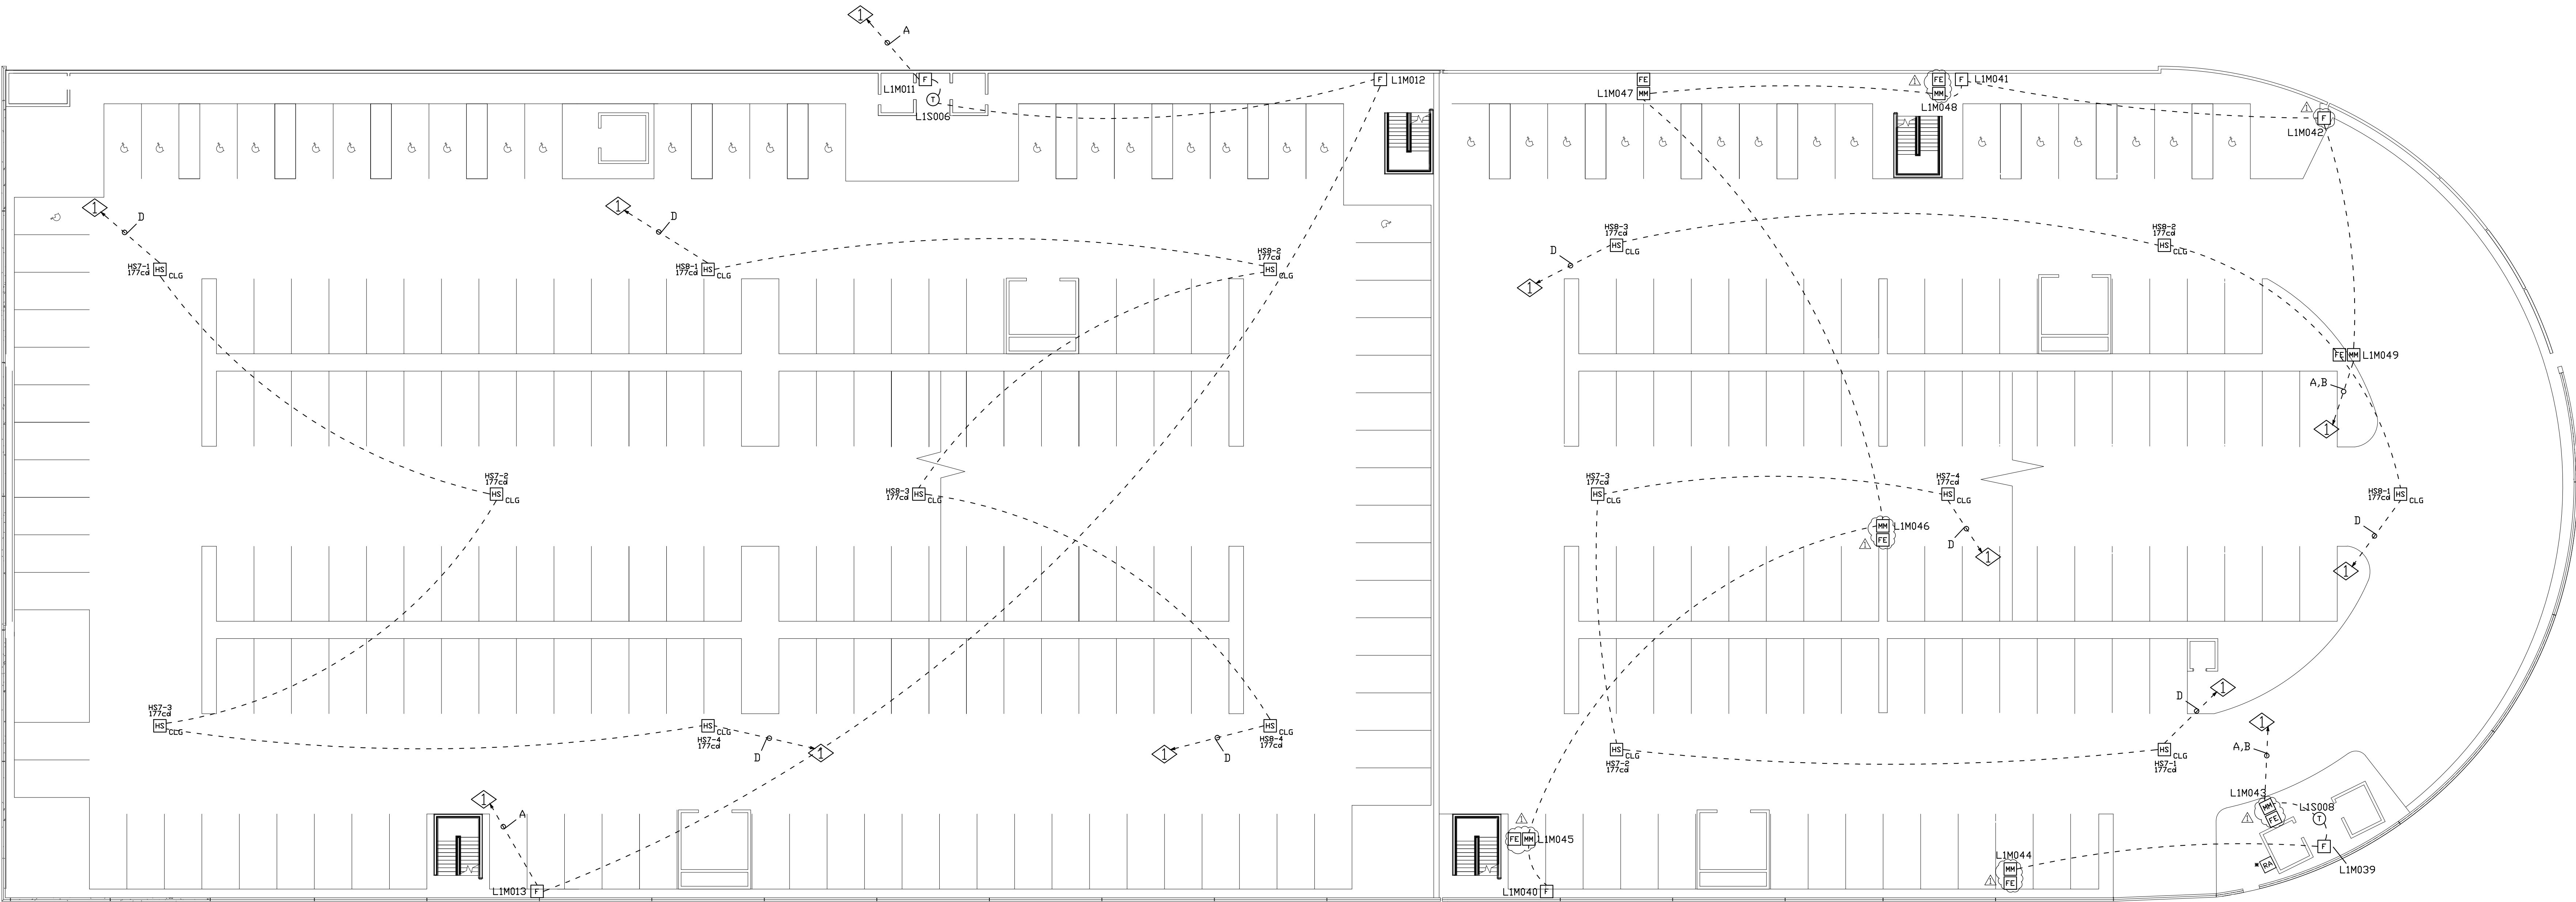

0' 5' 10' 15' 25' 50'
SCALE



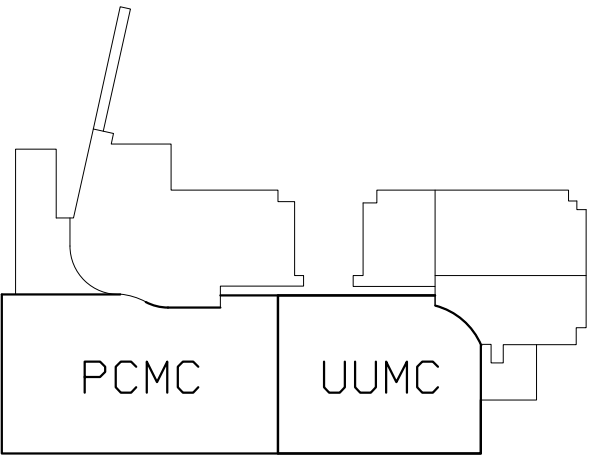


N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396


- ① TO MCPC TRANSPONDER ON LEVEL P1
- ② TO UUPC TRANSPONDER ON LEVEL P1
- ③ 120 VAC WITH GROUND

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	24 VDC AUX POWER	2 #14'S
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	MANUAL PULL STATION
	TAMPER SWITCH
	WATERFLOW SWITCH
	CONTROL MODULE
	MICA W/MONITOR MODULE
	SPEAKER/STROBE
 CLG	CEILING MOUNT SPEAKER/STROBE
	TRANSPONDER PANEL
	FIRE ALARM CONTROL PANEL

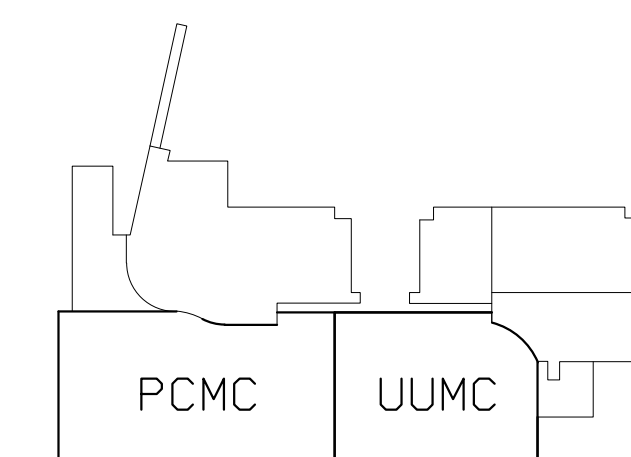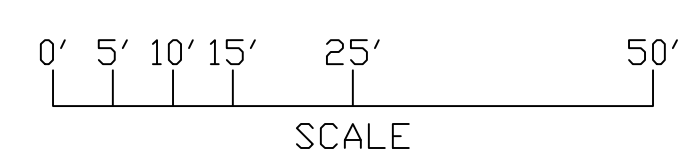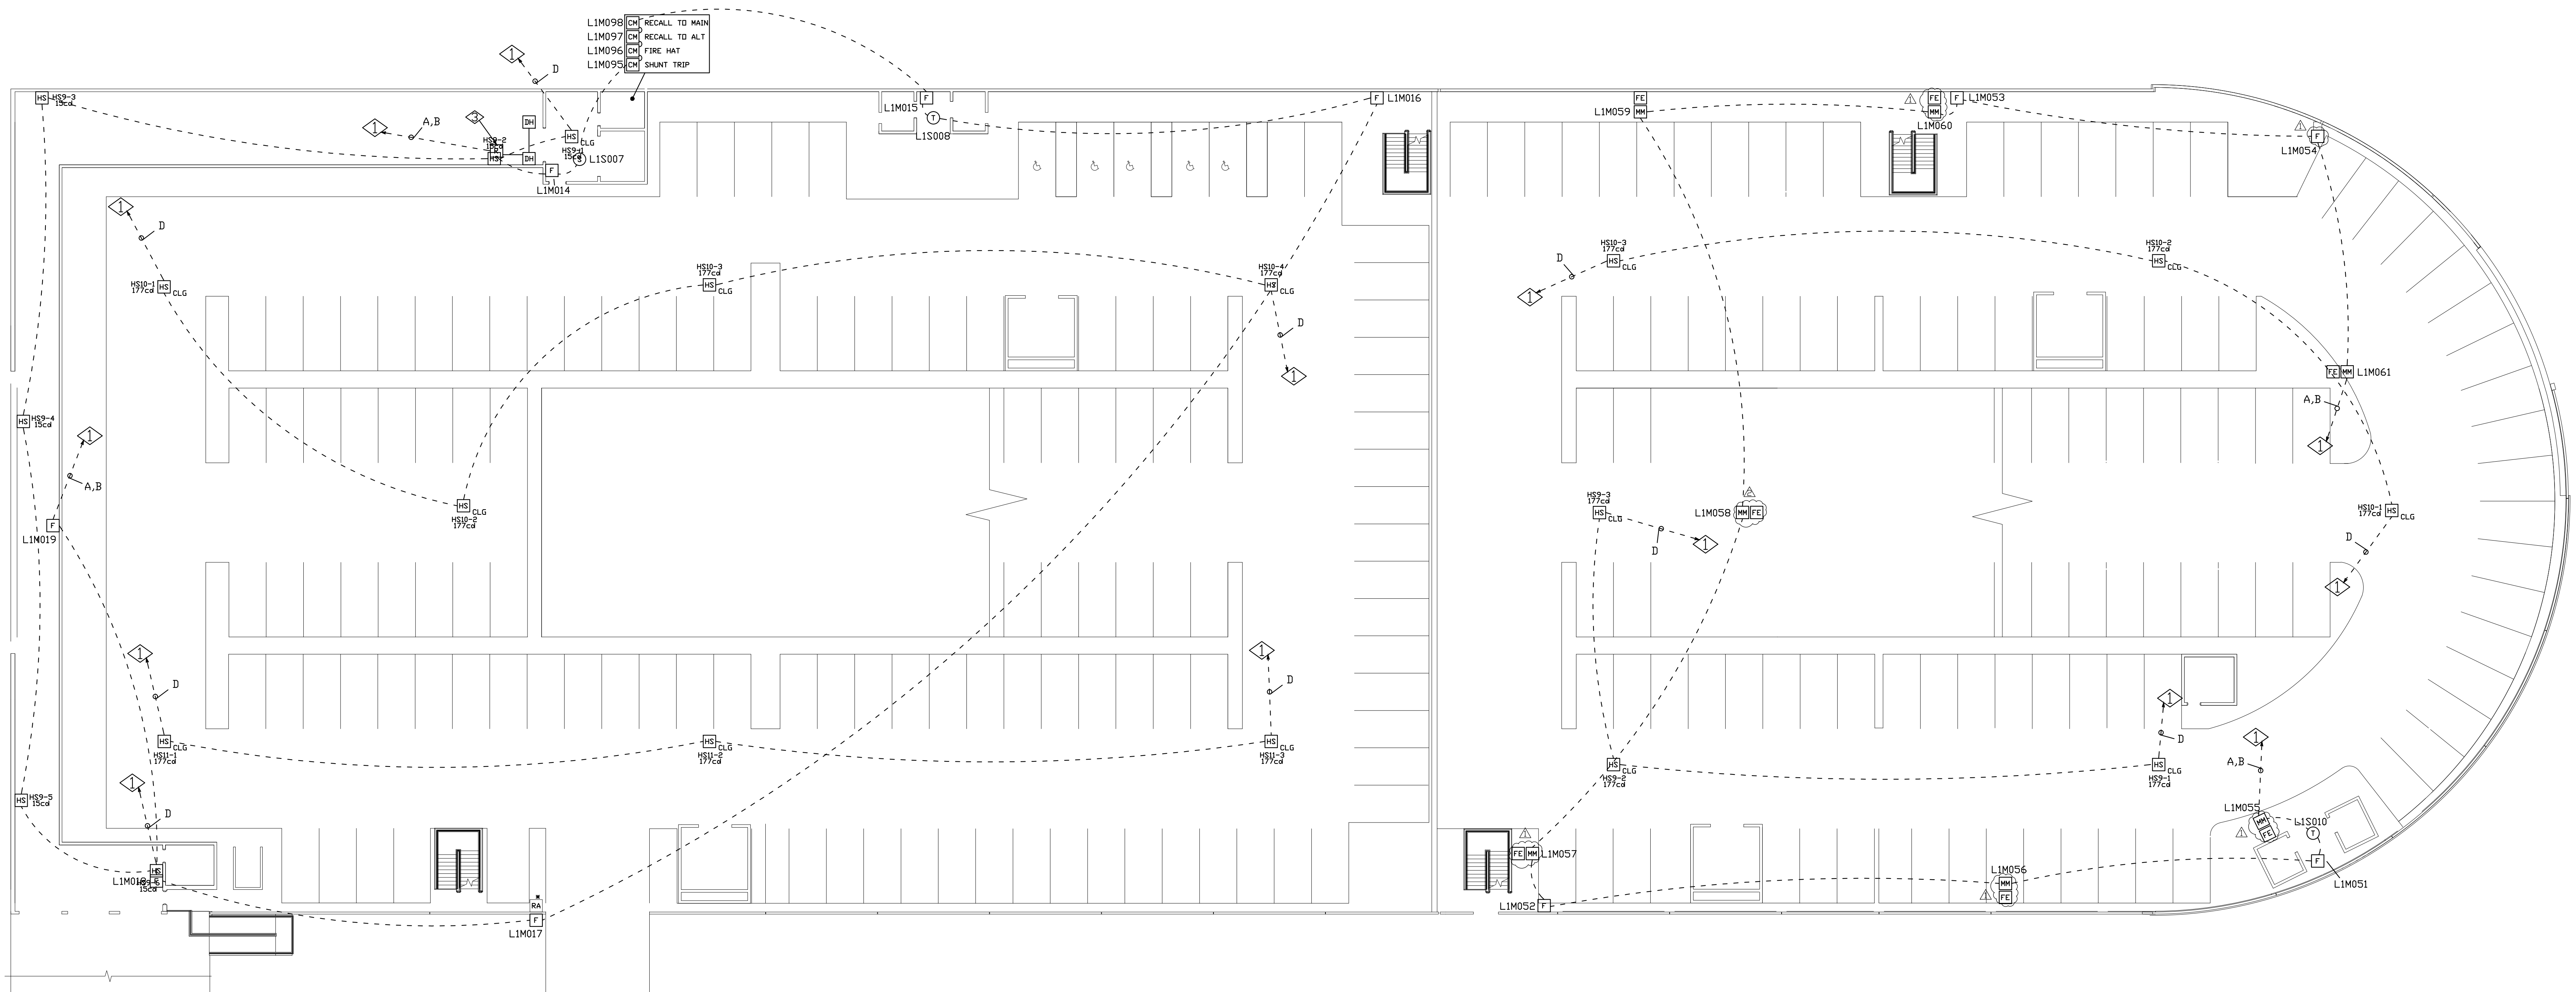

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

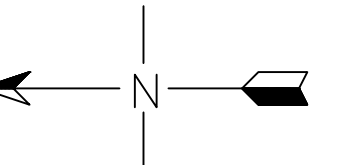

NOTE:

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE FOR THE ACCURACY OF ALL INFORMATION PROVIDED HEREIN. NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
AMBULATORY CARE PARKING STRUCTURE
LEVEL P5
MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84113
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	SPECTRUM
APPROVED BY:	DPS
DATE:	11/20/12
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	PARKING P5.DWG

FIRE ALARM SYSTEM

FVFI P5

CONFIDENTIAL

PAGE:

FA-P5-08