




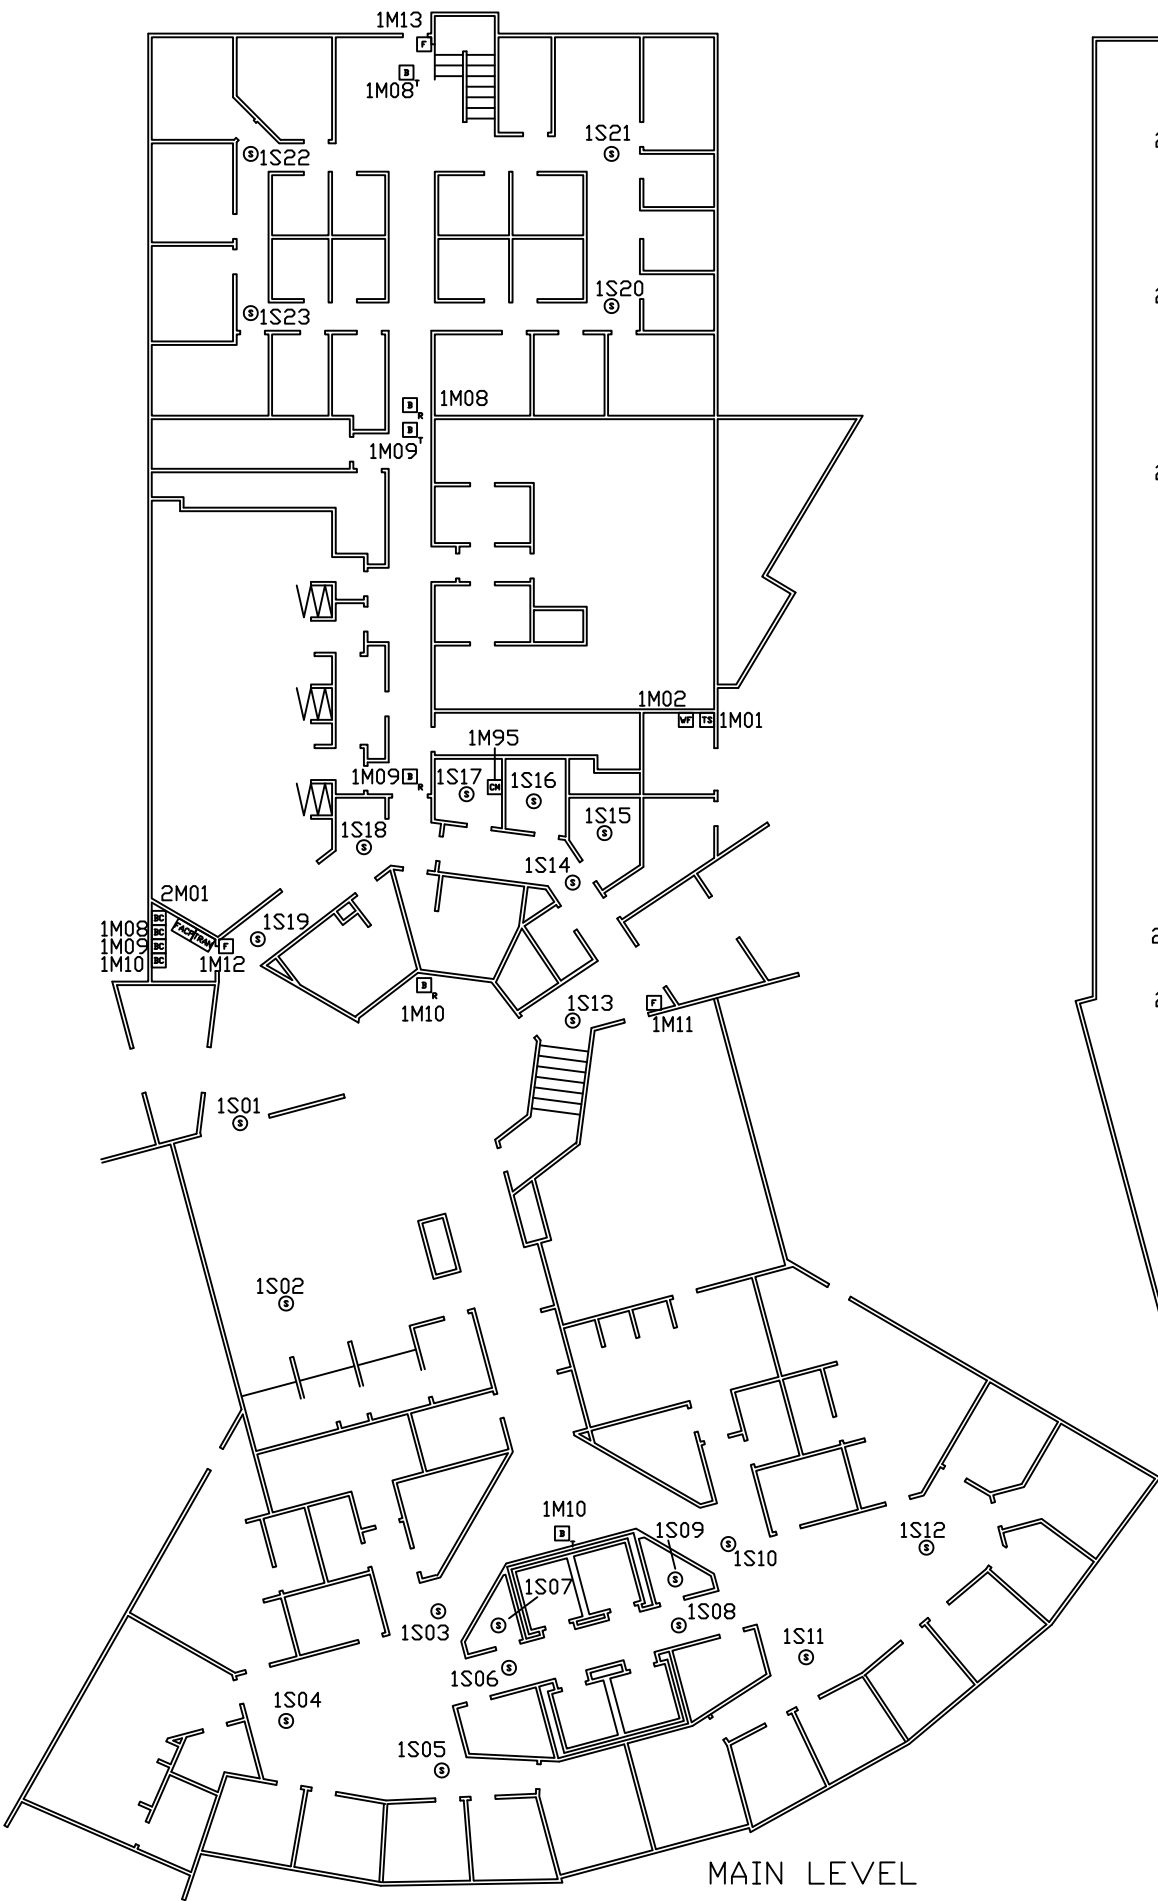

MAIN LEVEL

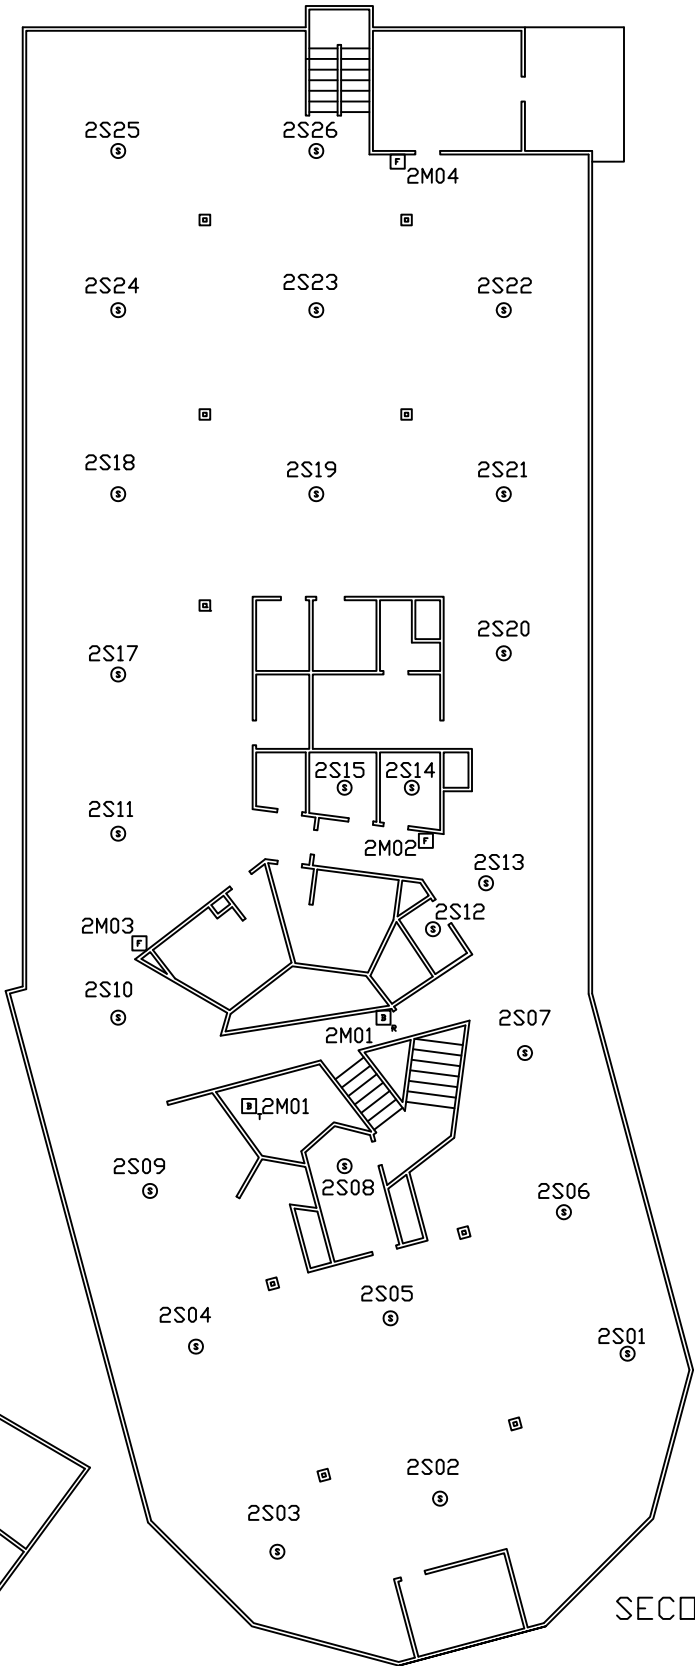


SECOND LEVEL

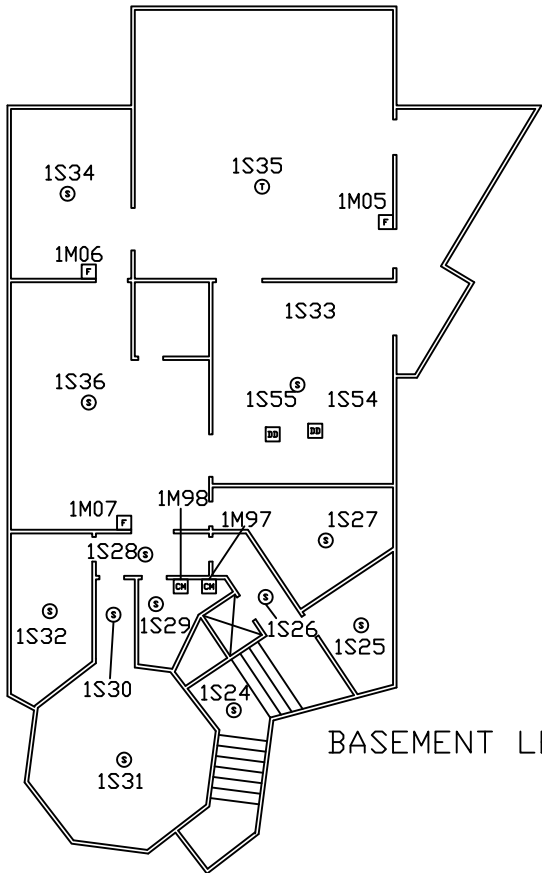

BASEMENT LEVEL


NFS

NELSON FIRE SYSTEMS
801-288-9905




- LEGEND
- ⊙ SMOKE DETECTOR
 - ⊙ HEAT DETECTOR
 - MANUAL PULL STATION
 - ▣ DUCT DETECTOR
 - ▤ WATERFLOW SWITCH
 - ▥ TAMPER SWITCH
 - ▧ BEAM DETECTOR TRANSMITTER
 - ▨ BEAM DETECTOR RECEIVER
 - ▩ BEAM DETECTOR CONTROL PANEL
 - CONTROL MODULE
 - FIRE ALARM CONTROL PANEL
 - ▬ TRANSPONDER PANEL


CHILDRENS SPECIAL HEALTH
CARE NEEDS CLINIC
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
MARCH 6, 2002
CHLDHC1.DWG

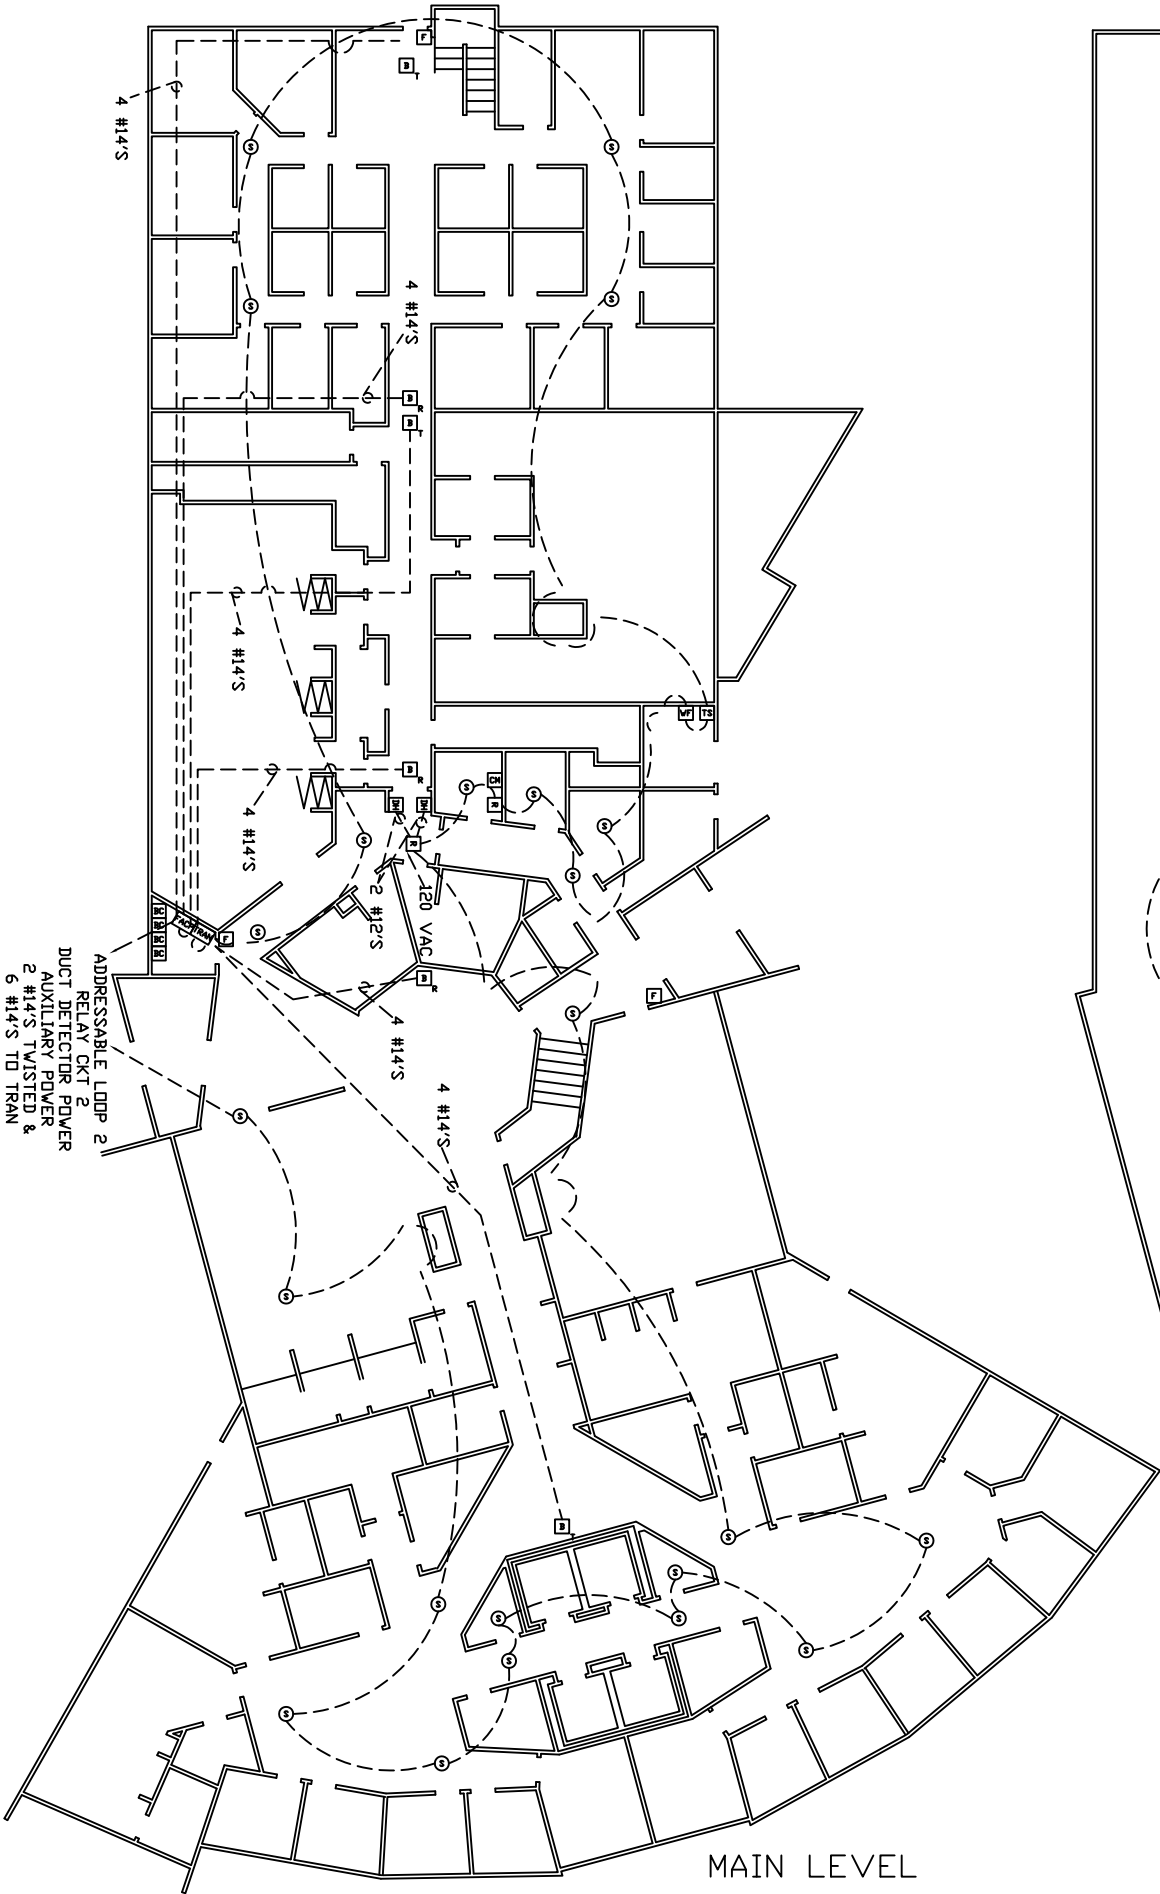

MAIN LEVEL

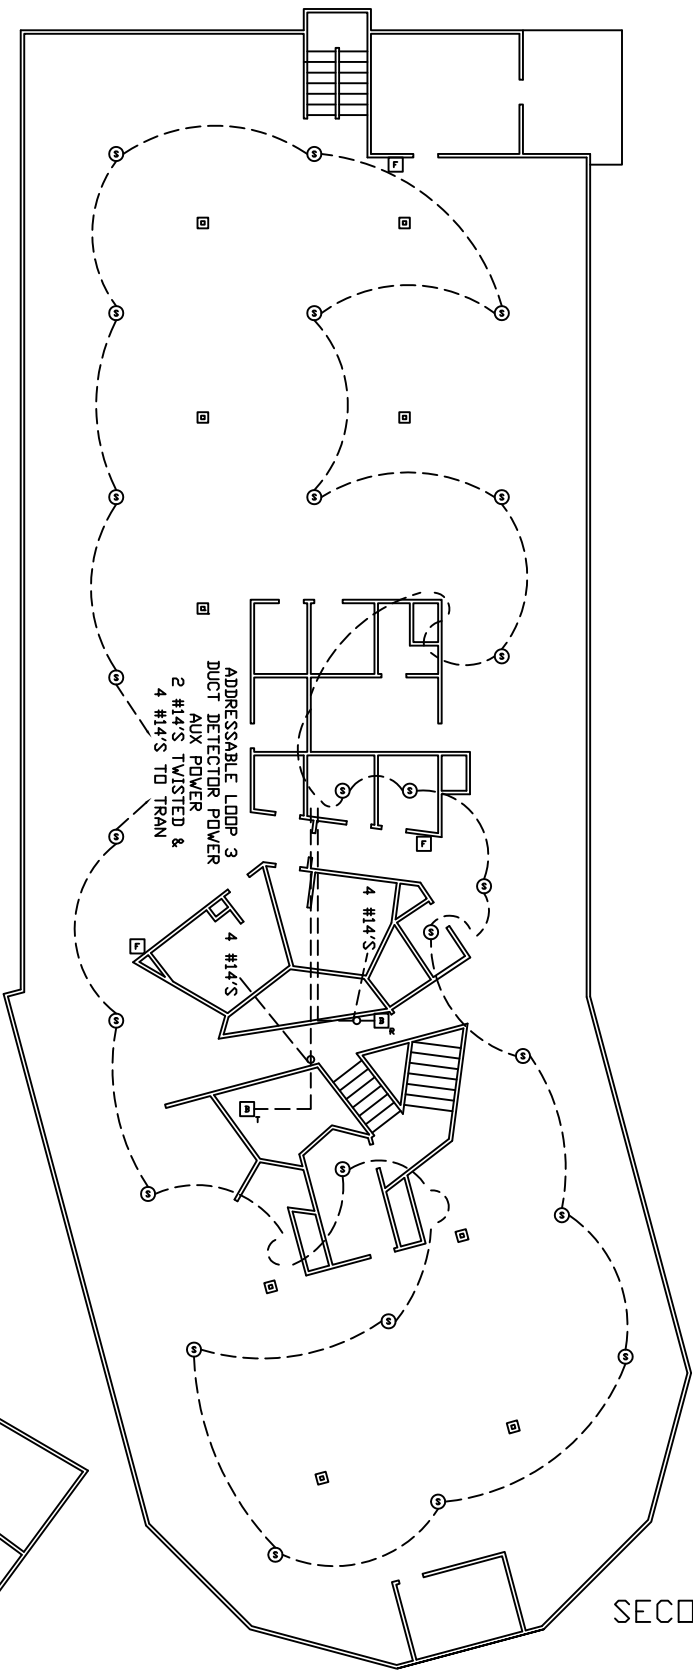


SECOND LEVEL

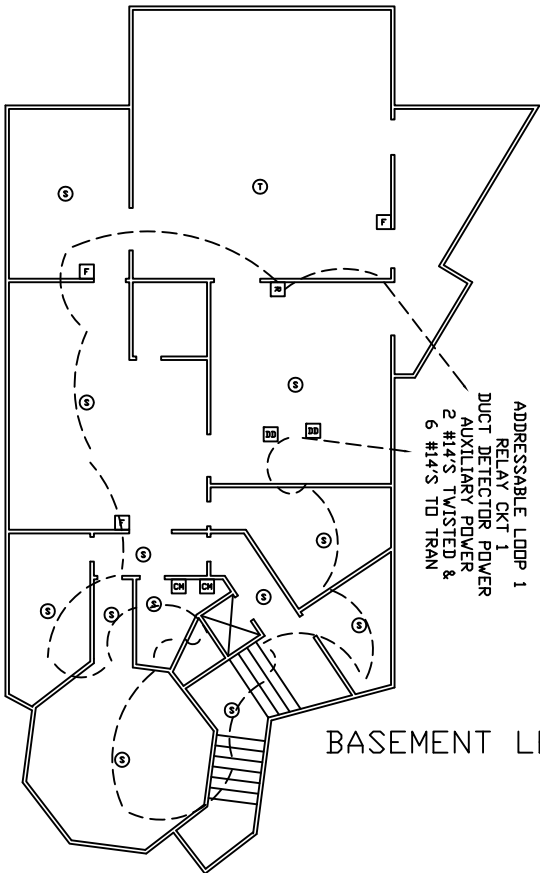

BASEMENT LEVEL




NFS

NELSON FIRE SYSTEMS
801-288-9905




- LEGEND
- ⊙ SMOKE DETECTOR
 - ⊙ HEAT DETECTOR
 - MANUAL PULL STATION
 - ▣ DUCT DETECTOR
 - ▣ WATERFLOW SWITCH
 - ▣ TAMPER SWITCH
 - ▣ BEAM DETECTOR TRANSMITTER
 - ▣ BEAM DETECTOR RECEIVER
 - ▣ BEAM DETECTOR CONTROL PANEL
 - ▣ CONTROL MODULE
 - ▣ FIRE ALARM CONTROL PANEL
 - ▣ TRANSPONDER PANEL

CHILDRENS SPECIAL HEALTH
 CARE NEEDS CLINIC
 UNIVERSITY OF UTAH
 SALT LAKE CITY, UTAH
 MARCH 6, 2002
 CHLDHC1.DWG

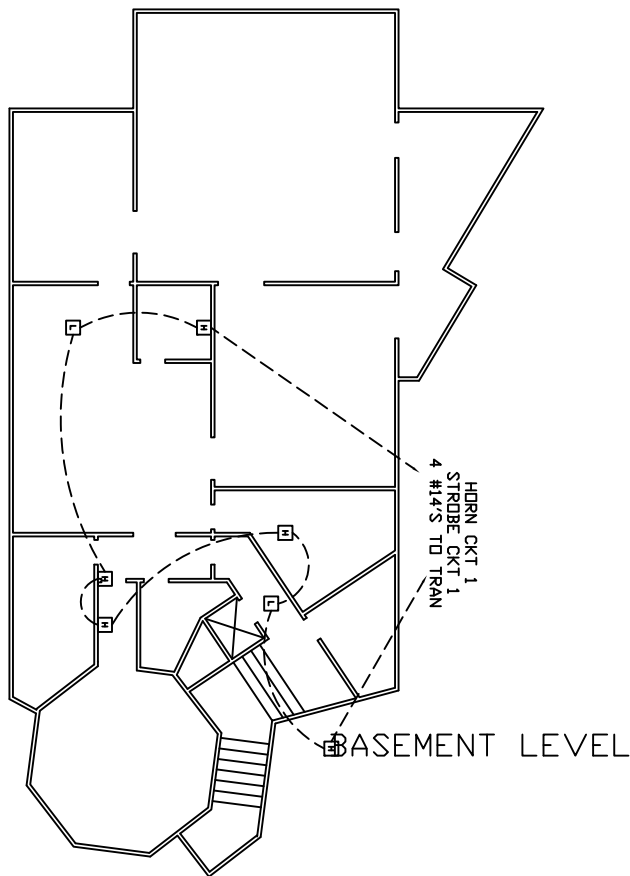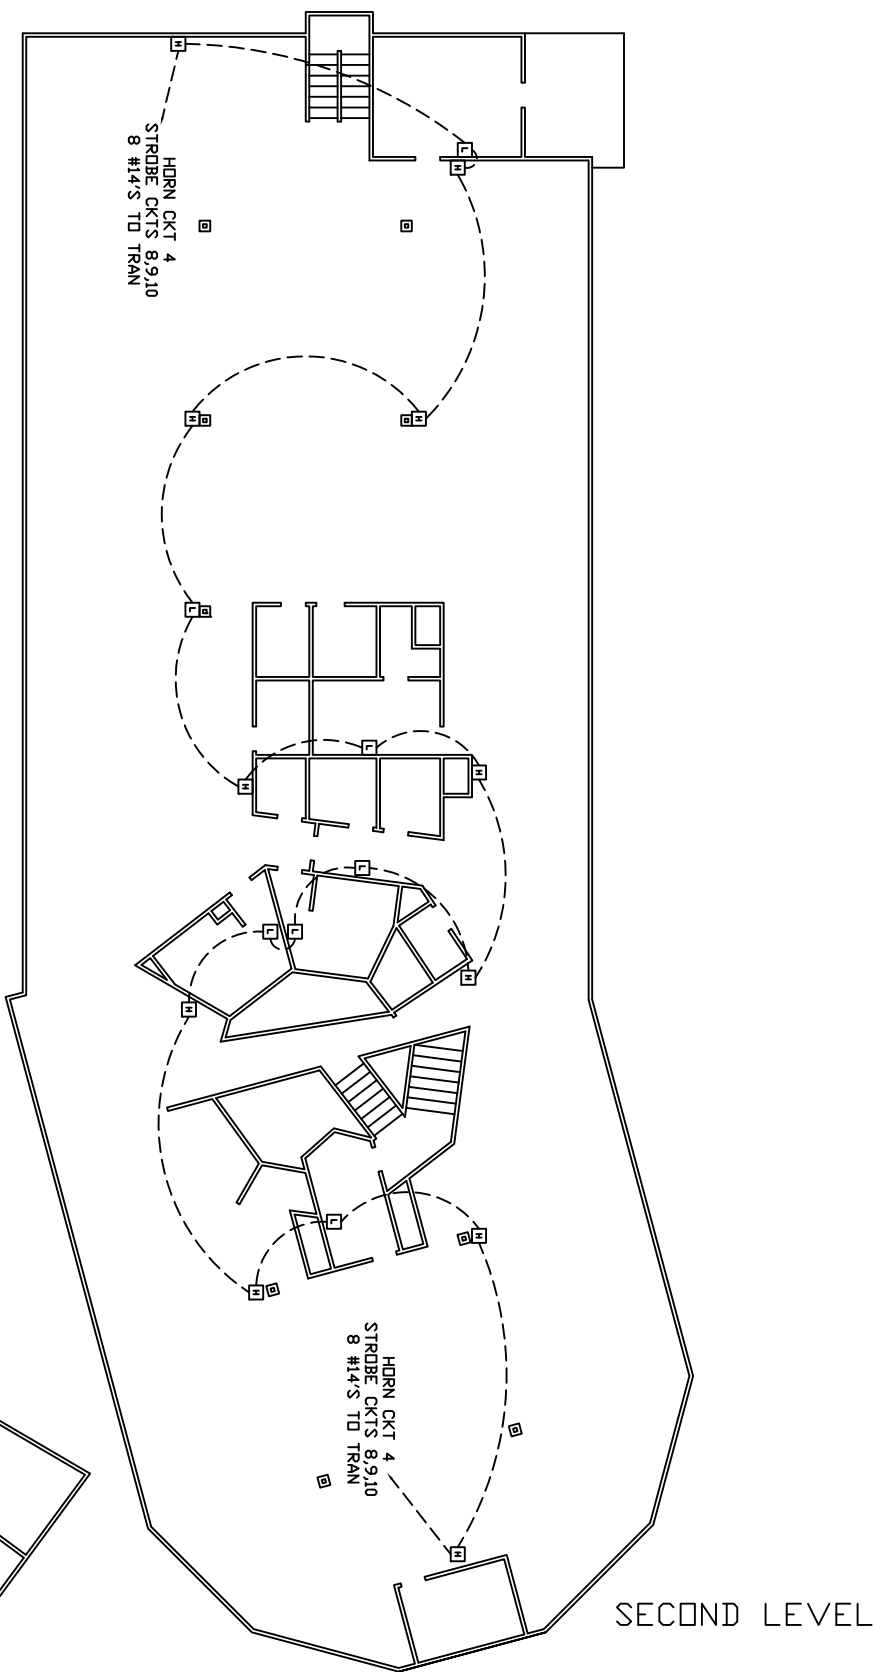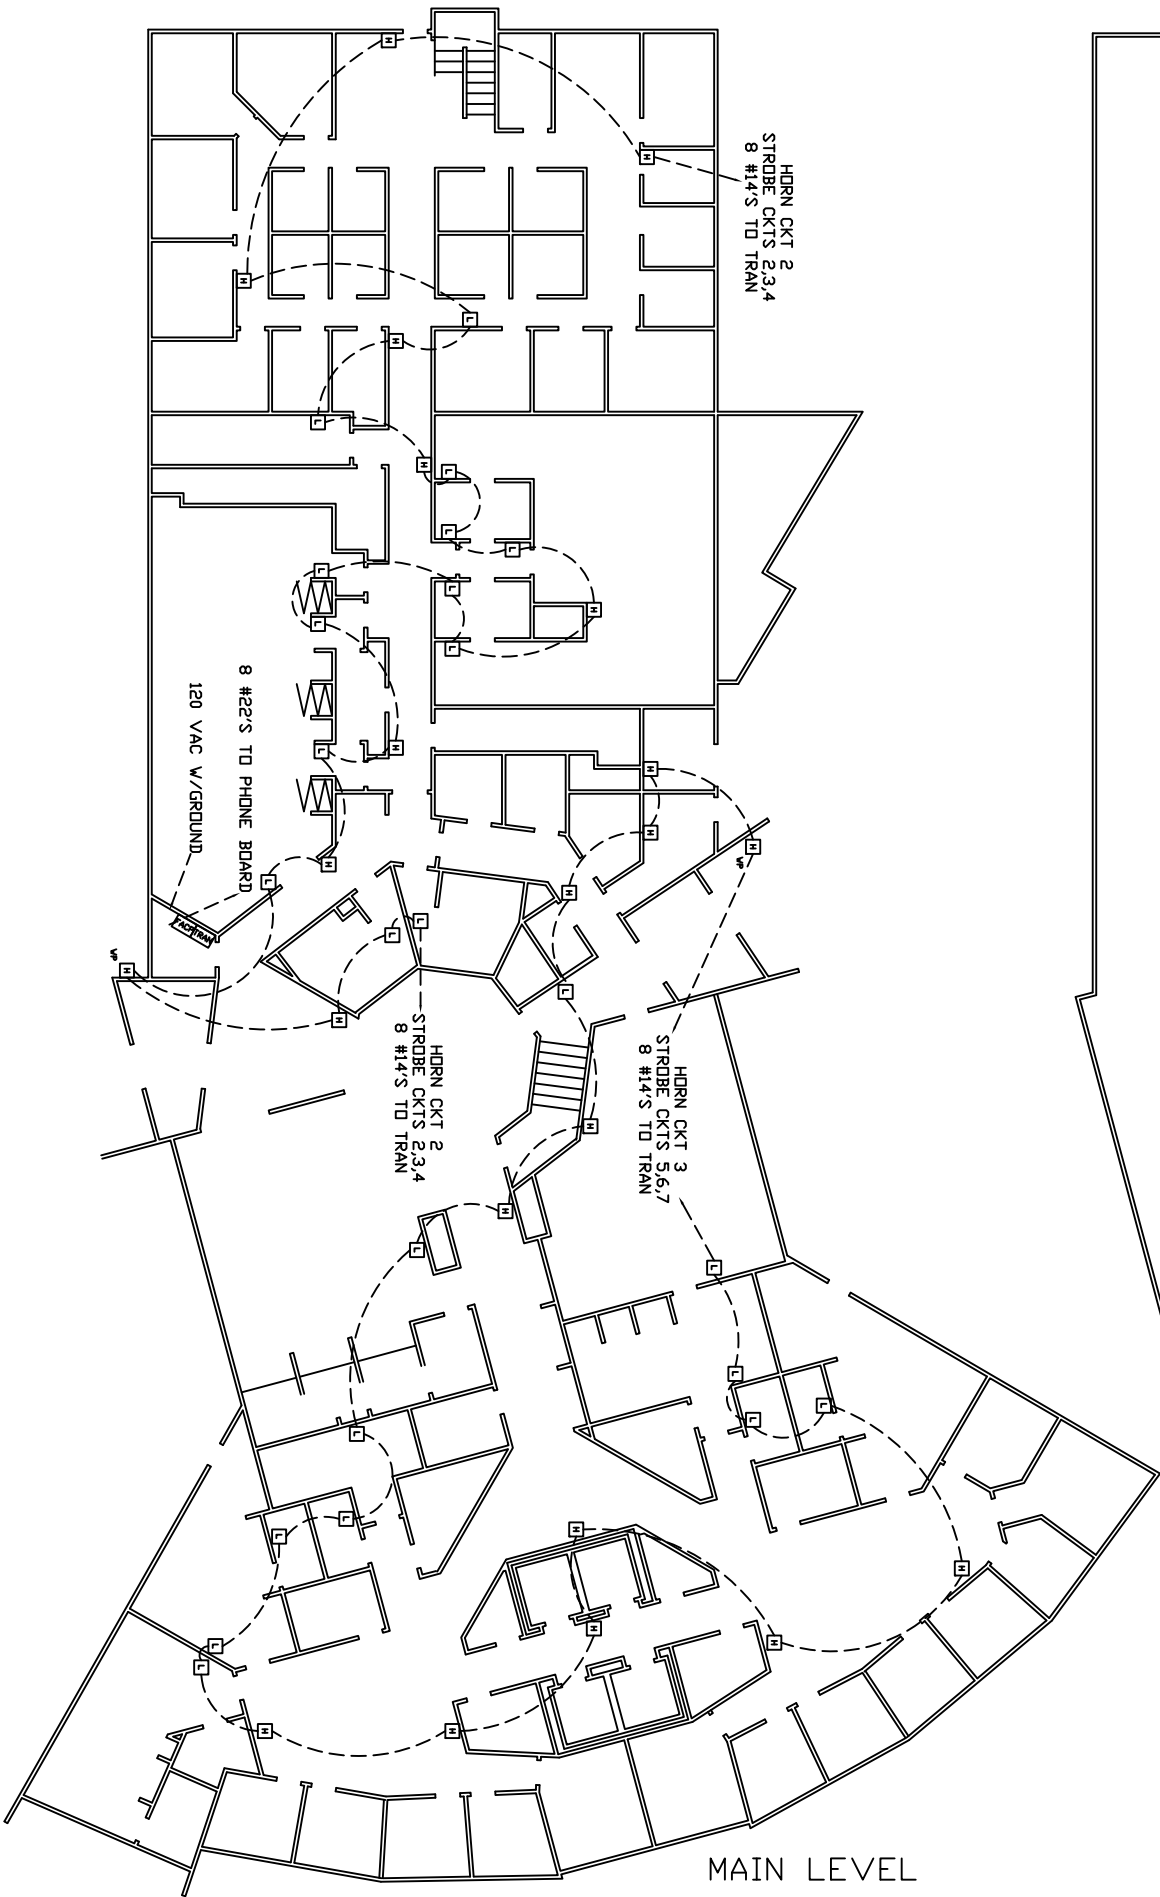

NFS
NELSON FIRE SYSTEMS
801-288-9905



- LEGEND
- ⊙ SMOKE DETECTOR
 - ⊙ HEAT DETECTOR
 - MANUAL PULL STATION
 - DUCT DETECTOR
 - WATERFLOW SWITCH
 - TAMPER SWITCH
 - BEAM DETECTOR TRANSMITTER
 - BEAM DETECTOR RECEIVER
 - BEAM DETECTOR CONTROL PANEL
 - CONTROL MODULE
 - FIRE ALARM CONTROL PANEL
 - TRANSPONDER PANEL

CHILDRENS SPECIAL HEALTH
CARE NEEDS CLINIC
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
MARCH 6, 2002
CHLDHC1.DWG