

UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
FIRE ALARM SYSTEM

BUILDING CONSTRUCTION TYPE: IIB
BUILDING SQUARE FOOTAGE: 258,189 FT ²

INDEX OF DRAWINGS			
PAGE	SHEET #	LEVEL	SHEET CONTENTS
1	FA-C-01		PROJECT COVER SHEET / INDEX OF DRAWINGS
2	FA-R-01		FIRE ALARM BUILDING RISER DIAGRAM / MATRIX
3	FA-B-01	BASEMENT	ADDRESSABLE CIRCUITS
4	FA-B-02	BASEMENT	NOTIFICATION CIRCUITS
5	FA-1-01	MAIN	ADDRESSABLE CIRCUITS
6	FA-1-02	MAIN	NOTIFICATION CIRCUITS
7	FA-2-01	SECOND	ADDRESSABLE CIRCUITS
8	FA-2-02	SECOND	NOTIFICATION CIRCUITS
9	FA-3-01	THIRD	ADDRESSABLE CIRCUITS
10	FA-3-02	THIRD	NOTIFICATION CIRCUITS
11	FA-4-01	FOURTH	ADDRESSABLE CIRCUITS
12	FA-4-02	FOURTH	NOTIFICATION CIRCUITS
13	FA-5-01	FIFTH	ADDRESSABLE CIRCUITS
14	FA-5-02	FIFTH	NOTIFICATION CIRCUITS

DEVICE SCHEDULE				
COUNTS	SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENT
504	Ⓢ	SMOKE DETECTOR w/BASE	ASD-PL3 w/B300-6	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
18	Ⓣ	HEAT DETECTOR w/BASE	ATD-L3R w/B300-6	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
1	ⓕ	MANUAL PULL STATION	MS-7AF	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
10	ⓓⓈ	DUCT DETECTOR w/SAMPLING TUBE	DNR w/DST-5	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
45	ⓂⓂ	MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" DEEP BOX MINIMUM
6	ⓐⓂ	OUTPUT RELAY CONTROL MODULE	AOM-2RF	4 SQ. 2-1/8" DEEP BOX MINIMUM
7	ⓐⓂ	SUPERVISED CONTROL MODULE	AOM-2SF	4 SQ. 2-1/8" DEEP BOX MINIMUM
7	Ⓡ	MULTI-VOLTAGE RELAY	PR-3	4 SQ. 2-1/8" DEEP BOX MINIMUM
414	ⓈⓈ	SPEAKER/STROBE- WALL	SPSWL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/1-1/2" EXT. RING
78	ⓈⓈ _C	SPEAKER/STROBE- CEILING	SPSCWL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/1-1/2" EXT. RING
5	ⓈⓈ _{WP}	WEATHERPROOF SPEAKER/STROBE- WALL	SPSWK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	Ⓛⓐⓐ	LOCAL OPERATING CONSOLE	E3-BB-BB	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	ⓕⓐⓐ	FIRE ALARM CONTROL UNIT	E3-BB-BB	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
6	ⓉⓇⓐⓃ	TRANPSONDER PANEL	SBB-D4	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
6	ⓂⓃ	VOICE PANEL	INX-CAB	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
2	ⓔⓐⓐ	ELEVATOR CONTROL PANEL	ECP	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: KK
DATE: 8/31/21
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: UOFU HELIX COVER.DWG

NELSON FIRE SYSTEMS
PROJECT COVER SHEET

PAGE:
FA-C-01

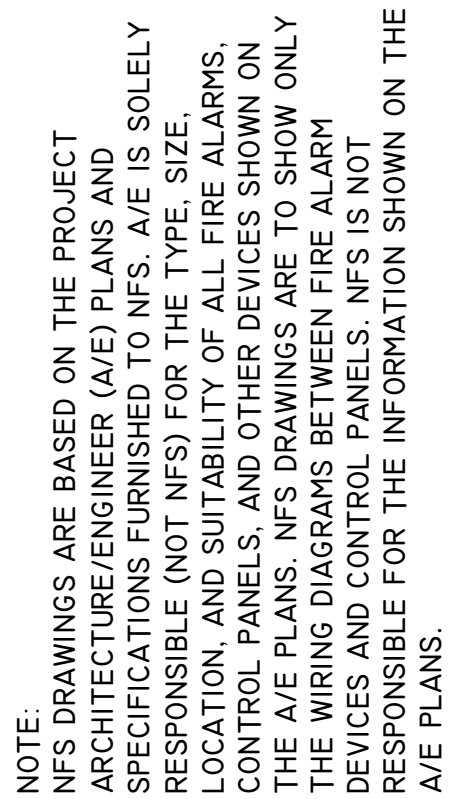


$$\begin{array}{r} 6 \\ 41 \\ \hline 6 \\ 5 \end{array}$$


NFS

FIFA-BMAP



MAIN LEVEL

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
	SD	SMOKE DETECTOR
	HD	HEAT DETECTOR
	P	PULL STATION
	DD	DUCT DETECTOR
	TS	TAMPER SWITCH
	WFS	WATERFLOW SWITCH
	CM	CONTROL MODULE
	CMS	CONTROL MODULE SUPERVISED
1	R	RELAY
75	SSW	SPEAKER/STROBE- WALL
26	SSC	SPEAKER/STROBE- CEILING
0	WPSW	WEATHERPROOF SPEAKER/STROBE- WALL
	LOC	LOCAL OPERATING CONSOLE
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	VP	VOICE PANEL
	ECP	ELEVATOR CONTROL PANEL

N
E
S
W

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION AND SUITABILITY OF ALL FIRE ALARMS
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.


UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: XXXX
DESIGNED BY: XXXX
APPROVED BY: XXXX
DATE: XXXX
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
UOFU HELIX OFFICE BLDG 1.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
ADDRESS HERE

PAGE:
FINAL MAP

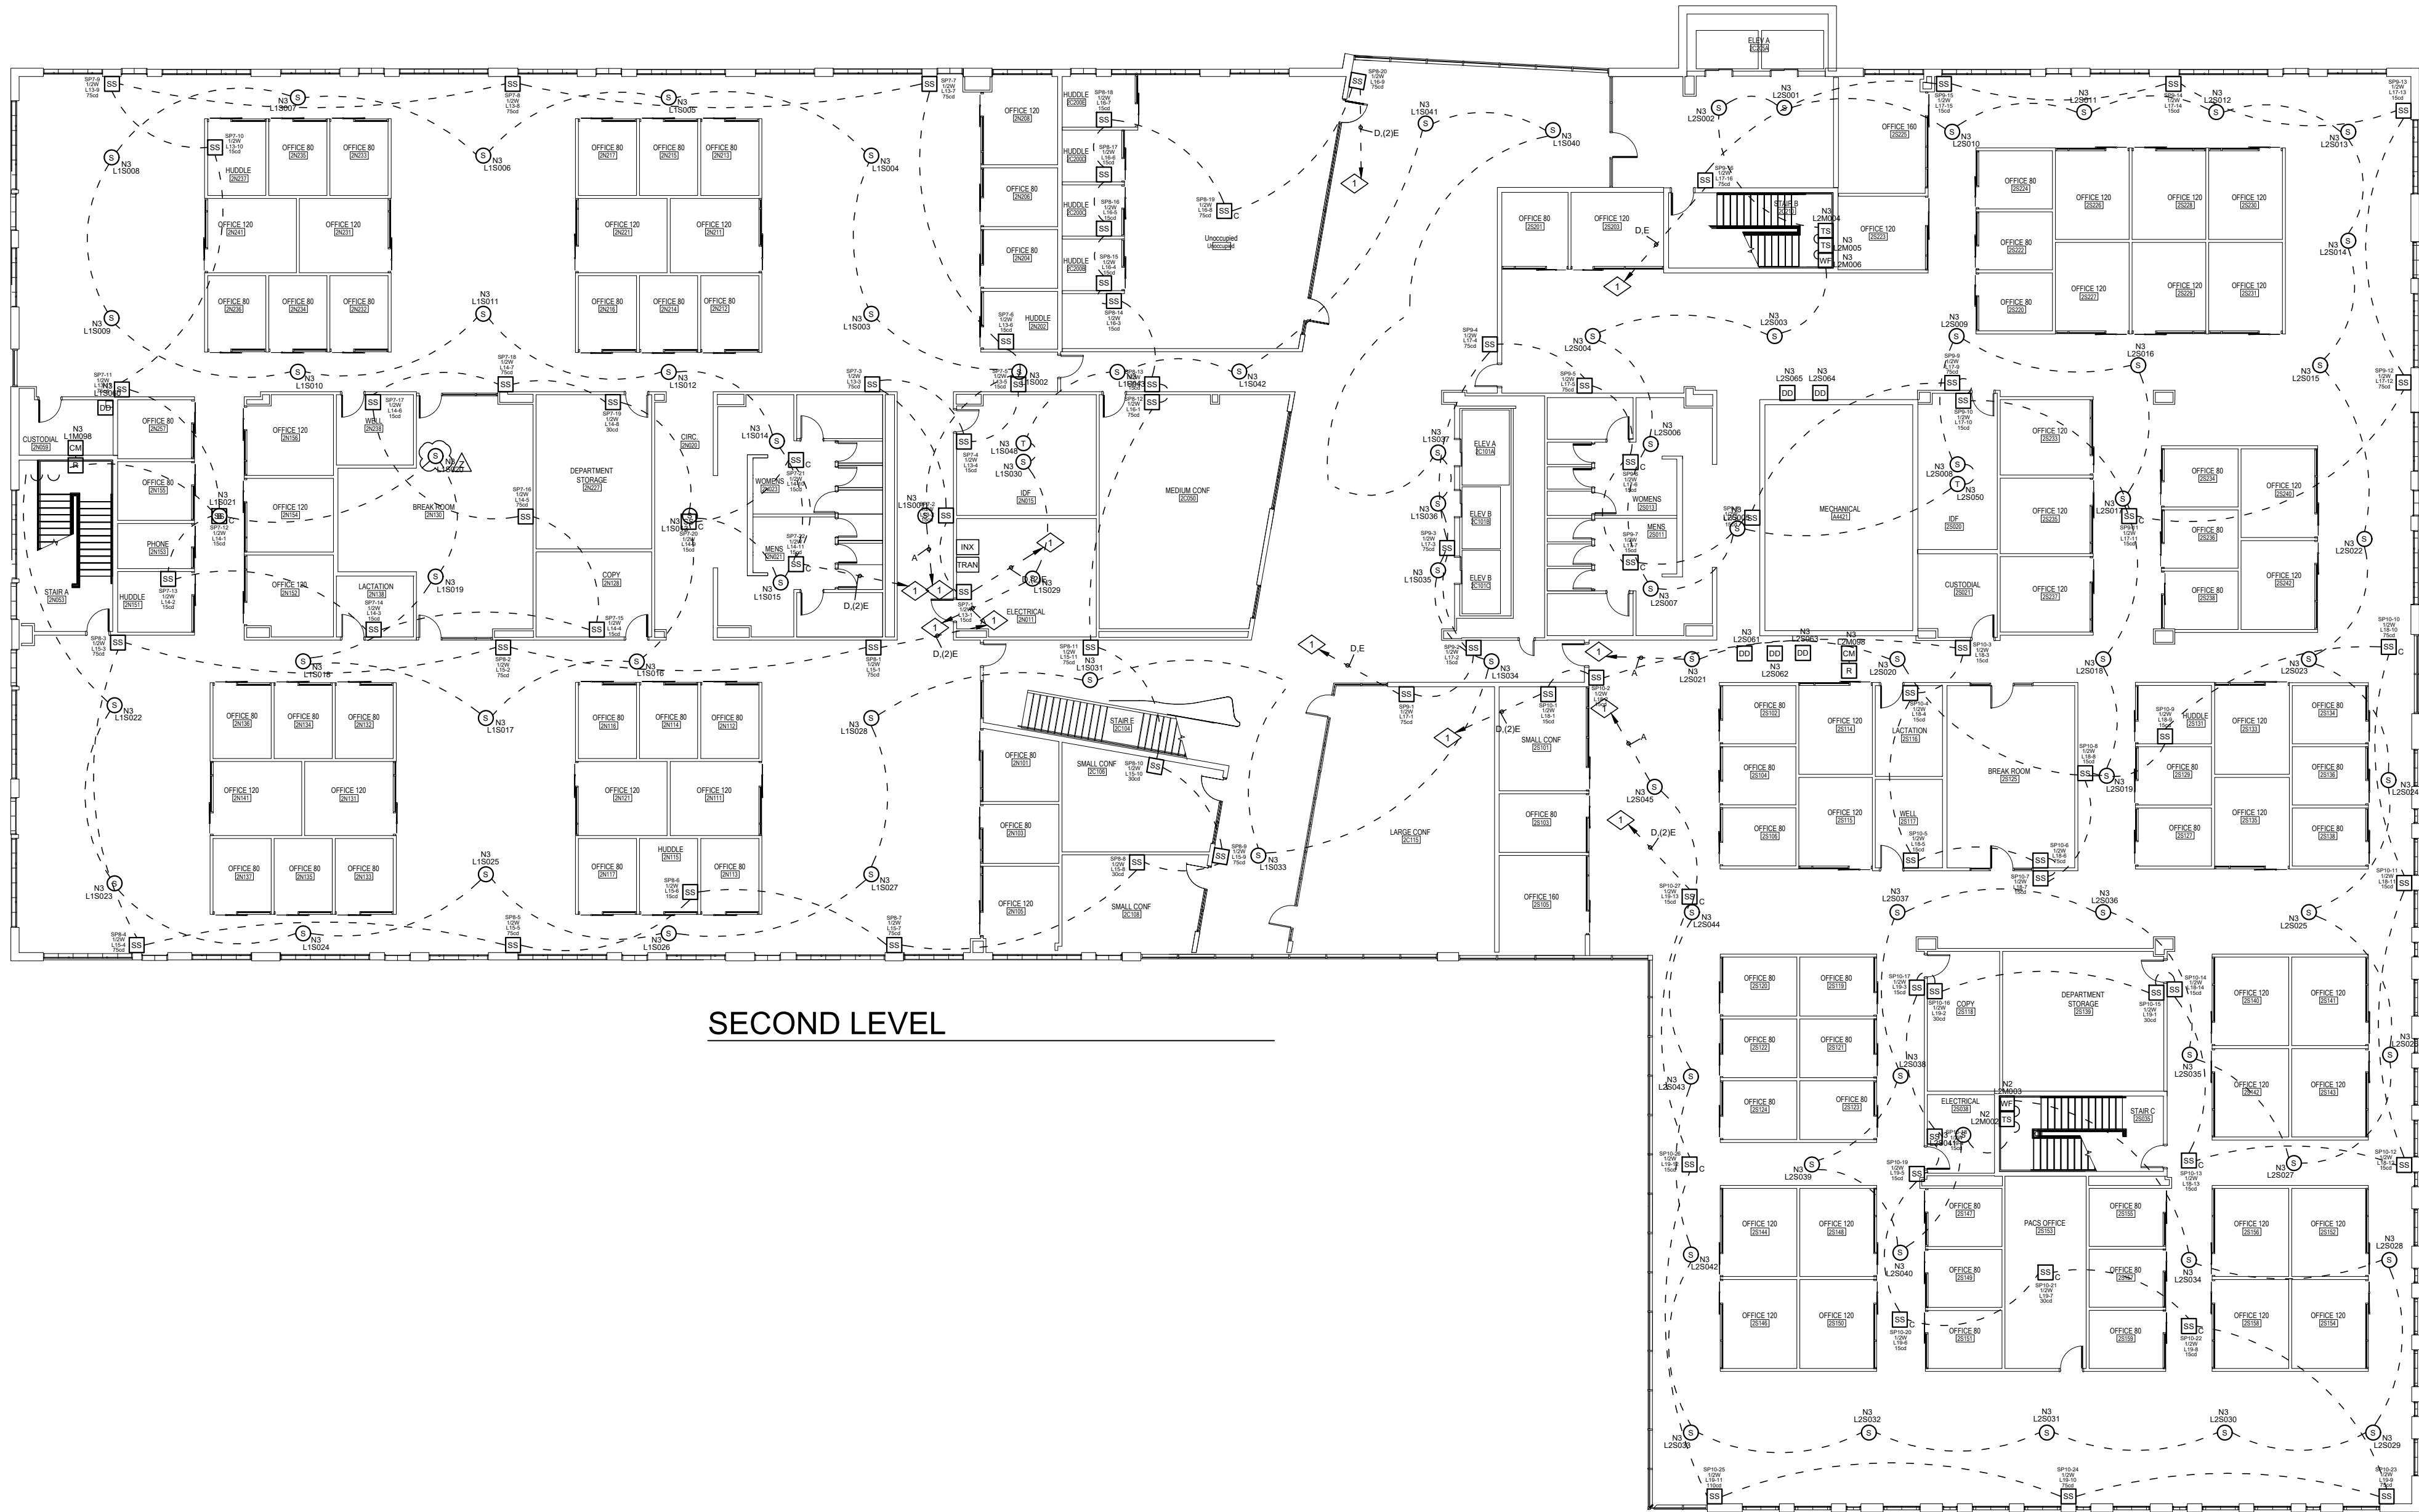

SECOND LEVEL

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
	SD	SMOKE DETECTOR
	HD	HEAT DETECTOR
	P	PULL STATION
	DD	DUCT DETECTOR
	TS	TAMPER SWITCH
	WFS	WATERFLOW SWITCH
	CM	CONTROL MODULE
	CM-S	CONTROL MODULE SUPERVISED
0	R	RELAY
70	SS	SPEAKER/STROBE- WALL
15	SS-C	SPEAKER/STROBE- CEILING
0	SS-WP	WEATHERPROOF SPEAKER/STROBE- WALL
	LOC	LOCAL OPERATING CONSOLE
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	INX	VOICE PANEL
	SCP	ELEVATOR CONTROL PANEL

N

E

S

W

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: XXXX

DESIGNED BY: XXXX

APPROVED BY: XXXX

DATE: XXXX

SCALE: N.T.S.

PROJECT NO: XXXX

REVISION NO: XXXX

DRAWING NAME:
UOFU HELIX OFFICE BLDG 2.DWG

NELSON FIRE SYSTEMS

SECOND LEVEL

ADDRESS

PAGE:

FINAL MAP



THIRD LEVEL

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
	S	SMOKE DETECTOR
	H	HEAT DETECTOR
	P	PULL STATION
	DD	DUCT DETECTOR
	TS	TAMPER SWITCH
	WFS	WATERFLOW SWITCH
	CM	CONTROL MODULE
	CMS	CONTROL MODULE SUPERVISED
0	R	RELAY
78	SSW	SPEAKER/STROBE- WALL
11	SSC	SPEAKER/STROBE- CEILING
0	WPSW	WEATHERPROOF SPEAKER/STROBE- WALL
	LOC	LOCAL OPERATING CONSOLE
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	VX	VOICE PANEL
	ECP	ELEVATOR CONTROL PANEL

N

E

S

W

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: XXXX

DESIGNED BY: XXXX

APPROVED BY: XXXX

DATE: XXXX

SCALE: XXXX

PROJECT NO: XXXX

REVISION NO: XXXX

DRAWING NAME:
UOFU HELIX OFFICE BLDG 3.DWG


NELSON FIRE SYSTEMS

THIRD LEVEL

ADDRESS HERE

PAGE:

FINAL MAP

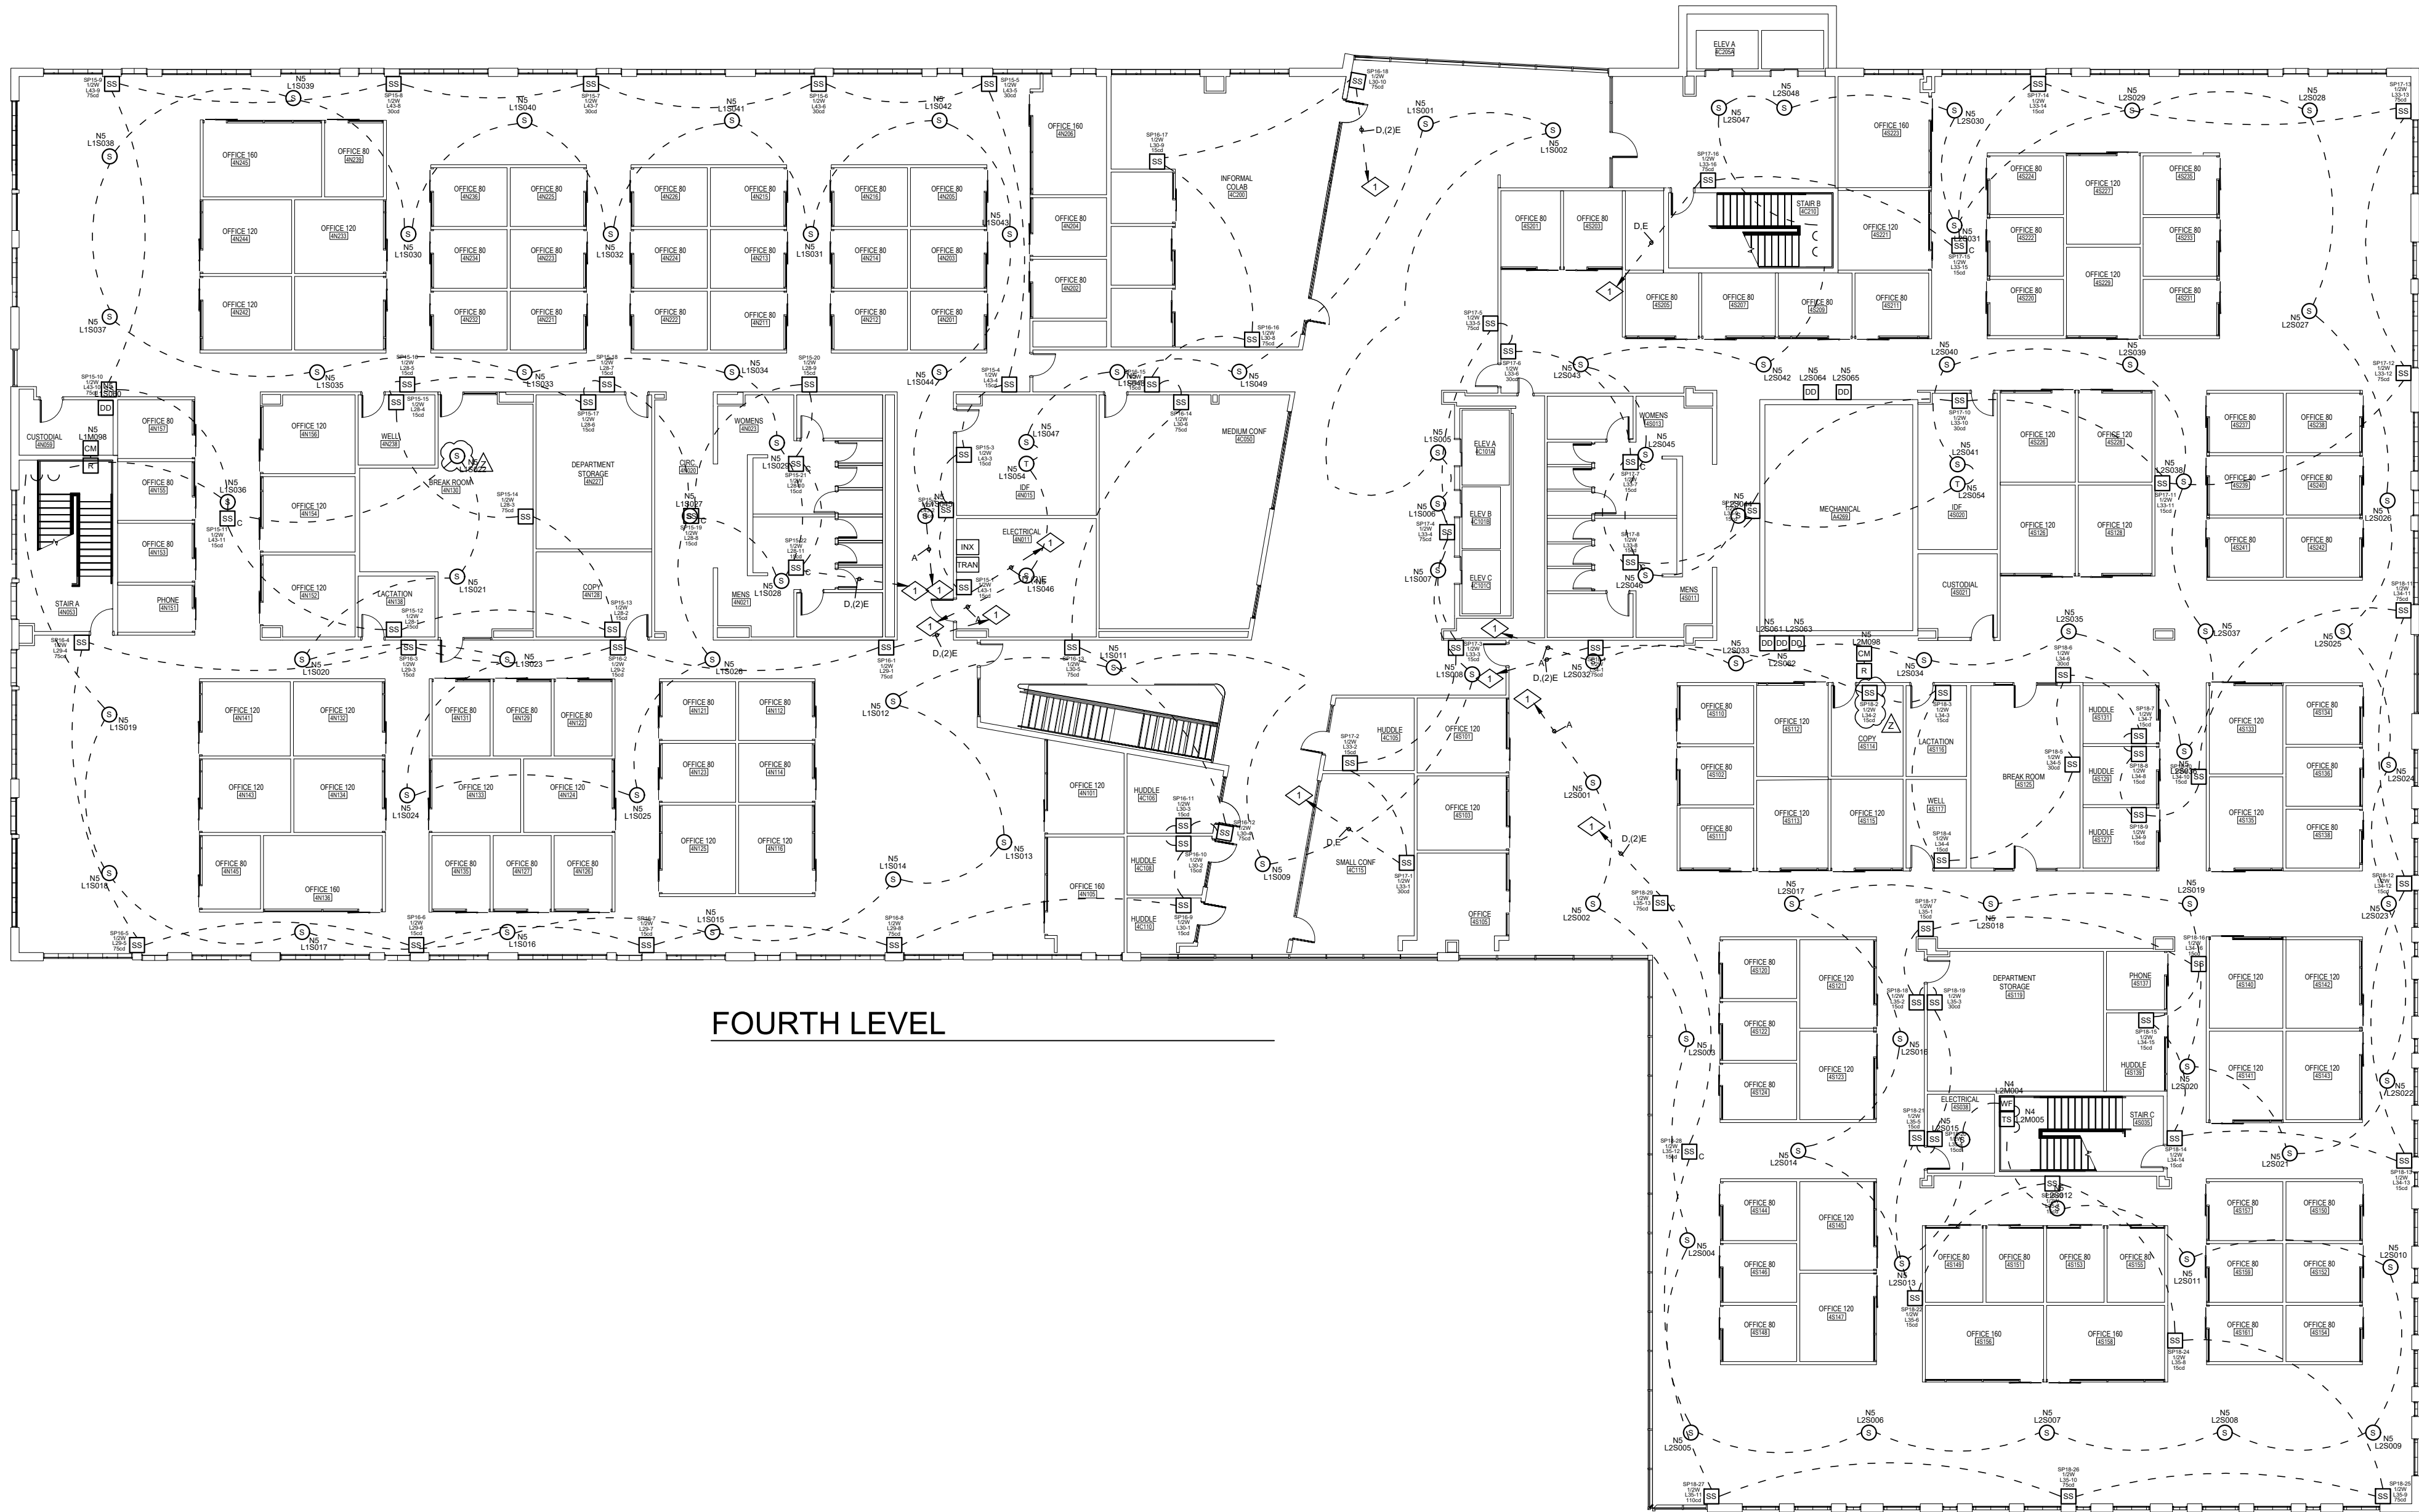

FOURTH LEVEL

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
	S	SMOKE DETECTOR
	H	HEAT DETECTOR
	P	PULL STATION
	DD	DUCT DETECTOR
	TS	TAMPER SWITCH
	WFS	WATERFLOW SWITCH
	CM	CONTROL MODULE
	CS	CONTROL MODULE SUPERVISED
0	R	RELAY
76	BS	SPEAKER/STROBE- WALL
9	BS	SPEAKER/STROBE- CEILING
0	BS WP	WEATHERPROOF SPEAKER/STROBE- WALL
	LOC	LOCAL OPERATING CONSOLE
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	INX	VOICE PANEL
	SCP	ELEVATOR CONTROL PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: XXXX
DESIGNED BY: XXXX
APPROVED BY: XXXX
DATE: XXXX
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
UOFU HELIX OFFICE BLDG 4.DWG

NELSON FIRE SYSTEMS
FOURTH LEVEL
ADDRESS: 30 NORTH MARIO CAPECCHI DRIVE

PAGE:
FINAL MAP



FIFTH LEVEL

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
	S	SMOKE DETECTOR
	H	HEAT DETECTOR
	P	PULL STATION
	DD	DUCT DETECTOR
	TS	TAMPER SWITCH
	WFS	WATERFLOW SWITCH
	CM	CONTROL MODULE
	CM-S	CONTROL MODULE SUPERVISED
0	R	RELAY
74	BS	SPEAKER/STROBE- WALL
11	BS-C	SPEAKER/STROBE- CEILING
0	BS-WP	WEATHERPROOF SPEAKER/STROBE- WALL
	LOC	LOCAL OPERATING CONSOLE
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	VPK	VOICE PANEL
	ECP	ELEVATOR CONTROL PANEL

N

E

S

W

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
HEALTH SCIENCE HELIX OFFICE BUILDING
30 NORTH MARIO CAPECCHI DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300



DRAWN BY:	XXXX
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	XXXX
SCALE:	XXXX
PROJECT NO:	XXXX
REVISION NO:	XXXX
DRAWING NAME:	UOFU HELIX OFFICE BLDG 5.DWG

NELSON FIRE SYSTEMS
FIFTH LEVEL
ADDRESS HERE

PAGE:
FIFTH LEVEL

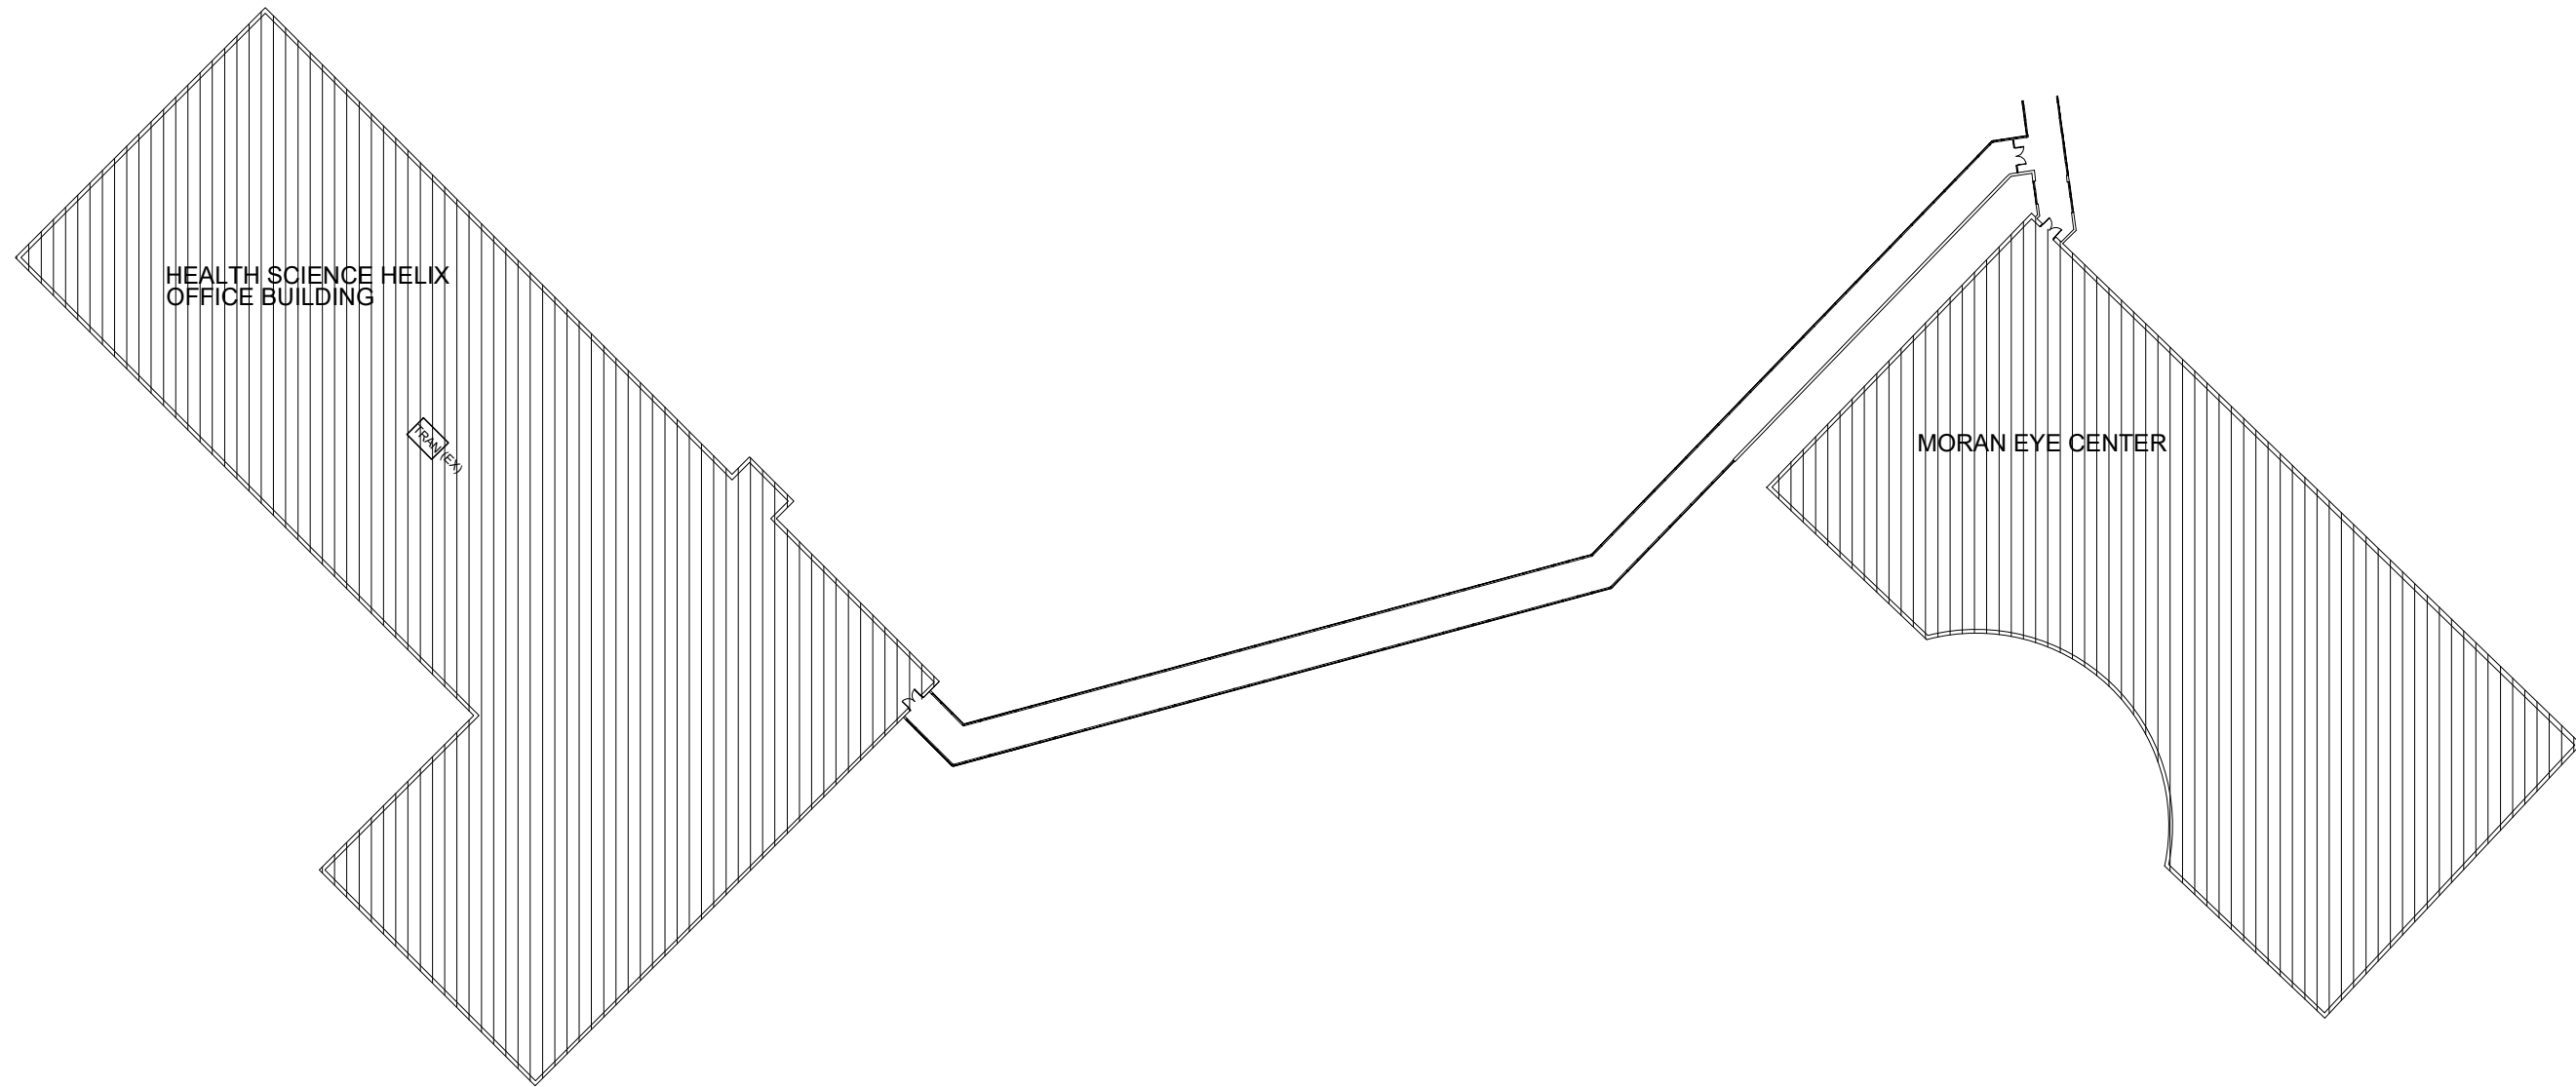

KEY PLAN:

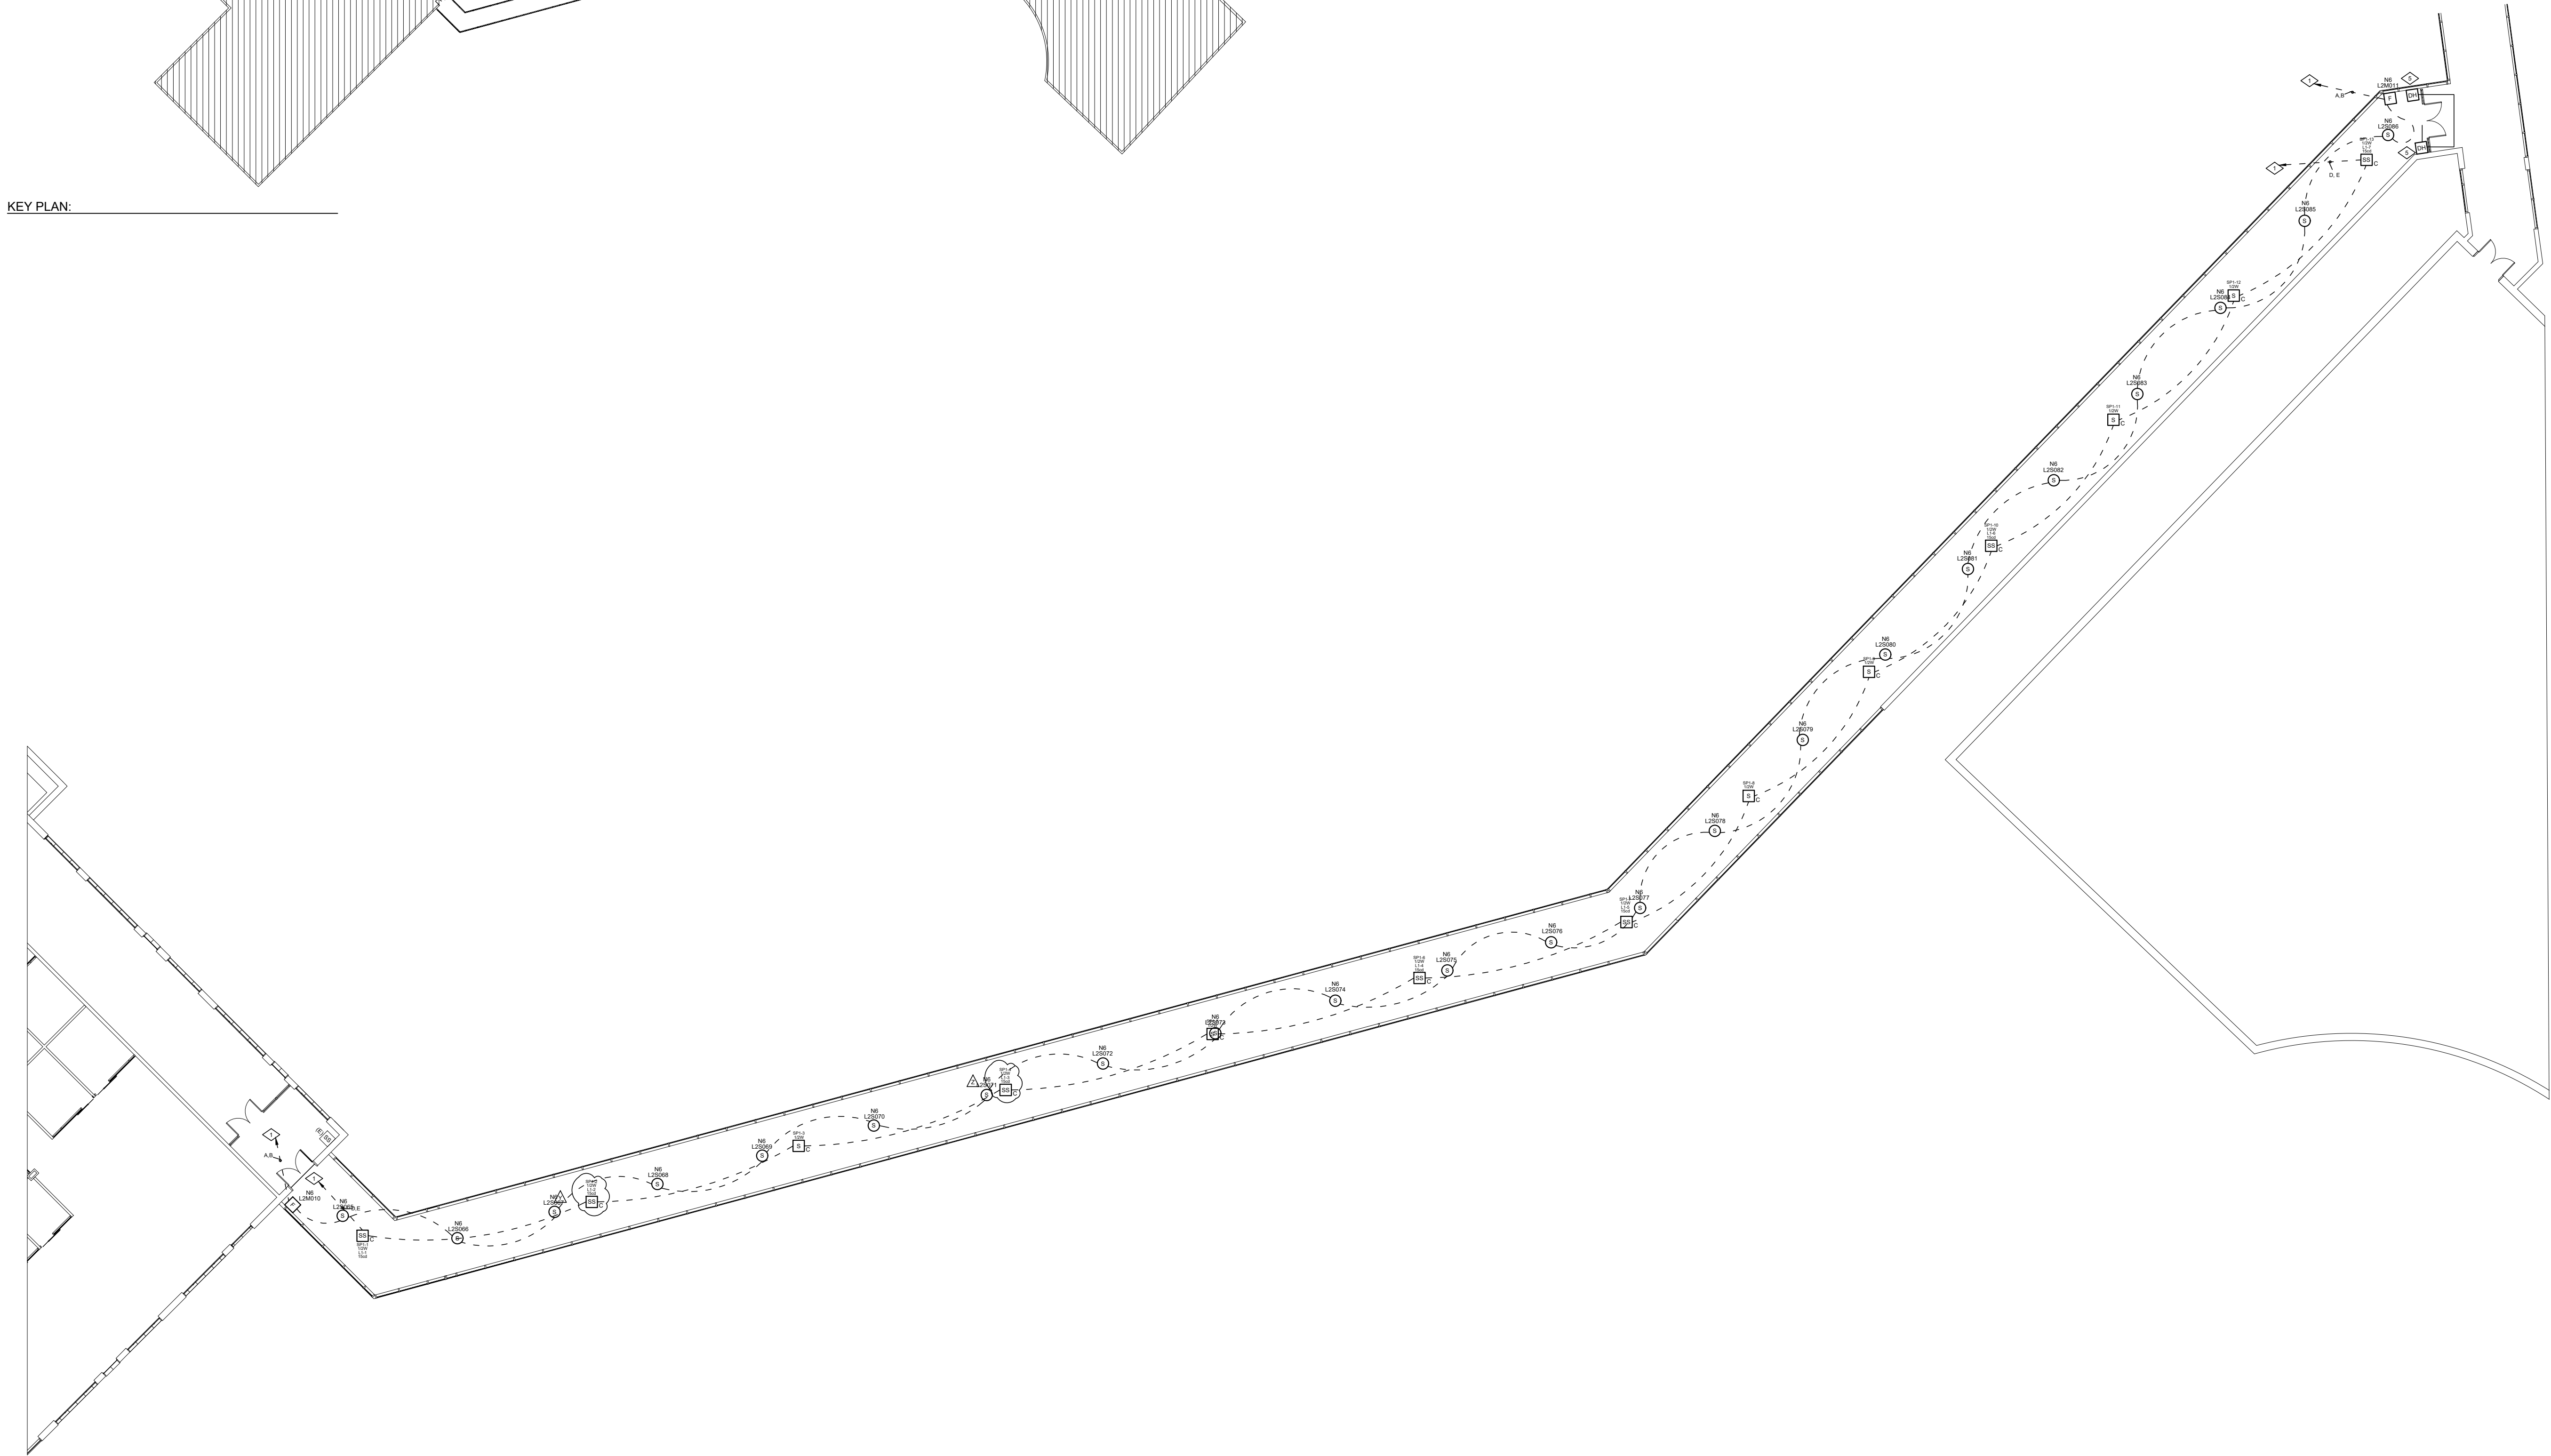

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
		SMOKE DETECTOR
		PULL STATION
		CONTROL MODULE SUPERVISED
1		RELAY
2		DOOR HOLDER (SUPPLIED BY OTHERS)
7		SPEAKER STROBE- CEILING
6		SPEAKER ONLY- CEILING
		EX FIRE ALARM CONTROL UNIT
		EX TRANSPONDER PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

HELIX BRIDGE
UNIVERSITY OF UTAH
30 NORTH MARIO CAPECCHI DR
SALT LAKE CITY, UT 84102
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KR

DESIGNED BY: XXXX

APPROVED BY: KK

DATE: XXXX

SCALE: N.T.S.

PROJECT NO: XXXX

REVISION NO: XXXX

DRAWING NAME: UOFU HELIX BRIDGE.DWG

NELSON FIRE SYSTEMS

LEVEL 5 BRIDGE

ADDRESS HERE

PAGE:

FINAL MAP