




4TH LEVEL

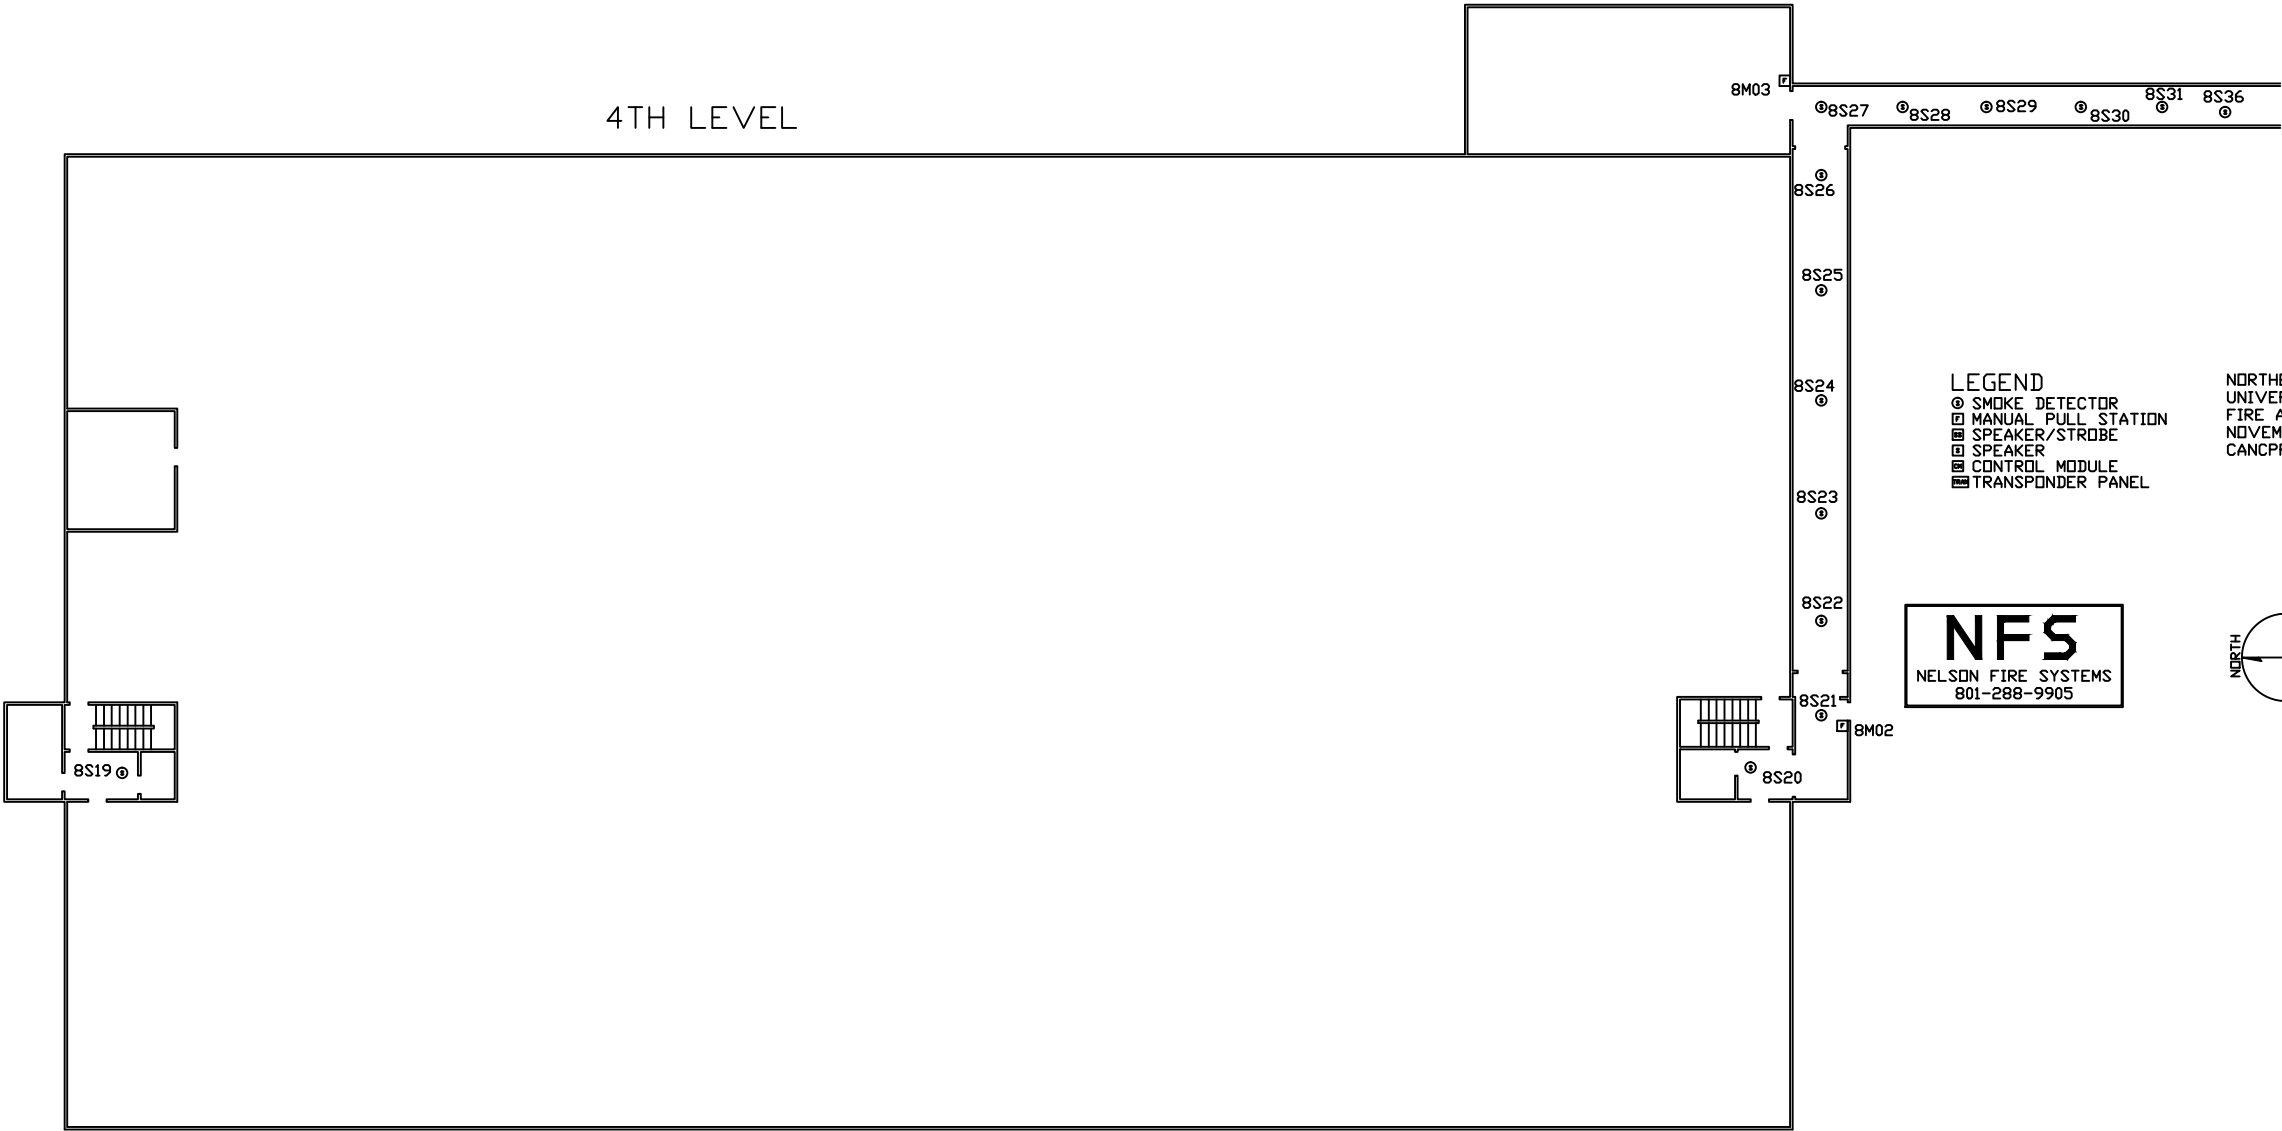

5TH LEVEL

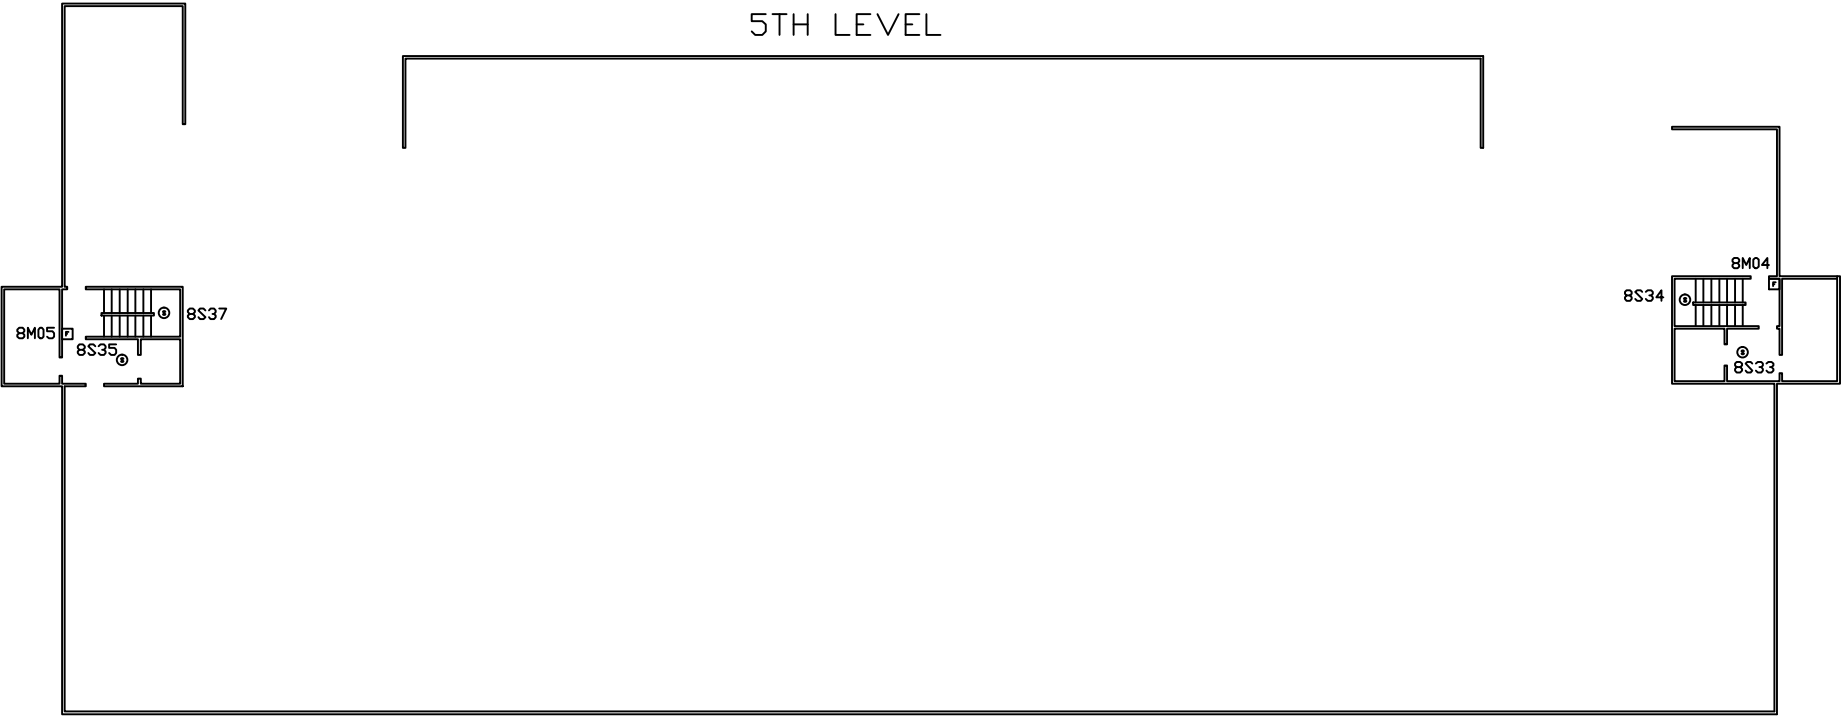

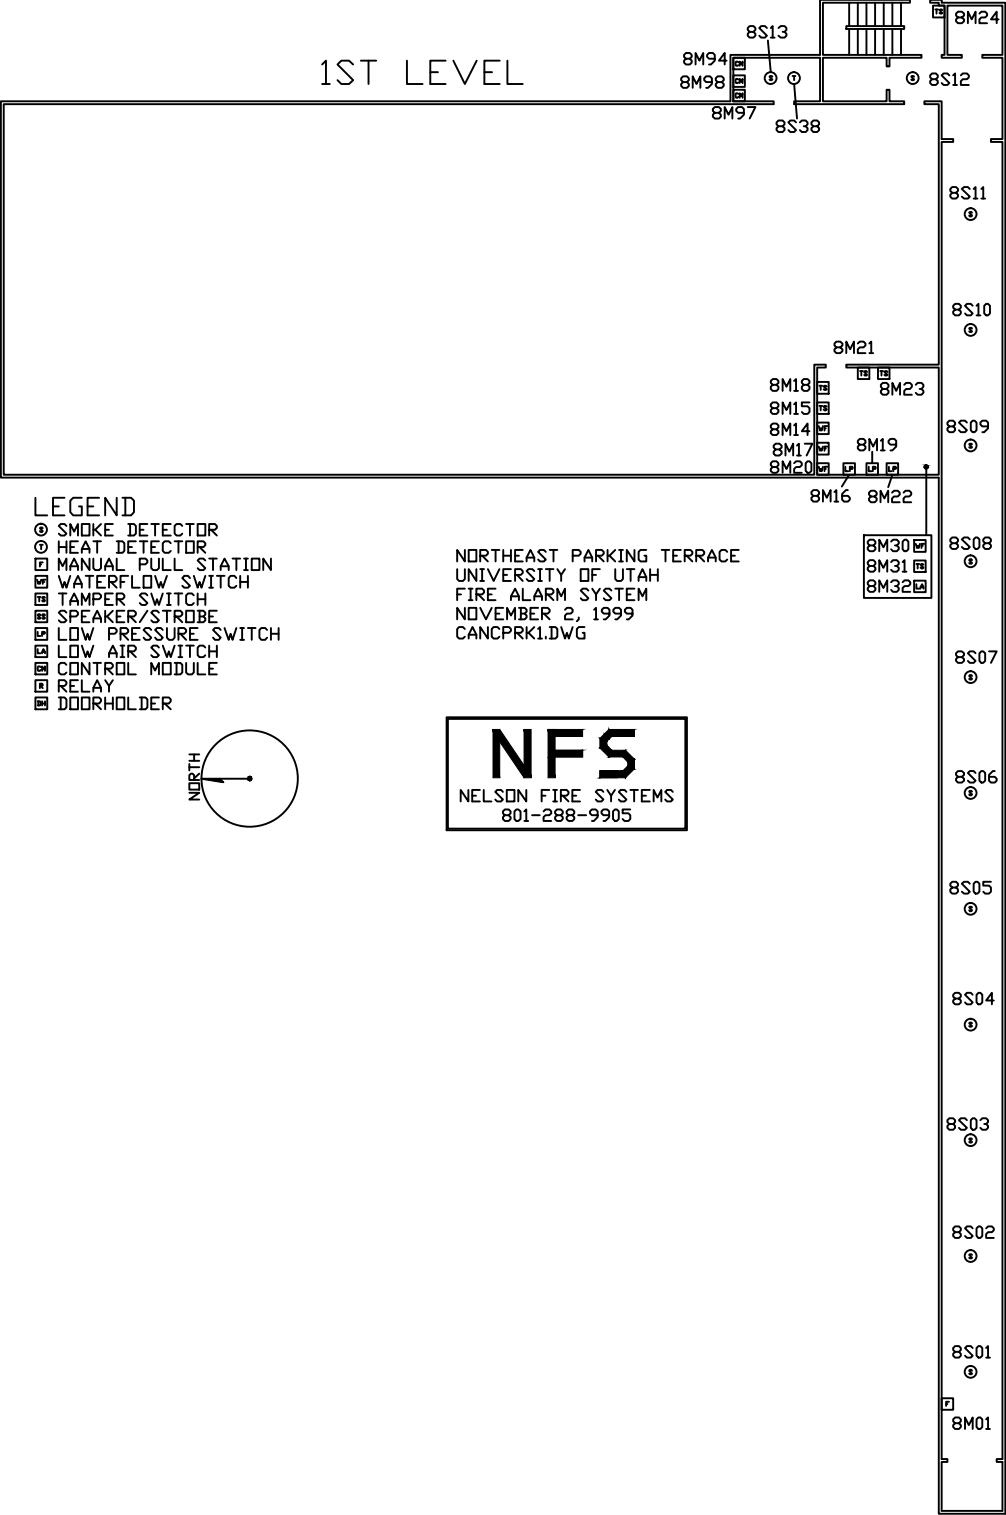


- LEGEND
- ⊙ SMOKE DETECTOR
 - ⊙ HEAT DETECTOR
 - MANUAL PULL STATION
 - WATERFLOW SWITCH
 - TAMPER SWITCH
 - SPEAKER/STROBE
 - LOW PRESSURE SWITCH
 - LOW AIR SWITCH
 - CONTROL MODULE
 - RELAY
 - DOORHOLDER

NORTHEAST PARKING TERRACE
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
NOVEMBER 2, 1999
CANCPRK1.DWG

NFS
NELSON FIRE SYSTEMS
801-288-9905

2ND LEVEL

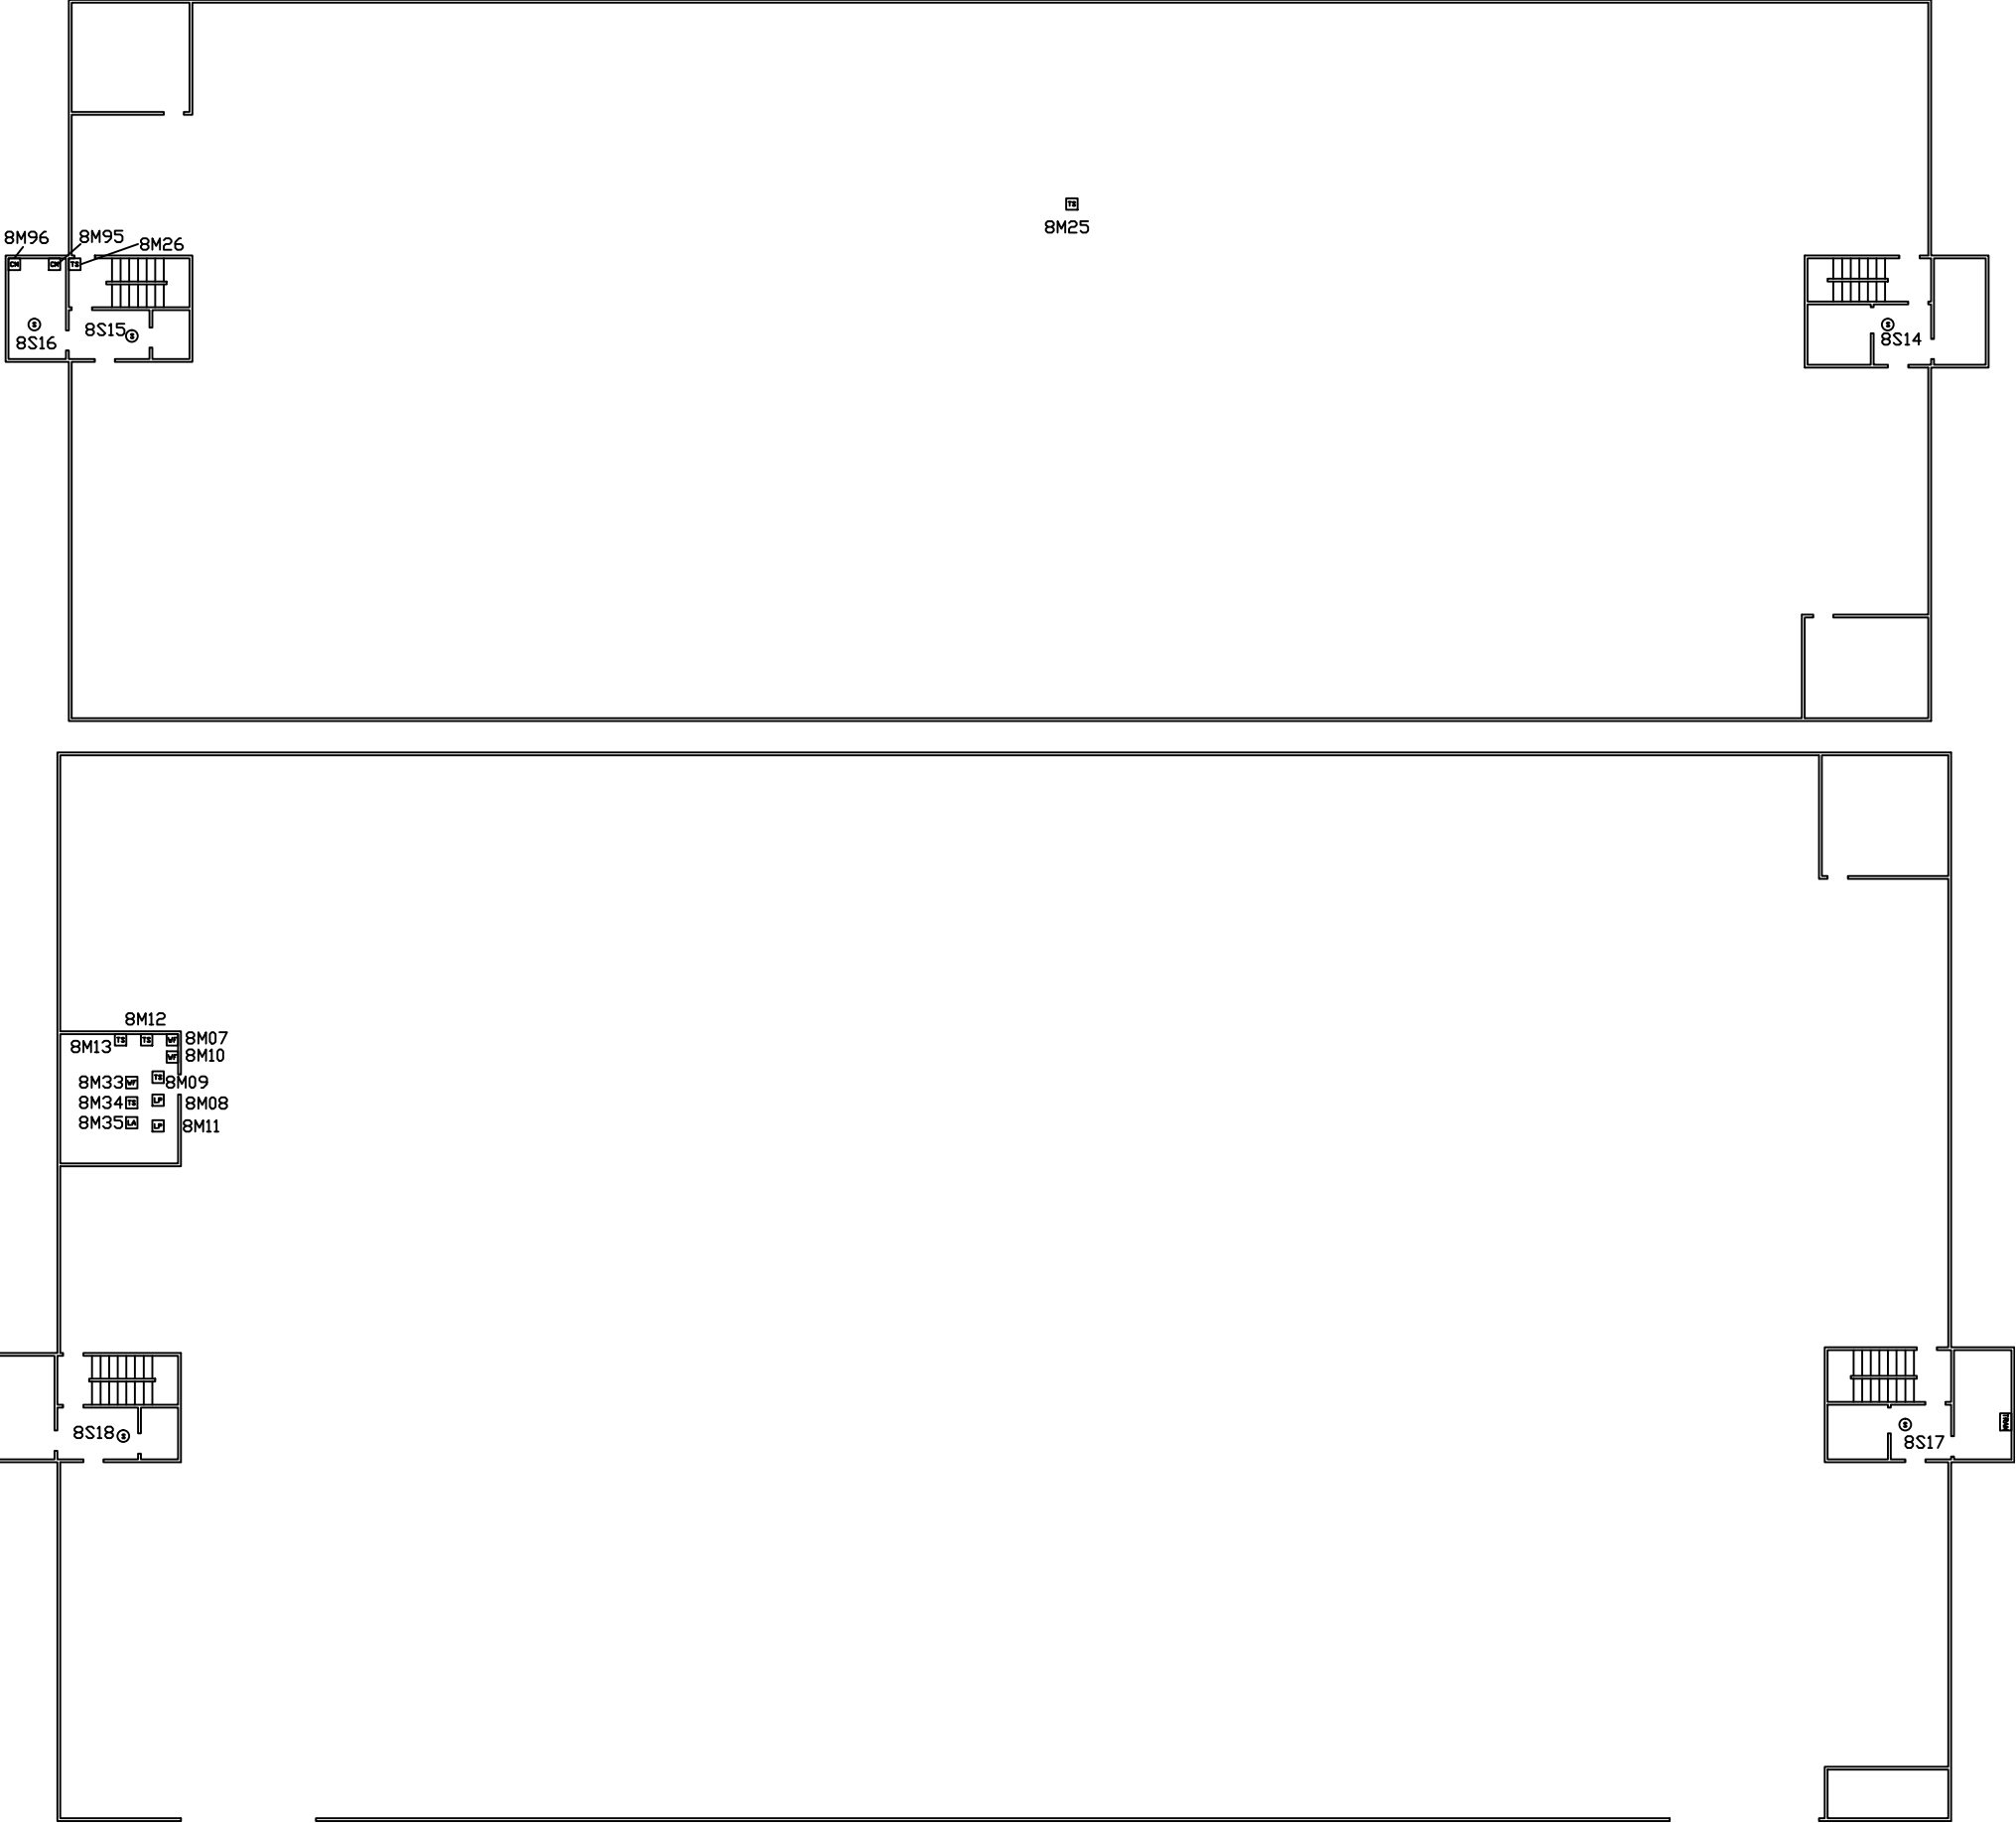

3RD LEVEL

