

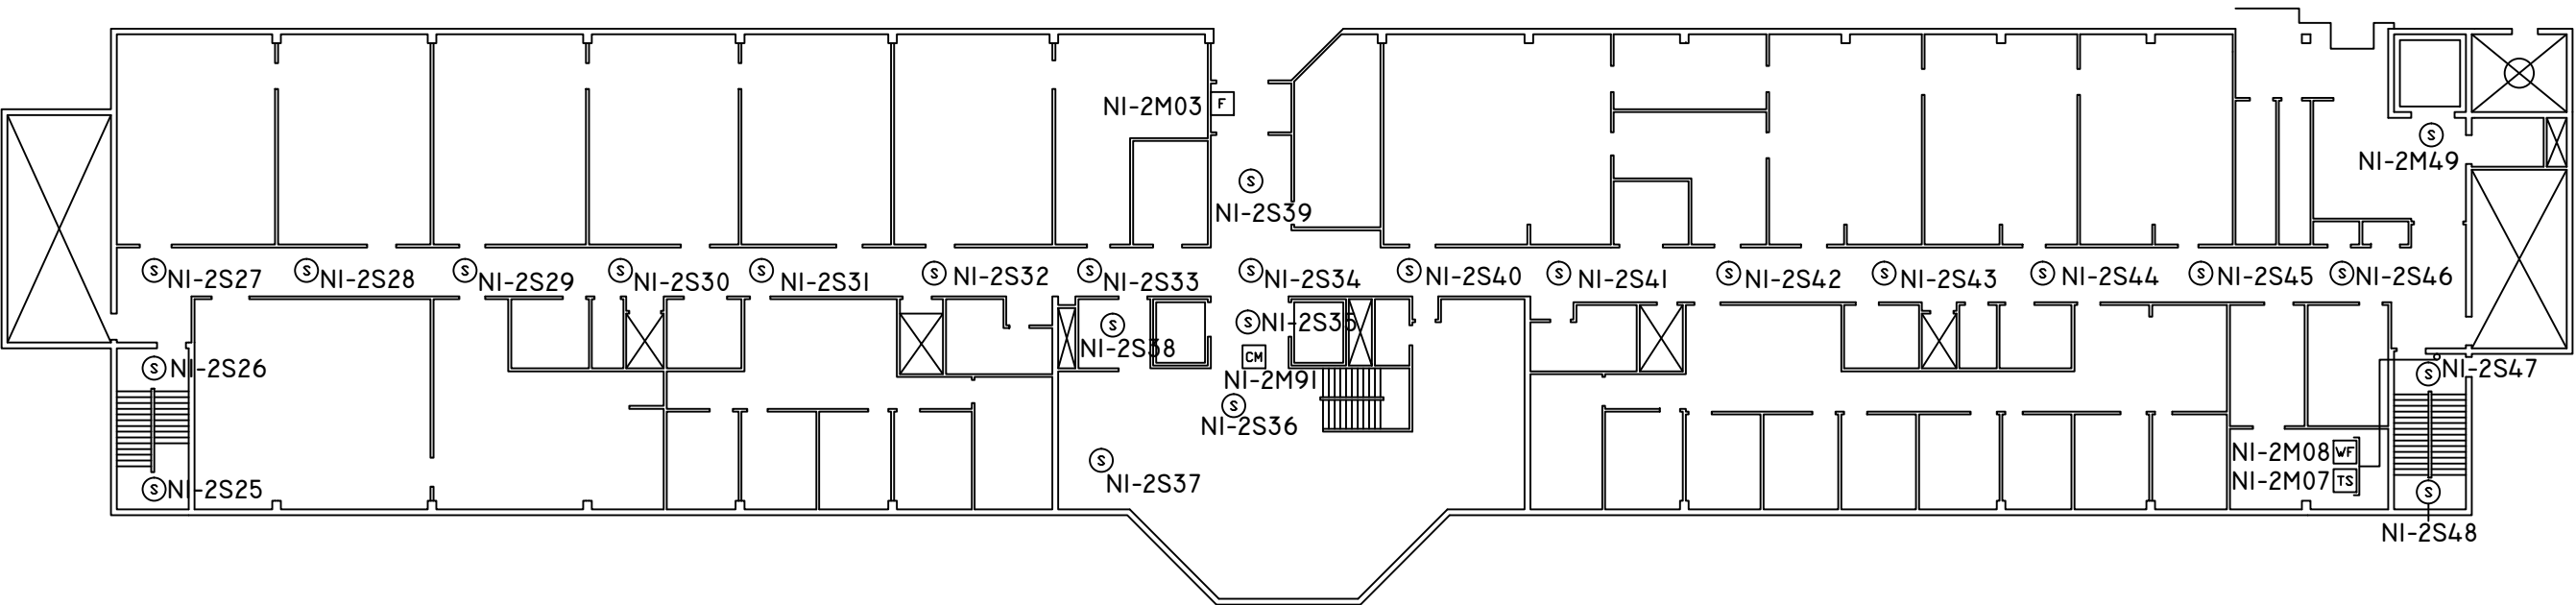


SECOND FLOOR



FIRST FLOOR

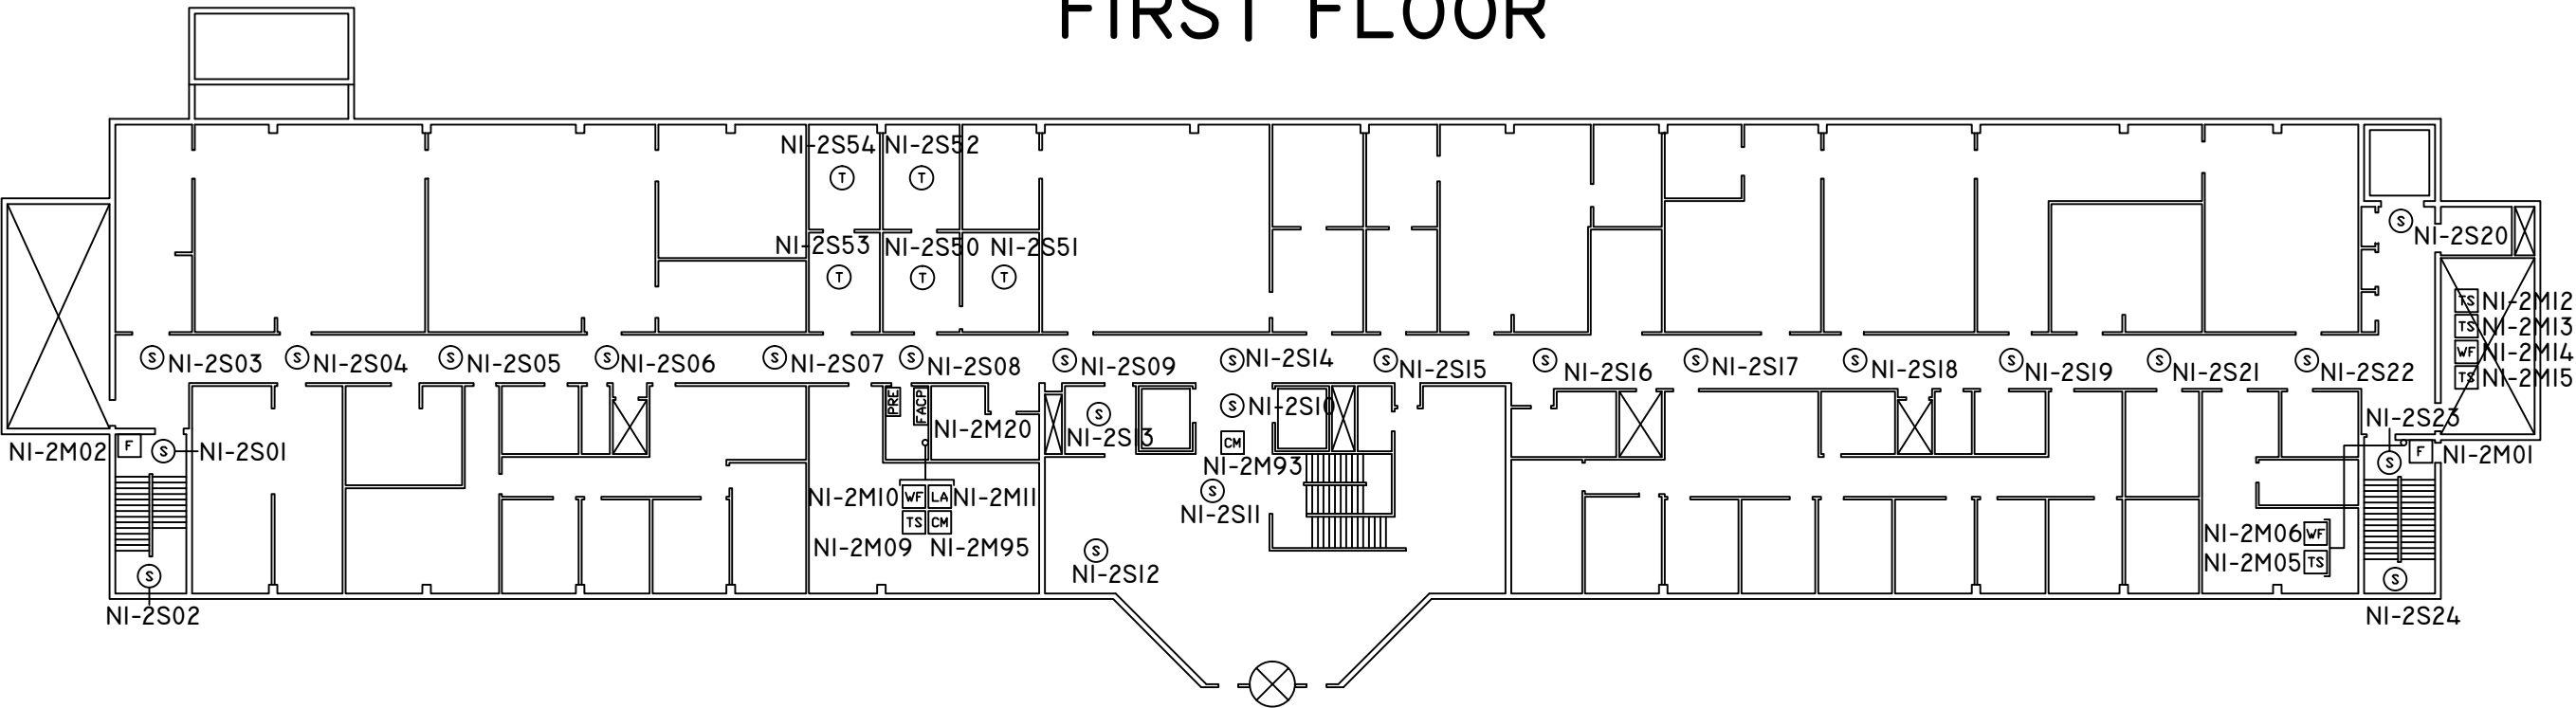

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
POLYMERS BUILDING
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300



DRAWN BY:	ZM
DESIGNED BY:	XXXX
APPROVED BY:	BN
DATE:	10/25/05
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	POLYMERSI&2.dwg

FIRE ALARM SYSTEM
DEVICE NUMBERS

FOURTH FLOOR

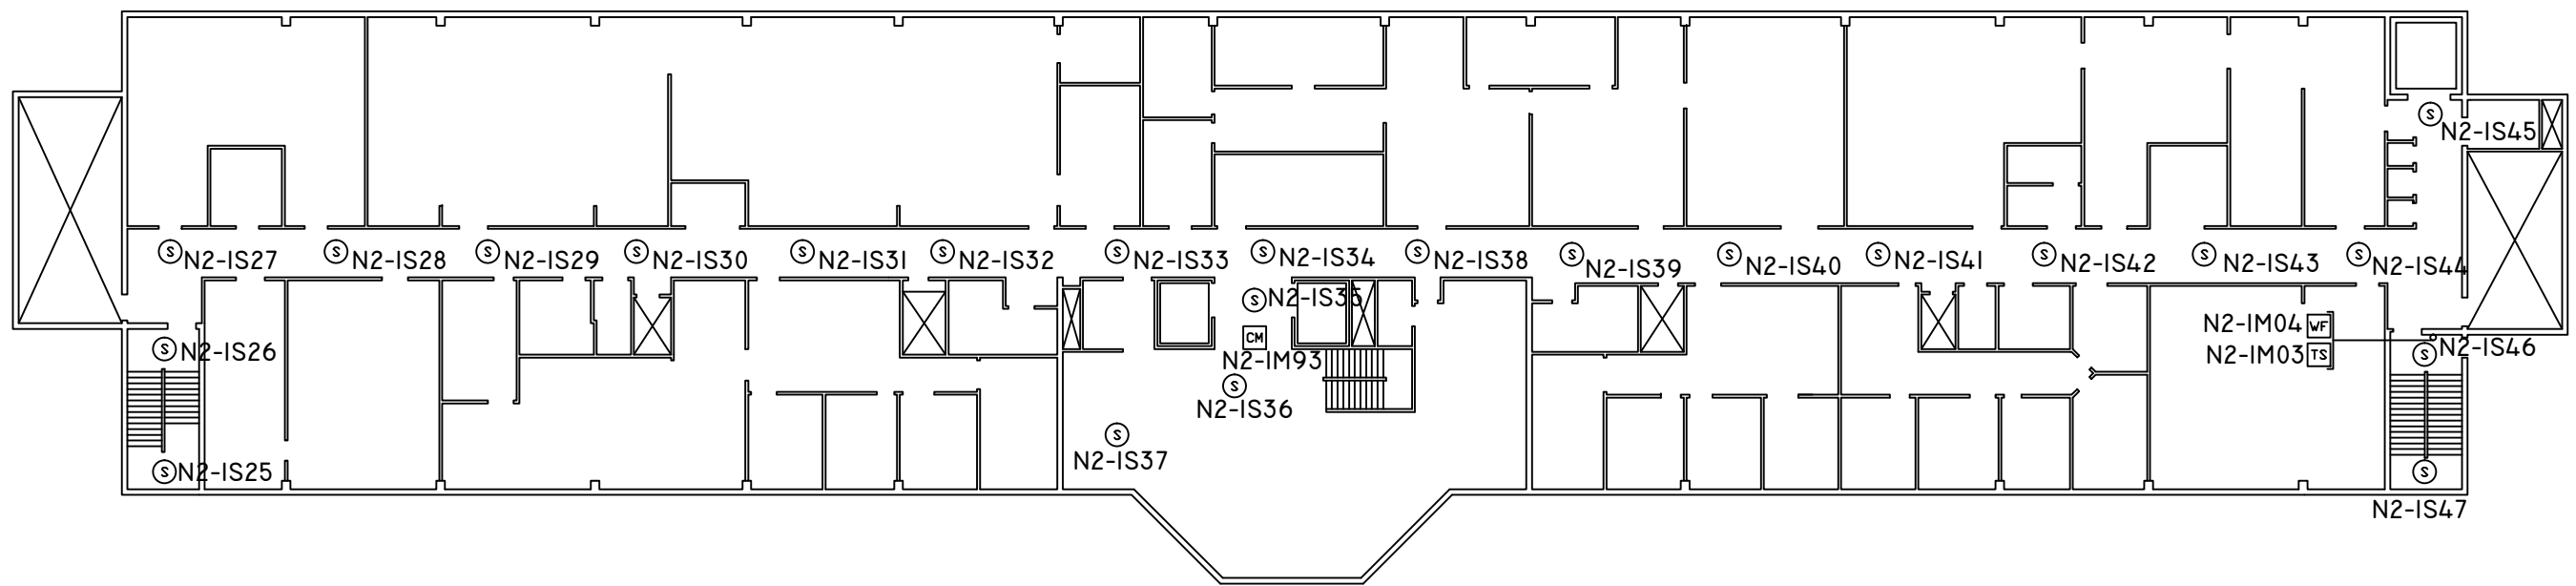

THIRD FLOOR

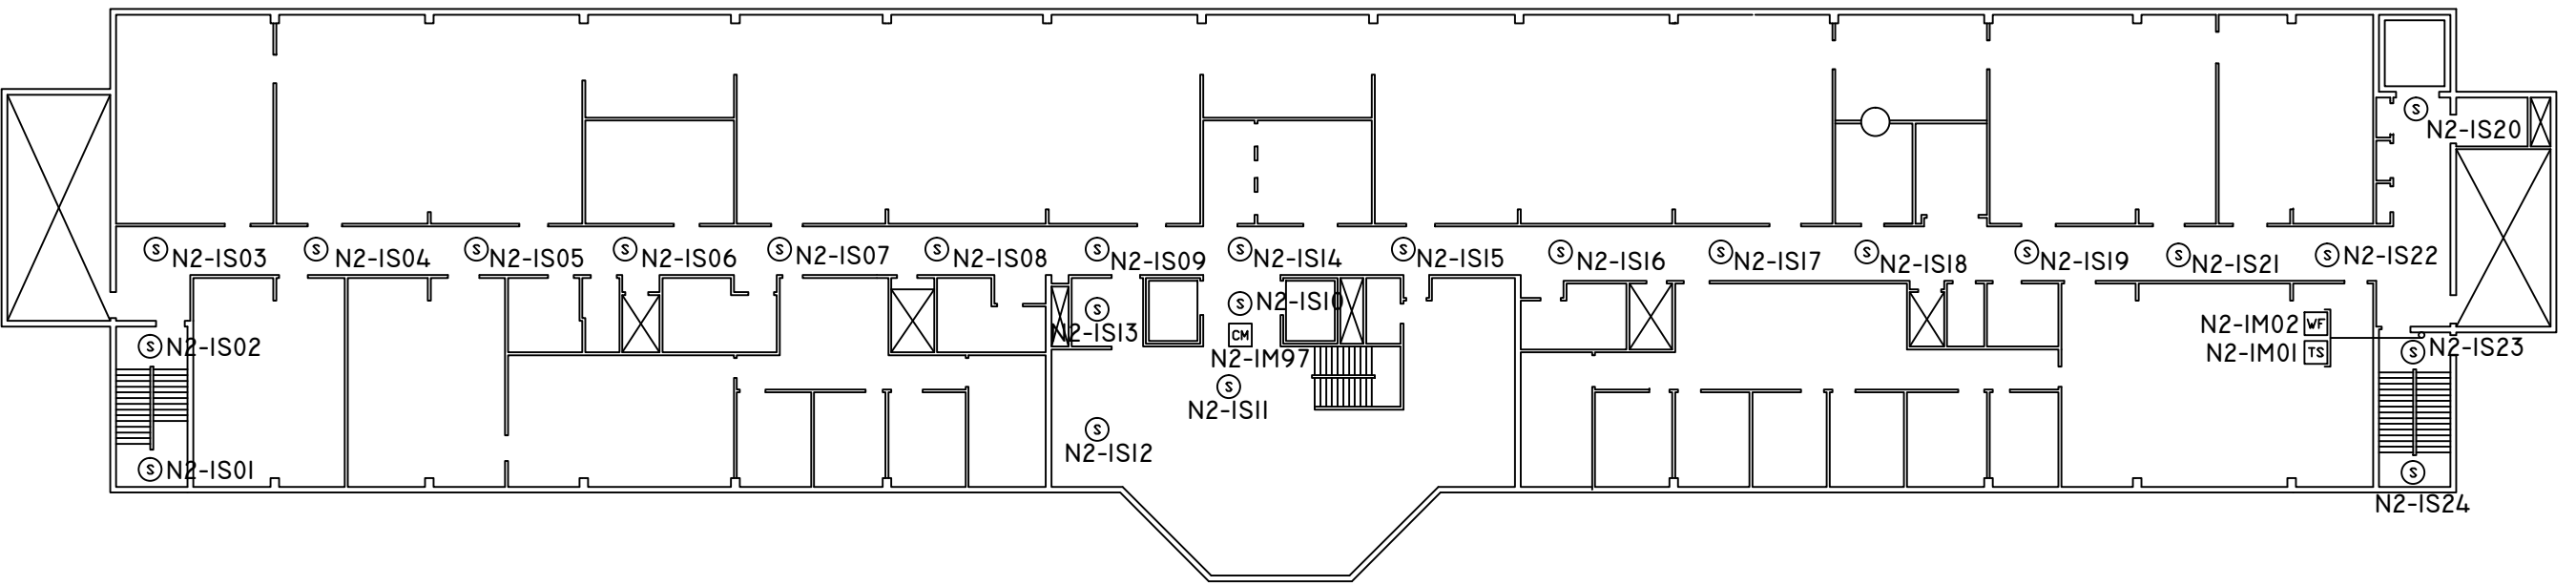

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
POLYMERS BUILDING
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300



DRAWN BY:	ZM
DESIGNED BY:	XXXX
APPROVED BY:	BN
DATE:	10/25/05
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	POLYMERS3&4.DWG

FIRE ALARM SYSTEM
DEVICE NUMBERS

PENTHOUSE

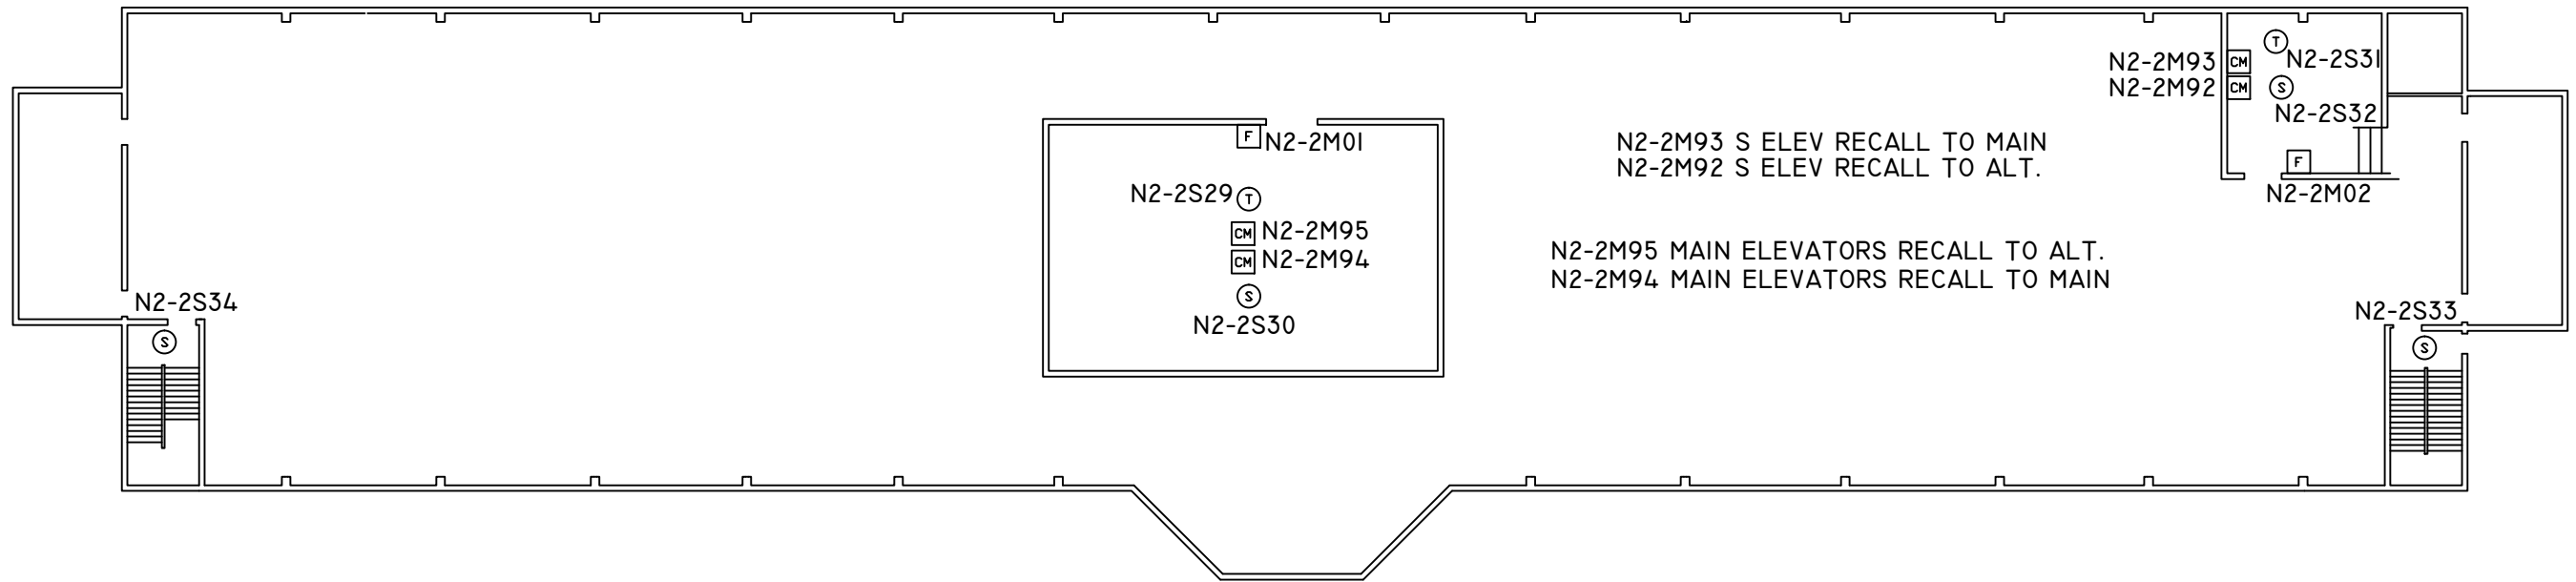

FIFTH FLOOR

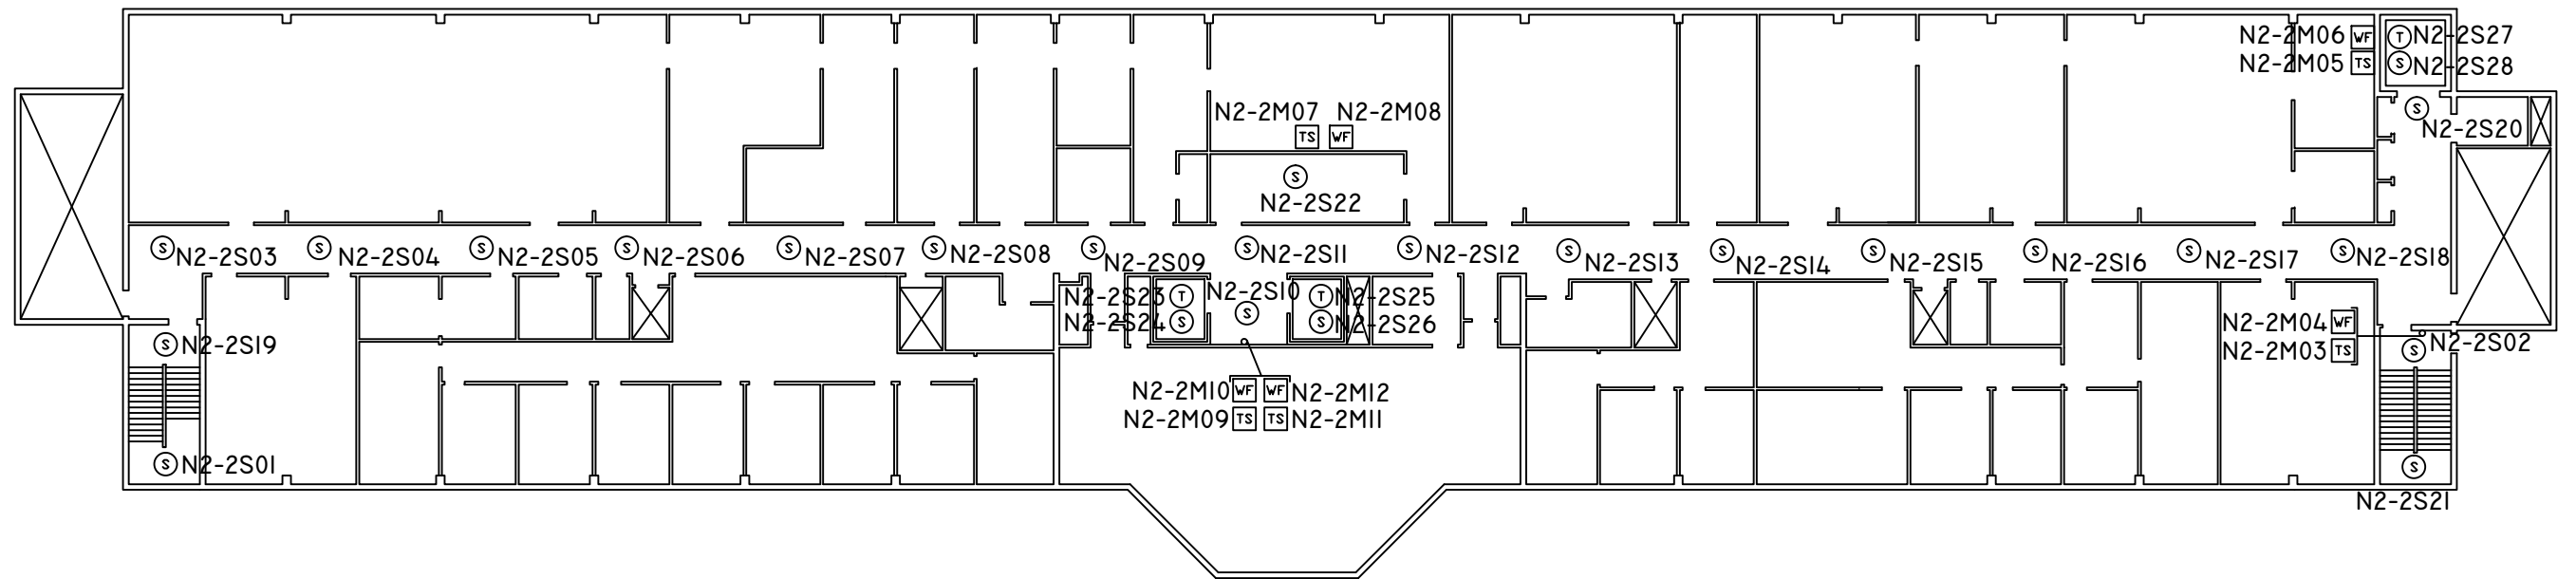

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
POLYMERS BUILDING
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: ZM
DESIGNED BY: XXXX
APPROVED BY: BN
DATE: 10/25/05
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
POLYMERS5&P.dwg

FIRE ALARM SYSTEM

DEVICE NUMBERS

PAGE:

FA-4



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
POLYMERS BUILDING
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: ZM
DESIGNED BY: XXXX
APPROVED BY: BN
DATE: 10/25/05
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
POLYMERSB.DWG


FIRE ALARM SYSTEM

DEVICE NUMBERS


PAGE:

FA-I

BASEMENT

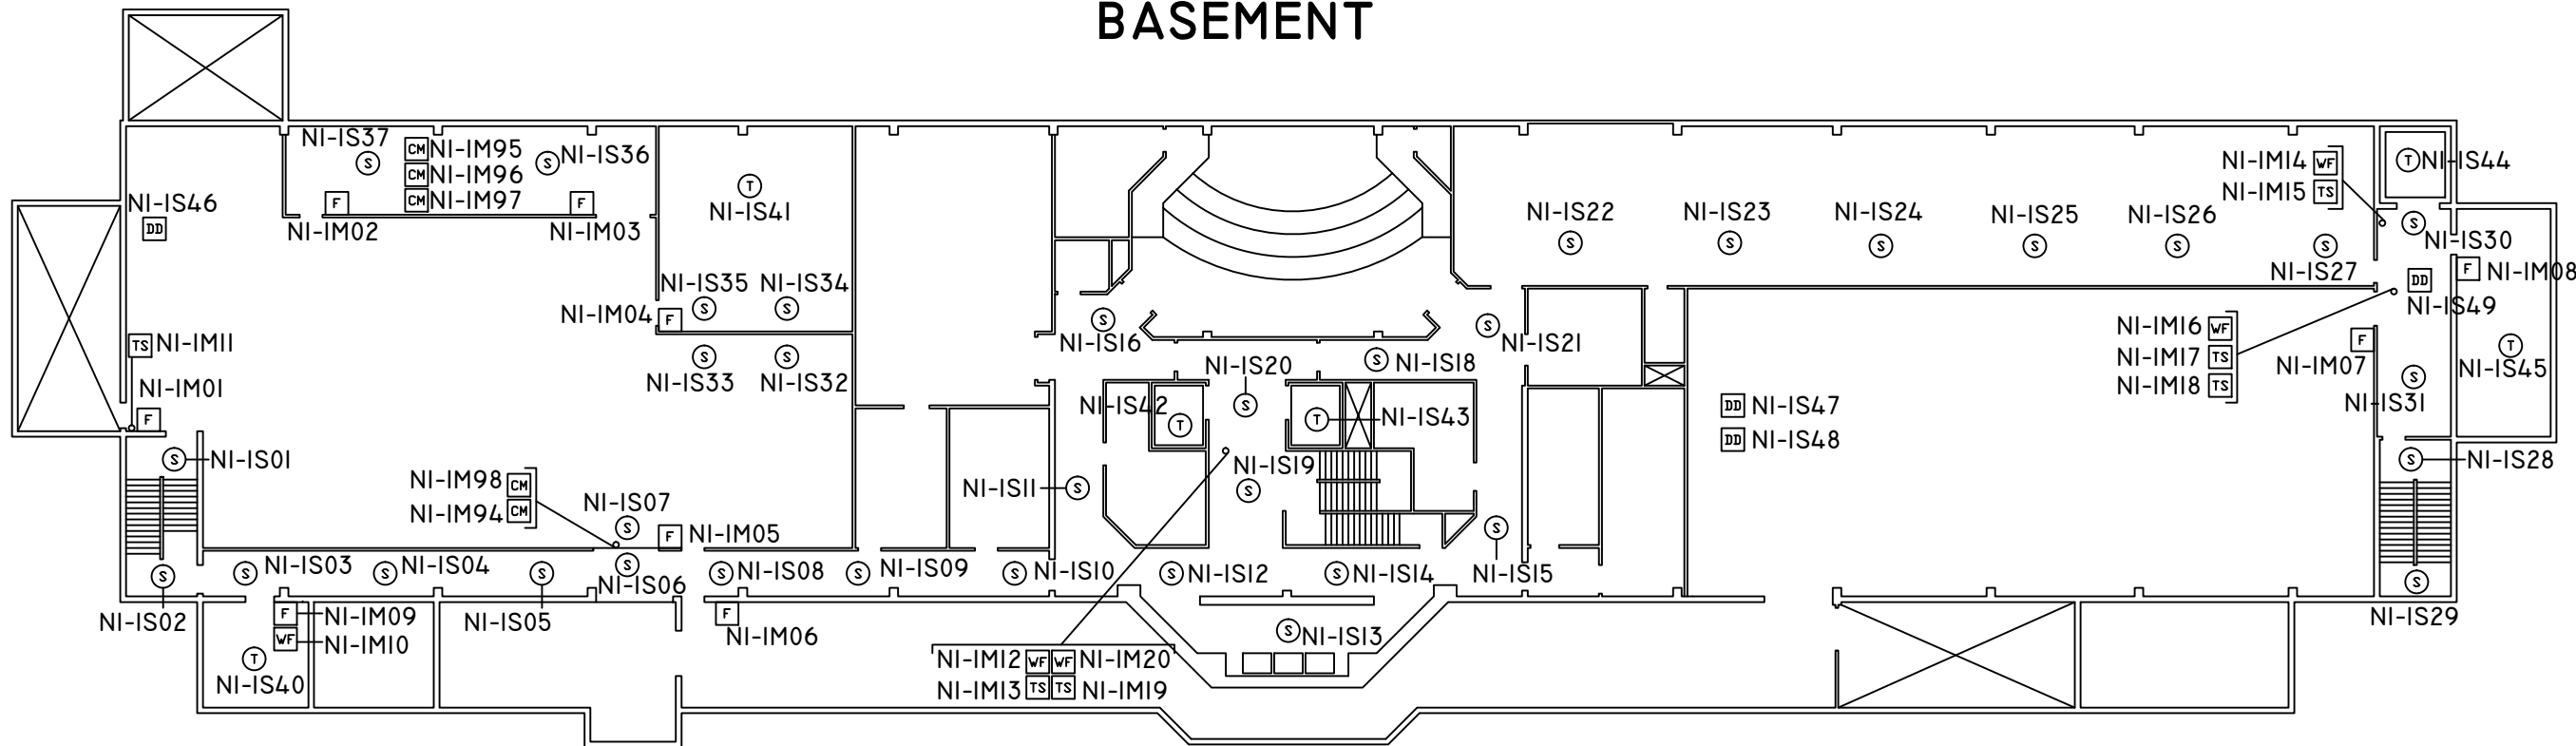

ADDRESS LABEL CLARIFICATION

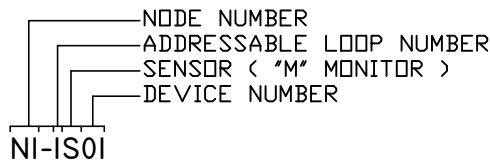

DEVICE LEGEND

SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(DD)	DUCT SMOKE DETECTOR
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(LA)	LOW AIR PRESSURE SWITCH
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(R)	RELAY- ARB-C
(DH)	DOORHOLDER
(RA)	REMOTE ANNUNCIATOR ENCLOSURE
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL