



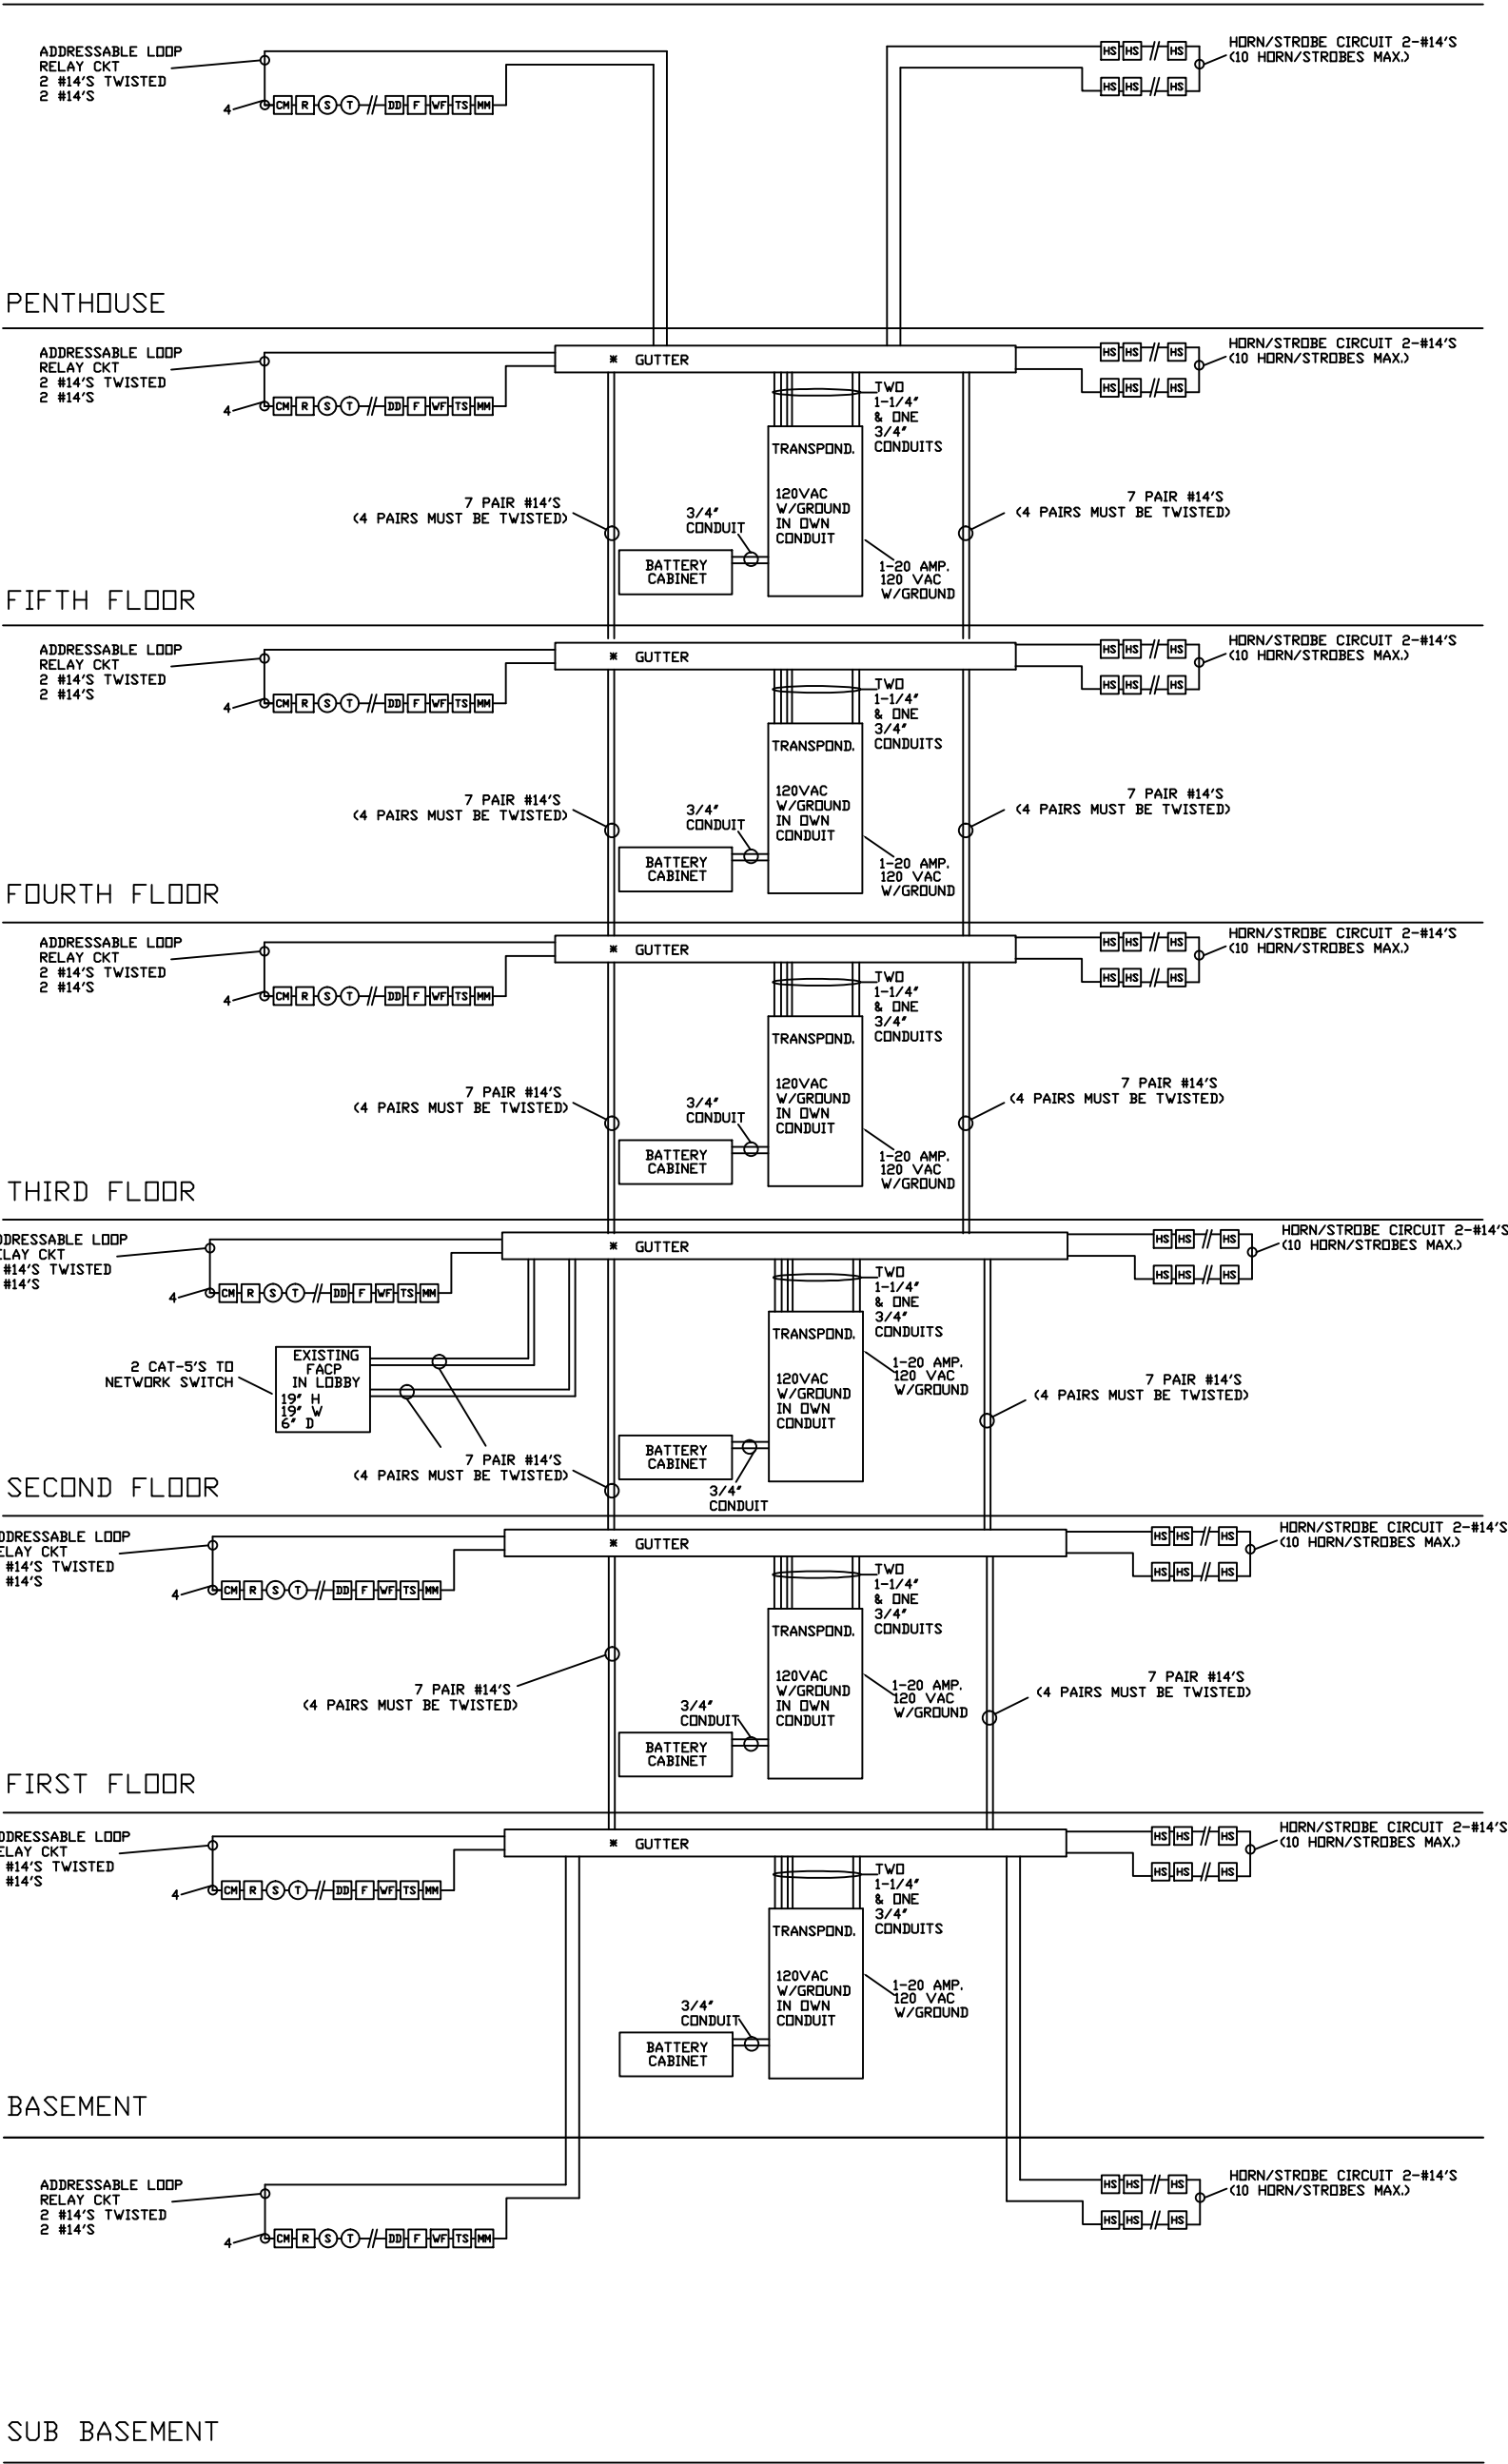

* GUTTERS SUPPLIED BY OTHERS

PAGE: FA-R-01	FIRE ALARM SYSTEM BUILDING RISER	DRAWING NAME: NURSING BUILDING	PROJECT NO.: XXXX	SCALE: NTS	DATE: 9/25/09	DESIGNED BY: DS	APPROVED BY: JUG	NFS NELSON FIRE SYSTEMS 801-468-8300	COLLEGE OF NURSING UNIVERSITY OF UTAH BUILDING RISER FIRE ALARM SYSTEM	NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

GUTTER SUPPLIED BY OTHER

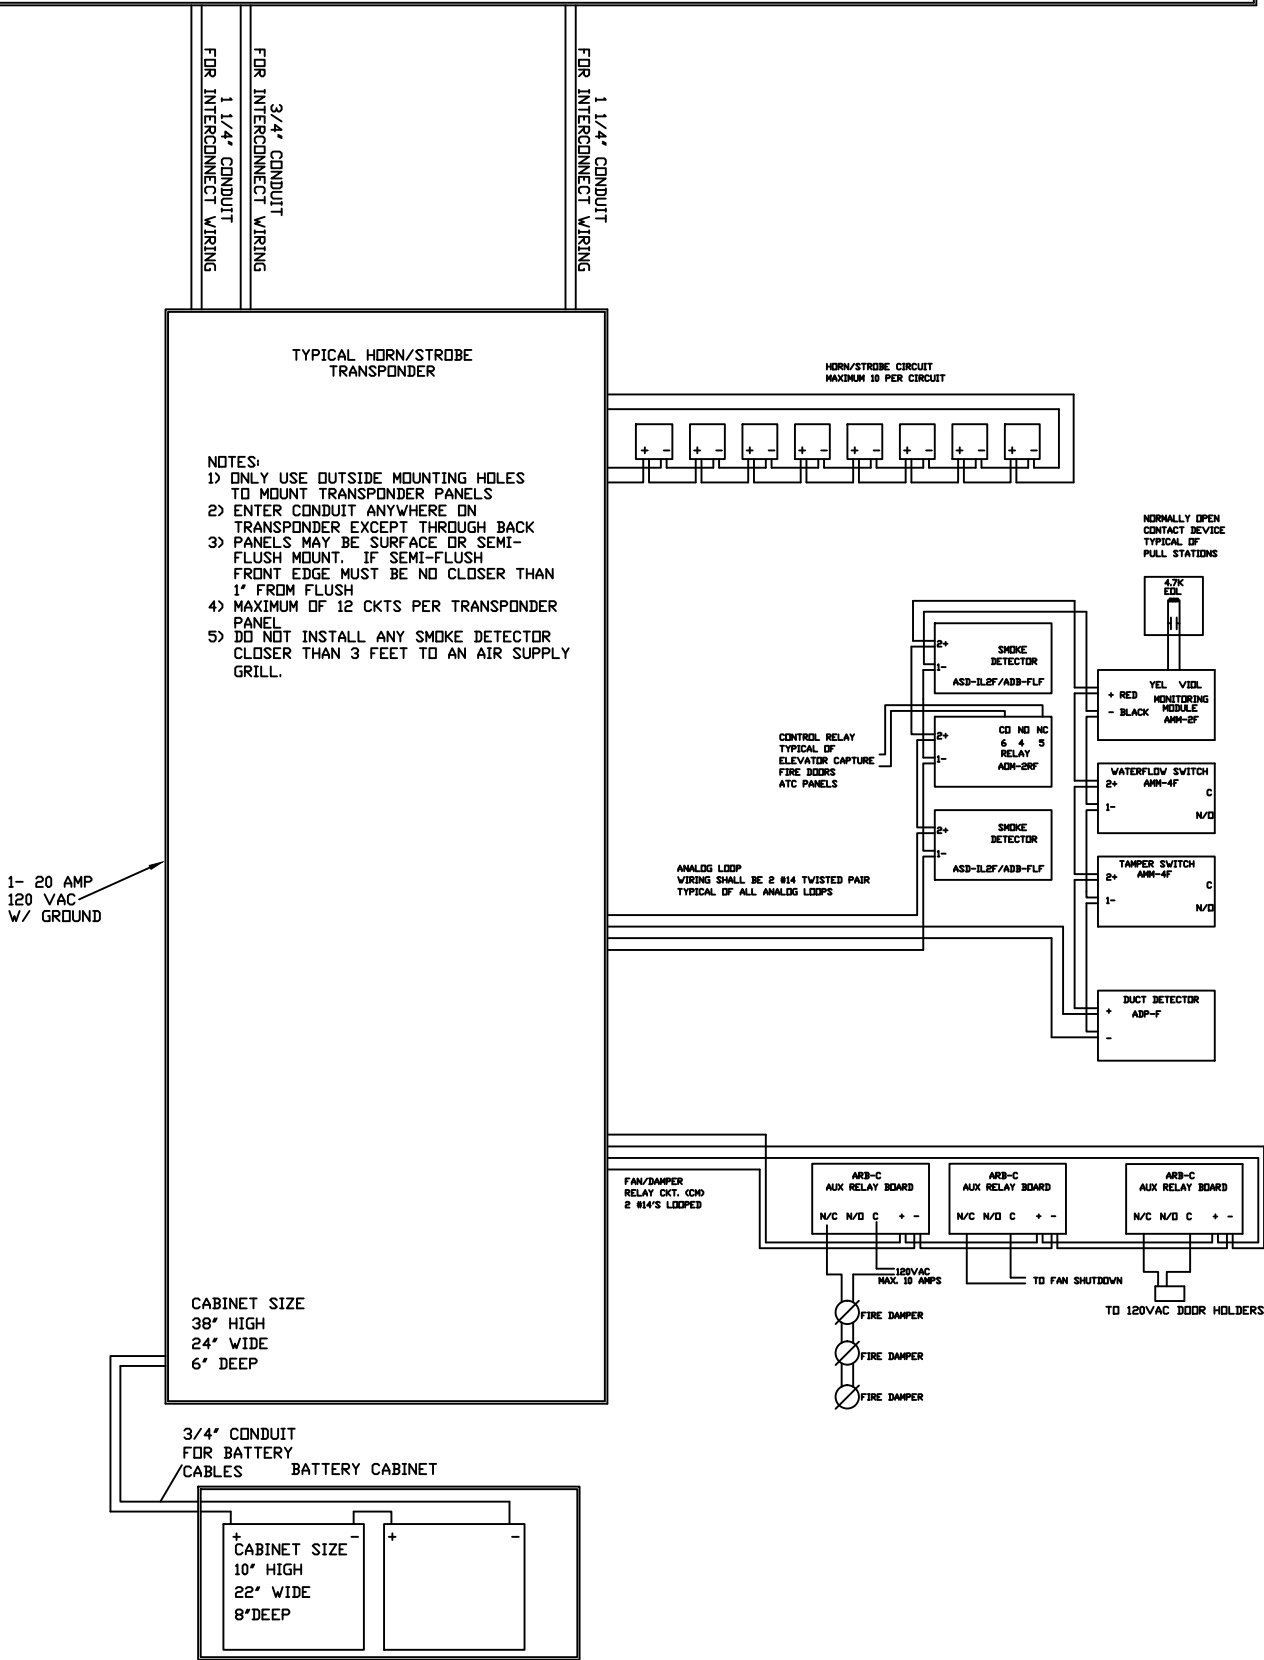

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
TYPICAL RISER
FIRE ALARM SYSTEM


NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DS
DATE: 9/25/09
SCALE: NTS
PROJECT NO:
REV NO: I
DRAWING NAME:
NURSING F2.DWG



FIRE ALARM SYSTEM
TYPICAL RISER

PAGE:
FA-R-02

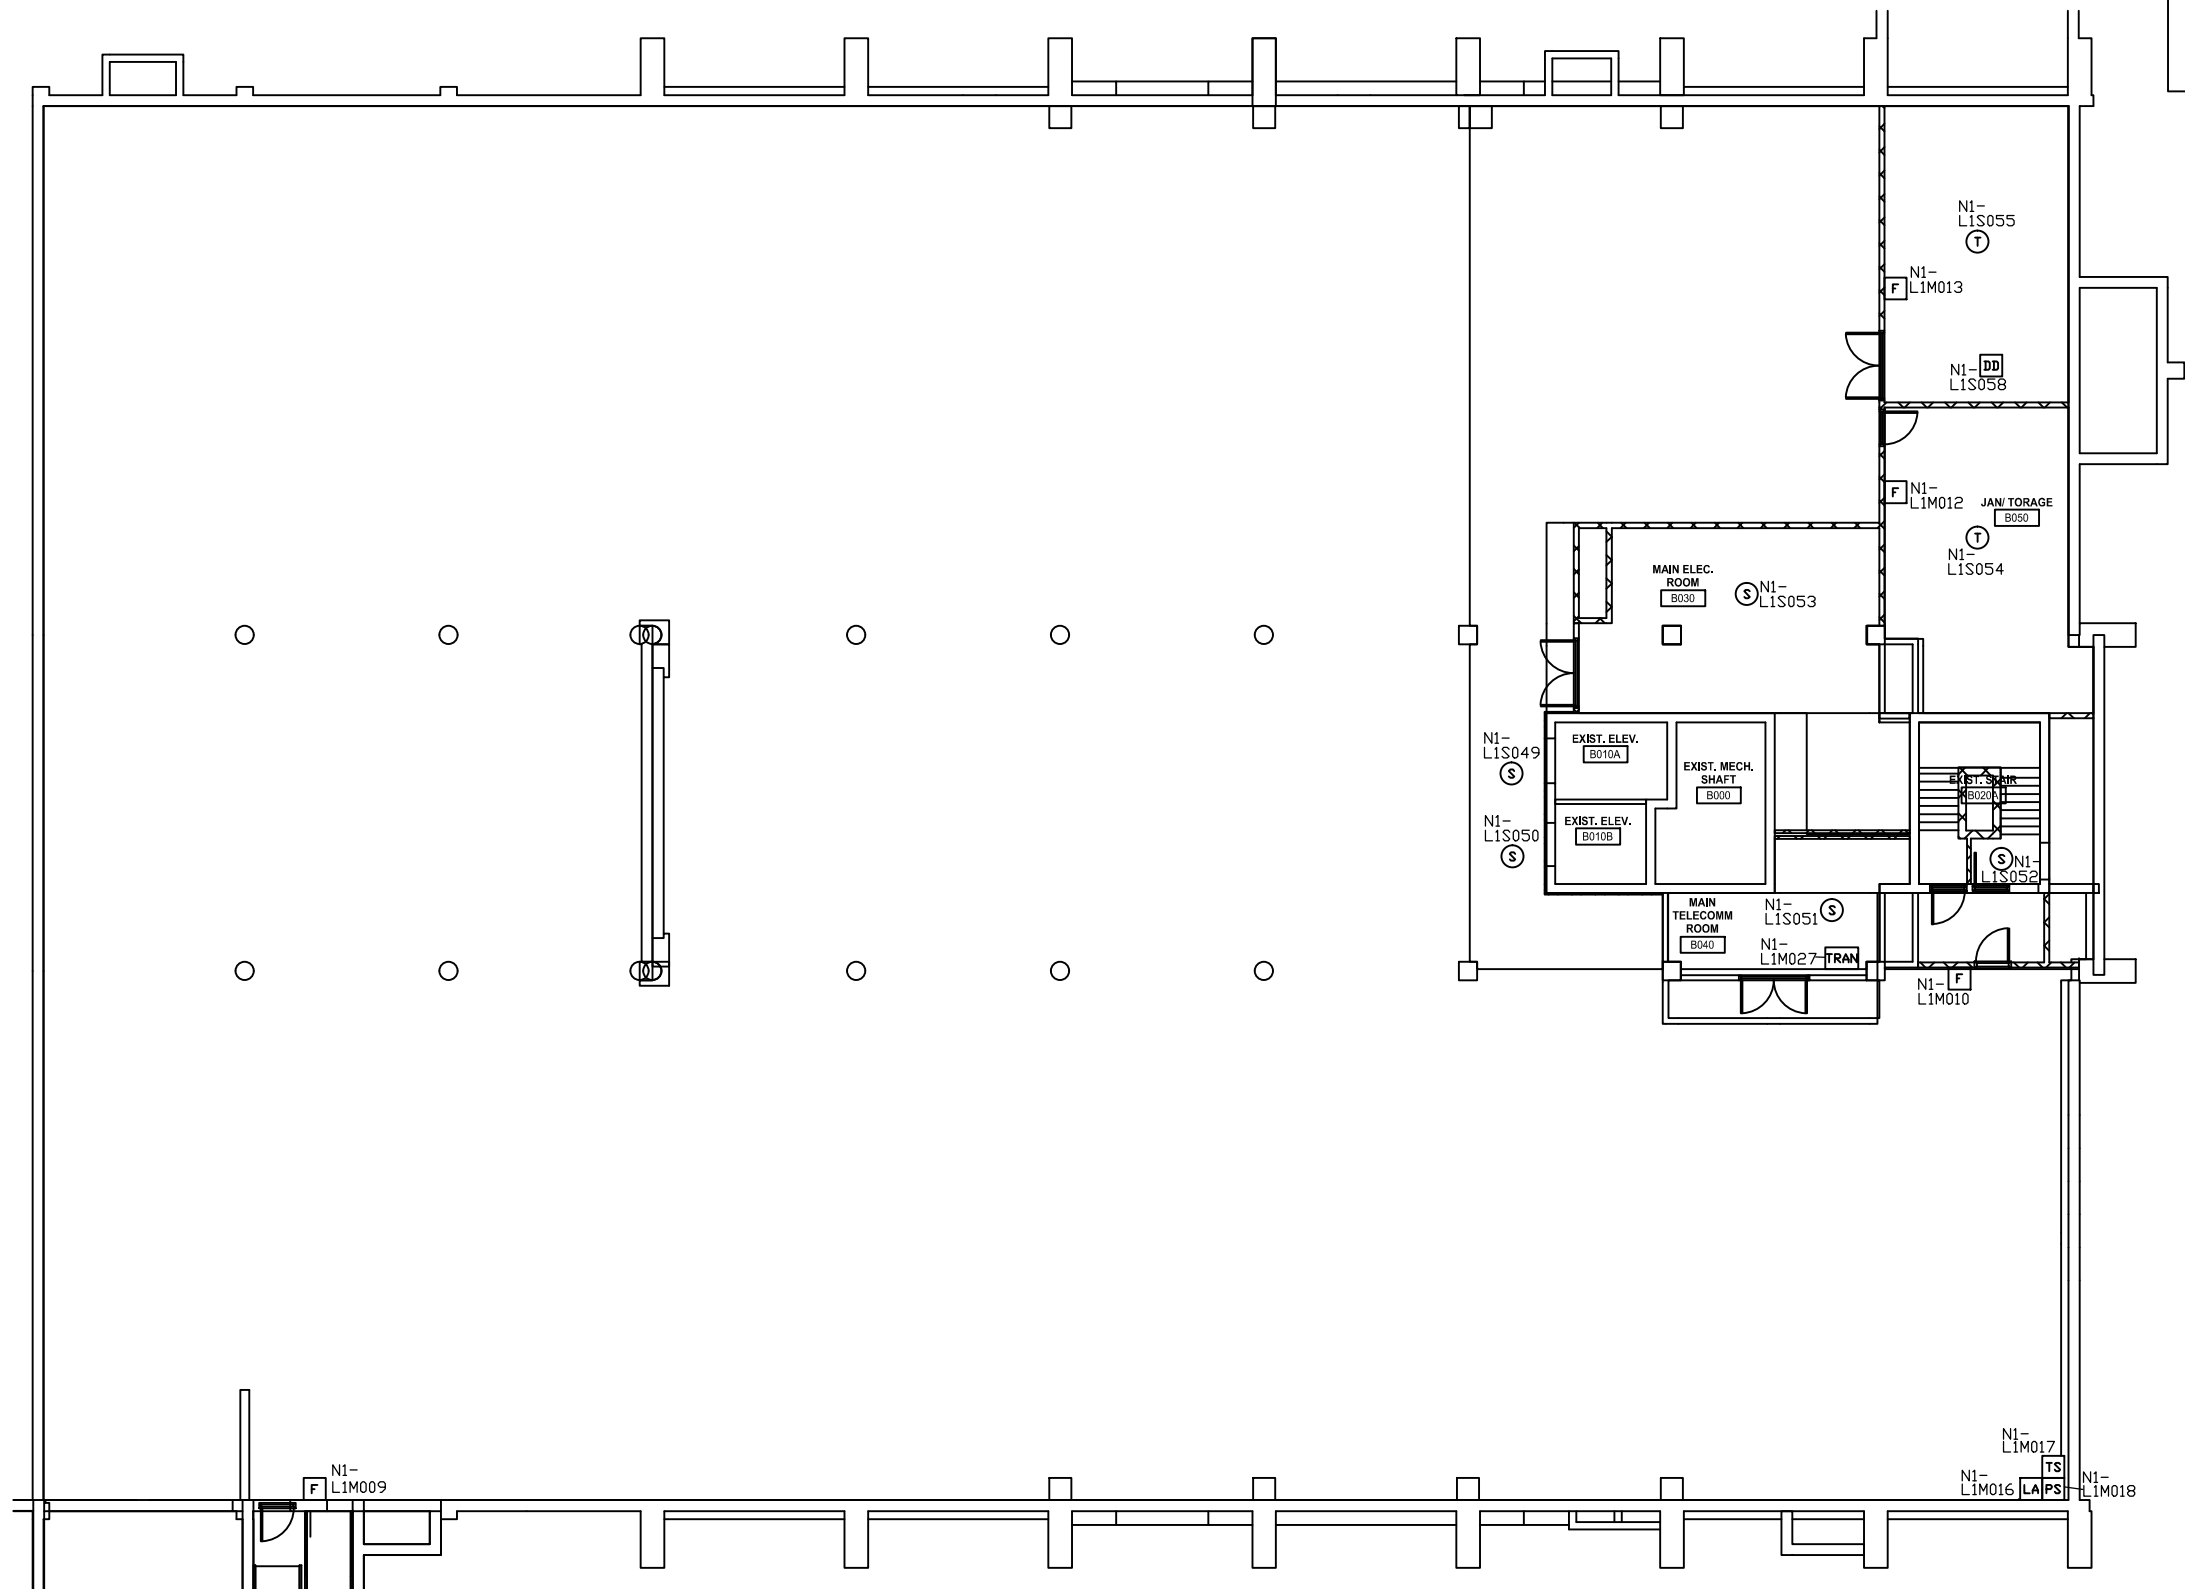

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	LOW AIR SWITCH
⊙	TAMPER SWITCH
⊙	DUCT SMOKE DETECTOR
⊙	PRESSURE SWITCH
⊙	CONTROL MODULE
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL

ADDRESS LABEL CLARIFICATION

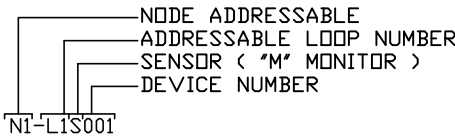

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
BASEMENT
FIRE ALARM SYSTEM

NFS


NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	6/8/2010
SCALE:	NTS
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	NURSING BASEMENT.DWG



FIRE ALARM SYSTEM

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

PAGE:

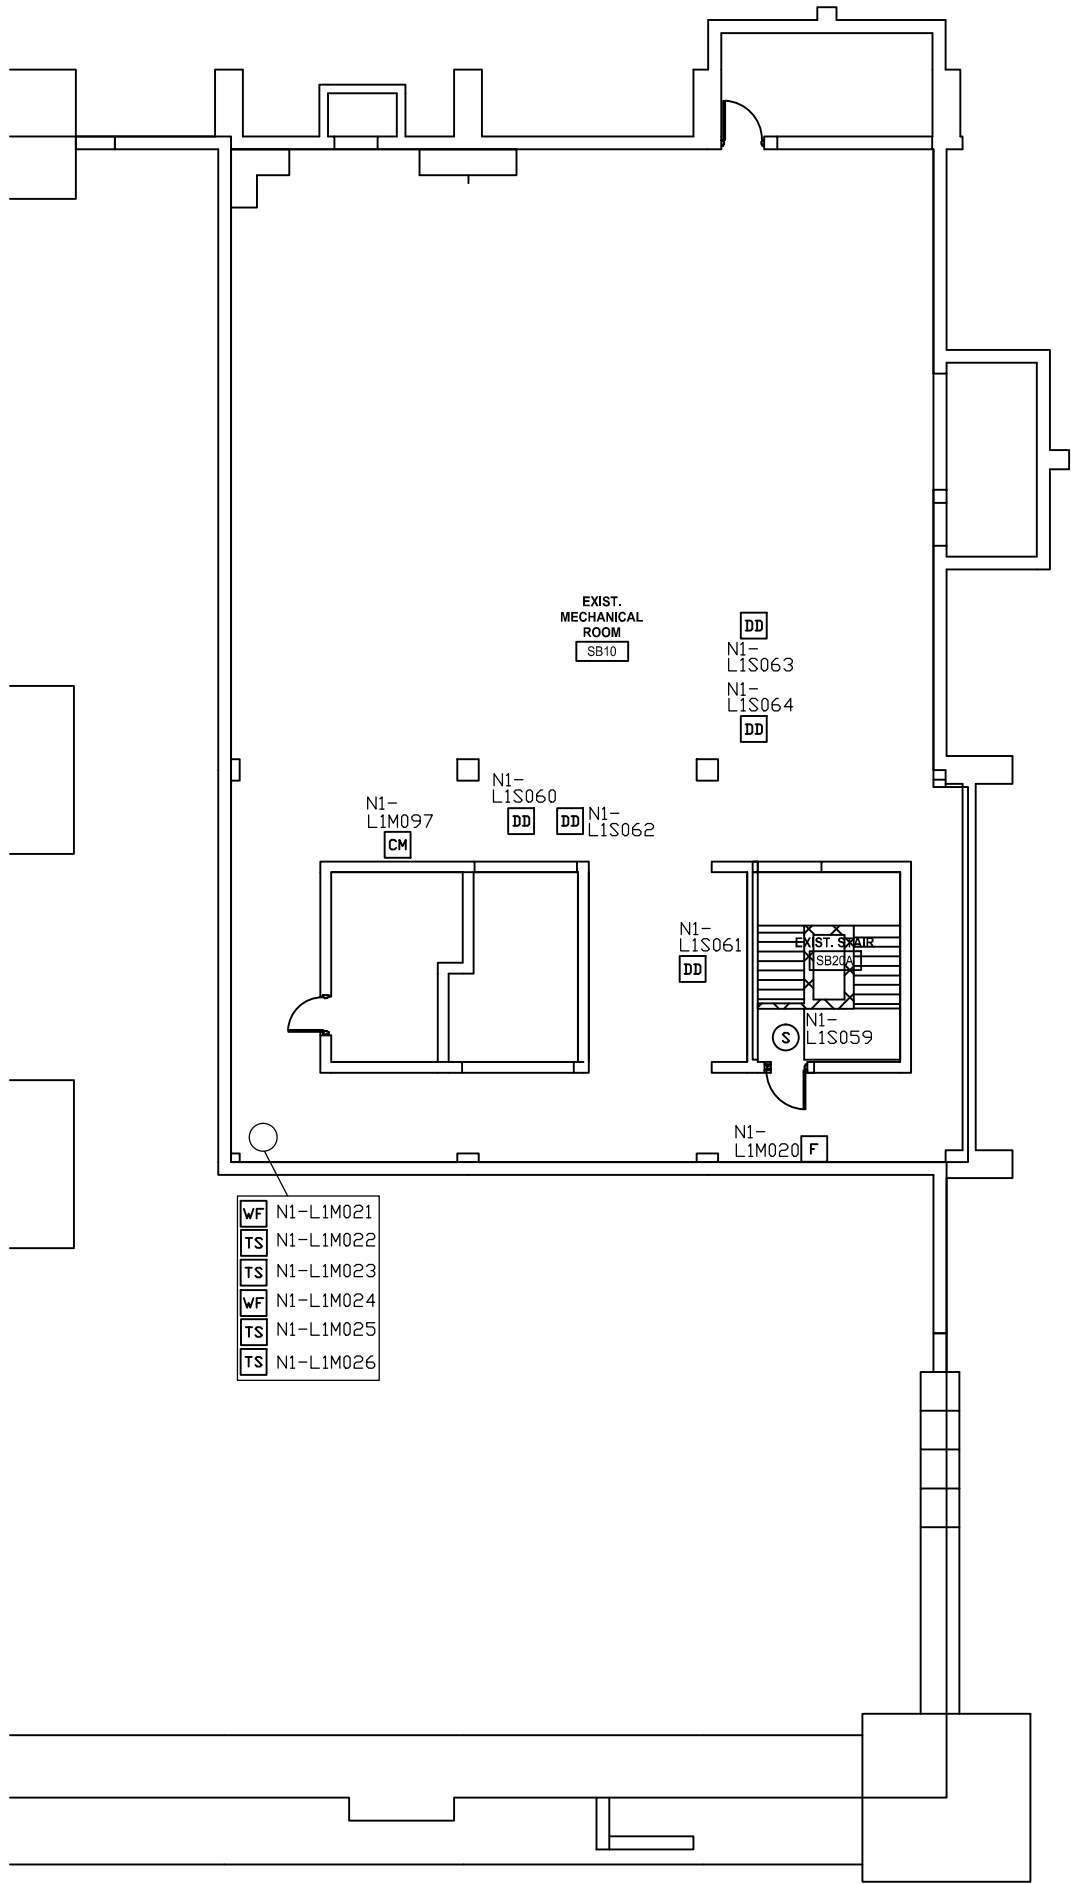

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
PS	PRESSURE SWITCH
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

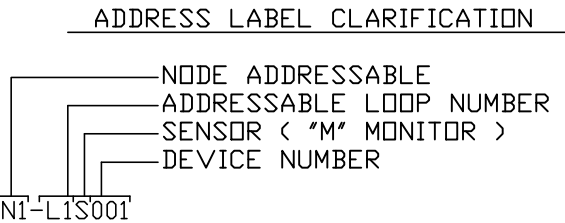

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
SUB BASEMENT
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	6/8/2010
SCALE:	NTS
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	NURSING SUB BASEMENT.DWG

FIRE ALARM SYSTEM



PAGE:

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

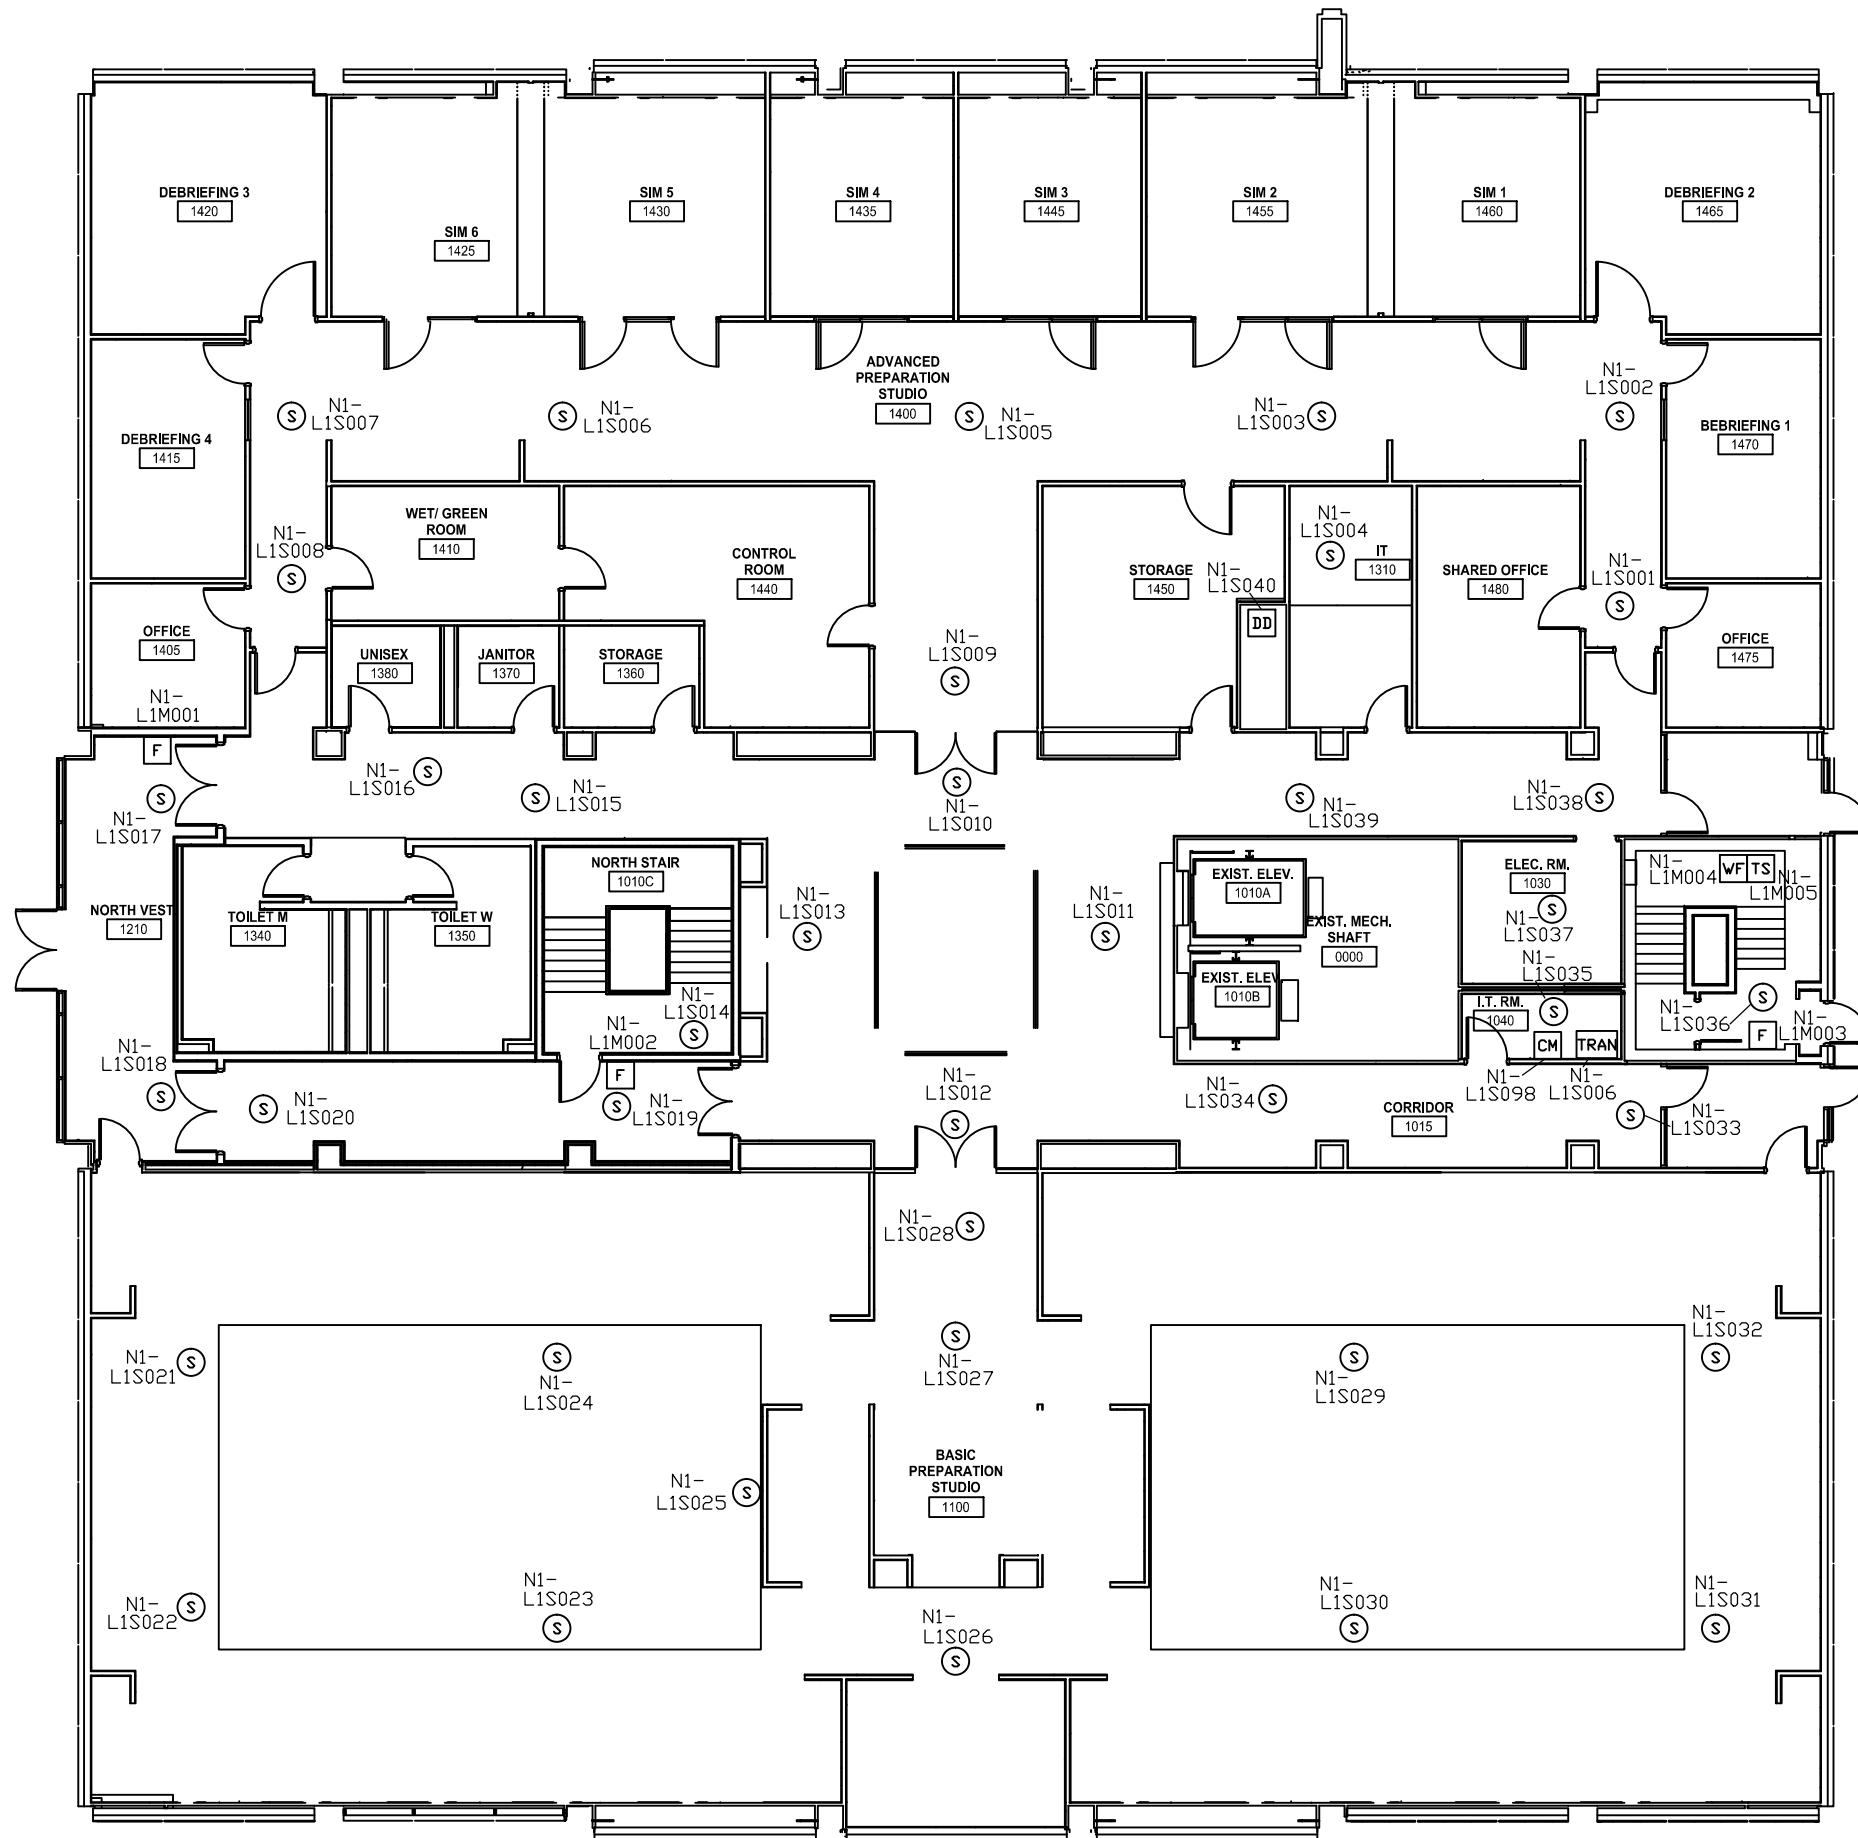

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
ⓕ	MANUAL PULL STATION
Ⓦⓕ	WATERFLOW SWITCH
ⓉⓈ	TAMPER SWITCH
ⓉⓈ	DUCT SMOKE DETECTOR
Ⓟ	PRESSURE SWITCH
ⓐ	CONTROL MODULE
ⓕⓐⓕⓅ	FIRE ALARM CONTROL PANEL
ⓉⓇⓐⓃ	TRANSPONDER PANEL

ADDRESS LABEL CLARIFICATION

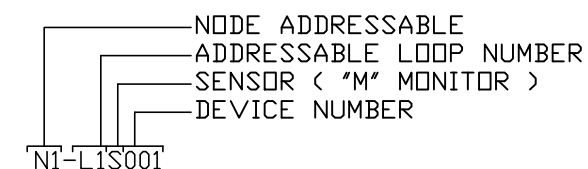

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING UNIVERSITY OF UTAH FIRST LEVEL FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 6/8/2010
SCALE: NTS
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
NURSING FIRST.DWG



FIRE ALARM SYSTEM

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

PAGE:

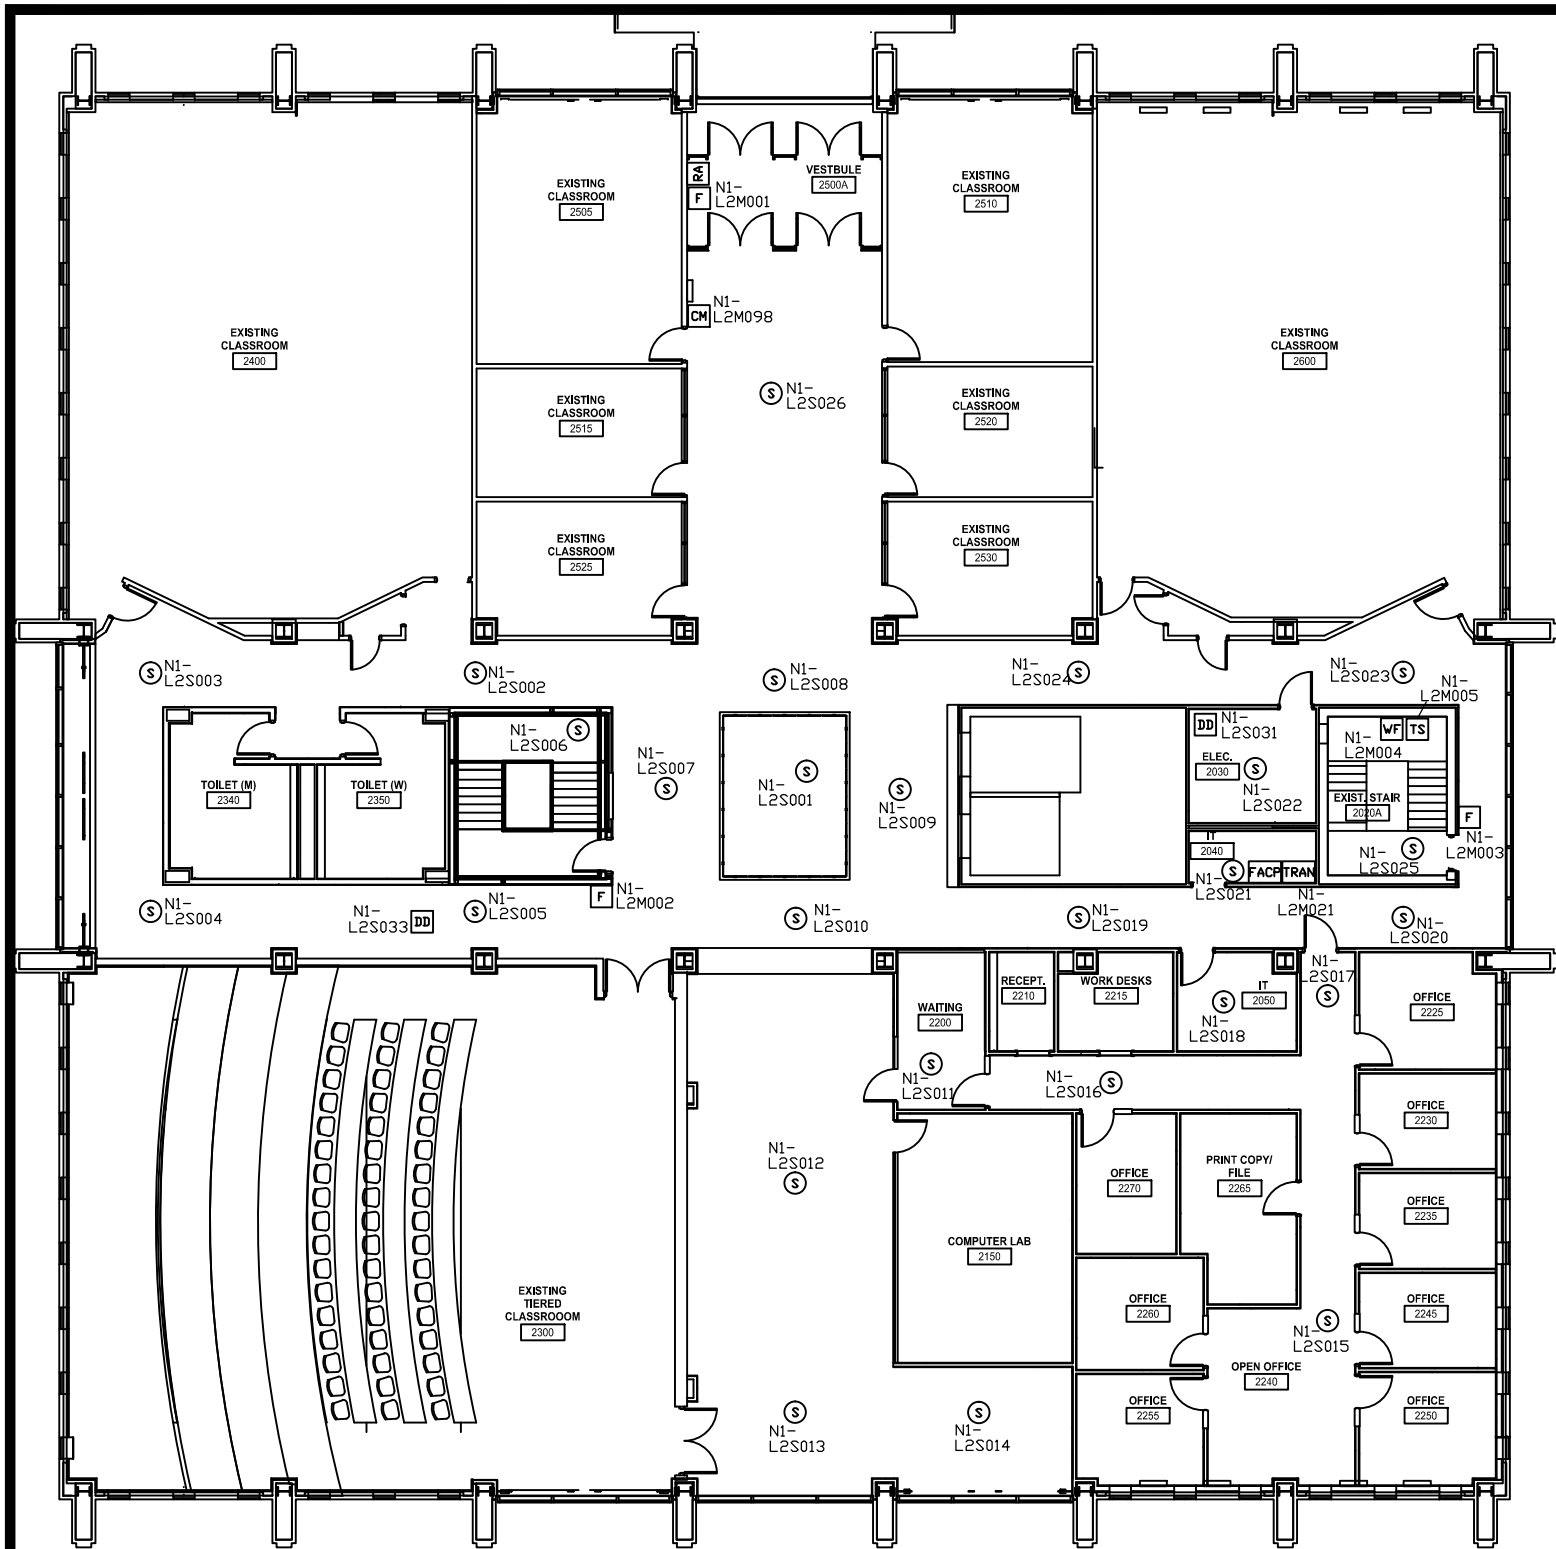

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊖	THERMAL DETECTOR
F	MANUAL PULL STATION
WS	WATERFLOW SWITCH
TS	TAMPER SWITCH
DS	DUCT SMOKE DETECTOR
PS	PRESSURE SWITCH
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

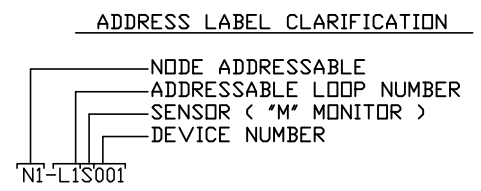

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND AMOUNT OF FIRE ALARM DEVICES, PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
SECOND LEVEL
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JUG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	6/8/2010
SCALE:	NTS
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	NURSING SECOND.DWG



FIRE ALARM SYSTEM

PAGE:

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104596

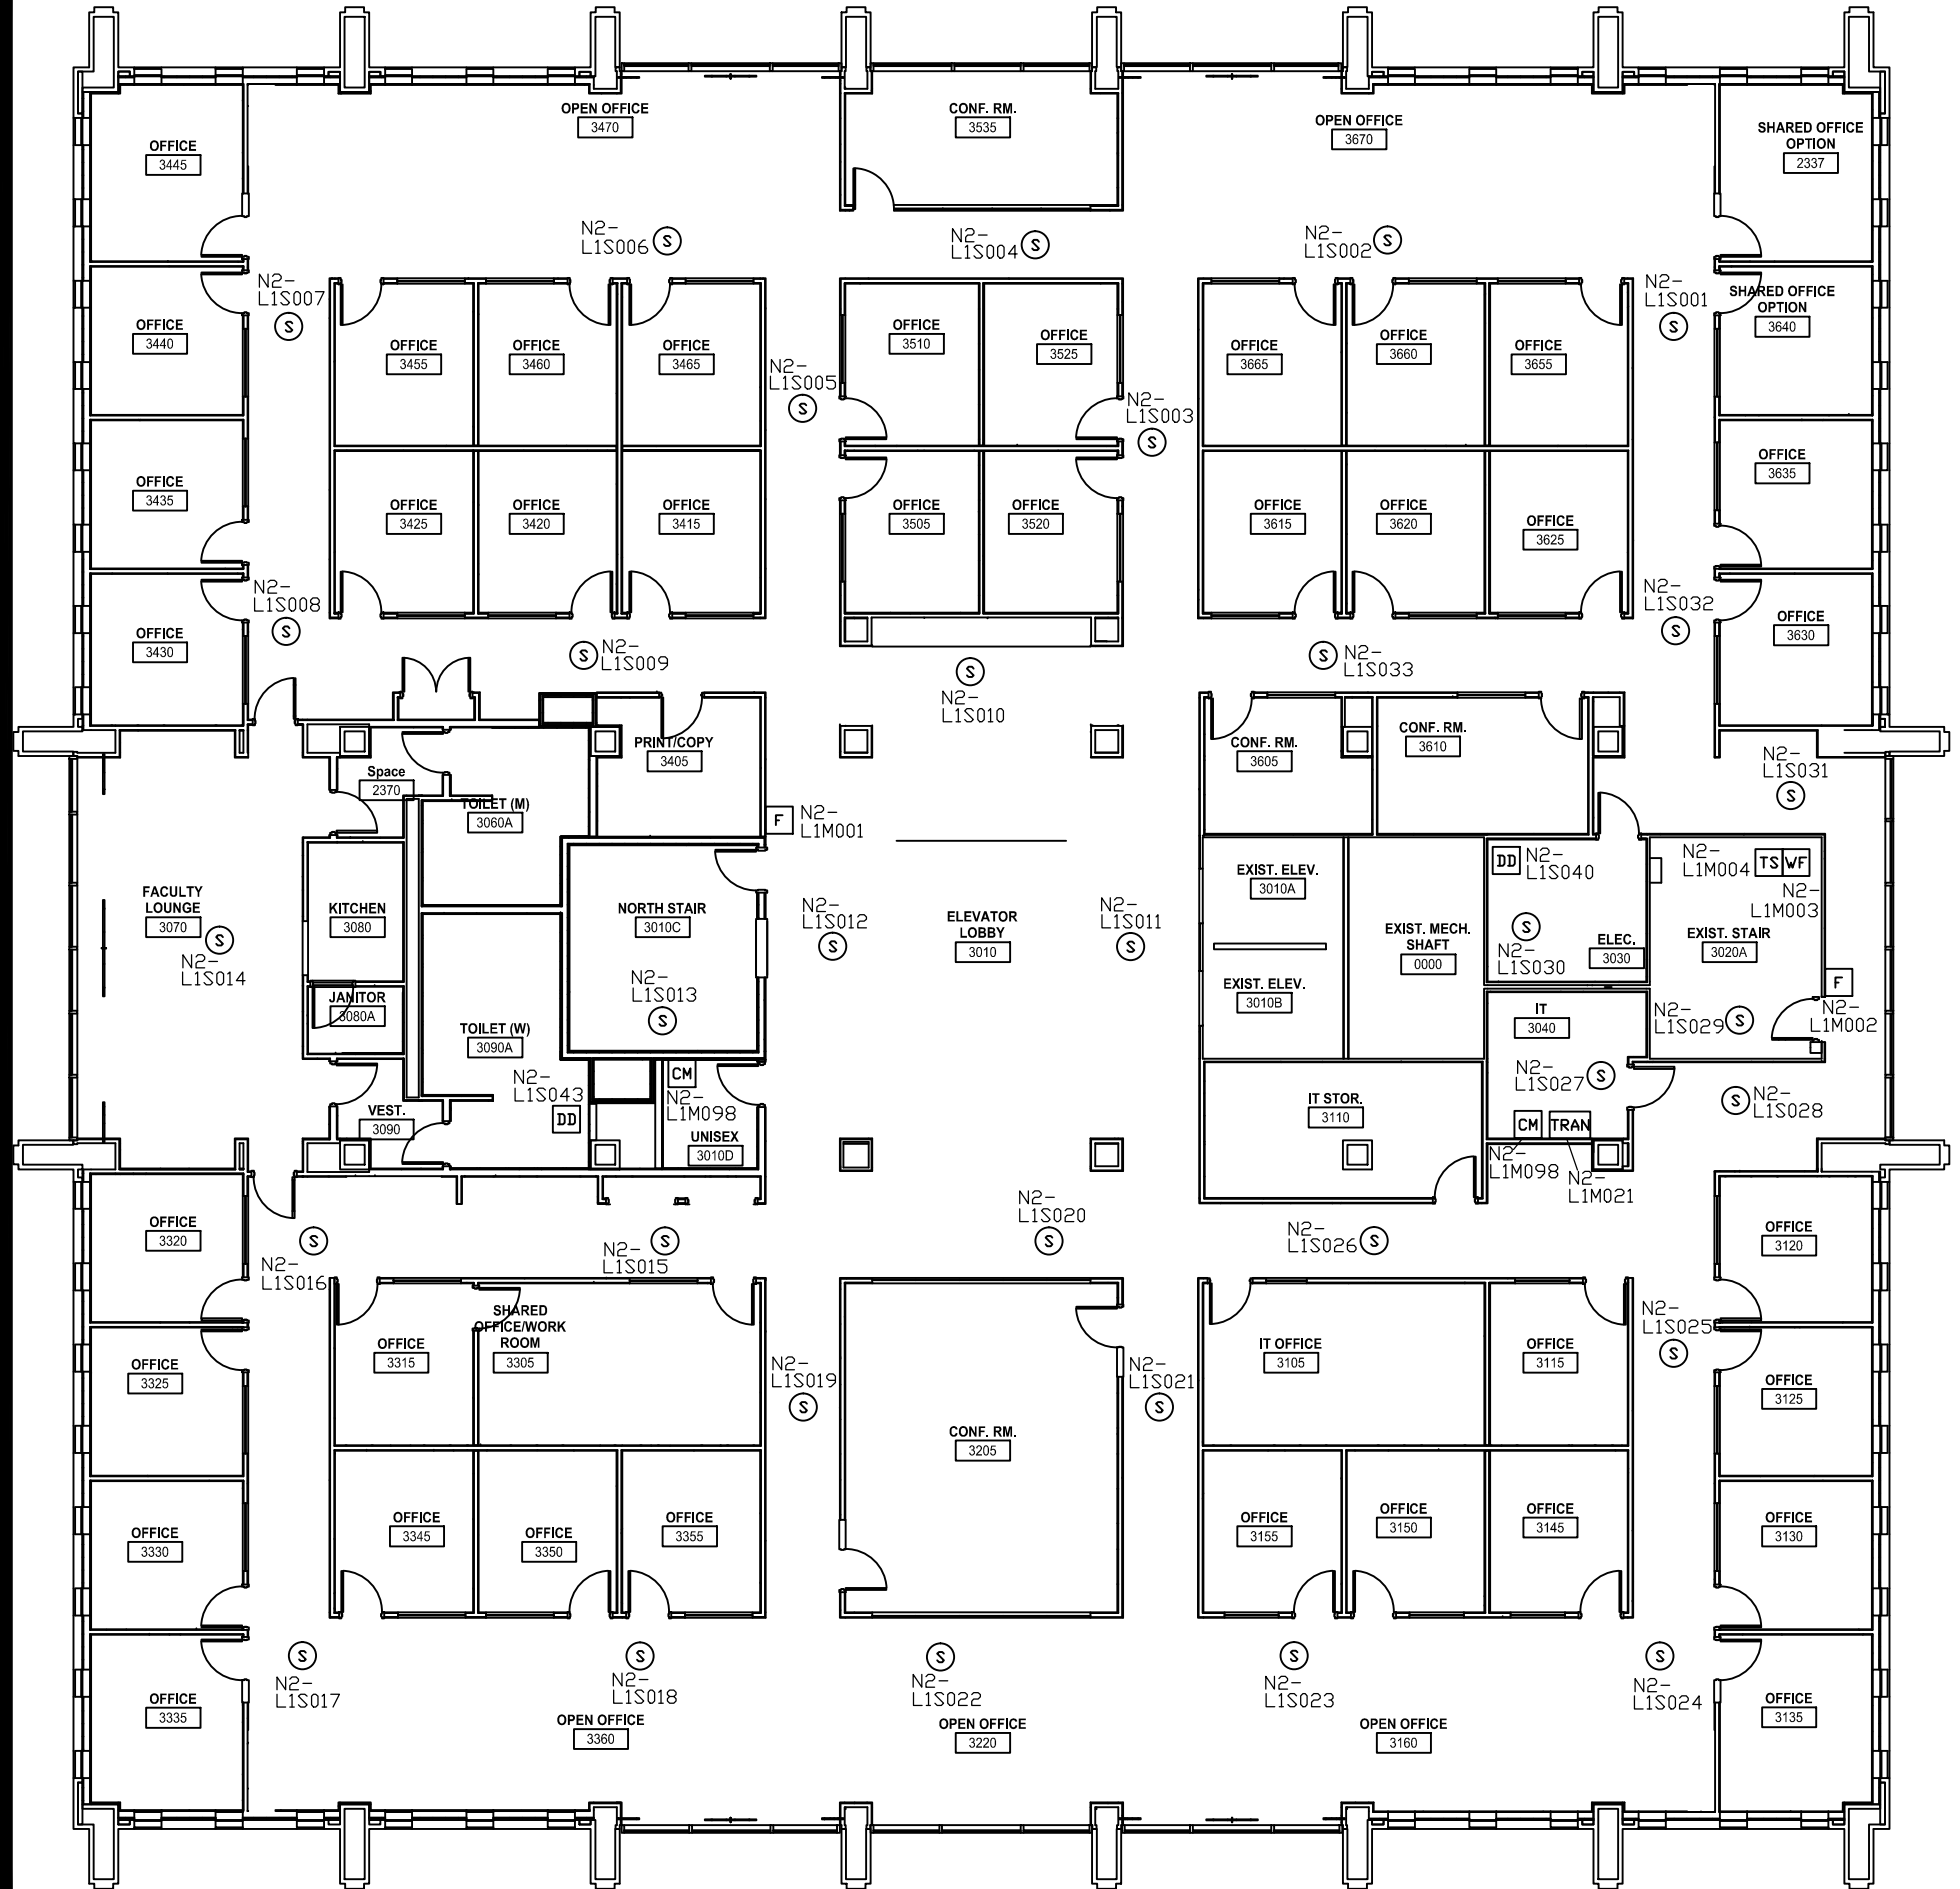

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ	THERMAL DETECTOR
F	MANUAL PULL STATION
WT	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
PS	PRESSURE SWITCH
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

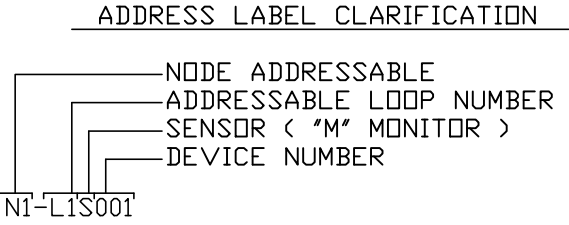

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
THIRD LEVEL
FIRE ALARM SYSTEM

NFS


NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	6/8/2010
SCALE:	NTS
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	NURSING THIRD.DWG

FIRE ALARM SYSTEM


PAGE:

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

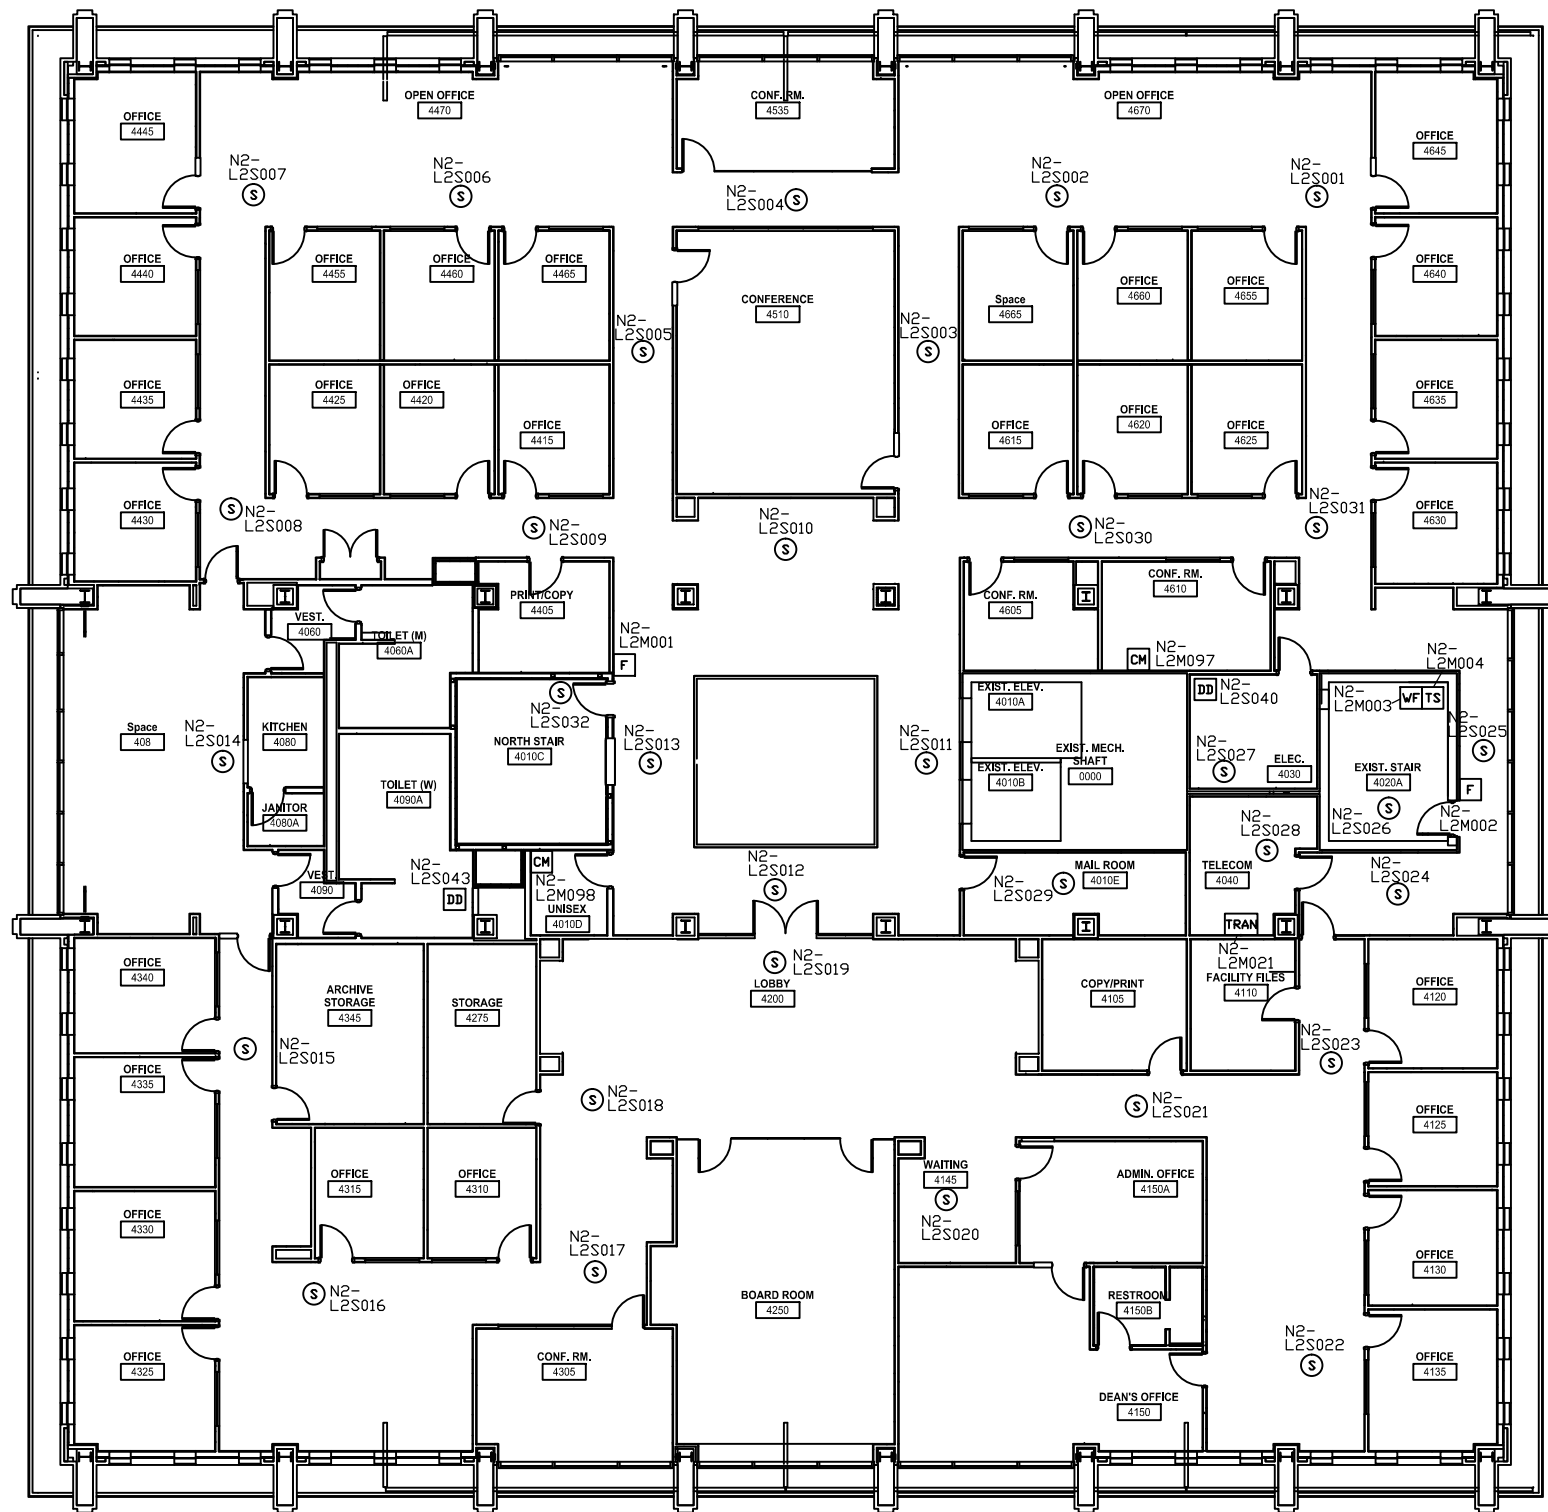

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊖	THERMAL DETECTOR
⊕	MANUAL PULL STATION
⊗	WATERFLOW SWITCH
⊘	TAMPER SWITCH
⊙	DUCT SMOKE DETECTOR
⊖	PRESSURE SWITCH
⊕	CONTROL MODULE
⊗	FIRE ALARM CONTROL PANEL
⊘	TRANSPONDER PANEL

ADDRESS LABEL CLARIFICATION

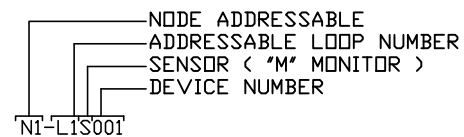

COLLEGE OF NURSING
UNIVERSITY OF UTAH
FOURTH LEVEL
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 6/8/2010
SCALE: NTS
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
NURSING FOURTH.DWG

FIRE ALARM SYSTEM



PAGE:

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104596

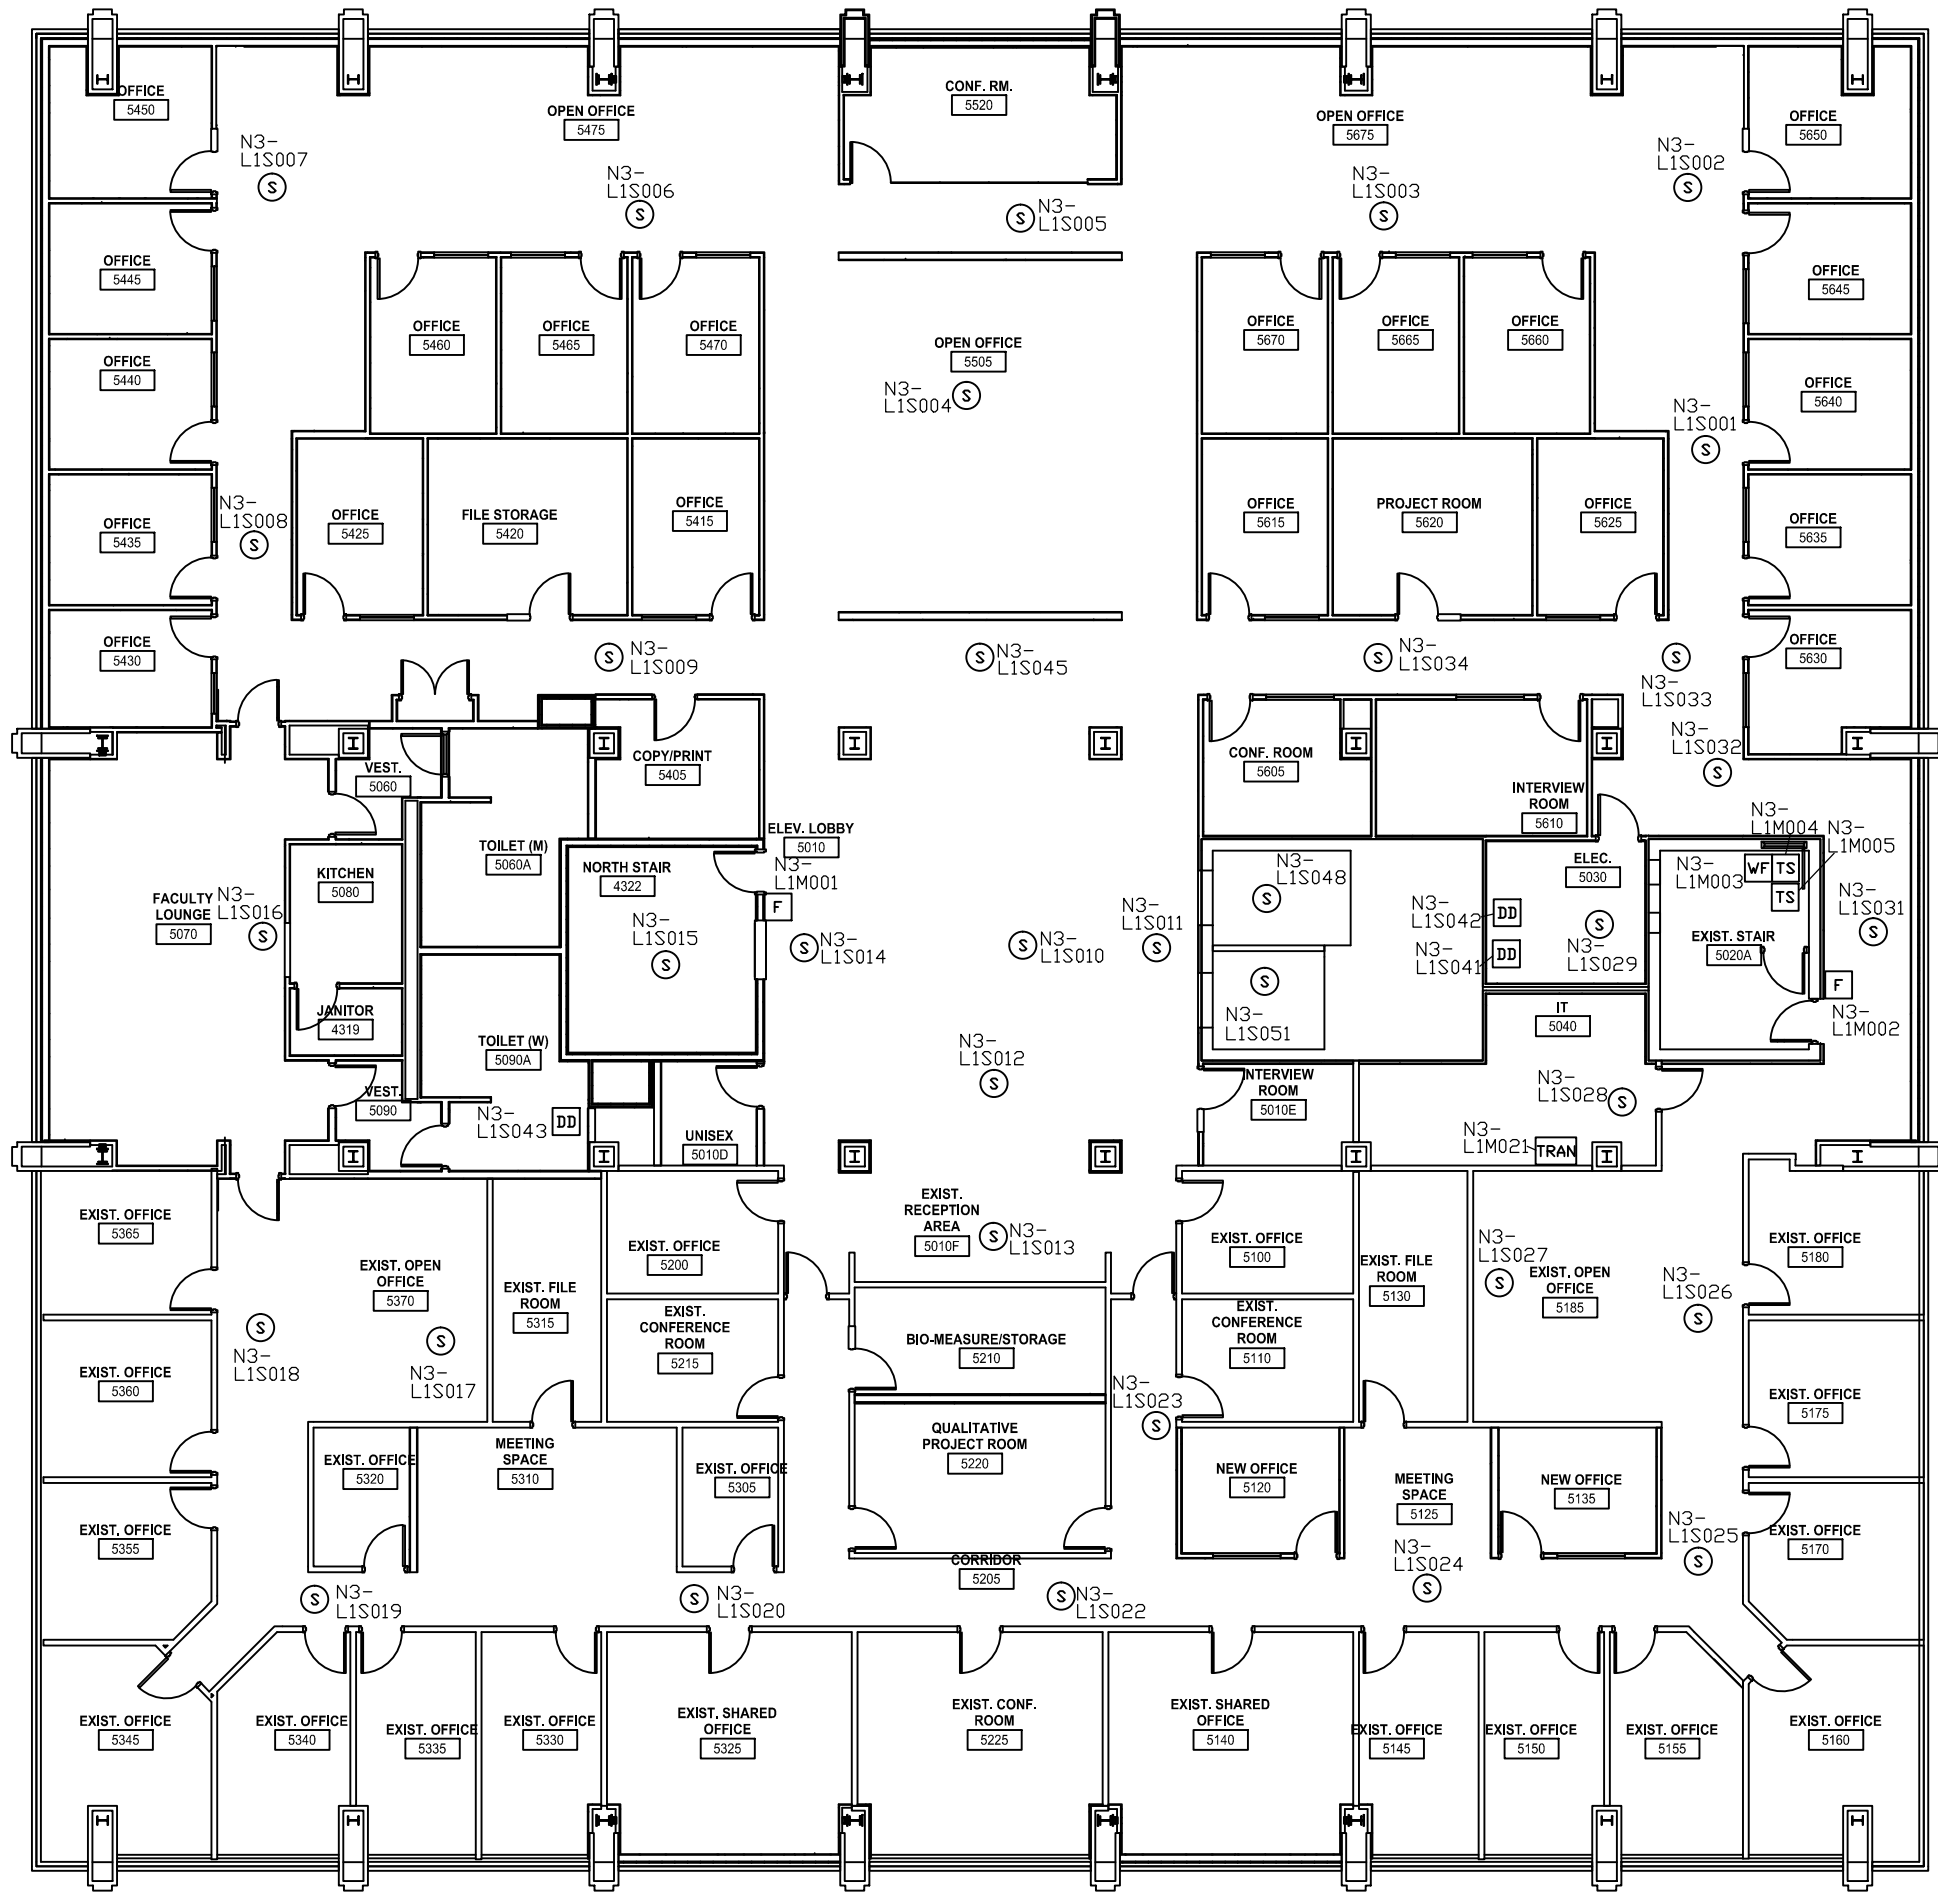


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
ⓕ	MANUAL PULL STATION
ⓌⓉ	WATERFLOW SWITCH
ⓉⓈ	TAMPER SWITCH
ⓓⓓ	DUCT SMOKE DETECTOR
ⓅⓈ	PRESSURE SWITCH
ⓐⓂ	CONTROL MODULE
ⓕⓐⓕⓅ	FIRE ALARM CONTROL PANEL
ⓉⓇⓐⓃ	TRANSPONDER PANEL

ADDRESS LABEL CLARIFICATION

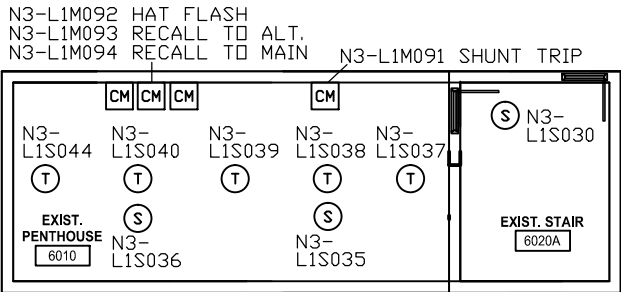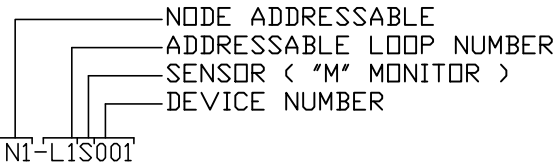

PENTHOUSE

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

COLLEGE OF NURSING
UNIVERSITY OF UTAH
FIFTH LEVEL AND PENTHOUSE
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 6/8/2010
SCALE: NTS
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME: NURSING FIFTH.DWG

FIRE ALARM SYSTEM

PAGE: