



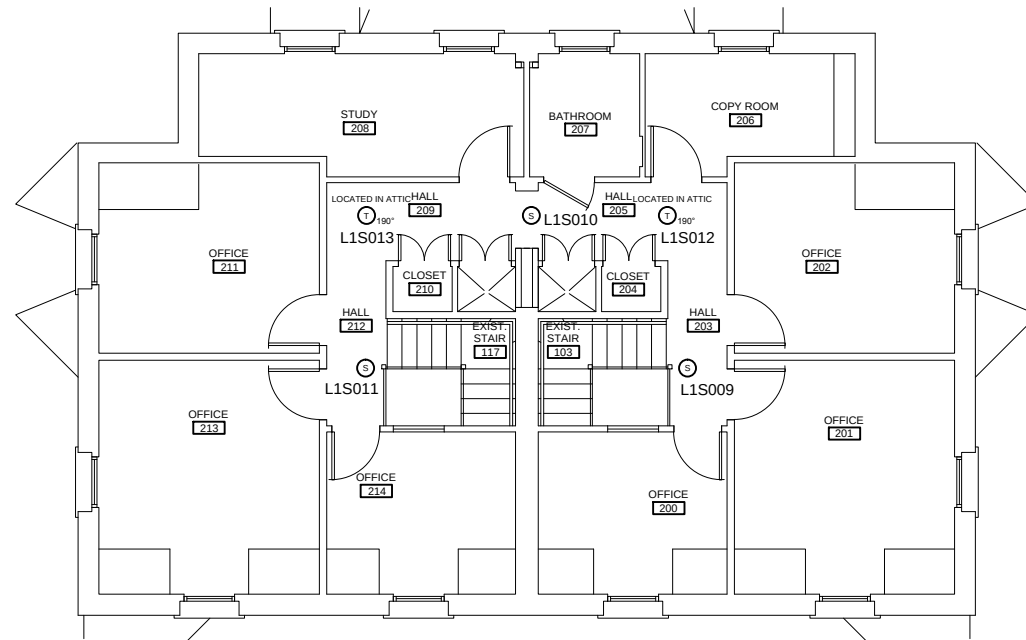

UPPER FLOOR

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T) 190°	HIGH TEMP HEAT DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH
(TS)	TAMPER SWITCH
(R)	RELAY
(RA)	REMOTE ANNUNCIATOR
(RAD)	RADIONICS MONITORING PANEL
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

GLOBAL PATHWAYS
FORT DOUGLAS 601
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM


NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	JJG
DESIGNED BY:	XXXX
CHECKED BY:	DS
DATE:	4/20/11
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	2
DRAWING NAME:	601 FINAL.DWG

FIRE ALARM SYSTEM

PAGE:

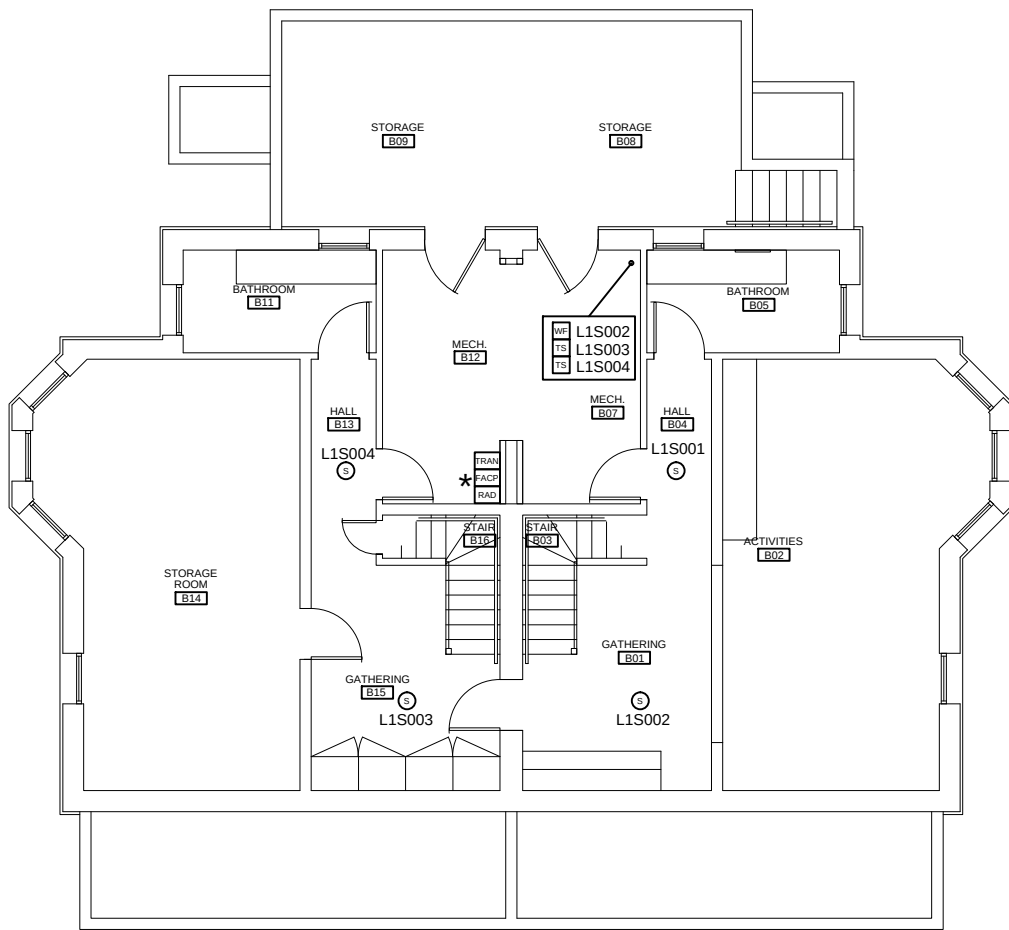

BASEMENT FLOOR

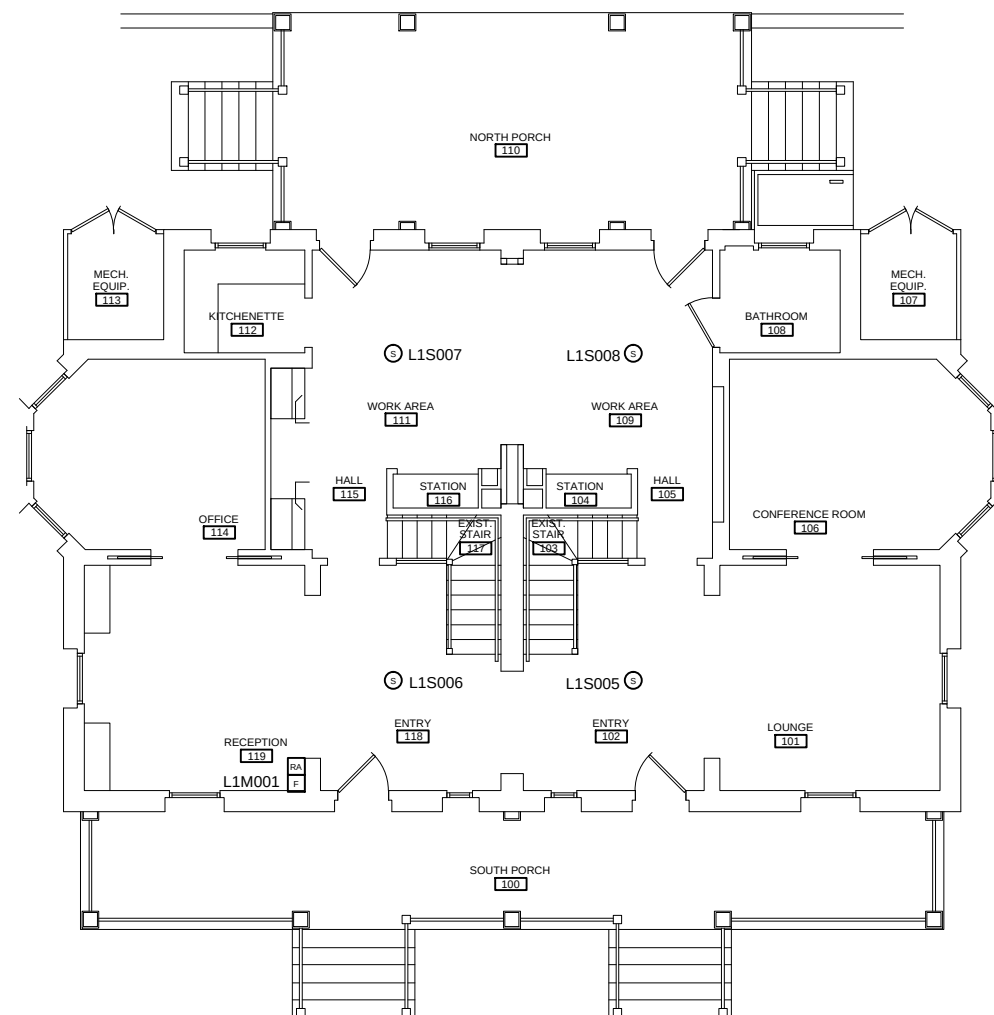

MAIN FLOOR

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396