



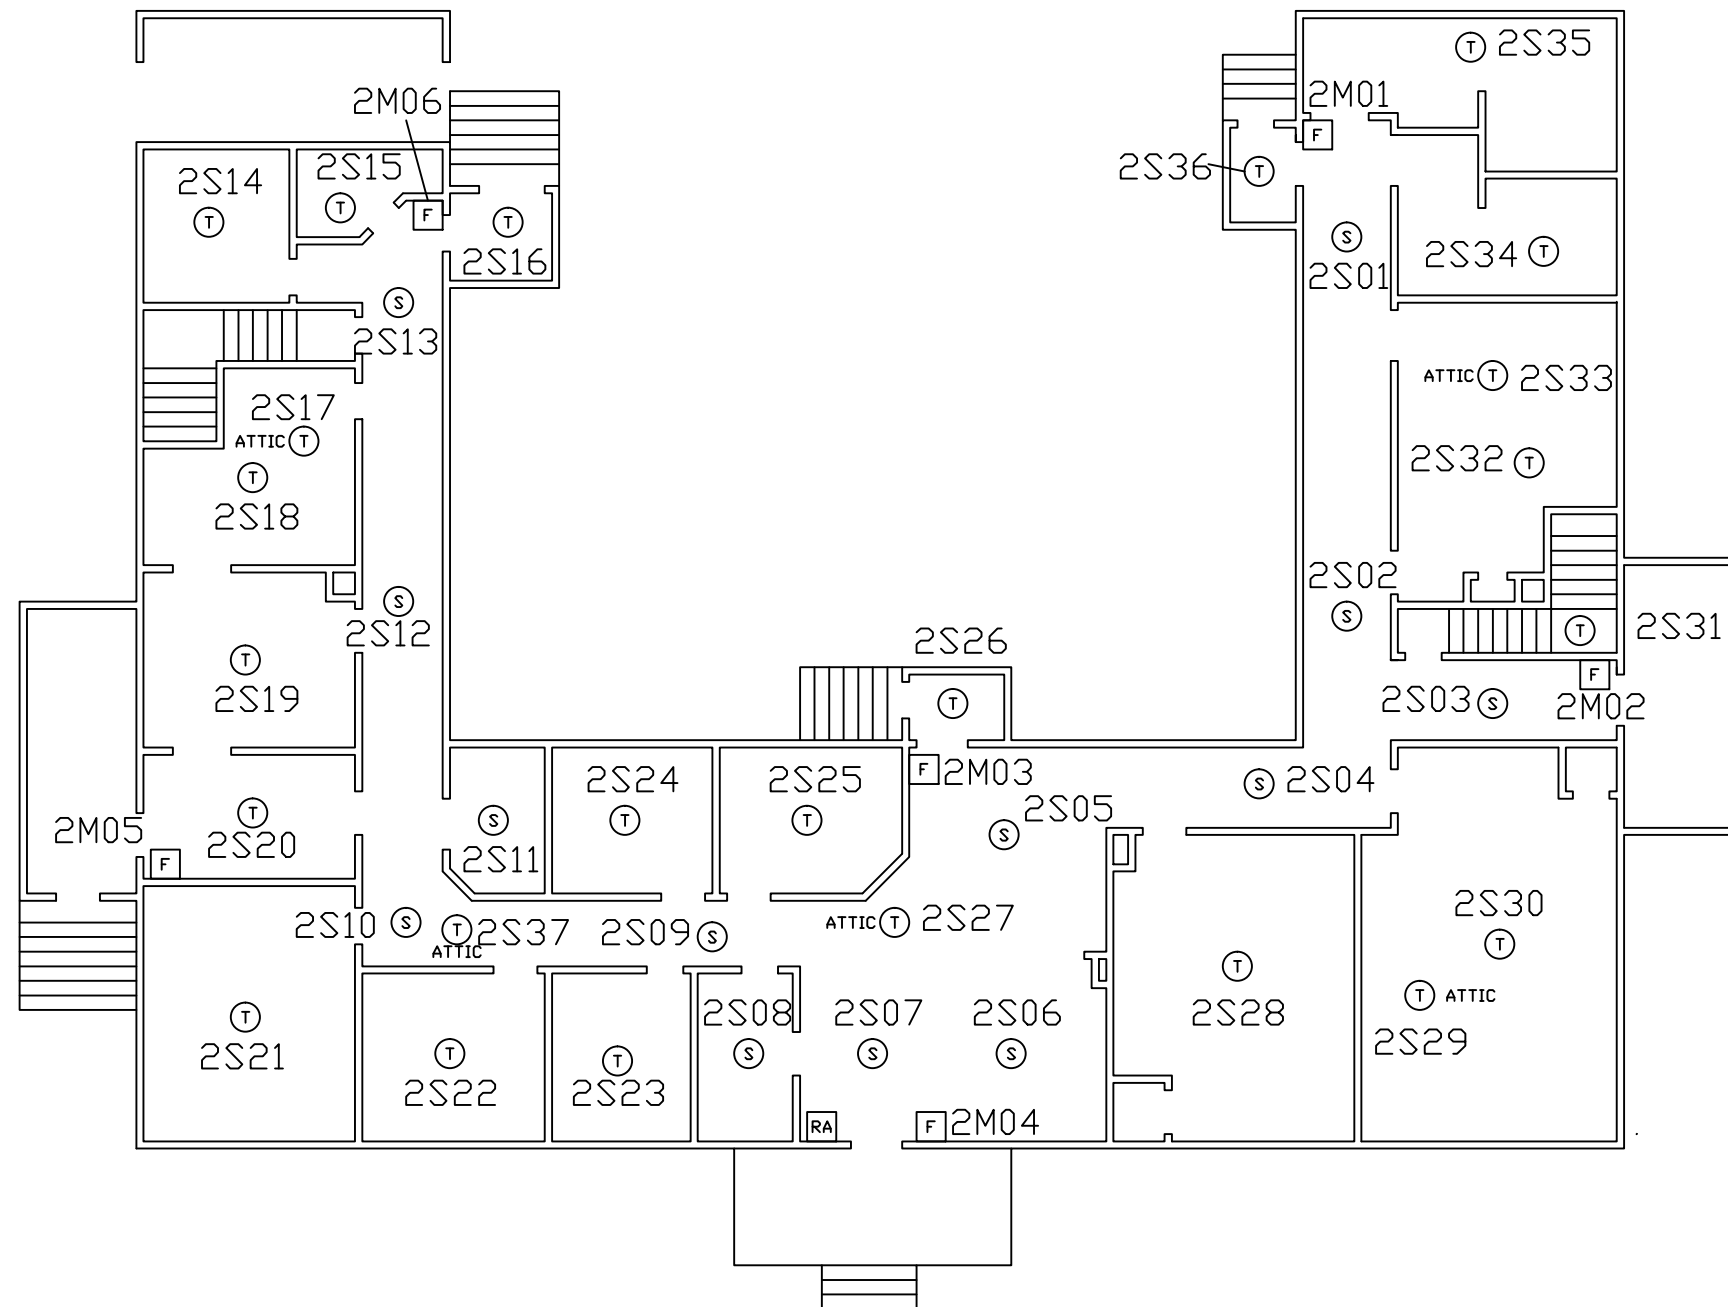

- SYSTEM NOTES:
- ① TO BASEMENT LEVEL TRAN
 - ② TO 120VAC WITH GROUND
 - ③ LOCATE IN ATTIC

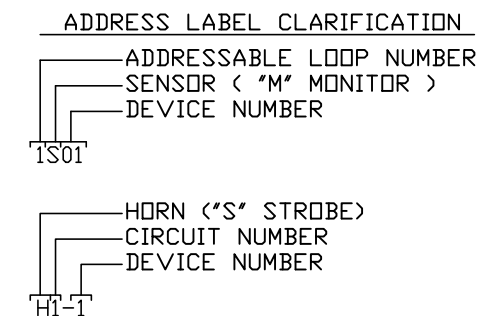

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE LOOP	2 #14'S TWISTED
B	HORN CKT 2	2 #14'S
C	STROBE CKT 2,3	4 #14'S
D	REMOTE ANNUNCIATOR	2 PAIR #14'S TWISTED
E	120 VAC POWER	3 #12'S
F		

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR W/BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(DD)	DUCT SMOKE DETECTOR
(HS)	HORN/STROBE
(H)	WEATHERPROOF HORN
(L)	STROBE LIGHT
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(R)	RELAY- ARB-C
(RA)	REMOTE ANNUNCIATOR ENCLOSURE
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

FORT DOUGLAS HONORS CENTER
UNIVERSITY OF UTAH
FIRST LEVEL
1975 DETROBRIAND STREET
SALT LAKE CITY, UTAH 84113

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DPS
DESIGNED BY: BNA
APPROVED BY: TCT
DATE: 6/22/04
SCALE: N.T.S.
PROJECT NO: 0619-11447
REV NO: XXXX
DRAWING NAME: FDHONORSI.DWG

FIRE ALARM SYSTEM
FIRST LEVEL
ADDRESSABLE NUMBERS

NFS

FA-I-04

