

LEGEND


- ③ SMOKE DETECTOR- ASD-IL/ADB-FL
- ① HEAT DETECTOR- ATD-RL/ADB-FL
- F MANUAL PULL STATION- MS-2/AMM-2
- DD DUCT DETECTOR- DH500
- WF WATERFLOW SWITCH- AMM-4
- TS TAMPER SWITCH- AMM-4
- MM MONITOR MODULE- AMM-4
- CM CONTROL MODULE- ADM-2
- FACP FIRE ALARM CONTROL PANEL- EN-24
- TRAN TRANSPONDER PANEL- EN-24

FORT DOUGLAS
COMMANDS QUARTERS
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
JANUARY 17, 2002
FDCQRTR.DWG


* NOTE: HEAT DETECTOR IN ATTIC SPACE



SECOND FLOOR



FIRST FLOOR

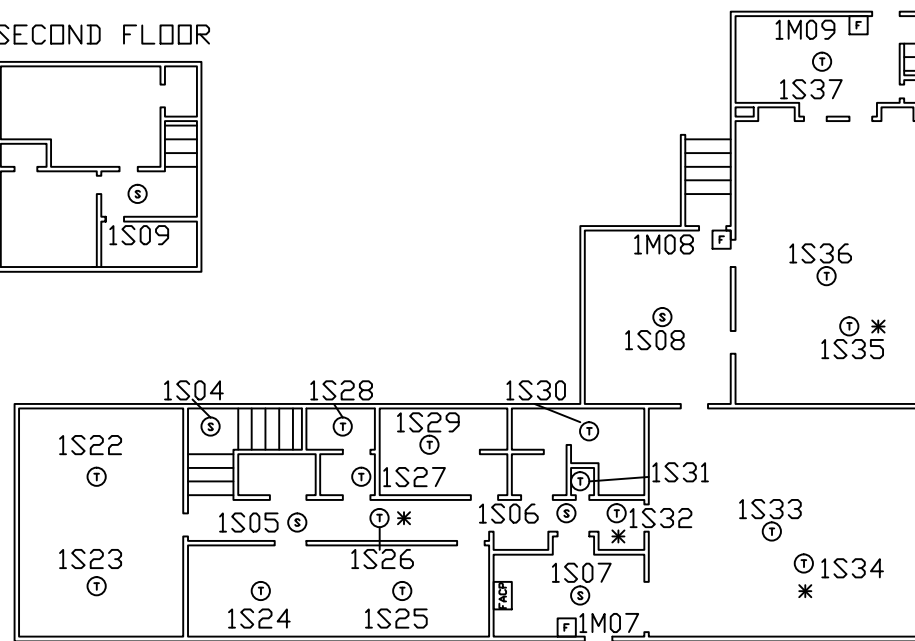

BASEMENT

