




DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S _A)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL

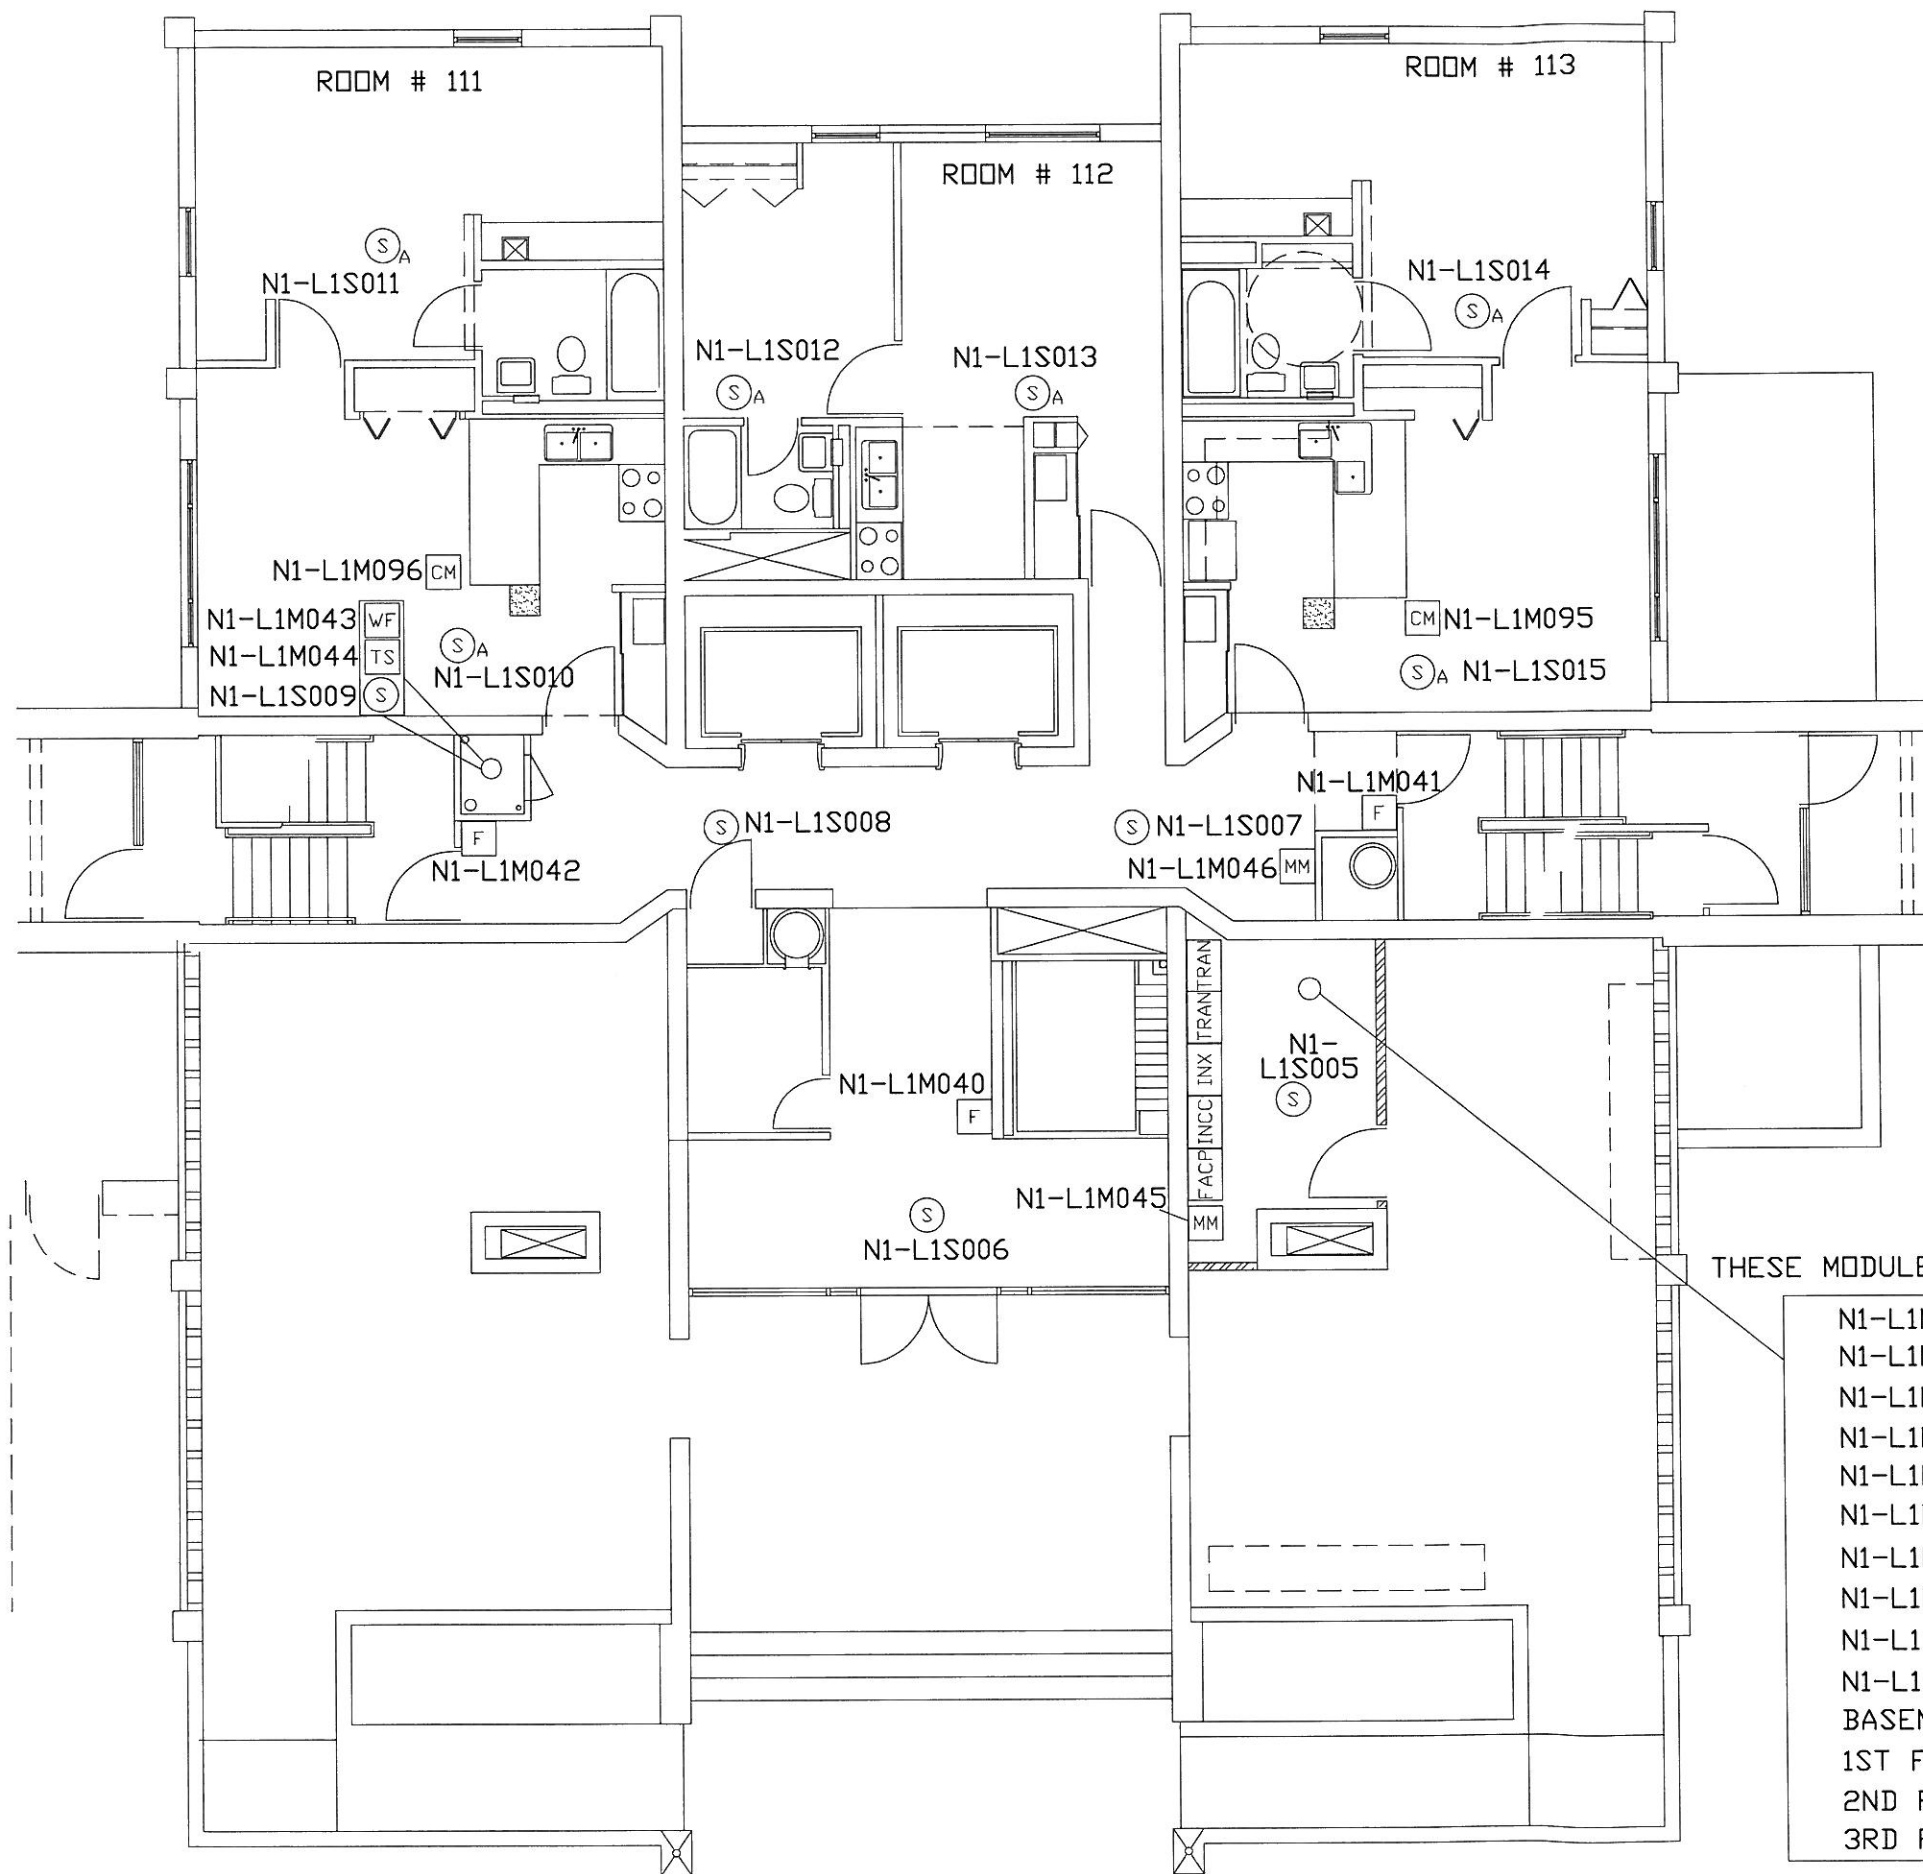

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. NFS IS SOLELY RESPONSIBLE FOR THE TYPE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
FIRST FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/2008
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME: NORTHMED1.DWG

FIRE ALARM SYSTEM
FIRST FLOOR
ADDRESSABLE NUMBERS

PAGE:

FA-I-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

THESE MODULES ARE IN THE FIRE COMMAND CENTER

N1-L1M090 BASEMENT STROBES
N1-L1M091 1ST FLOOR STROBES
N1-L1M092 2ND FLOOR STROBES
N1-L1M093 3RD FLOOR STROBES
N1-L1M089 ASM SUPERVISION
N1-L1M047 1ST FLOOR TRANSPONDER
N1-L1M048 ASM SUPERVISION
N1-L1M025 GENERATOR RUNNING
N1-L1M026 COMMON ALARM
N1-L1M027 GENERATOR LOW FUEL
BASEMENT FIREPHONES
1ST FLOOR FIREPHONES
2ND FLOOR FIREPHONES
3RD FLOOR FIREPHONES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
BASEMENT
FIRE ALARM SYSTEM

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	8/15/2008
SCALE:	NTS
PROJECT NO:	0701-13092
REV NO:	
DRAWING NAME:	NORTHMEDB.DWG

FIRE ALARM SYSTEM
BASEMENT
ADDRESSABLE LOOP


PAGE:

FA-B-01

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

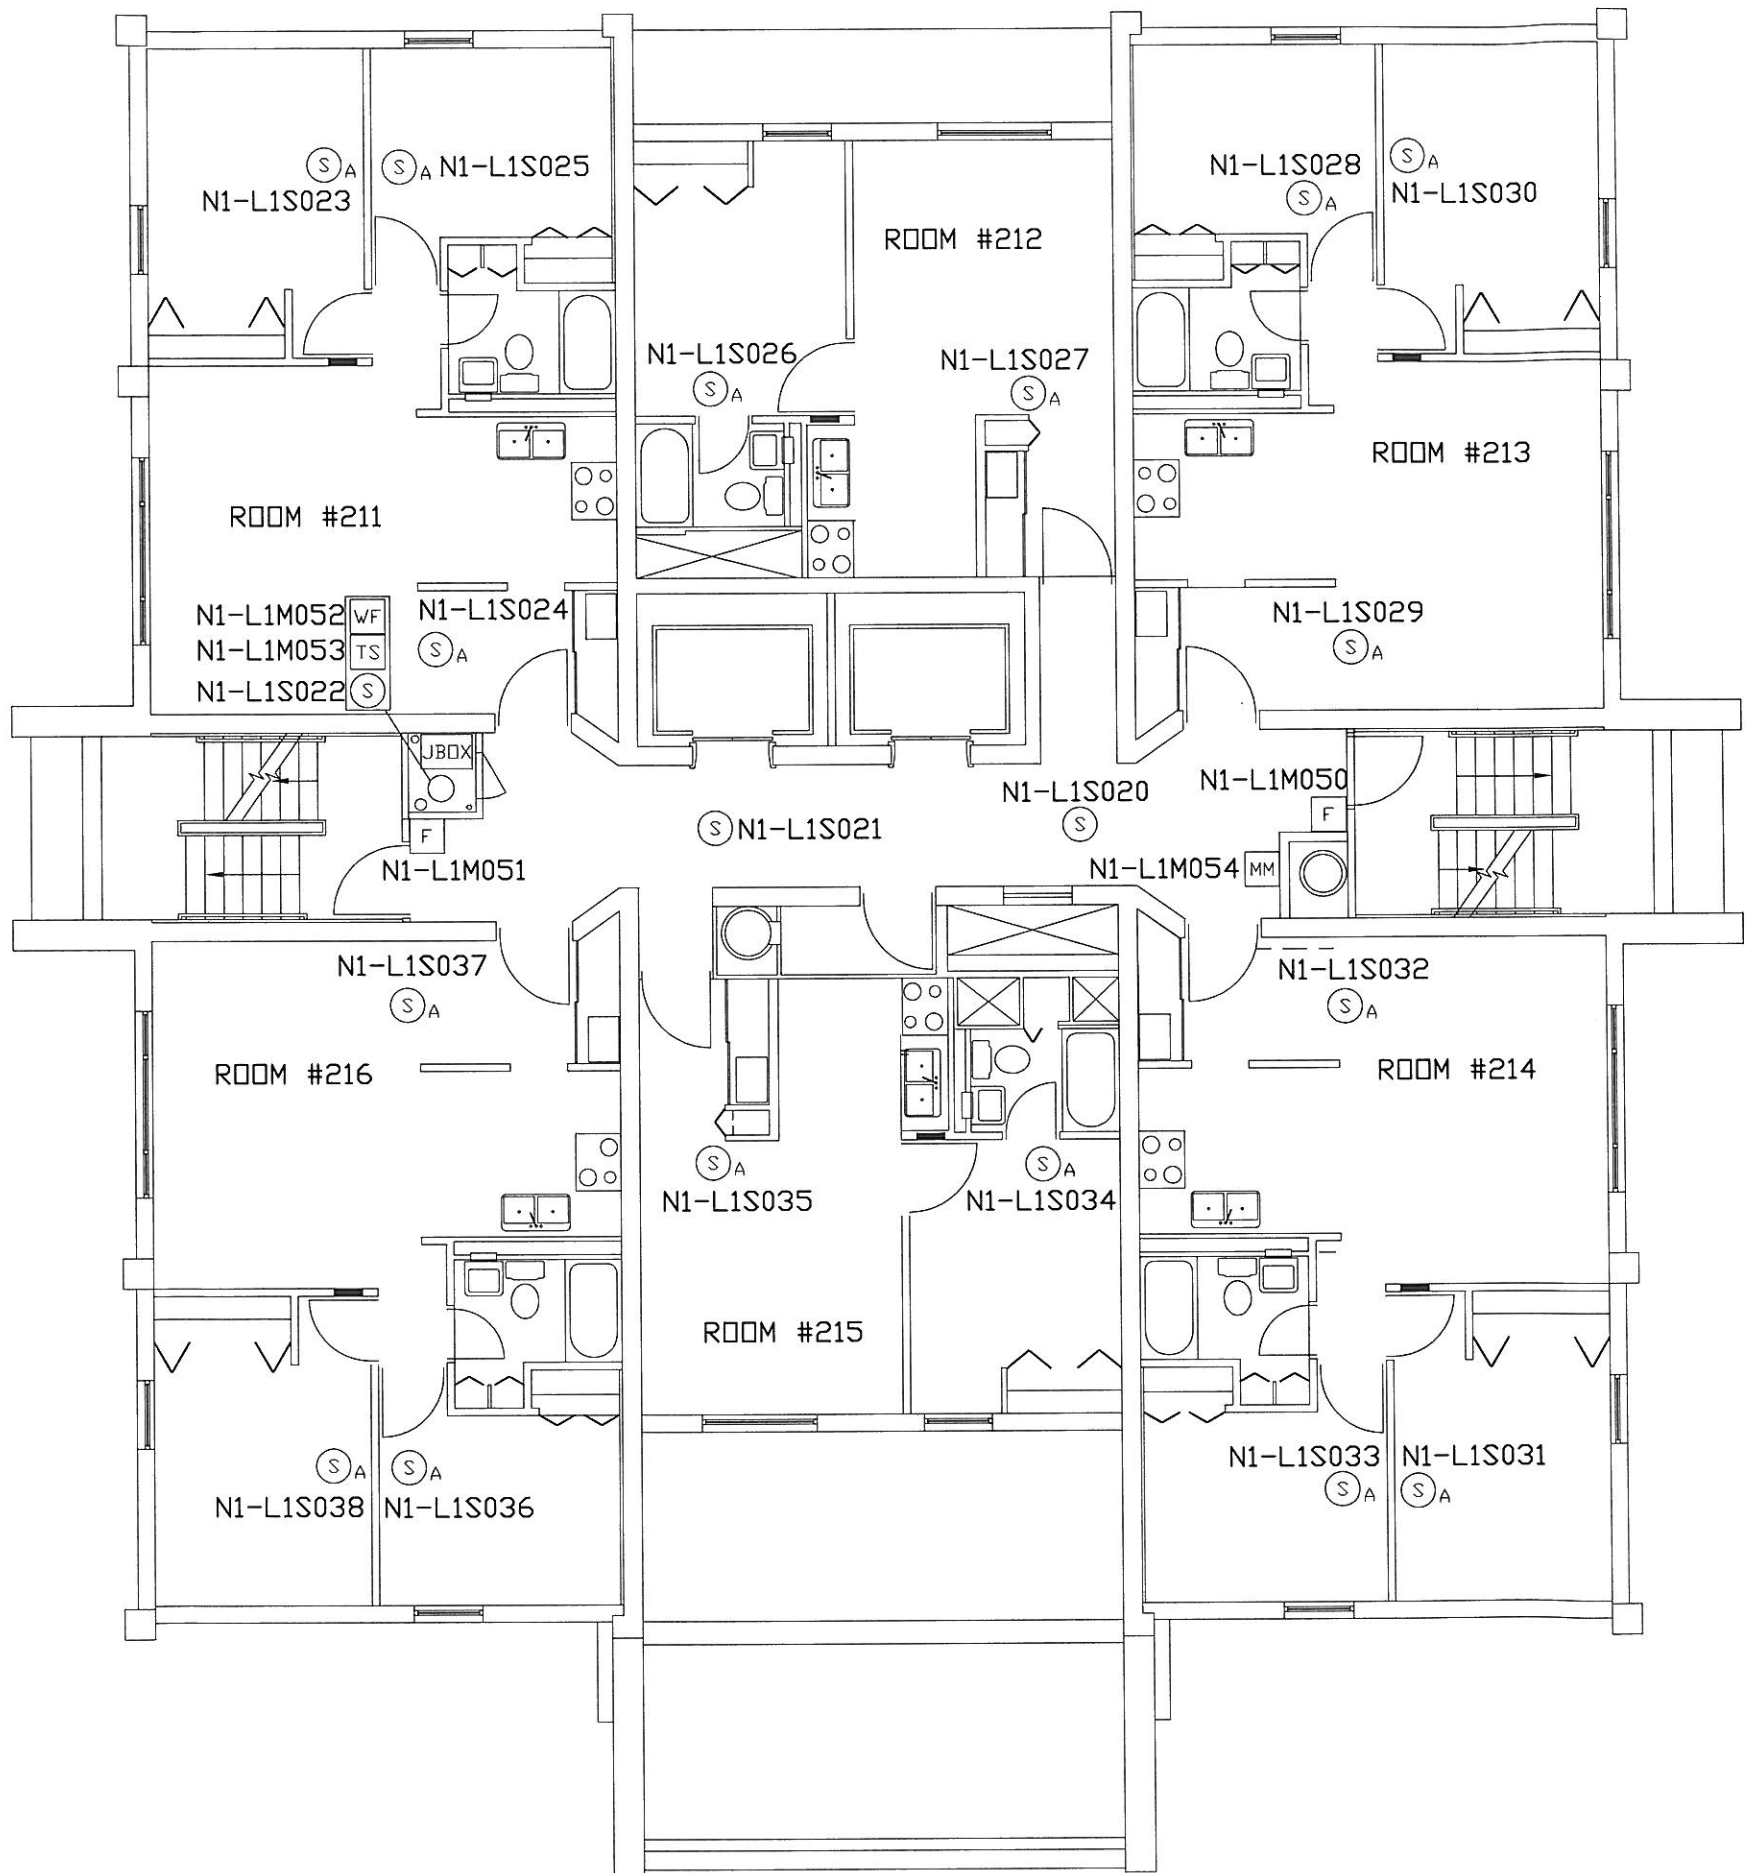

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S)A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CH	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
SECOND FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED2.DWG

FIRE ALARM SYSTEM

SECOND FLOOR
ADDRESSABLE NUMBERS


PAGE:

FA-2-04

N.I.C.E.T.
LEVEL III
CERTIFICATION


FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396

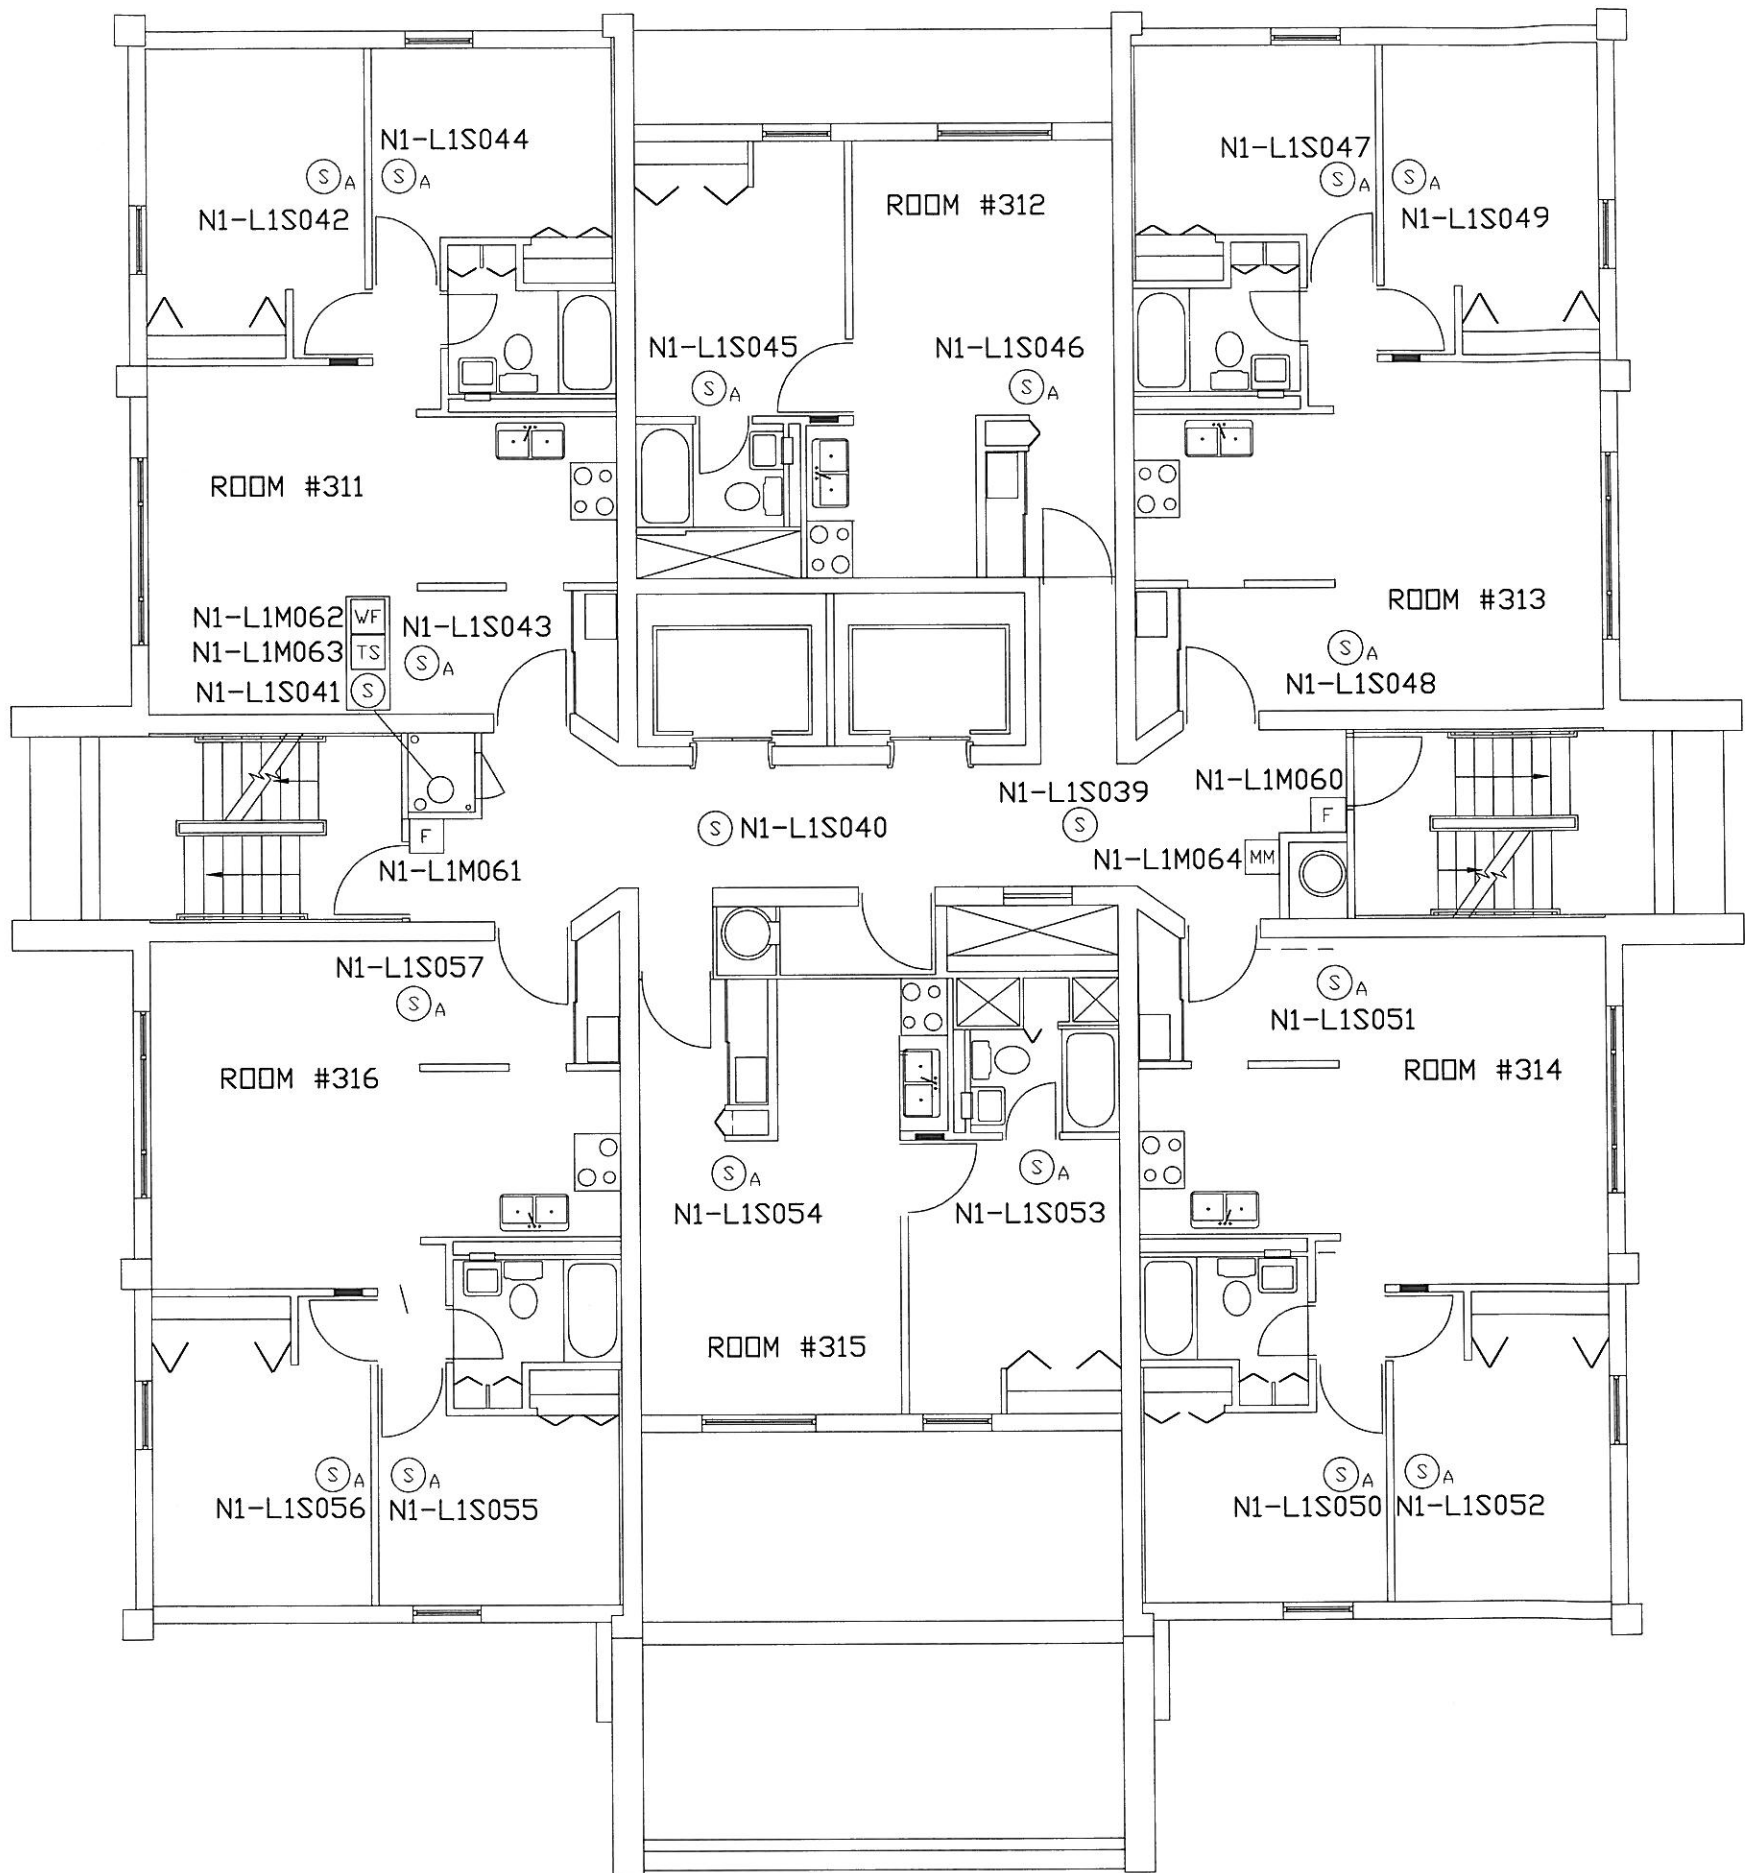

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S) ^A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL

LOCATED IN J-BOX ON THIS FLOOR:
 (MM) N1-L1M049 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
 UNIVERSITY OF UTAH
 THIRD FLOOR
 FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
 801-468-8300

DRAWN BY: DS
 DESIGNED BY: KGE
 APPROVED BY: TCT
 DATE: 8/15/08
 SCALE: NTS
 PROJECT NO: 0701-13092
 REV NO: 1
 DRAWING NAME:
 NORTHMED3.DWG


FIRE ALARM SYSTEM

THIRD FLOOR
 ADDRESSABLE NUMBERS

PAGE:

FA-3-04


N.I.C.E.T.
 LEVEL III
 CERTIFICATION
 FIRE ALARM SYSTEMS
 DONNY SCHULTZ
 #104396

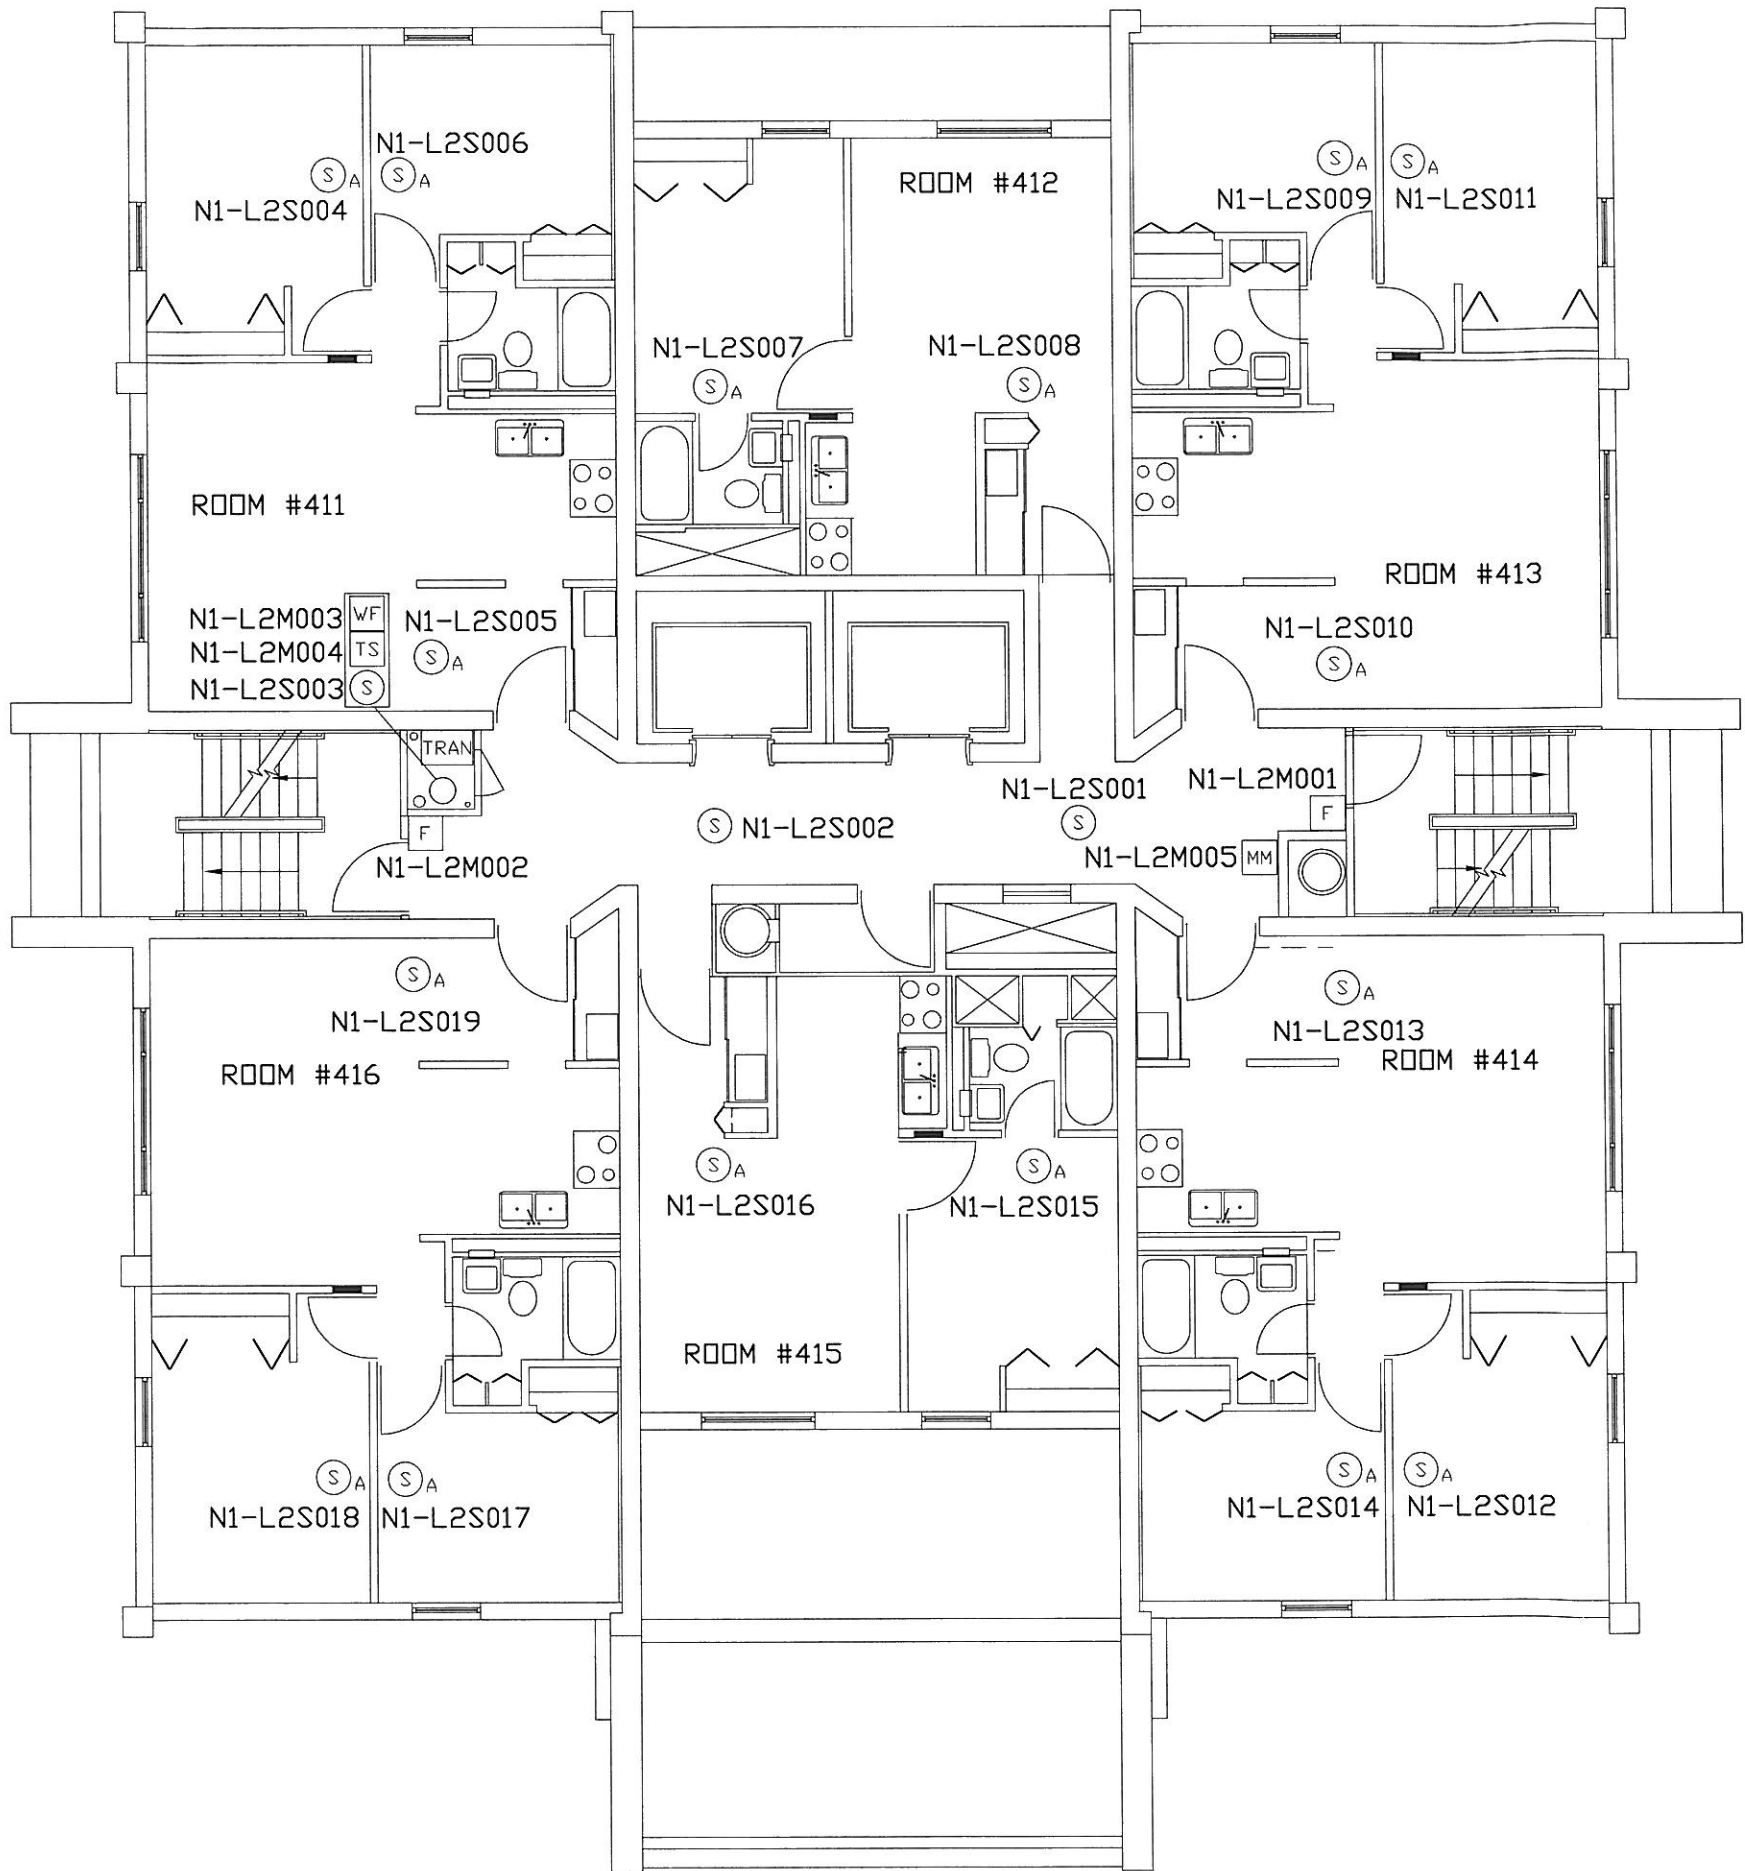

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

LOCATED IN TRAN ON THIS FLOOR:

- MM N1-L2M006 4TH FLOOR TRANSPONDER
- CM N1-L2M090 4TH FLOOR STROBES
- CM N1-L2M091 5TH FLOOR STROBES
- CM N1-L2M092 6TH FLOOR STROBES
- CM N1-L2M093 7TH FLOOR STROBES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
FOURTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED4.DWG

FIRE ALARM SYSTEM
FOURTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-4-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

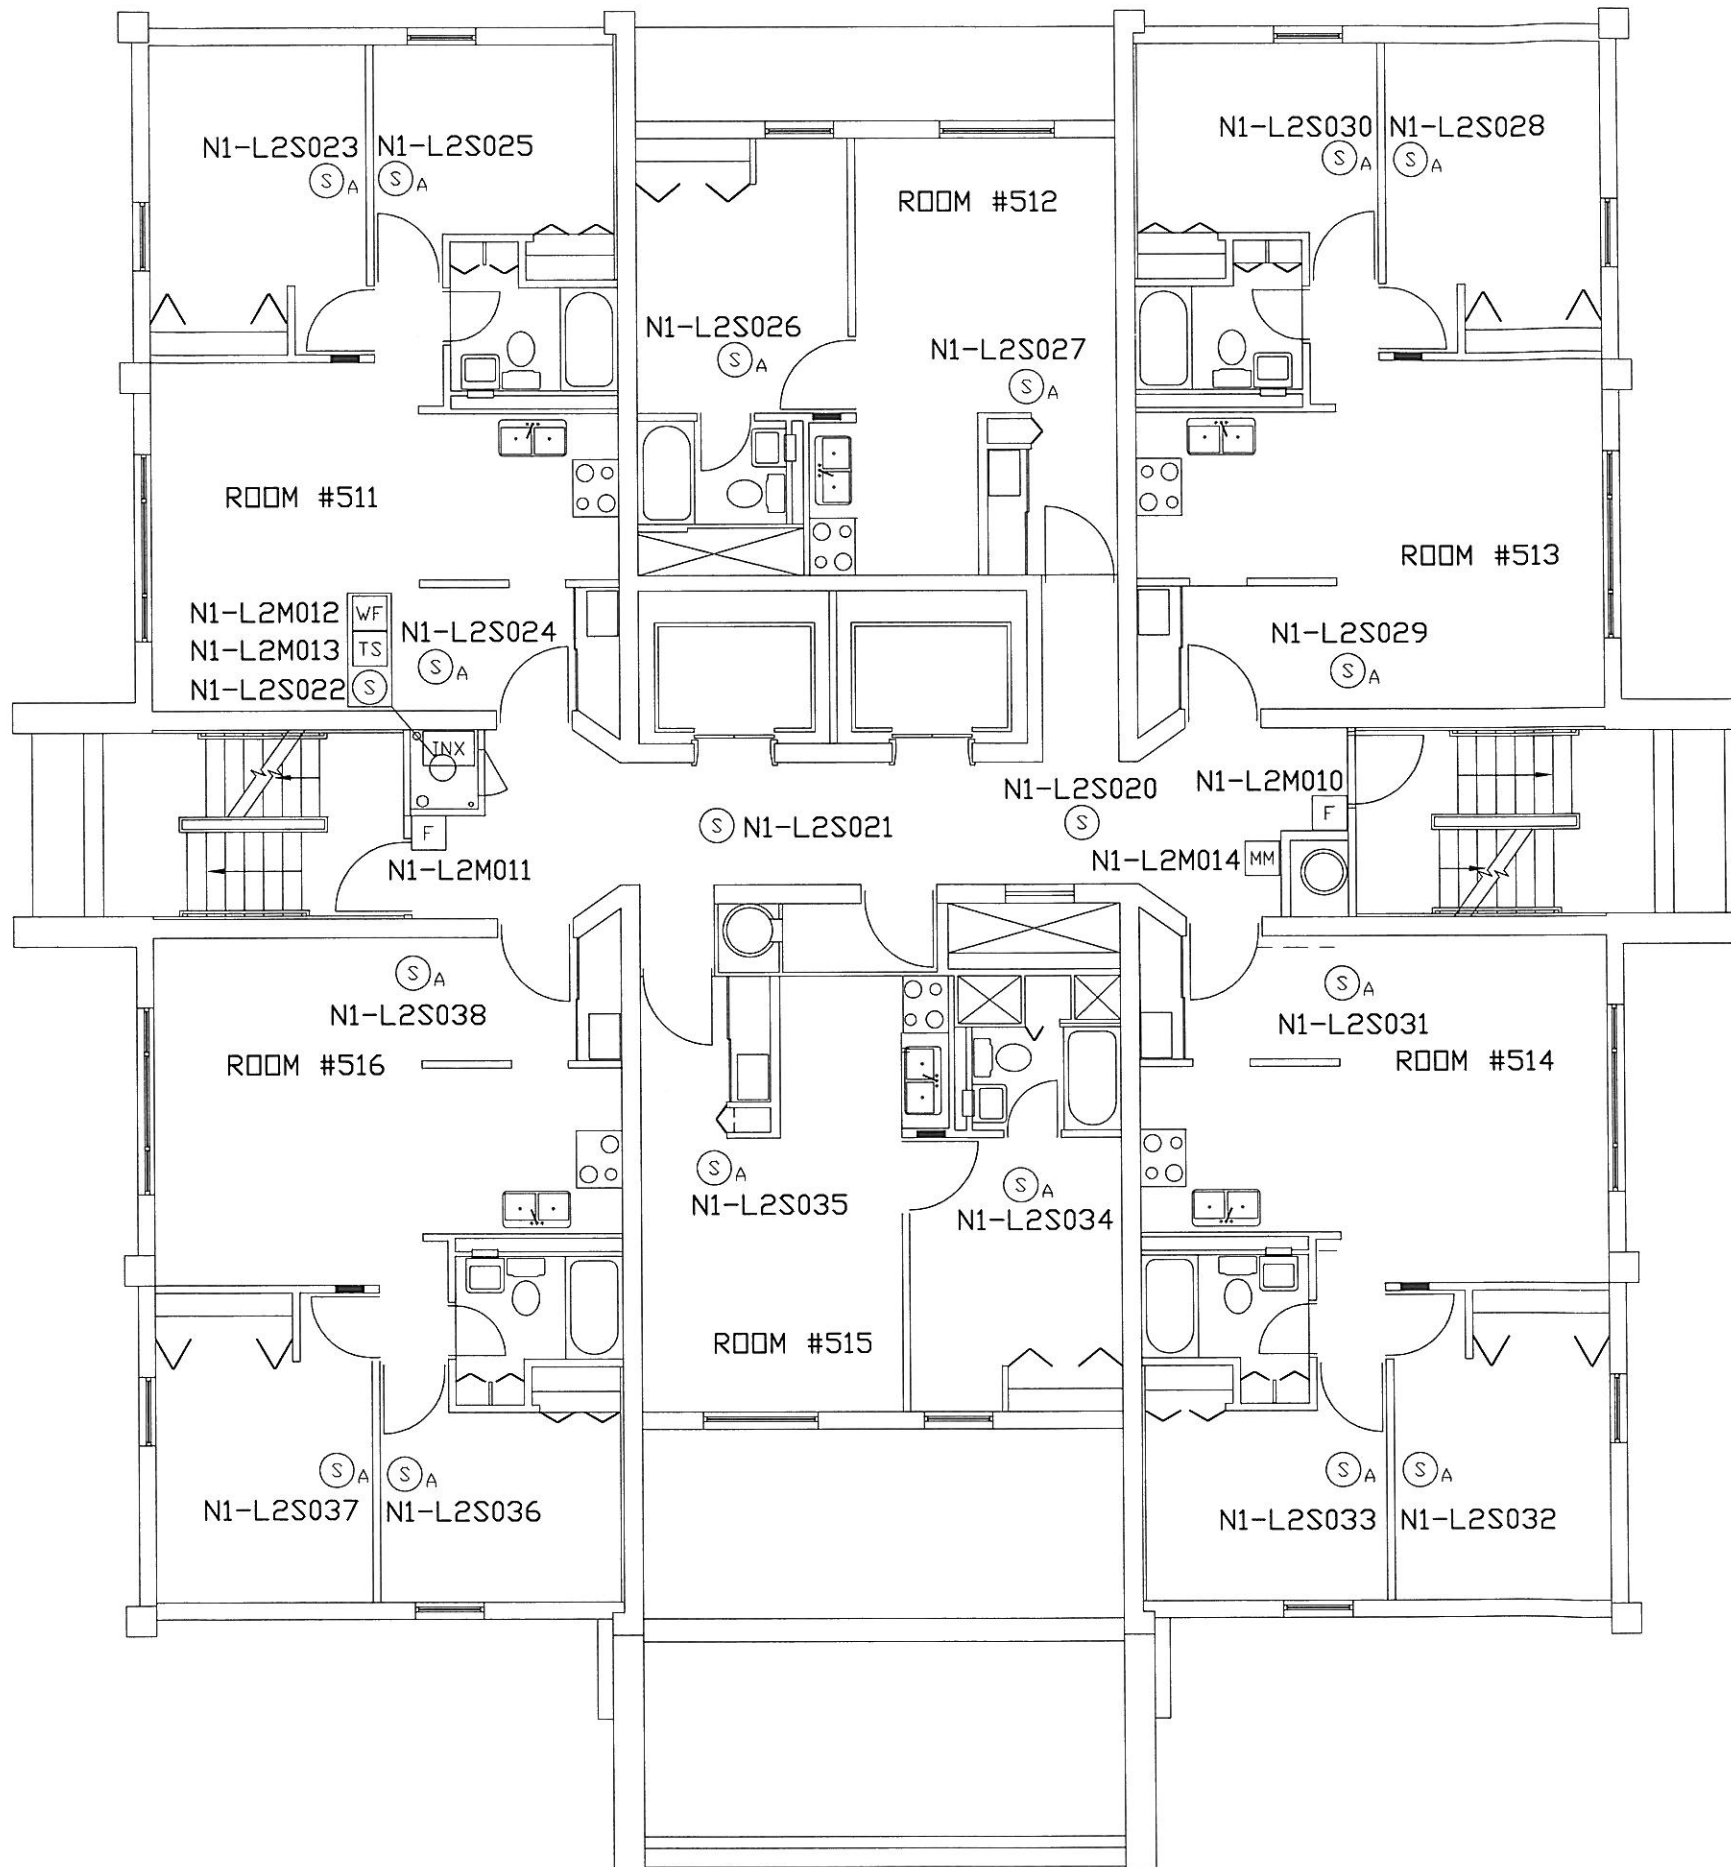

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S _A)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN INX PANEL ON THIS FLOOR:

- (CM) 4TH FLOOR FIREPHONES
- (CM) 5TH FLOOR FIREPHONES
- (CM) 6TH FLOOR FIREPHONES
- (CM) 7TH FLOOR FIREPHONES

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396


NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
FIFTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED5.DWG

FIRE ALARM SYSTEM
FIFTH FLOOR
ADDRESSABLE NUMBERS


PAGE:
FA-5-04



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. NFS IS NOT RESPONSIBLE FOR THE A/E'S DESIGN OR THE A/E'S SOLE RESPONSIBILITY FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

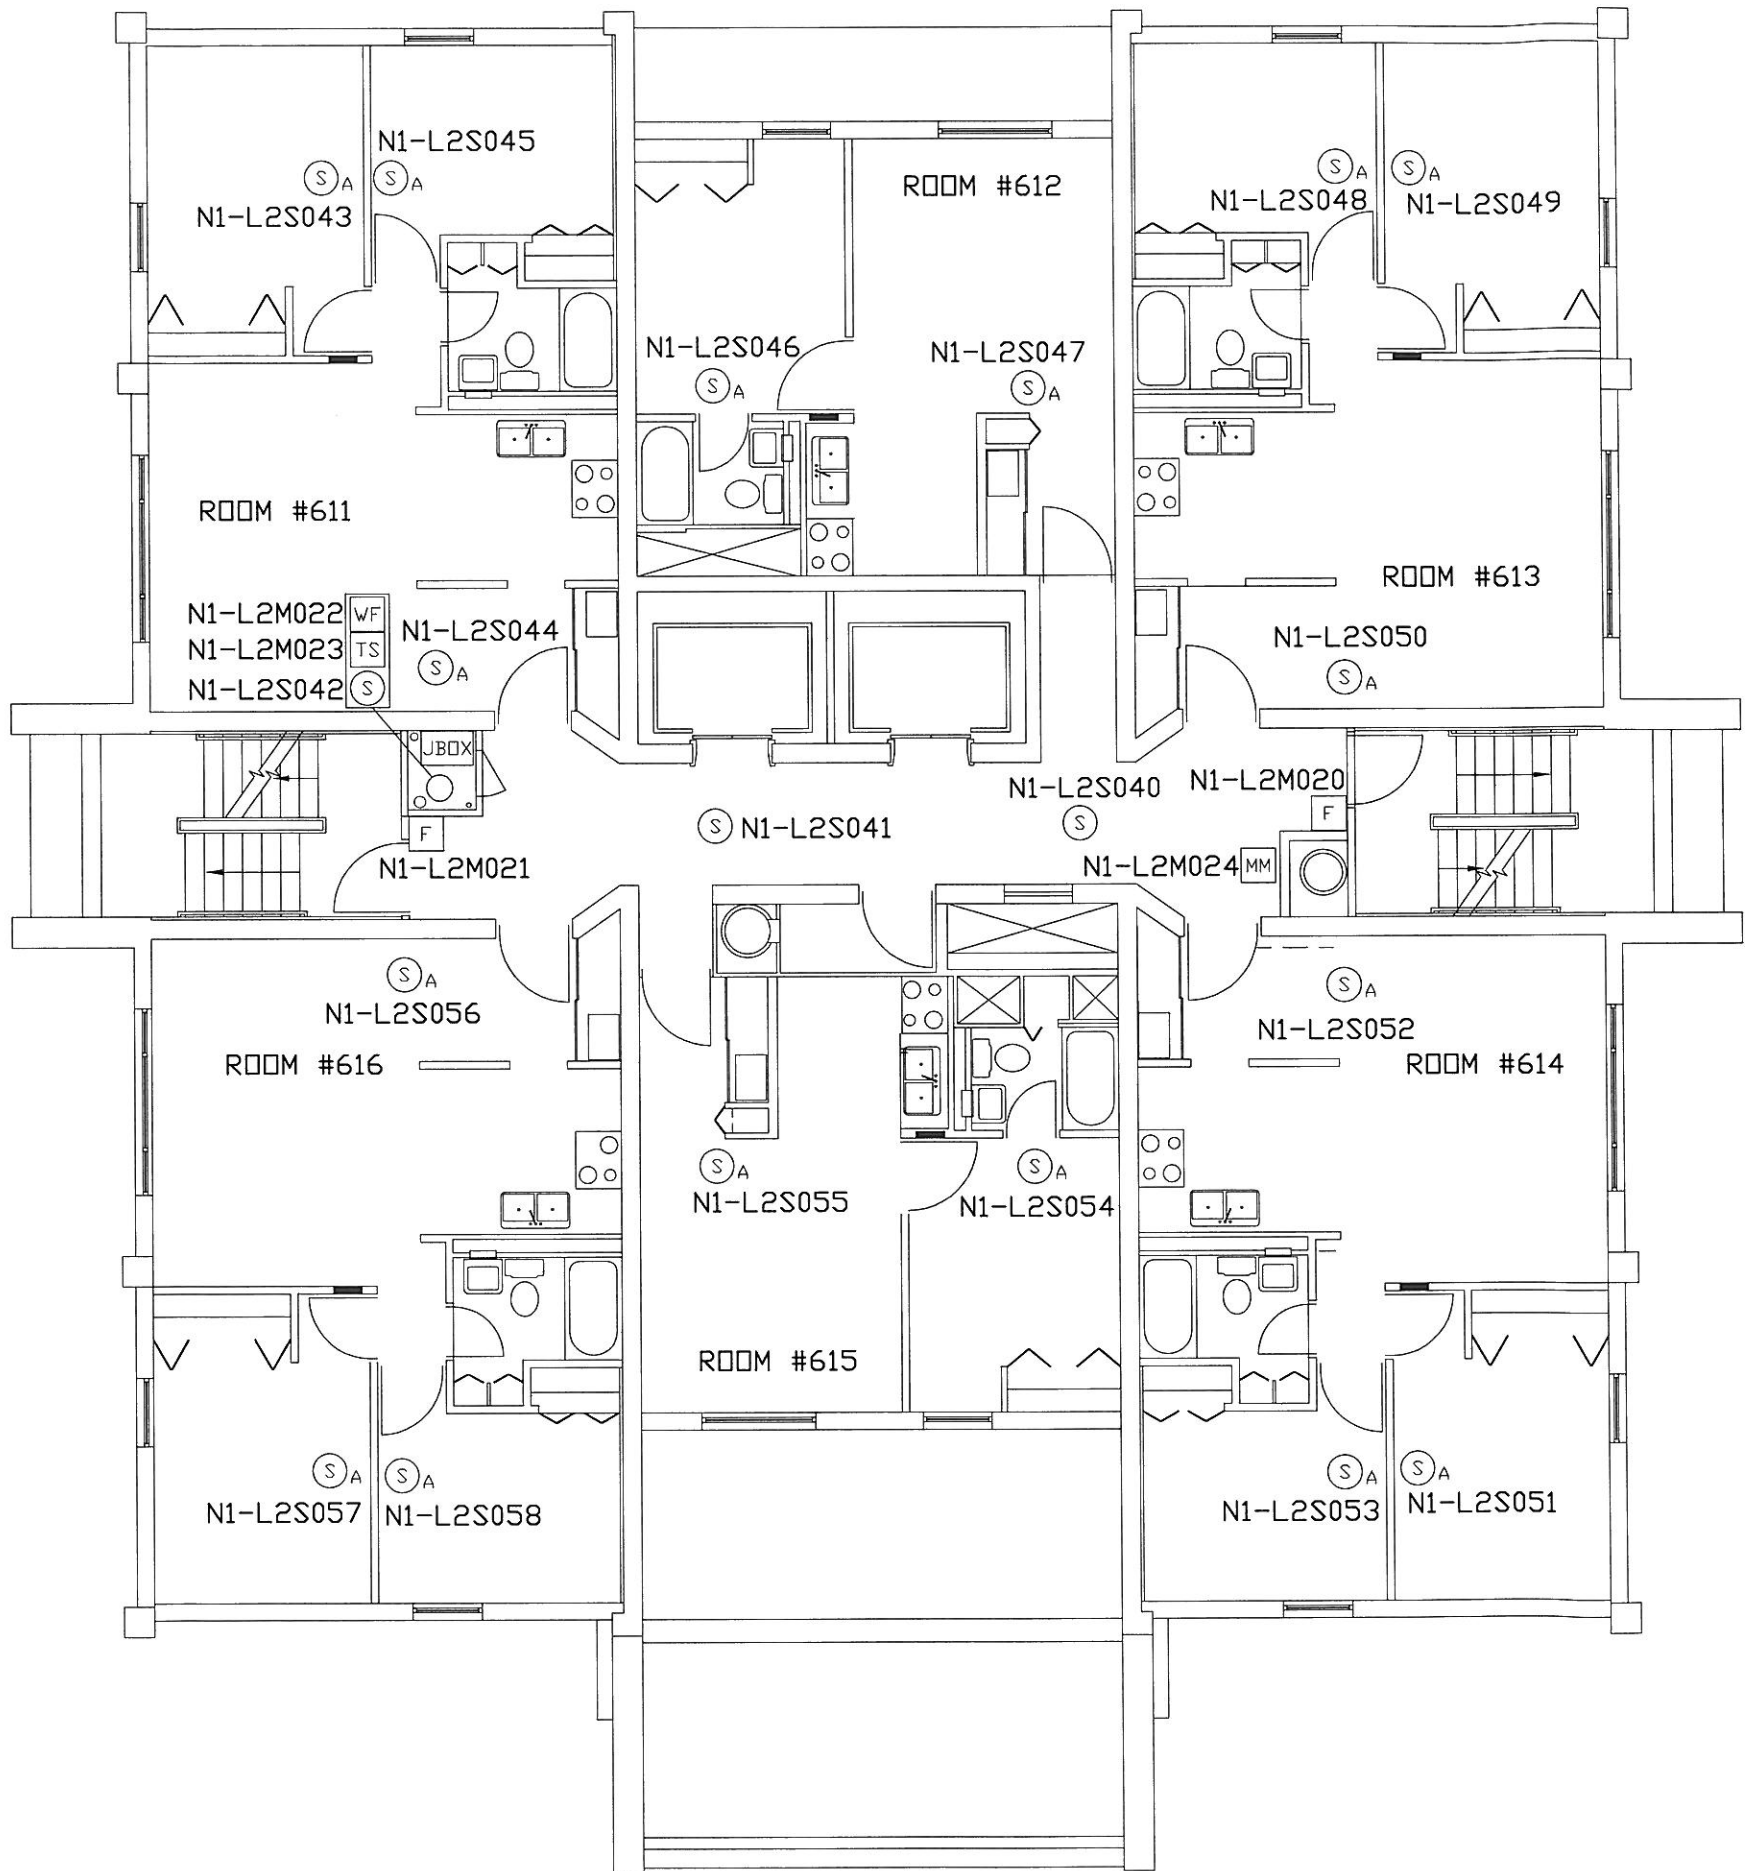

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S) ^A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(ACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
SIXTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED6.DWG


FIRE ALARM SYSTEM

SIXTH FLOOR
ADDRESSABLE NUMBERS

PAGE:

FA-6-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

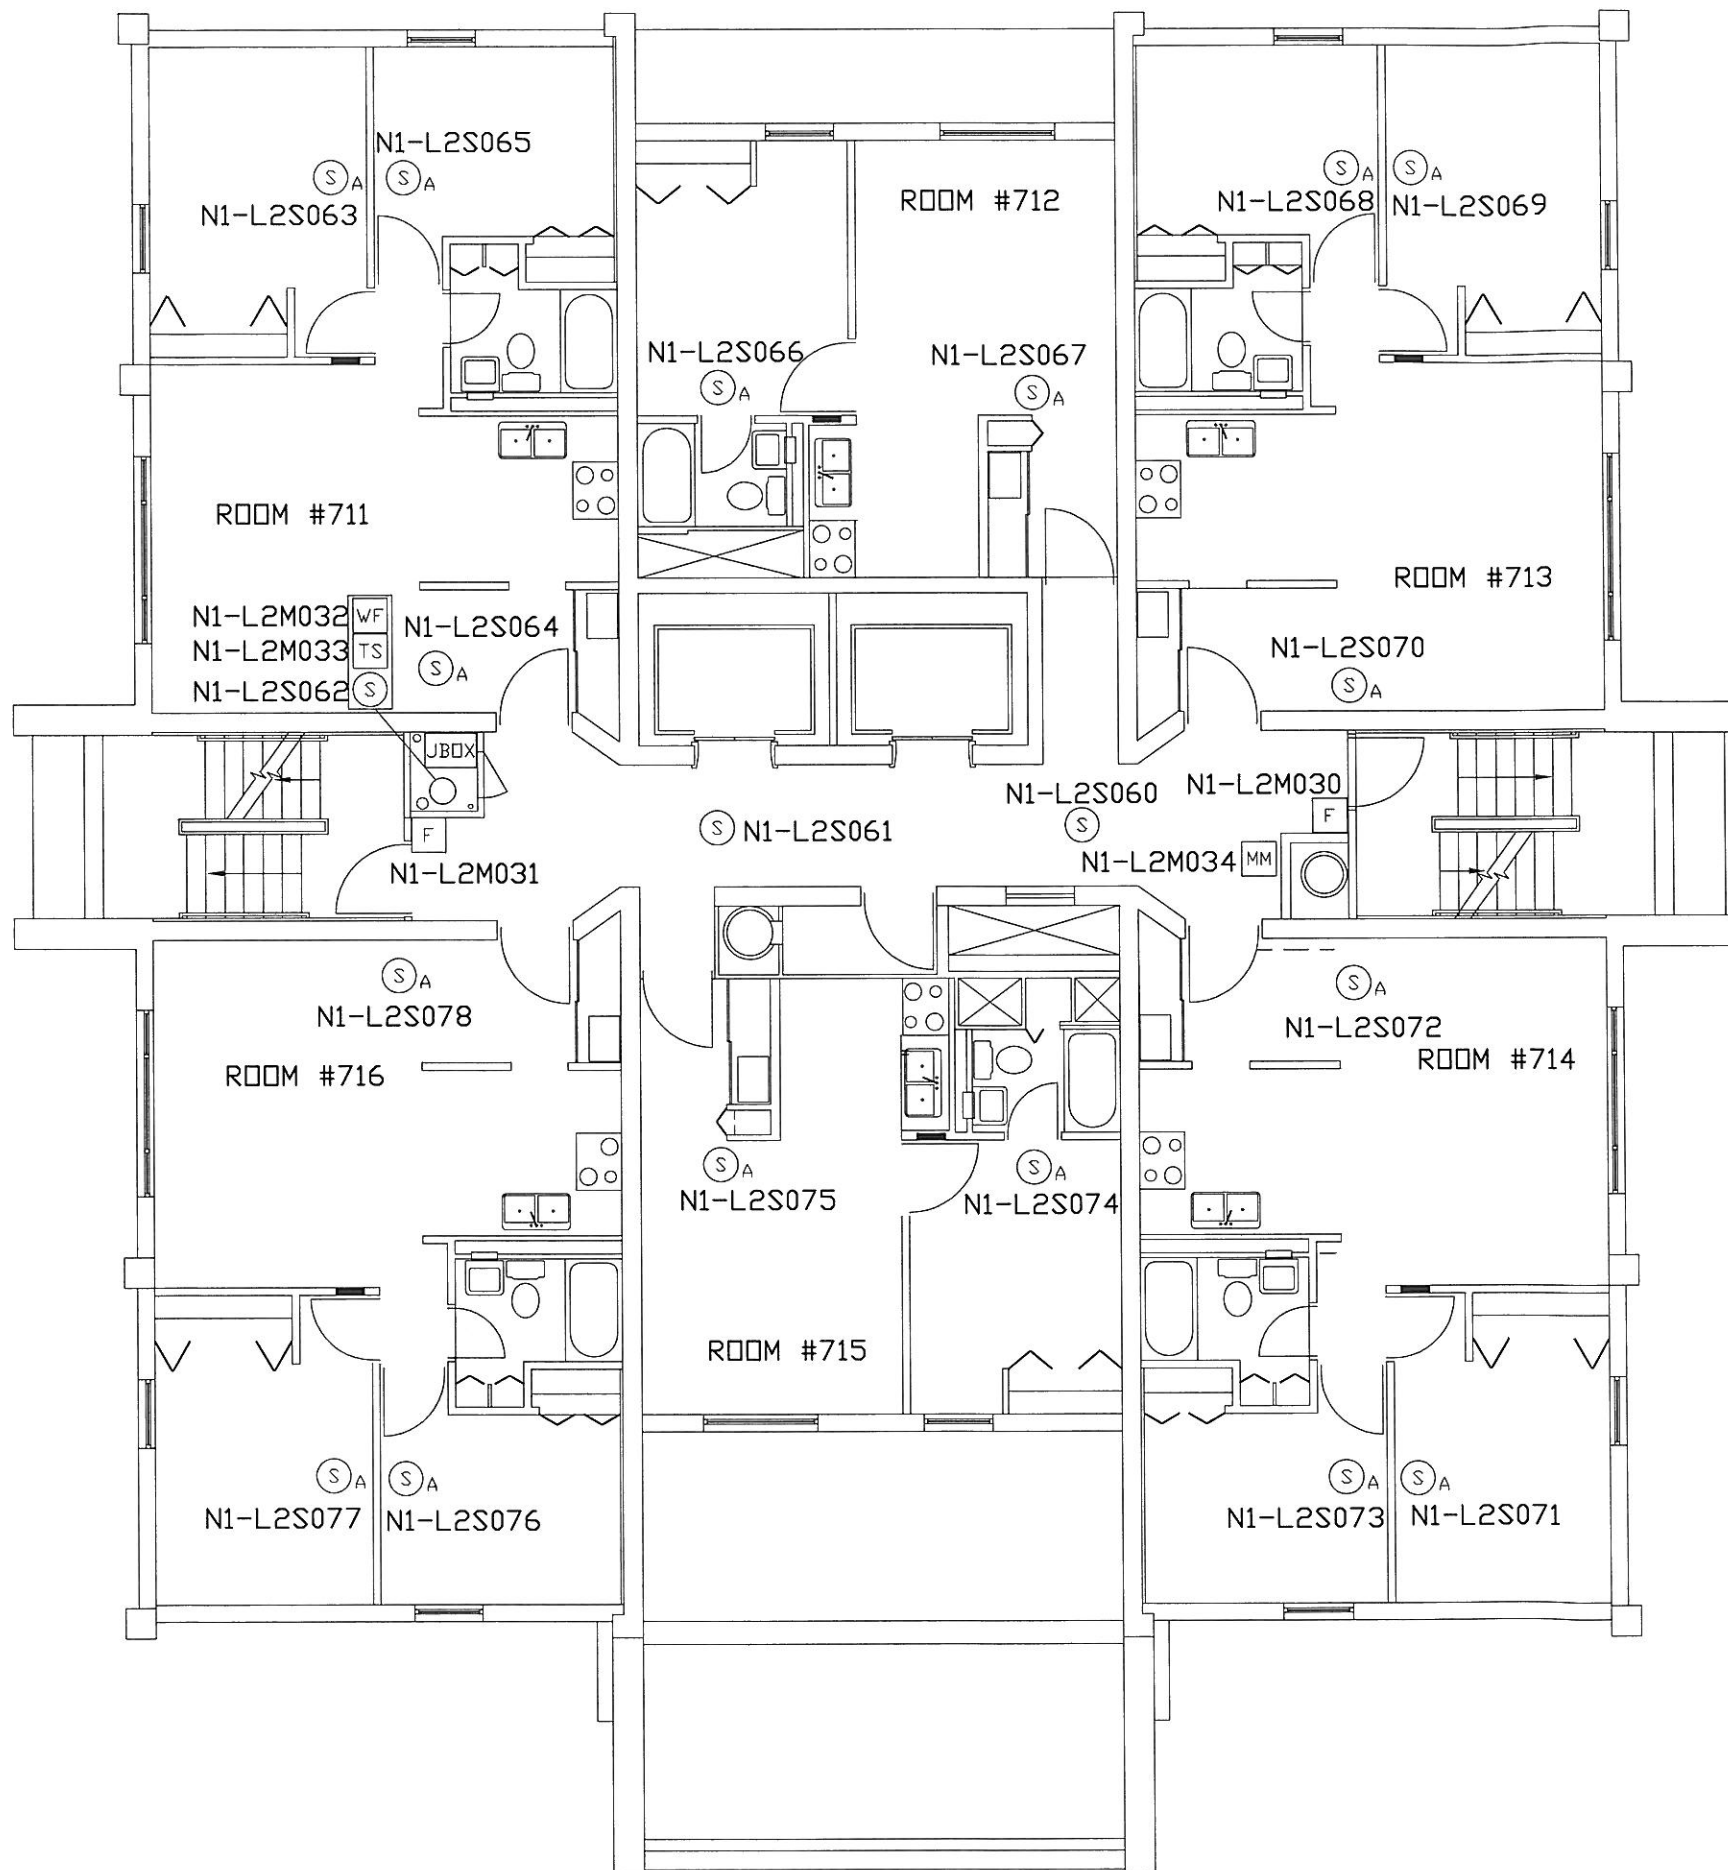

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S _A)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(VX)	VOICE PANEL

LOCATED IN J-BOX ON THIS FLOOR:

(MM) N1-L2M035 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
SEVENTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED7.DWG


FIRE ALARM SYSTEM

SEVENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:

FA-7-04


N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

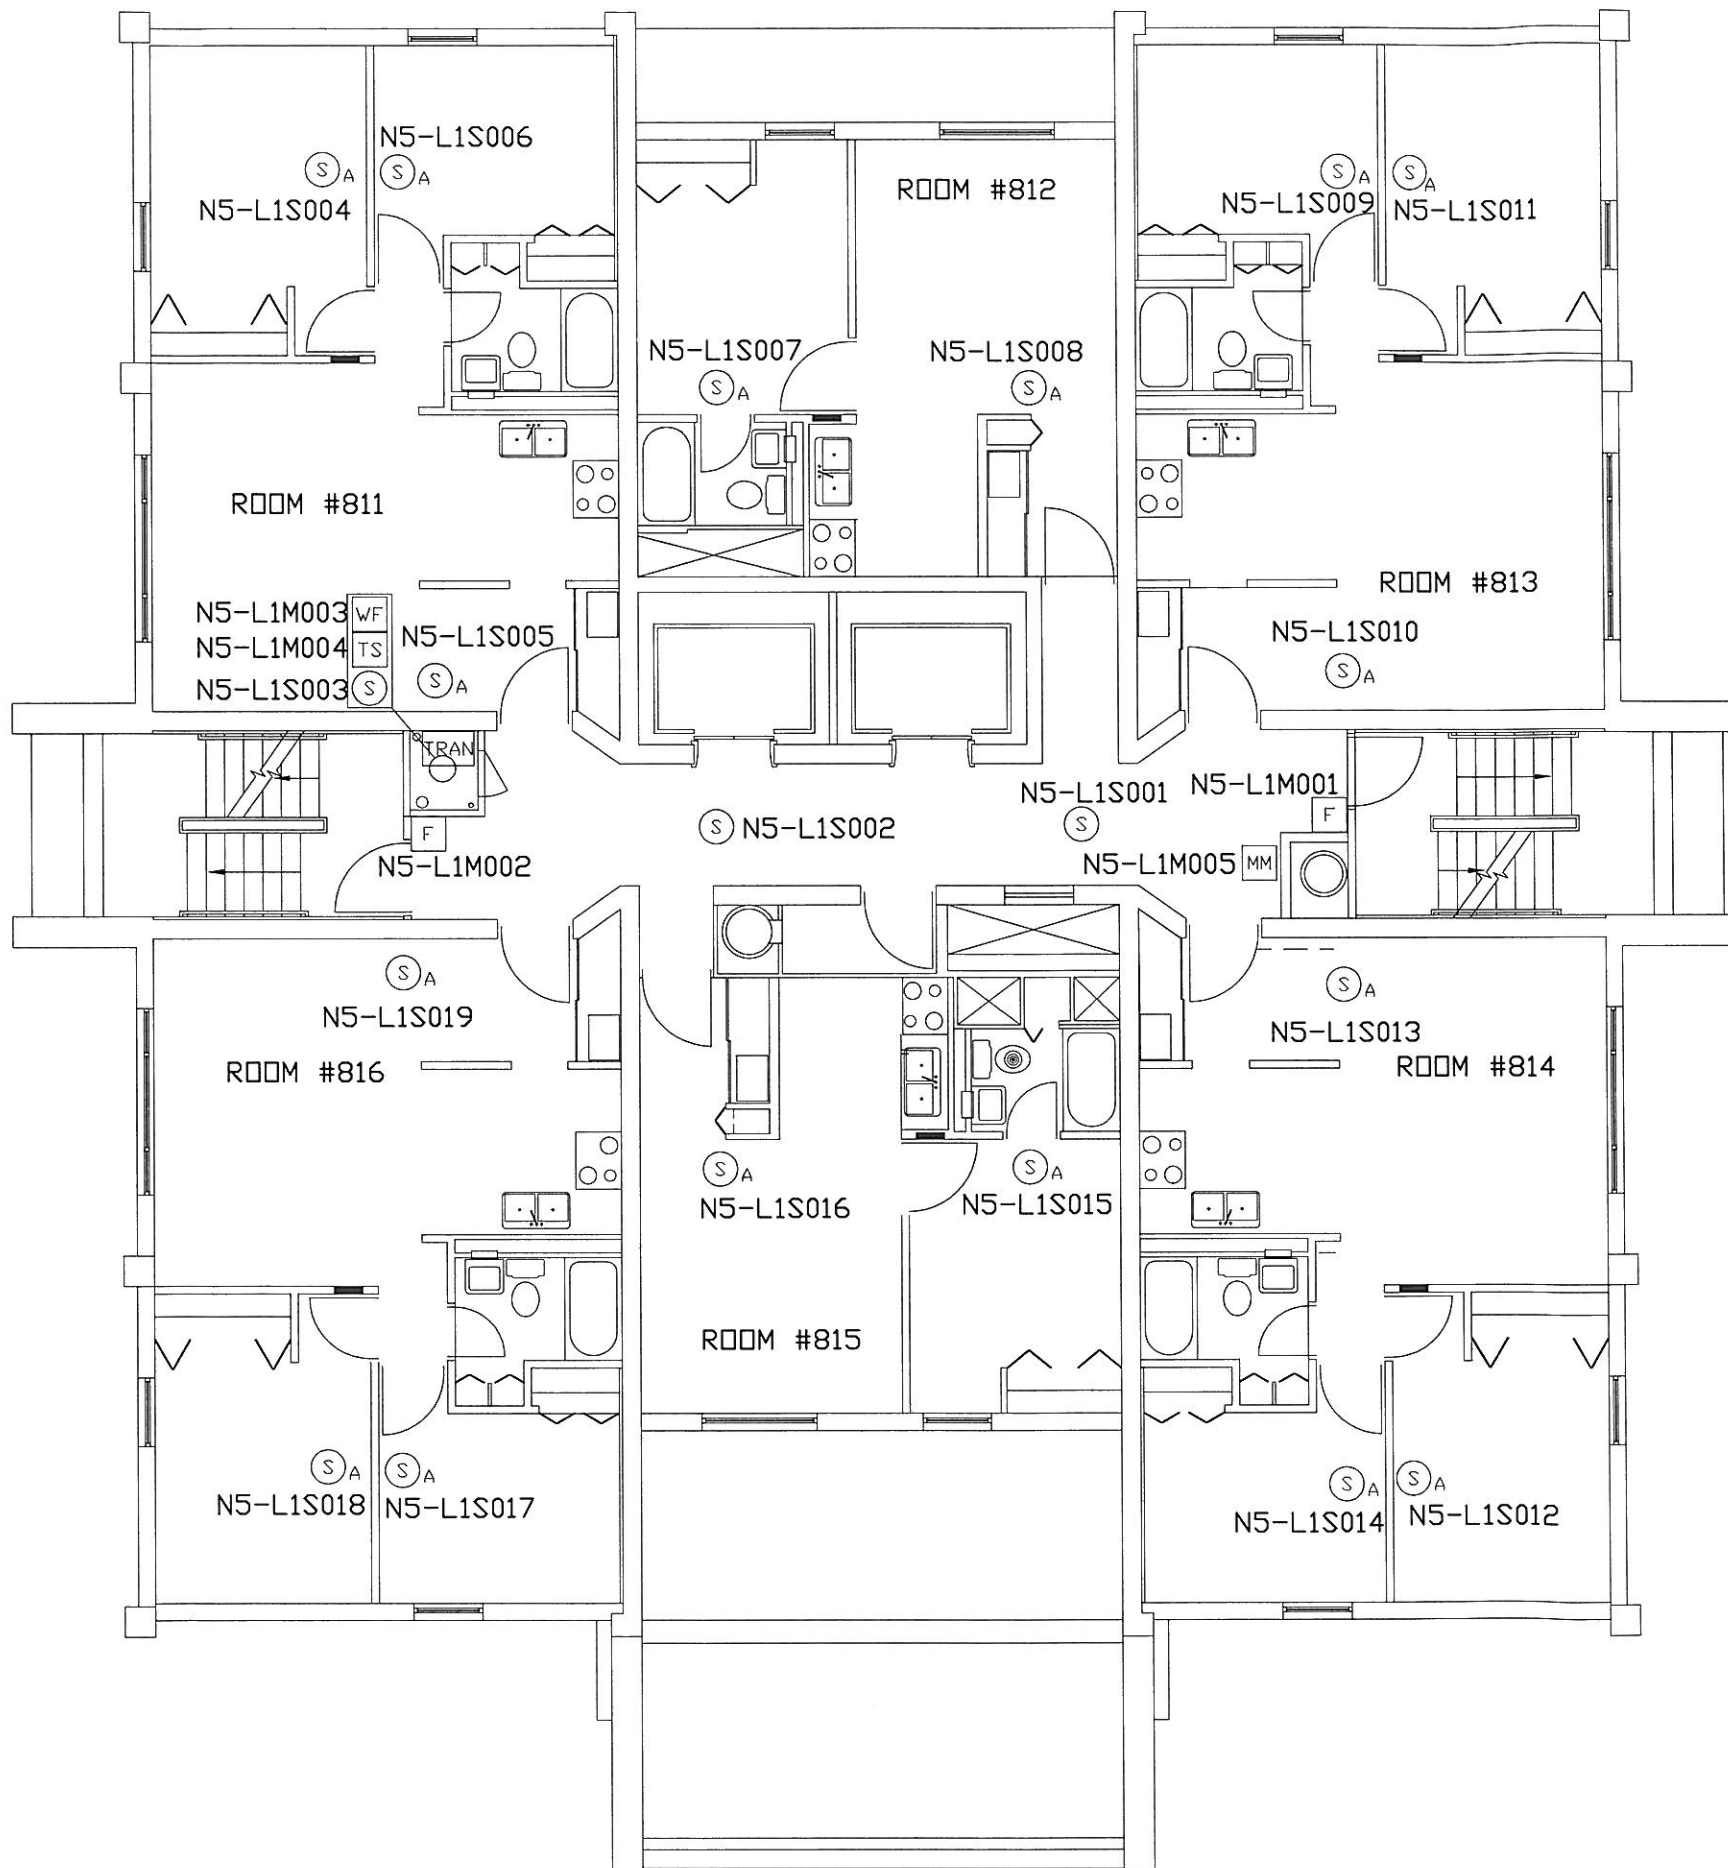

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(SA)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN TRAN ON THIS FLOOR:

- MM N5-L1M006 8TH FLOOR TRANSPONDER
- CM N5-L1M090 8TH FLOOR STROBES
- CM N5-L1M091 9TH FLOOR STROBES
- CM N5-L1M092 10TH FLOOR STROBES
- CM N5-L1M093 11TH FLOOR STROBES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
EIGHTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME: NORTHMED8.DWG

FIRE ALARM SYSTEM
EIGHTH FLOOR
ADDRESSABLE NUMBERS


PAGE:

FA-8-04

N.I.C.E.T.
LEVEL III
CERTIFICATION

FIRE ALARM SYSTEMS


DONNY SCHULTZ
#104396

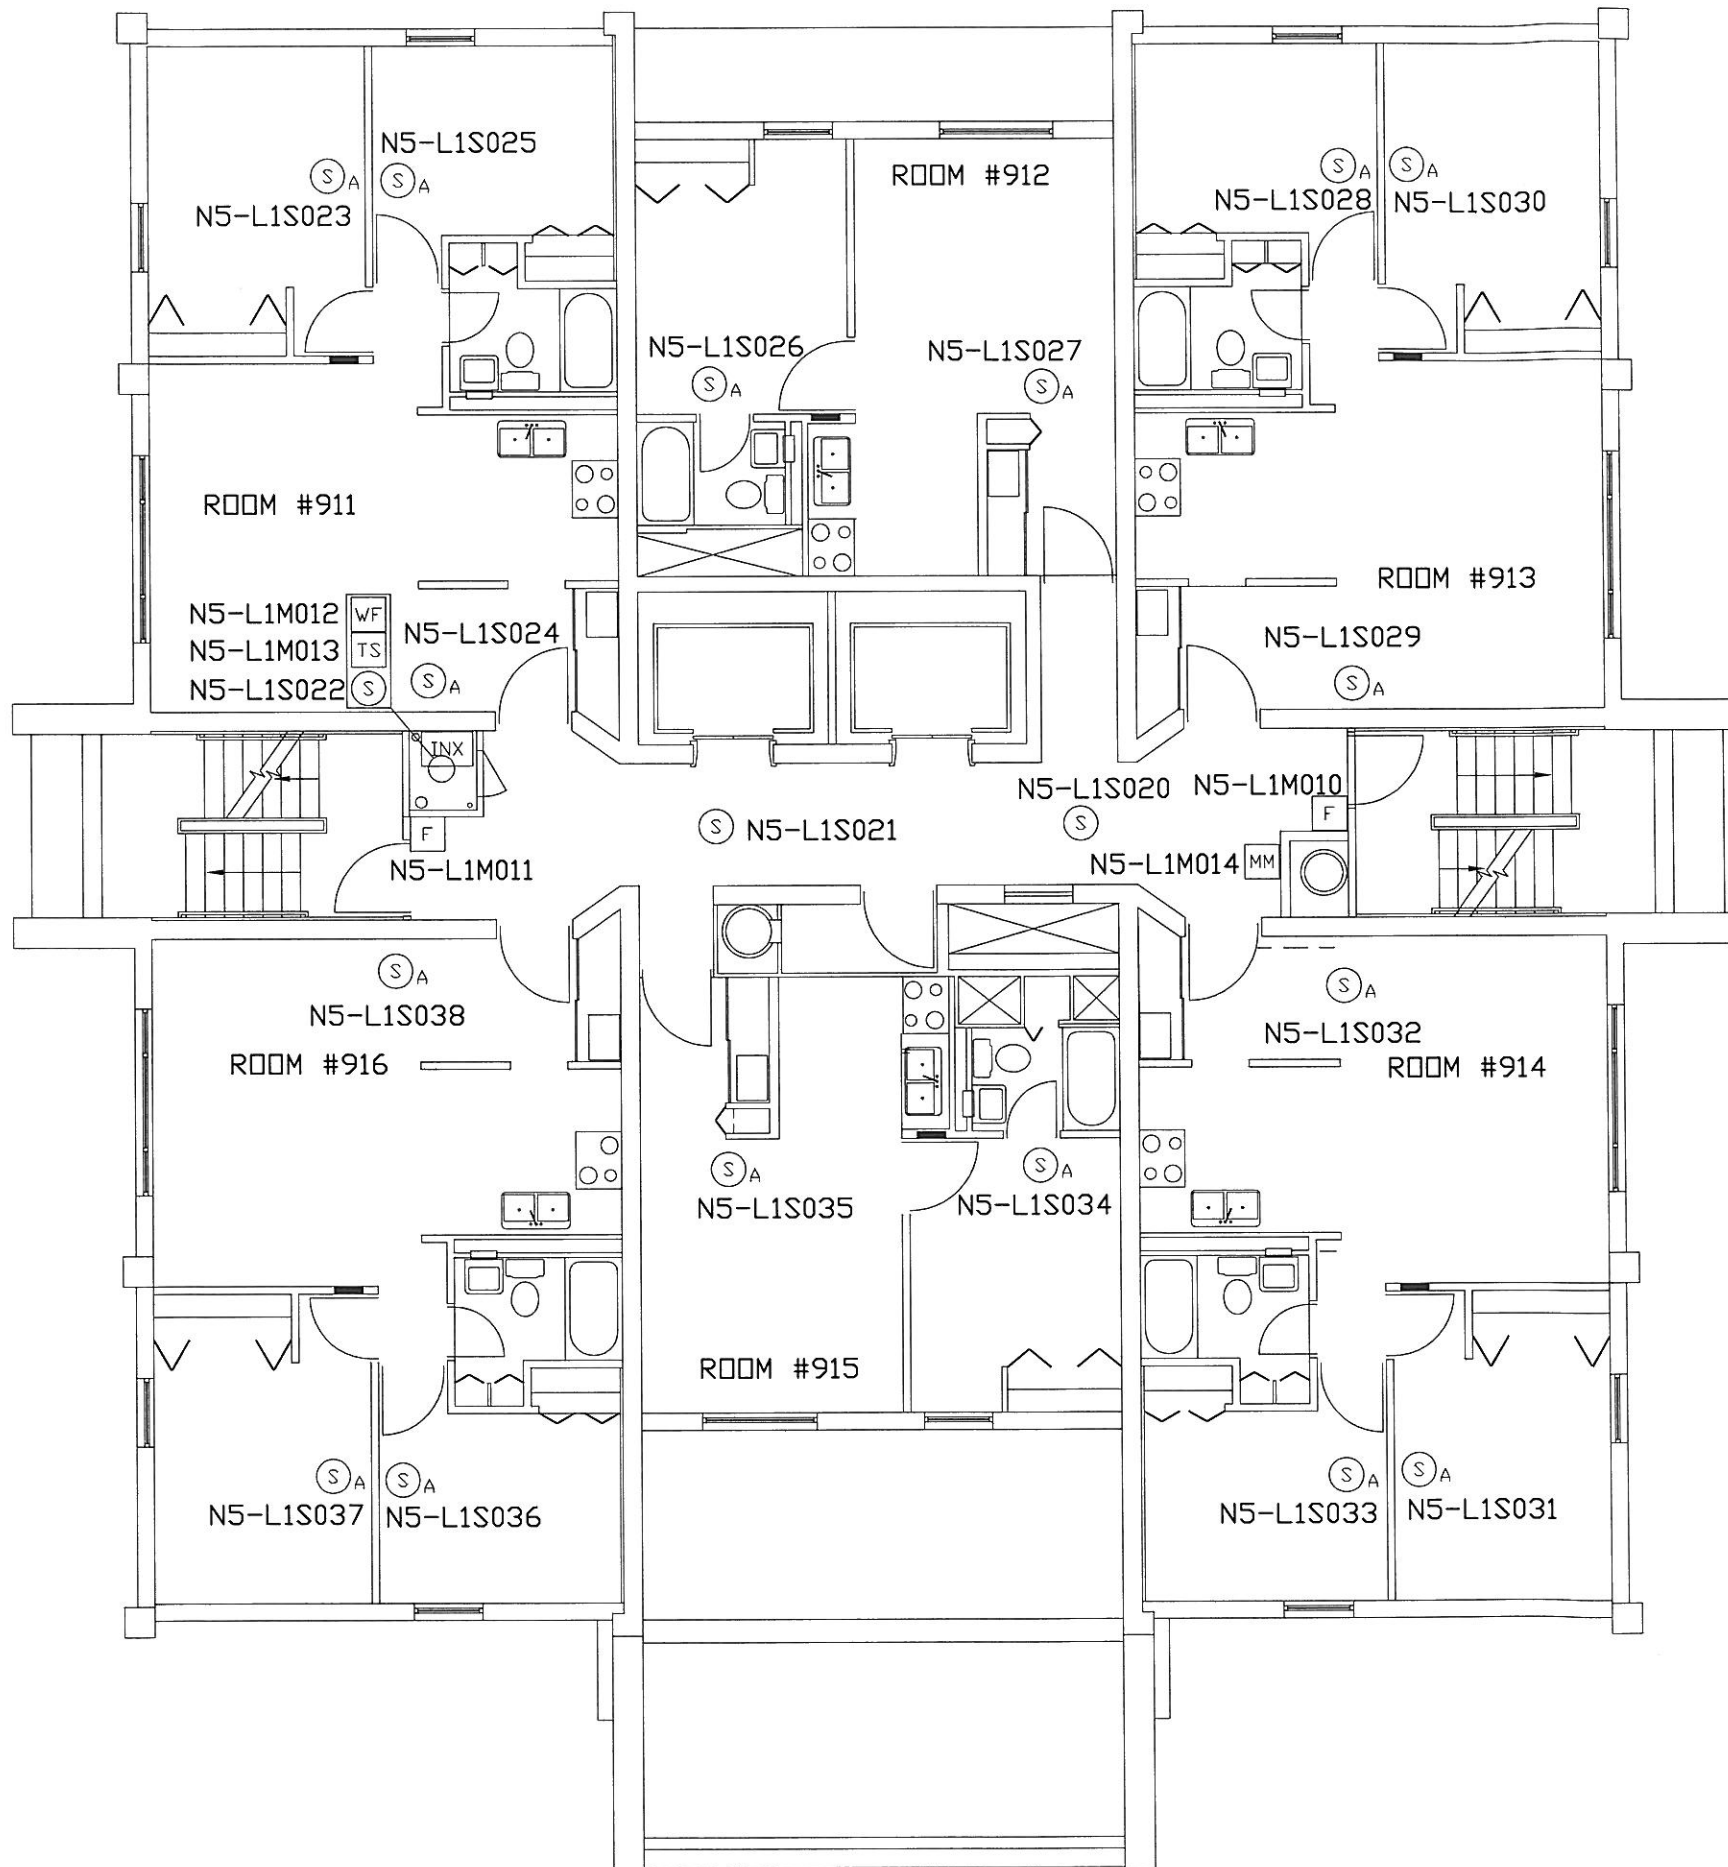

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S)A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN INX PANEL ON THIS FLOOR:

- (CM) 8TH FLOOR FIREPHONES
- (CM) 9TH FLOOR FIREPHONES
- (CM) 10TH FLOOR FIREPHONES
- (CM) 11TH FLOOR FIREPHONES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
NINTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: I
DRAWING NAME:
NORTHMED9.DWG


FIRE ALARM SYSTEM
NINTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-9-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

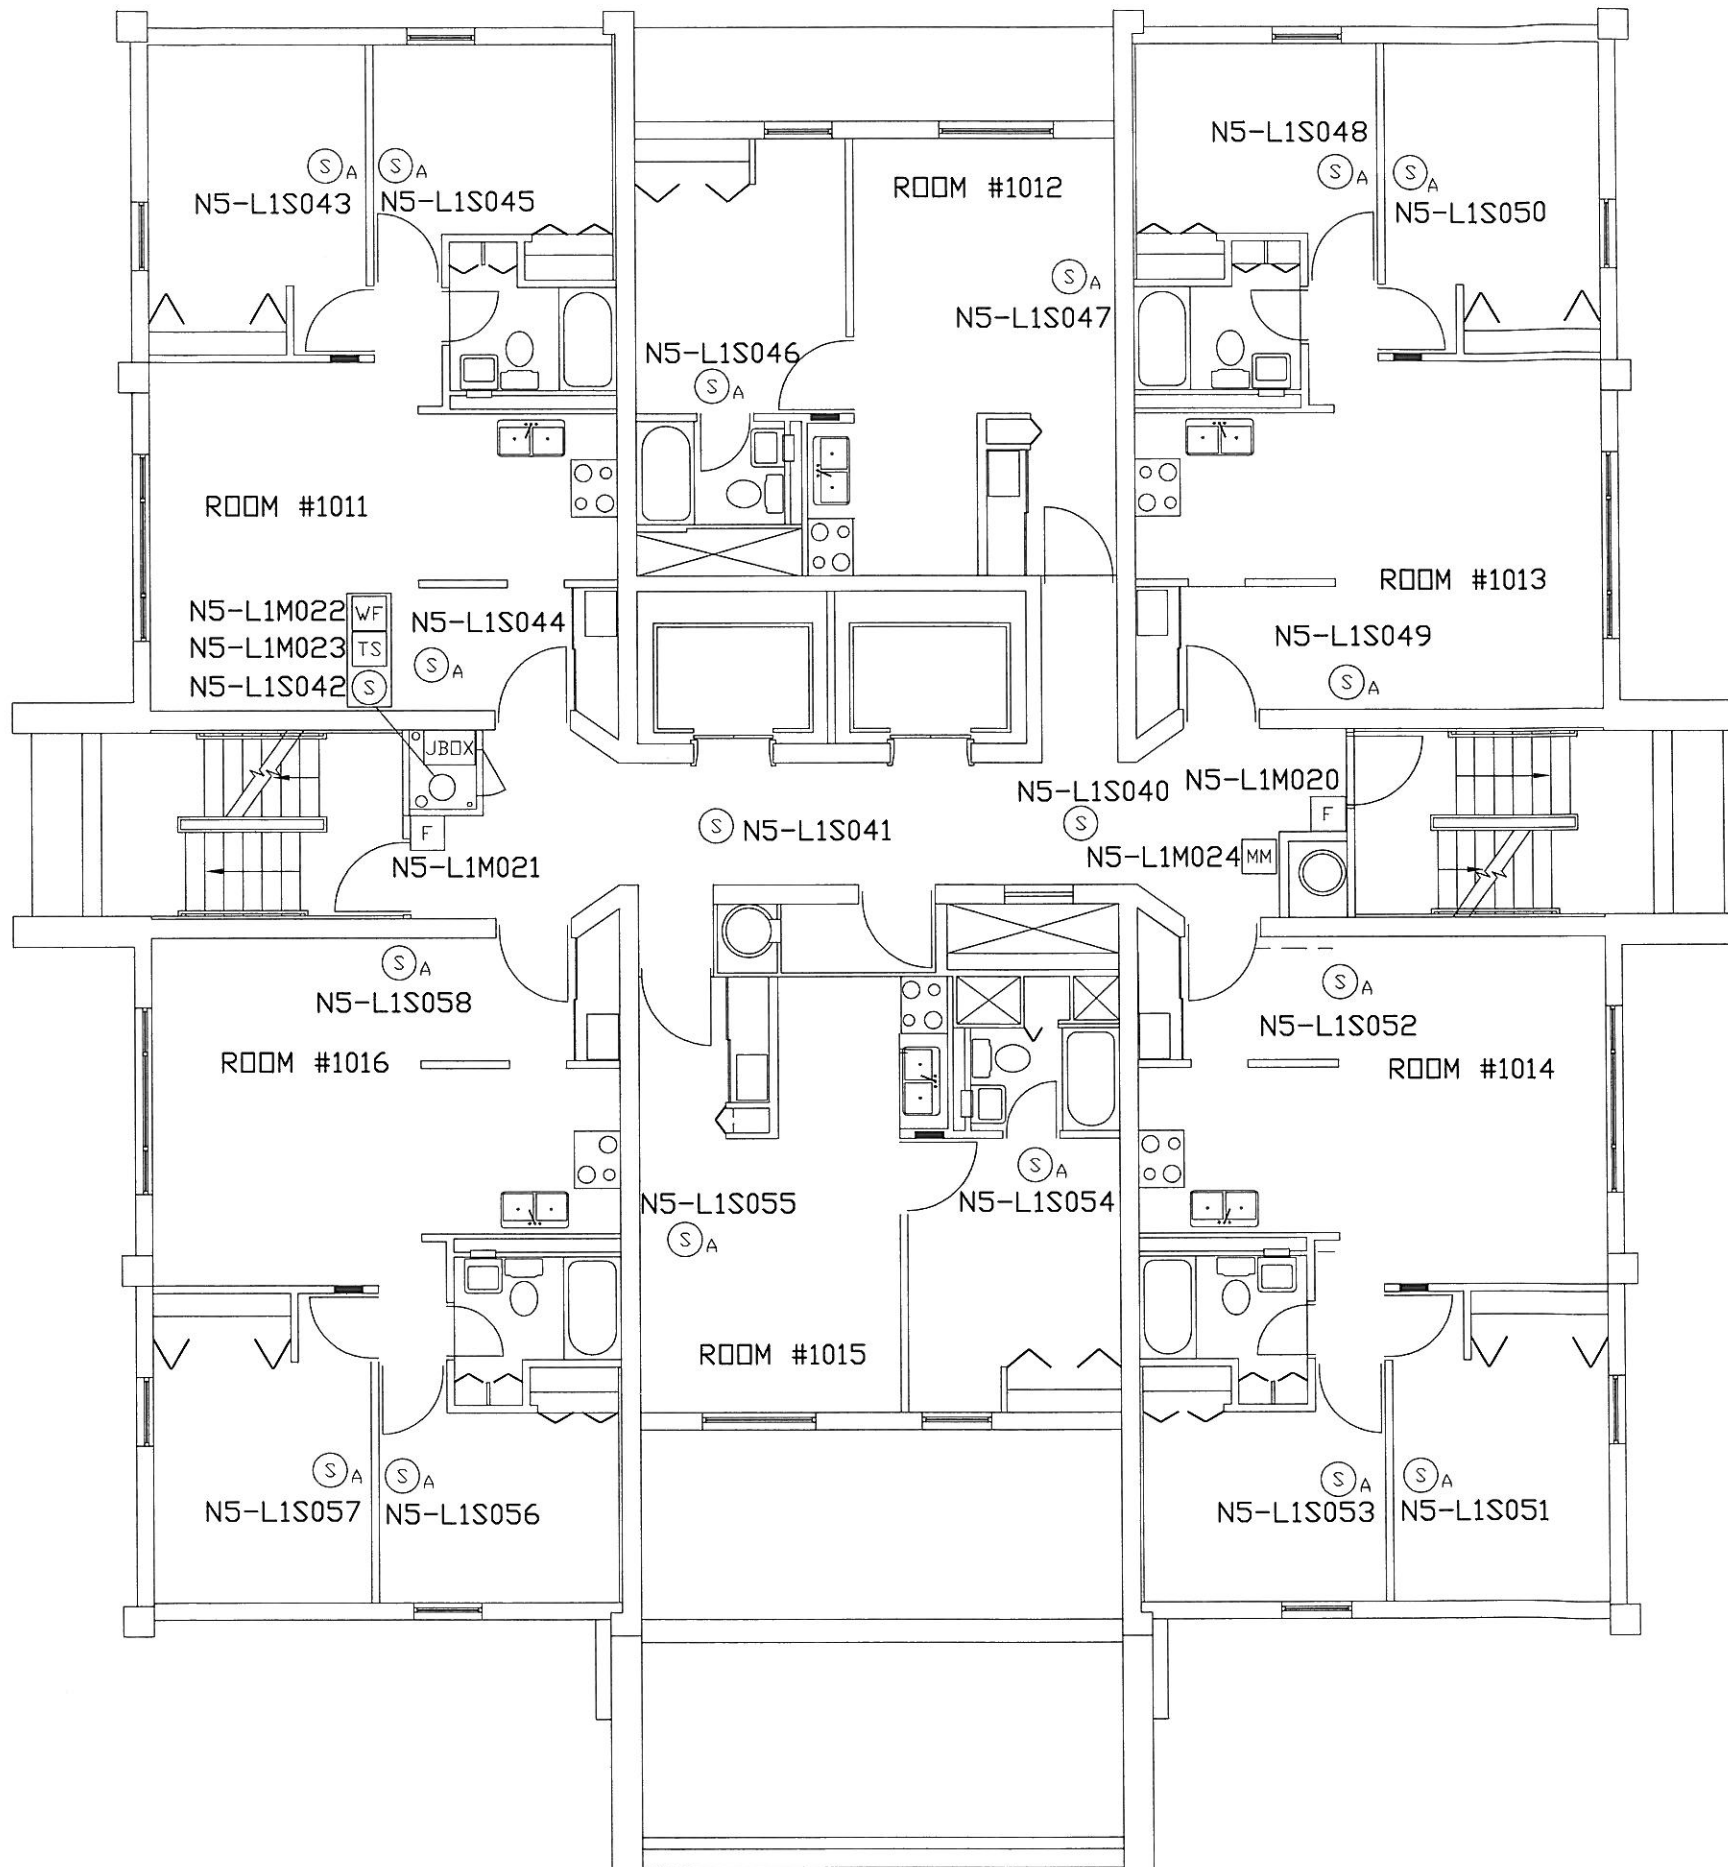

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S _A)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CH)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
TENTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME: NORTHMED10.DWG

FIRE ALARM SYSTEM
TENTH FLOOR
ADDRESSABLE LOOP


PAGE:
FA-10-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

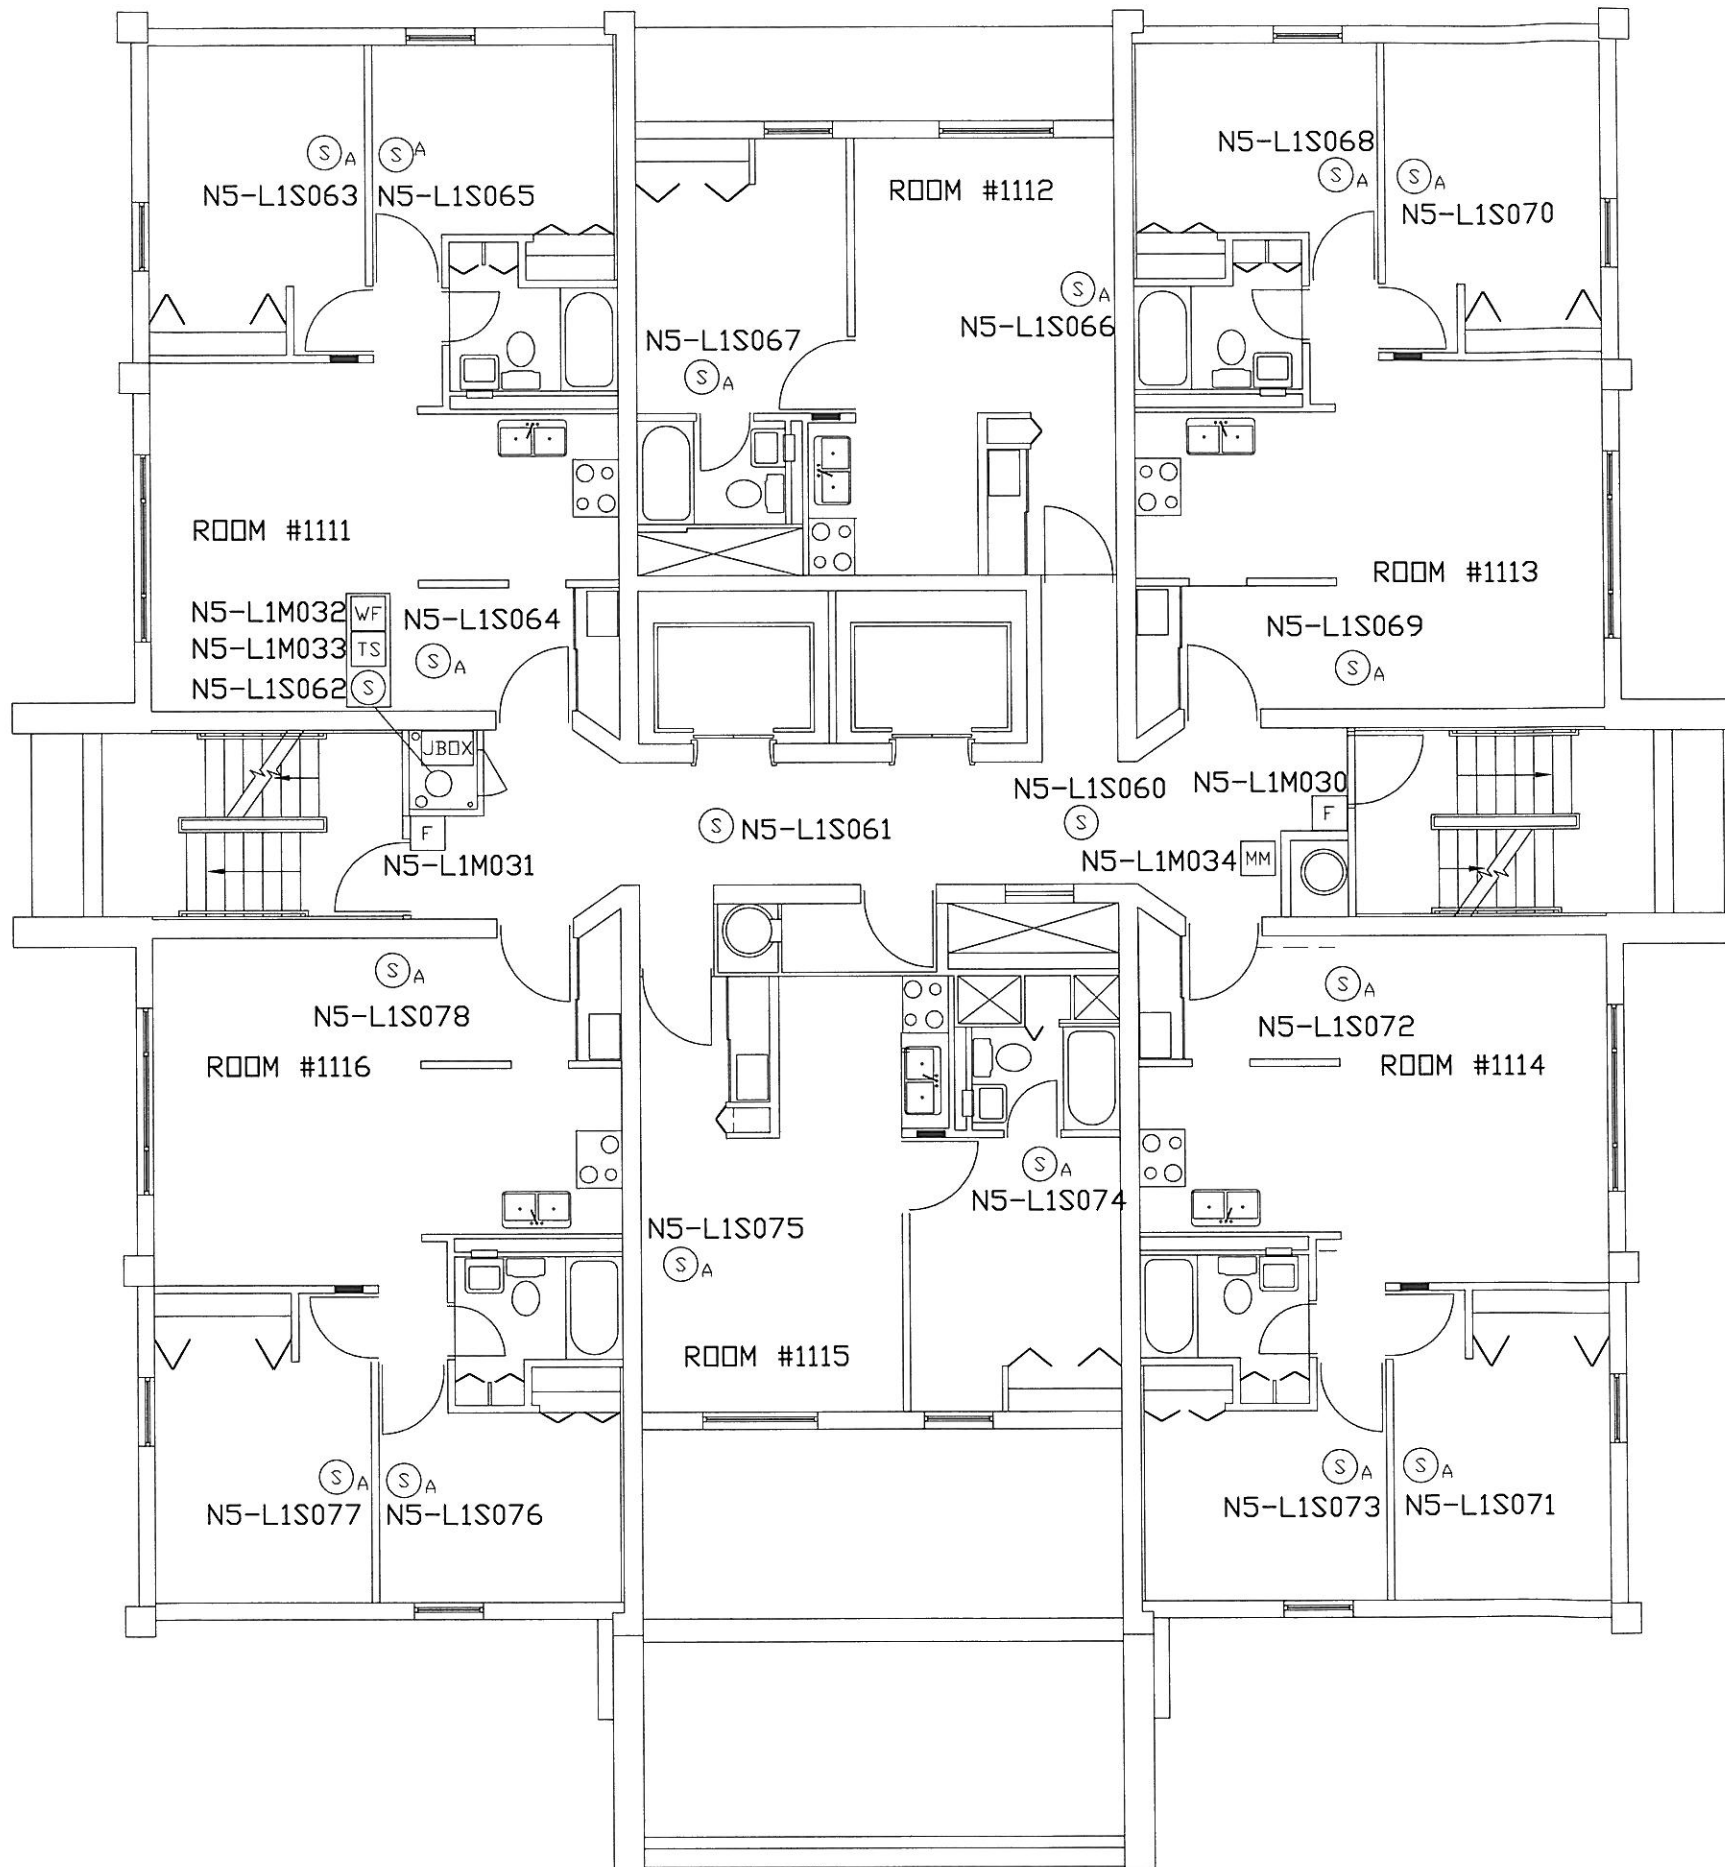

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S _A)	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN J-BOX ON THIS FLOOR:
 MM N5-L1M035 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

NORTH MEDICAL TOWER
 UNIVERSITY OF UTAH
 ELEVENTH FLOOR
 FIRE ALARM SYSTEM


NFS
 NELSON FIRE SYSTEMS
 801-468-8300

DRAWN BY: DS
 DESIGNED BY: KGE
 APPROVED BY: TCT
 DATE: 8/15/08
 SCALE: NTS
 PROJECT NO: 0701-13092
 REV NO: 1
 DRAWING NAME: NORTHMED11.DWG

FIRE ALARM SYSTEM
 ELEVENTH FLOOR
 ADDRESSABLE NUMBERS

PAGE:
 FA-II-04

N.I.C.E.T.
 LEVEL III
 CERTIFICATION
 FIRE ALARM SYSTEMS
 DONNY SCHULTZ
 #104396

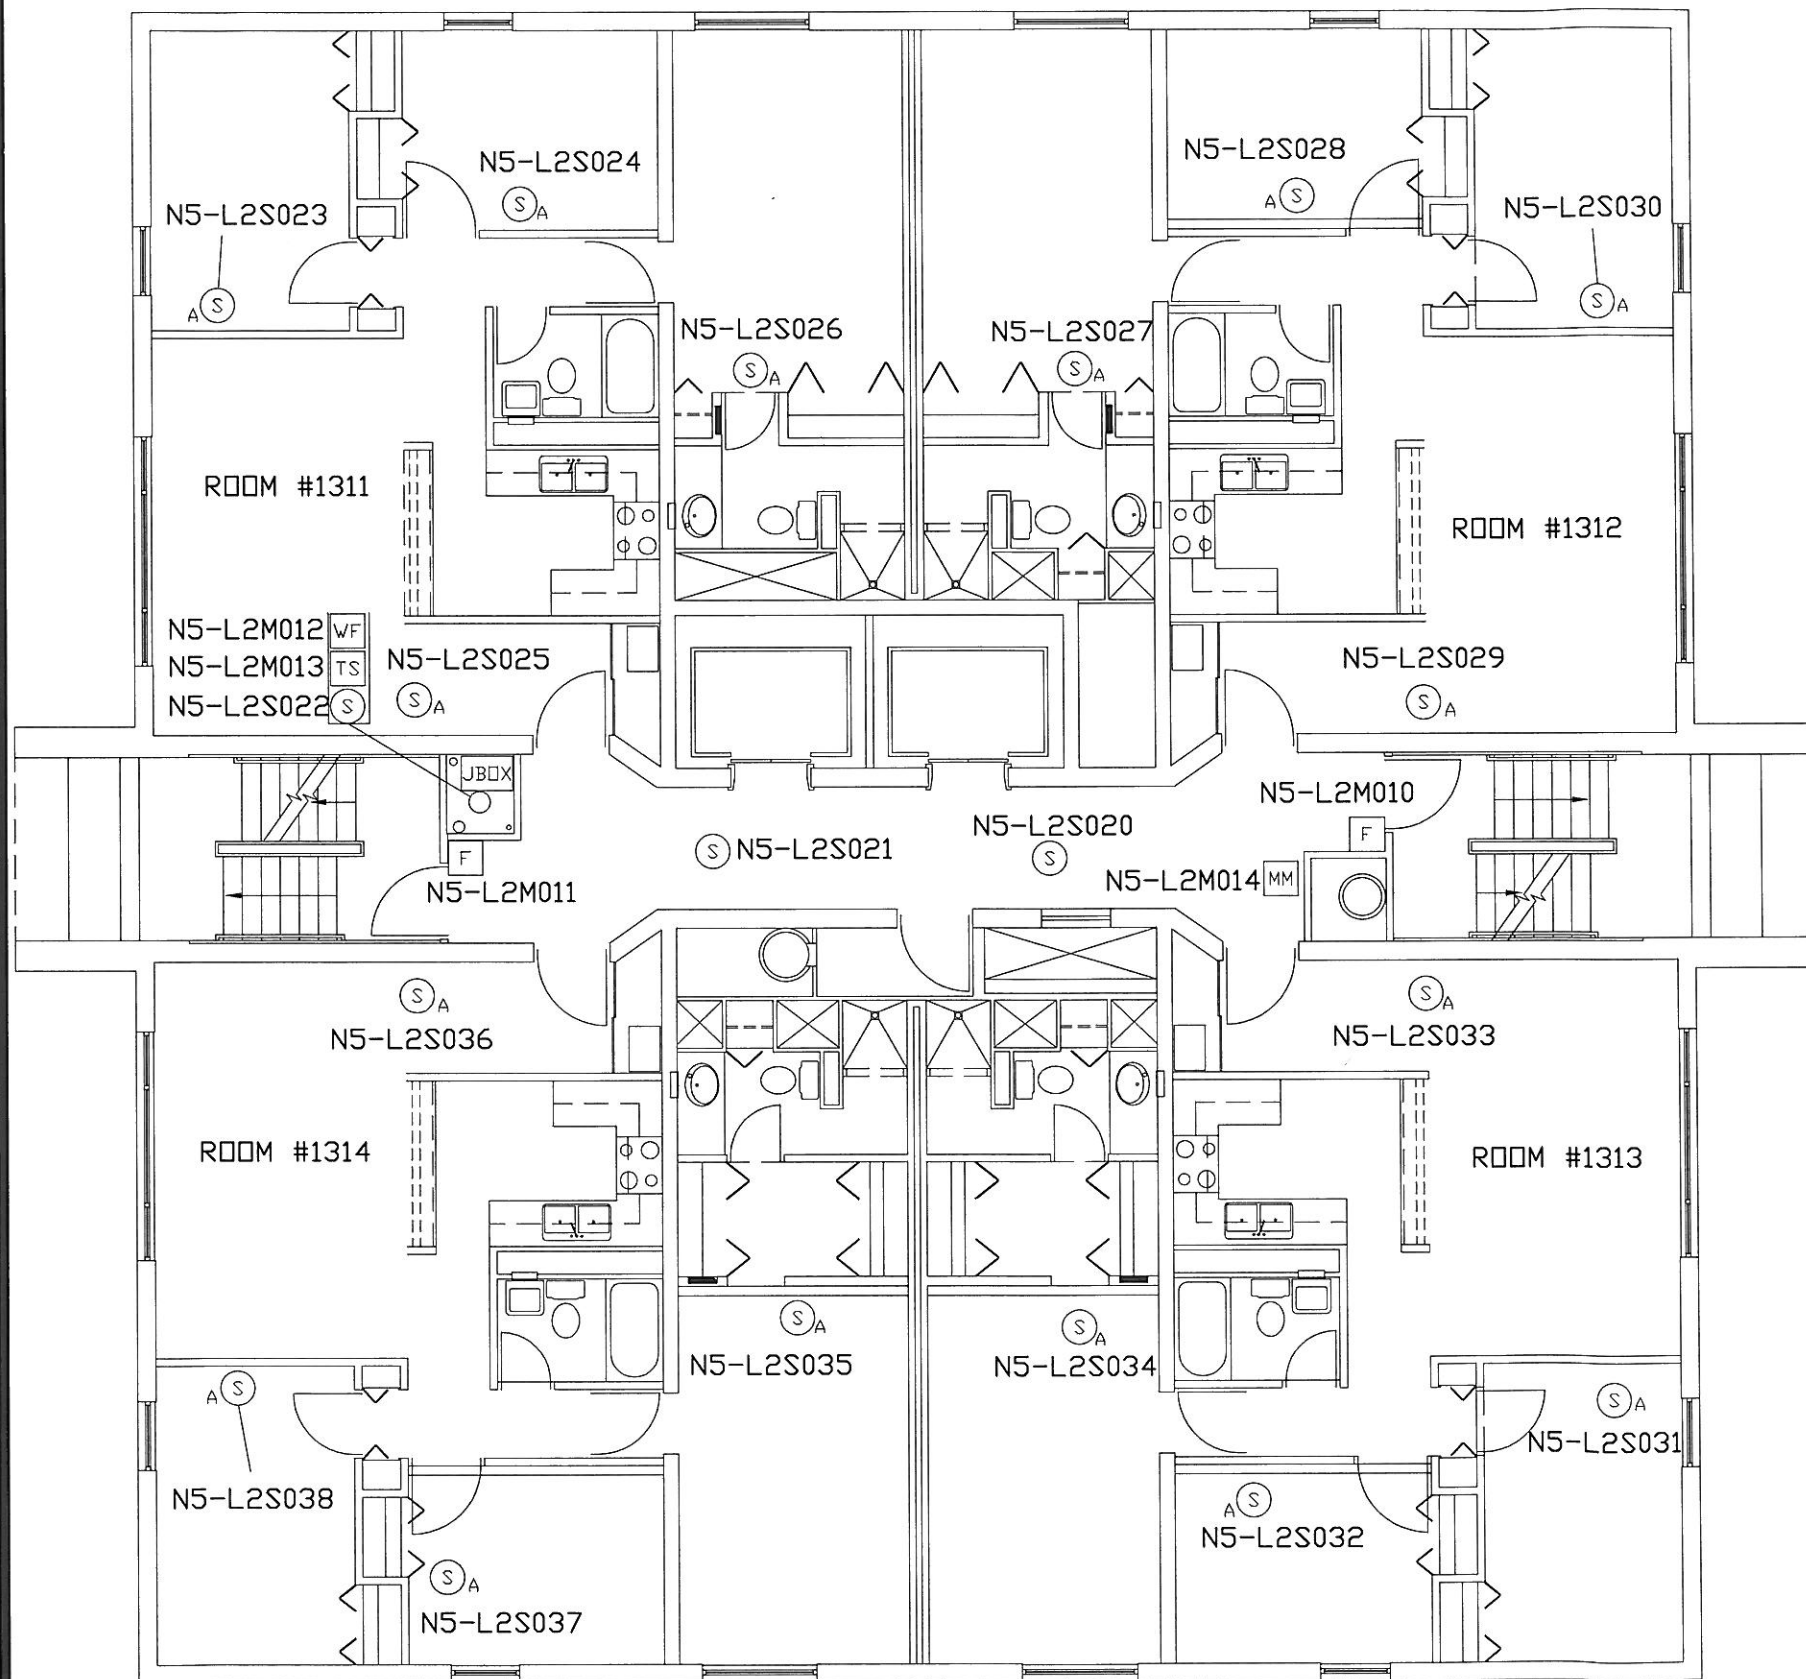


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ _A	SMOKE DETECTOR WITH SOUNDER BASE
Ⓢ _T	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
INX	VOICE PANEL

LOCATED IN J-BOX PANEL ON THIS FLOOR:

- CM 12TH FLOOR FIREPHONES
- CM 13TH FLOOR FIREPHONES
- CM 14/15TH FLOORS FIREPHONES

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
THIRTEENTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME: NORTHMED13.DWG

FIRE ALARM SYSTEM
THIRTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-13-04

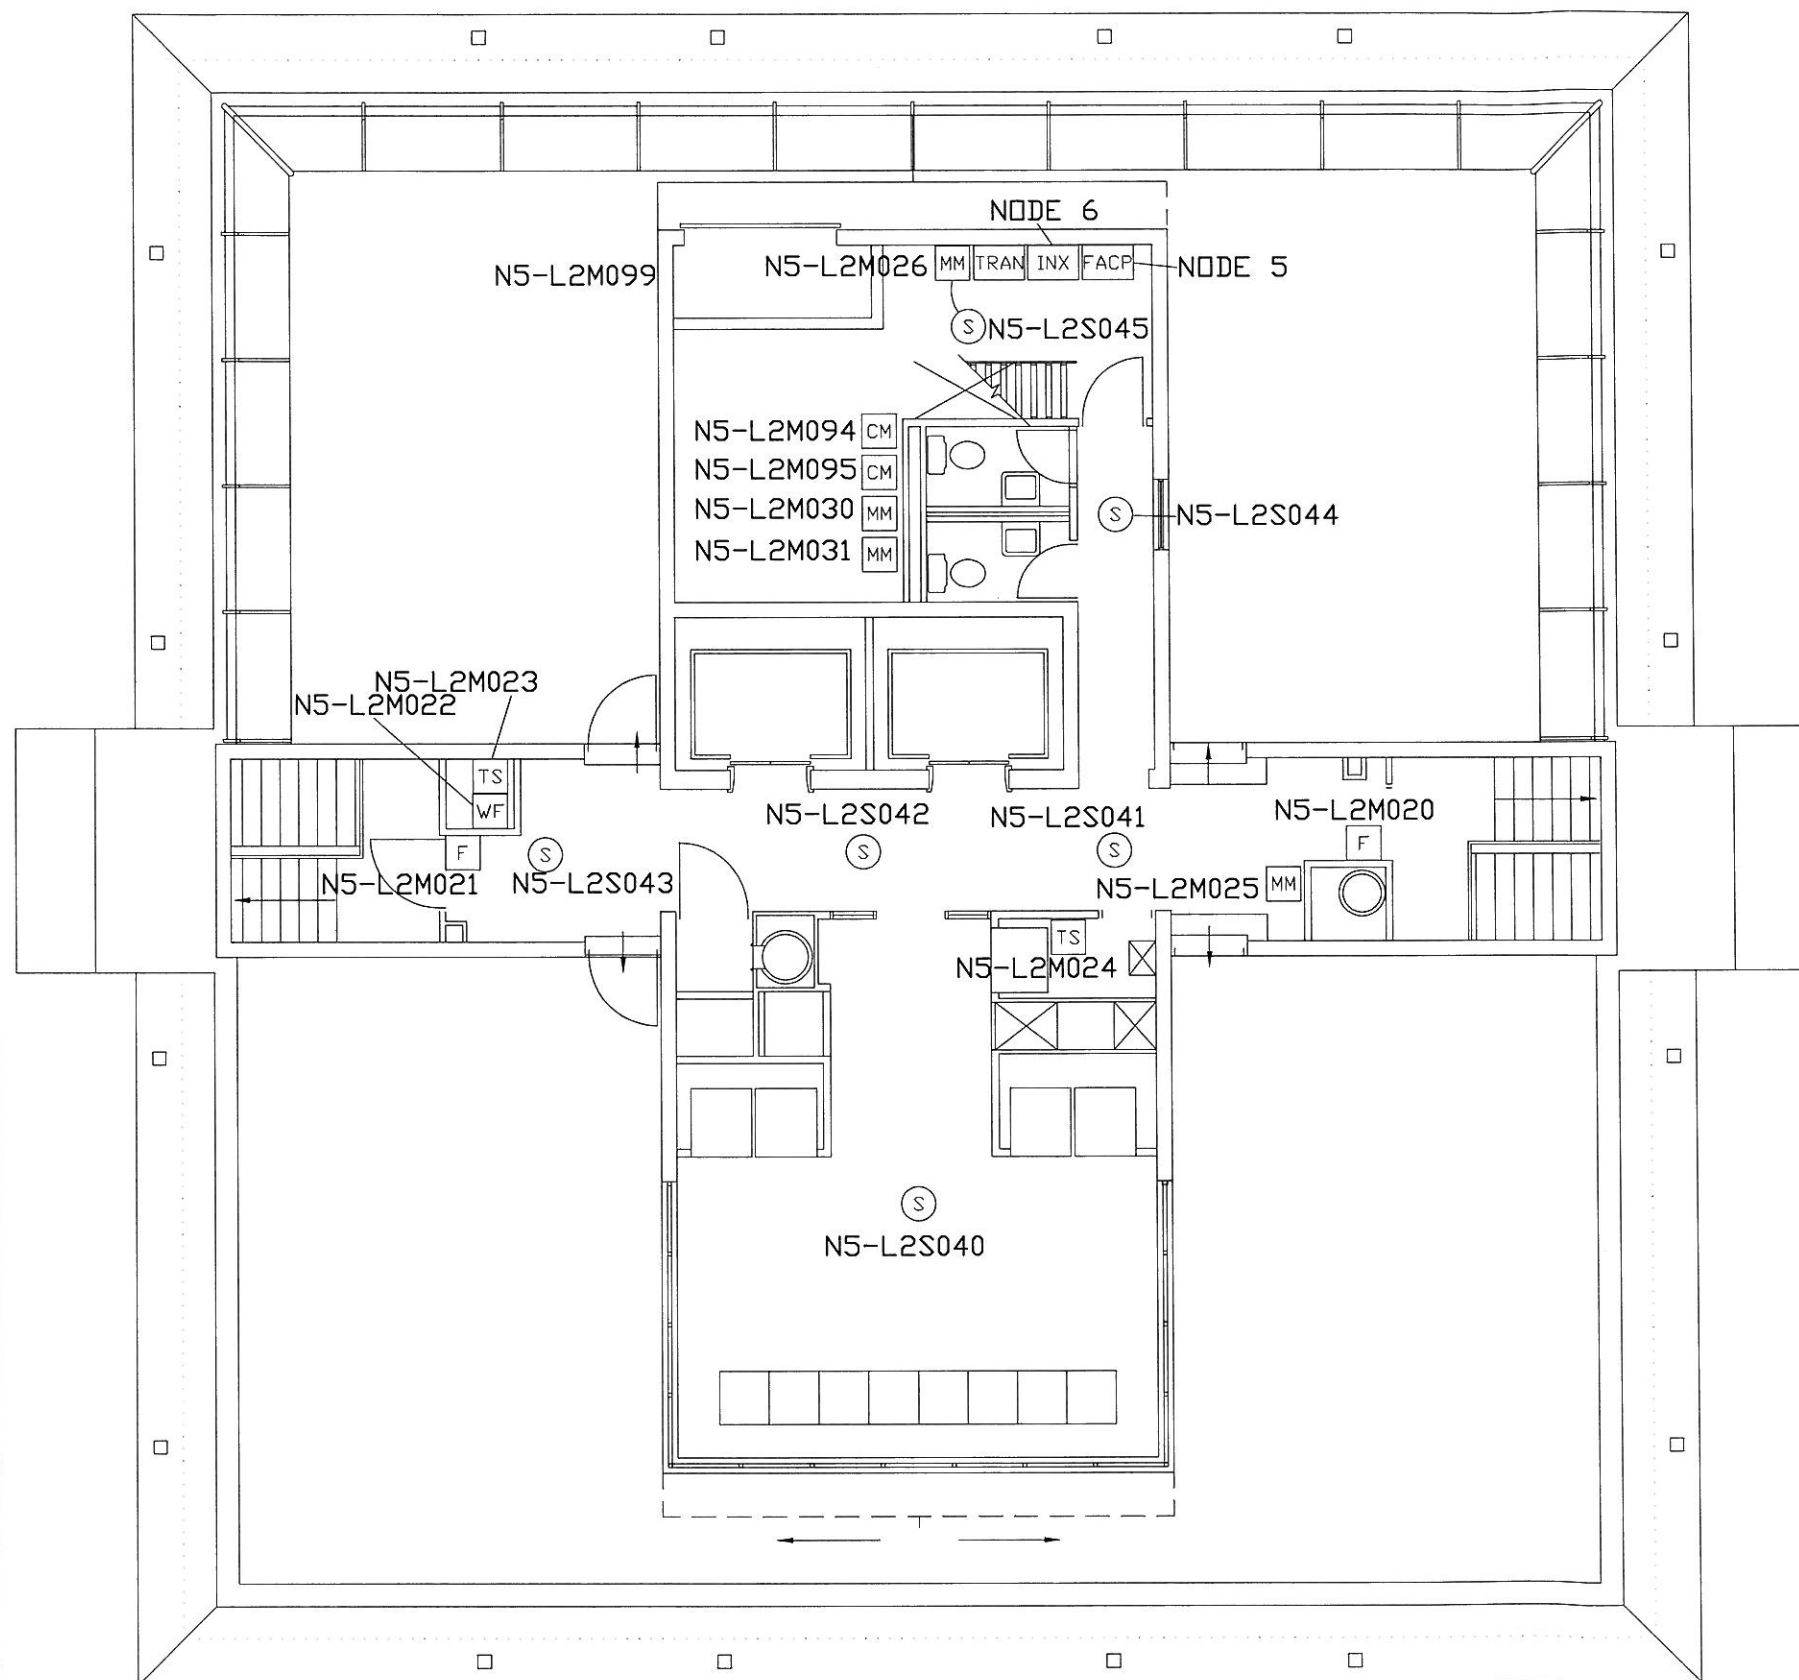

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S)A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN TRAN ON THIS FLOOR:

- (MM) N5-L2M027 14TH FLOOR TRANSPONDER
- (CM) N5-L2M090 12TH FLOOR STROBES
- (CM) N5-L2M091 13TH FLOOR STROBES
- (CM) N5-L2M092 14TH FLOOR STROBES
- (CM) N5-L2M093 15TH FLOOR STROBES

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
FOURTEENTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 8/15/08
SCALE: NTS
PROJECT NO: 0701-13092
REV NO: 1
DRAWING NAME:
NORTHMED14.DWG

FIRE ALARM SYSTEM
FOURTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-14-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

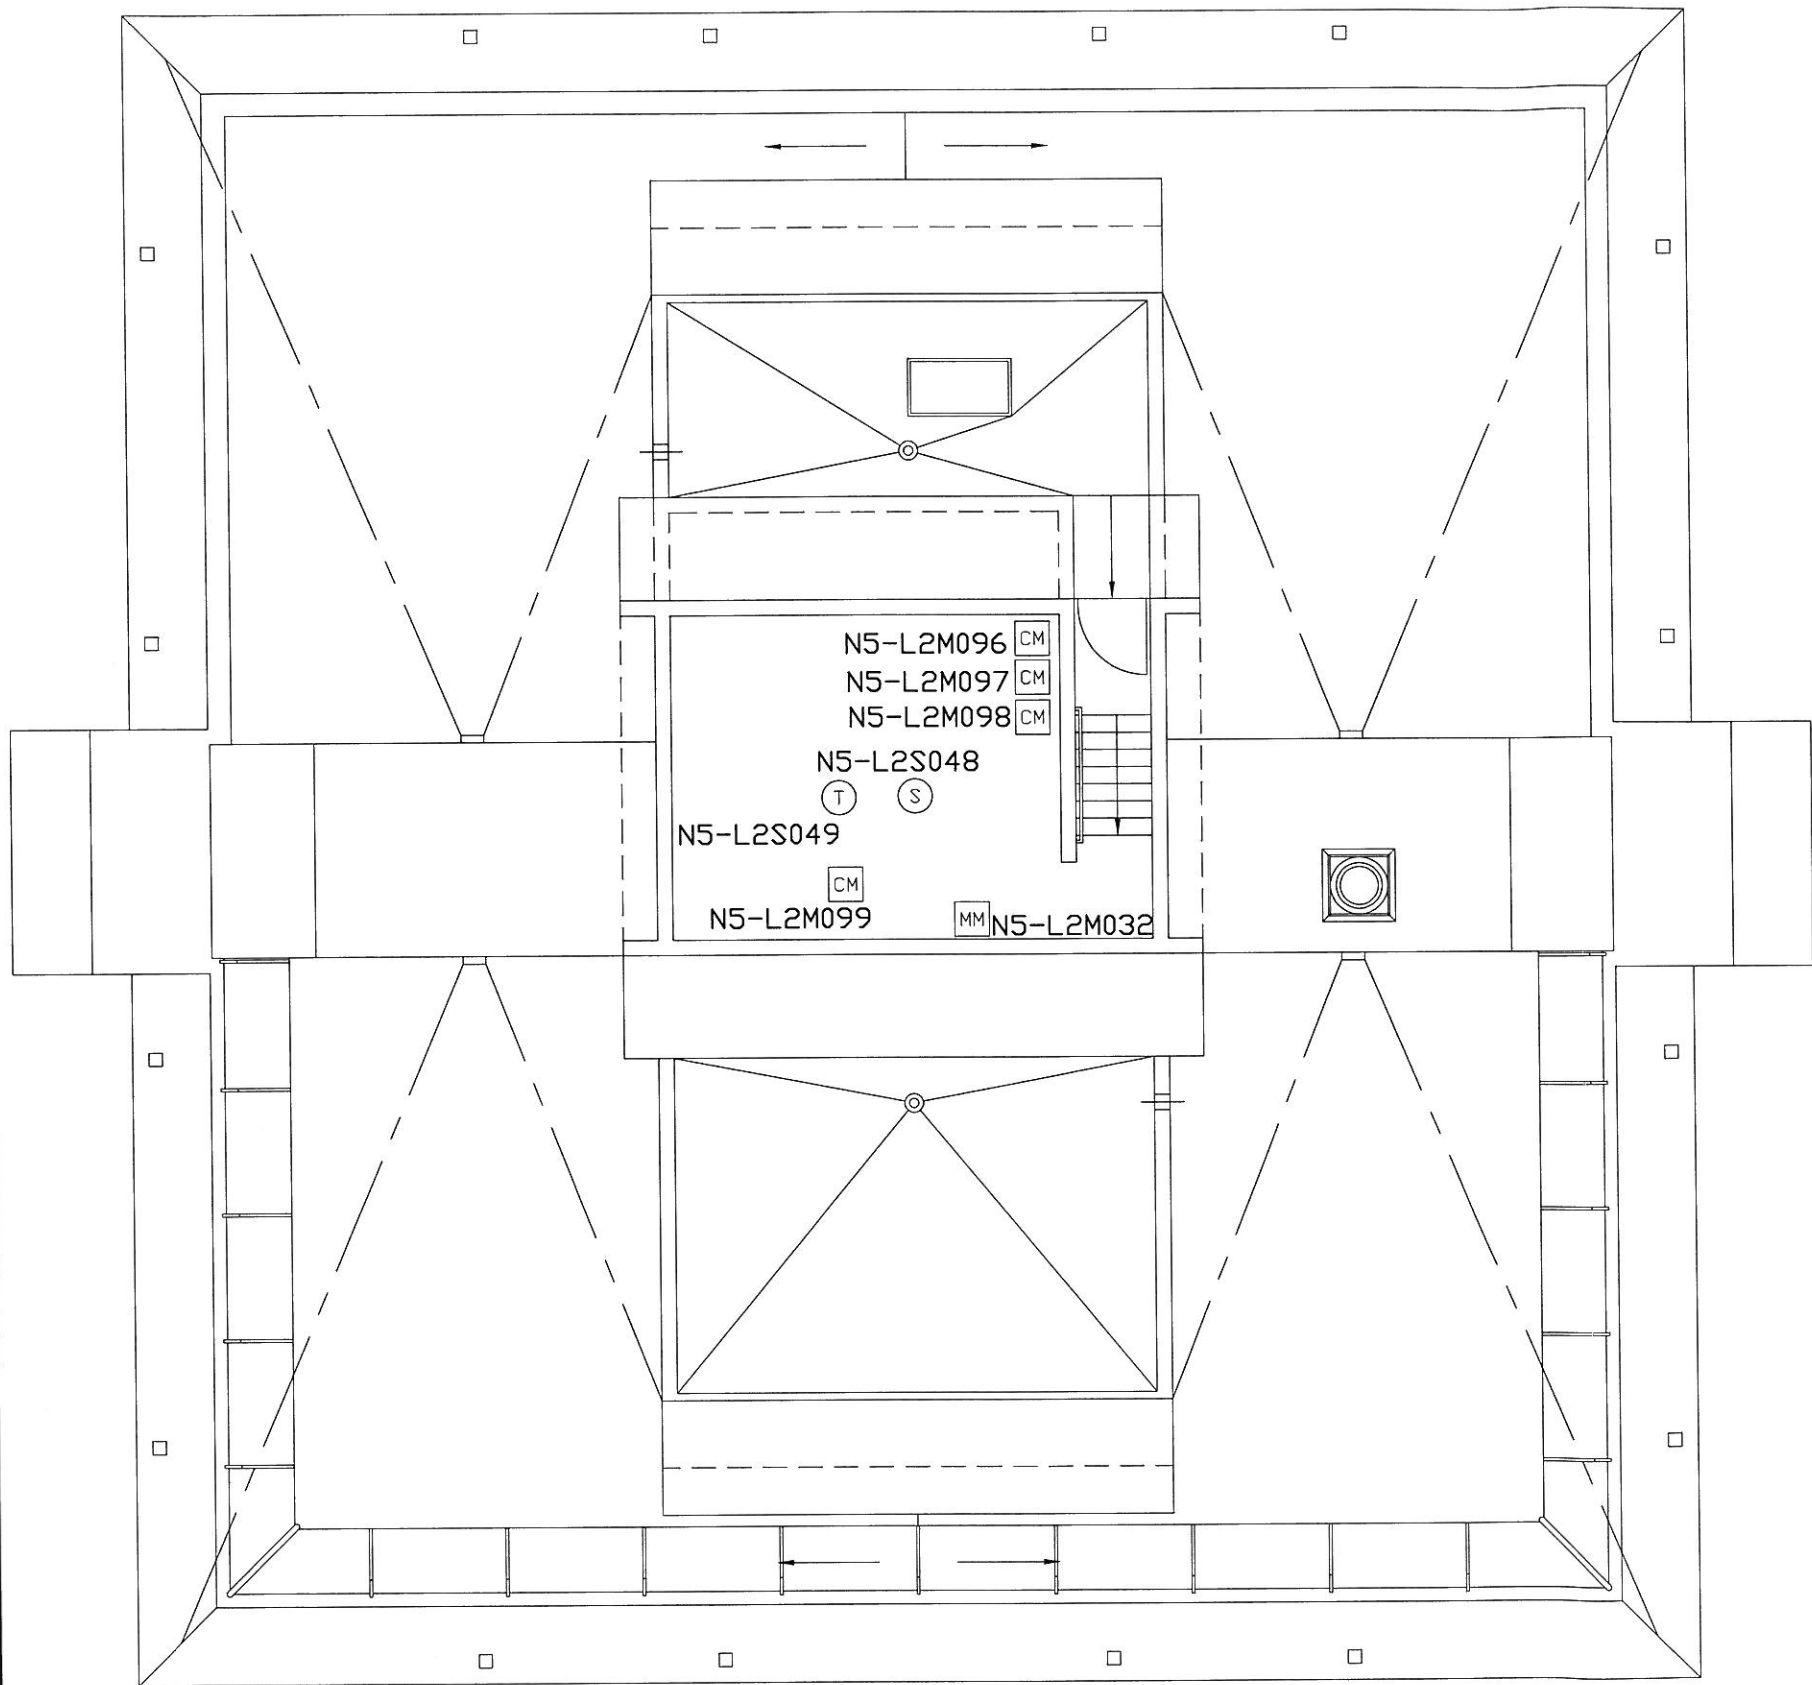

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ ^A	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
ⓕ	MANUAL PULL STATION
Ⓦⓕ	WATERFLOW SWITCH MONITOR MODULE
ⓉⓈ	TAMPER SWITCH MONITOR MODULE
ⓂⓂ	MONITOR MODULE
ⓐⓂ	CONTROL MODULE
ⓕⓔ	FIRE EXTINGUISHER
ⓕⓐⓐⓕ	FIRE ALARM CONTROL PANEL
Ⓣⓗⓗⓗ	TRANSPONDER PANEL
ⓂⓃⓕ	VOICE PANEL

NORTH MEDICAL TOWER
UNIVERSITY OF UTAH
FIFTEENTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS

801-468-8300

DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	8/15/08
SCALE:	NTS
PROJECT NO:	0701-13092
REV NO:	1
DRAWING NAME:	NORTHMED15.DWG

FIRE ALARM SYSTEM
FIFTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:

FA-15-04

N.I.C.E.T.
LEVEL III
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396