



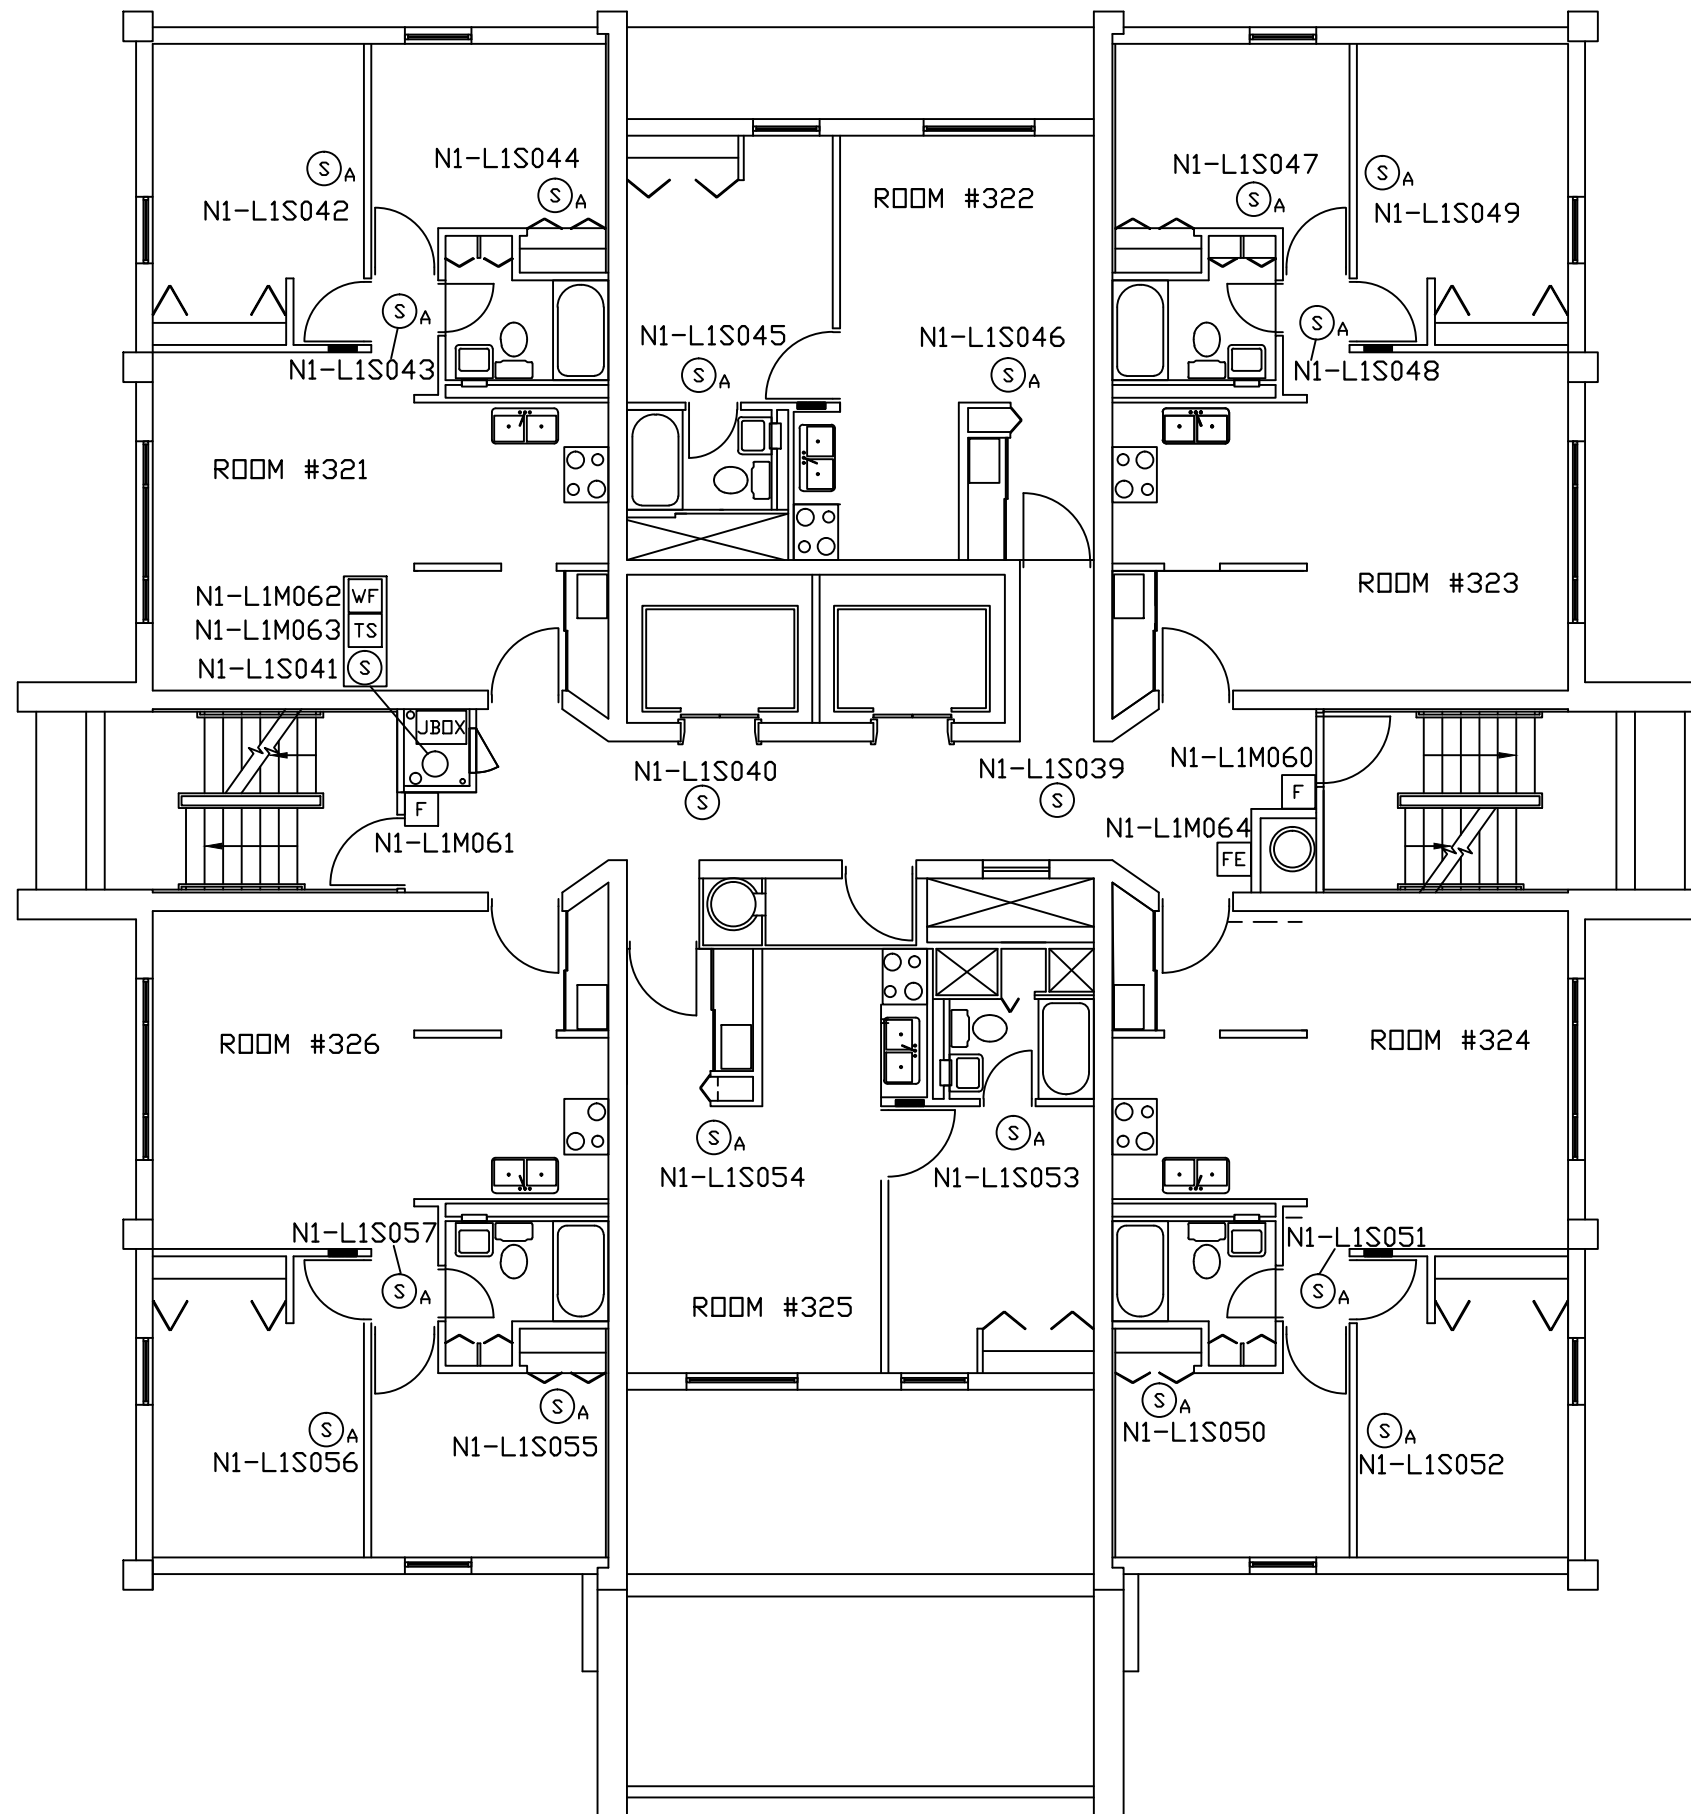

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓢ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

LOCATED IN J-BOX ON THIS FLOOR:

MM N1-L1M049 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
THIRD FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME: SOUTHMED3.DWG

FIRE ALARM SYSTEM
THIRD FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-3-04


N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

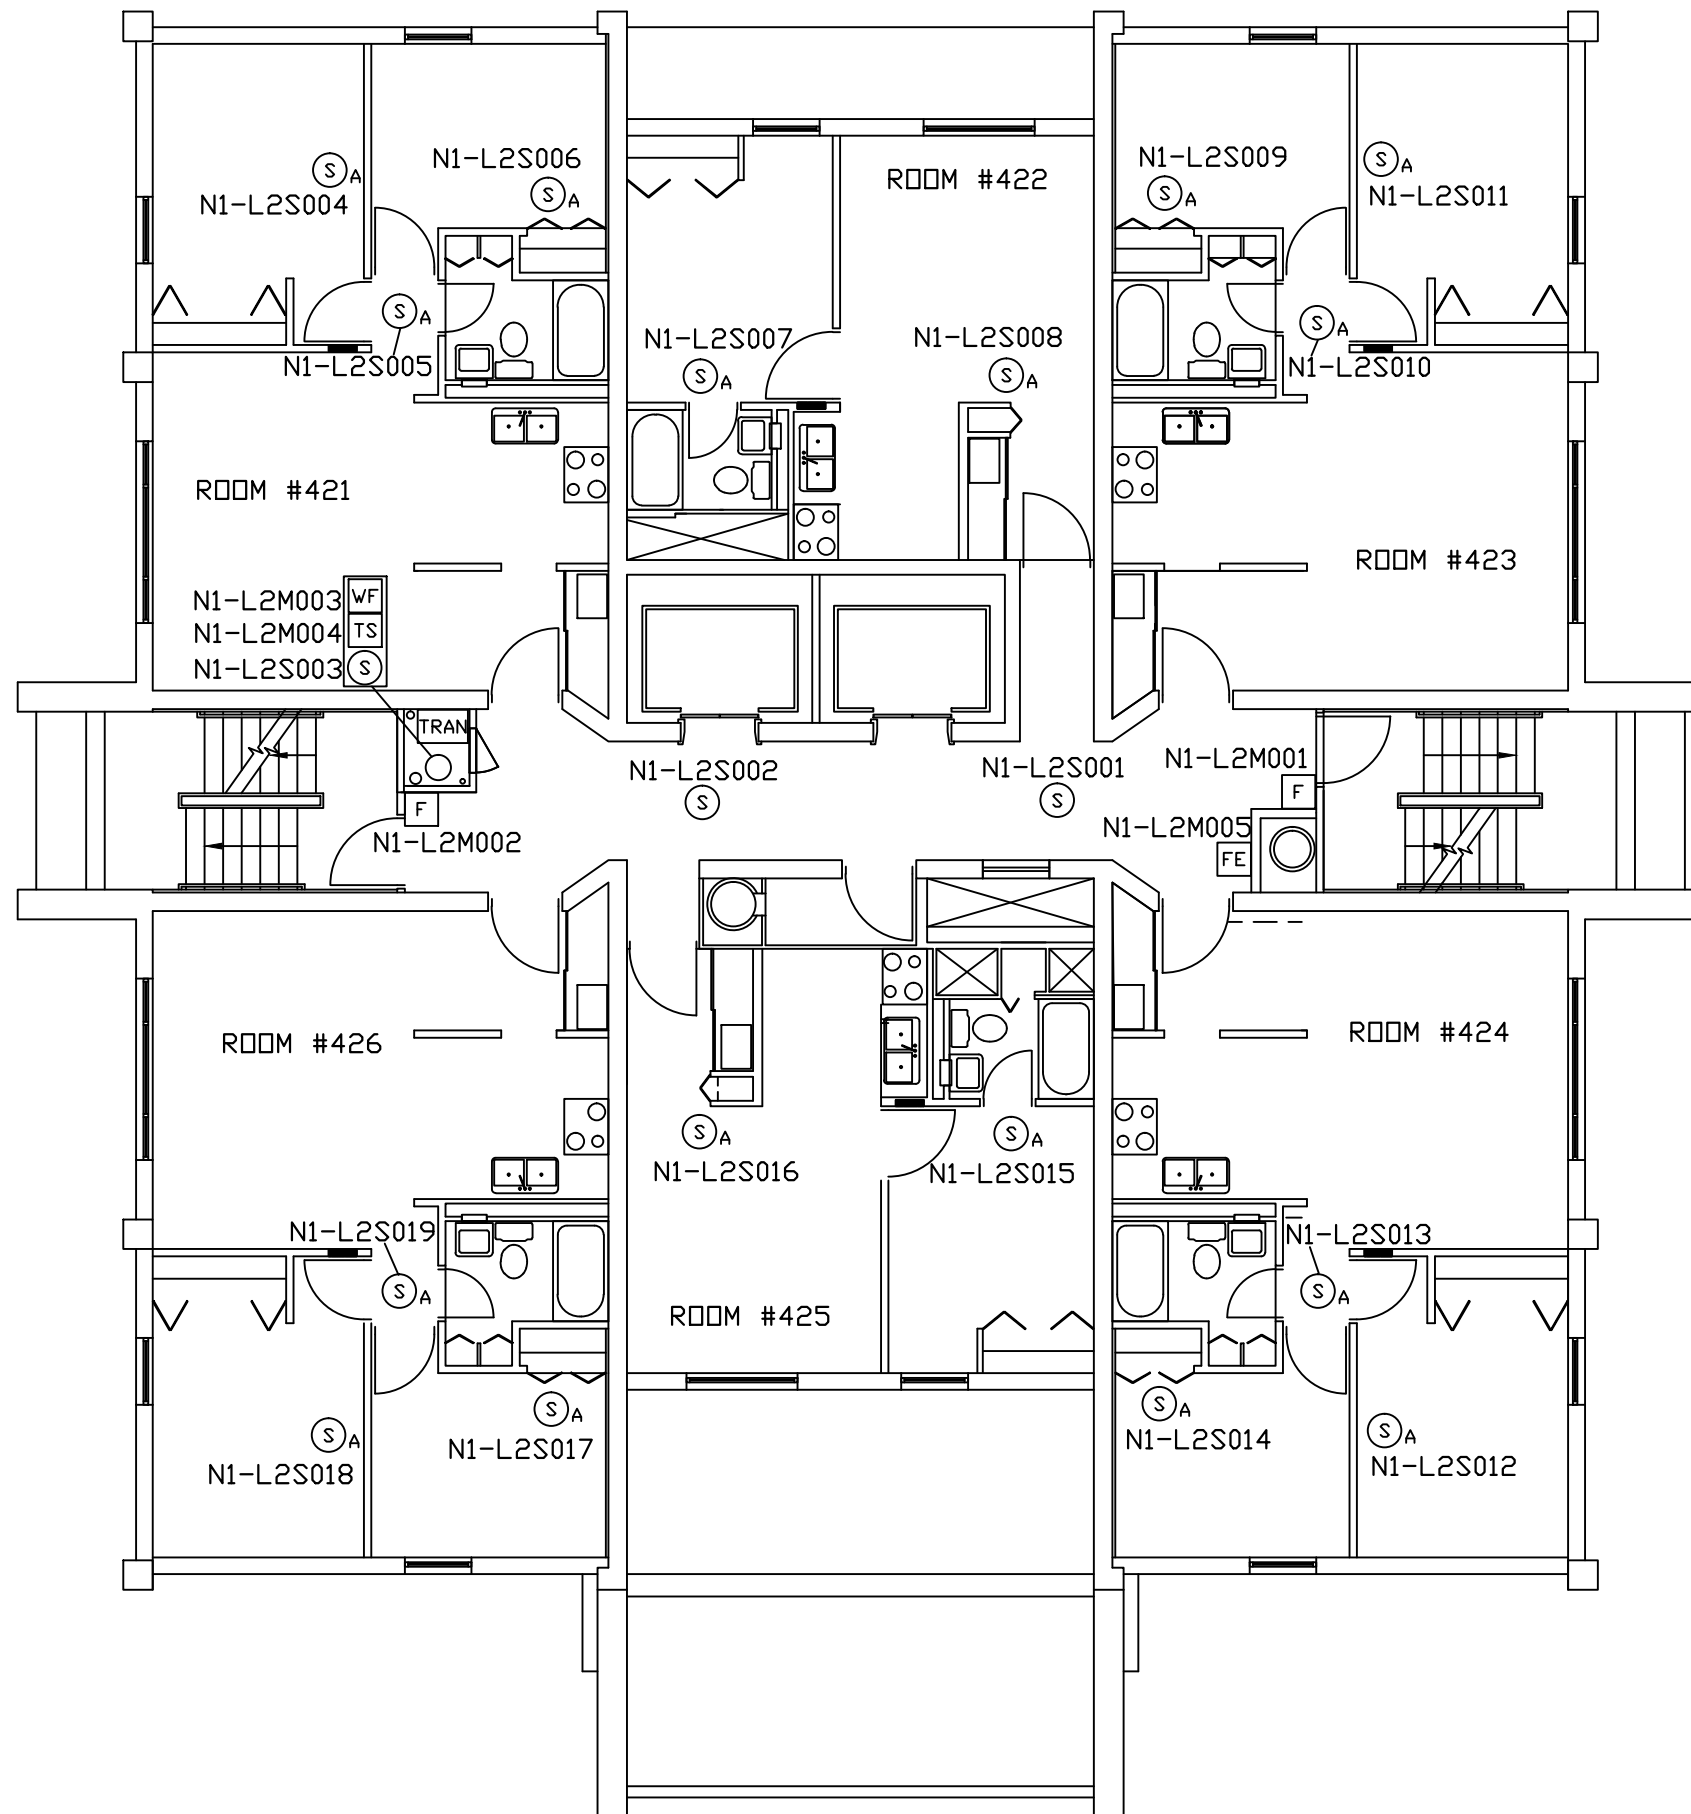

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL

LOCATED IN TRAN ON THIS FLOOR:

- MM N1-L2M006 4TH FLOOR TRANSPONDER
- CM N1-L2M090 4TH FLOOR STROBES
- CM N1-L2M091 5TH FLOOR STROBES
- CM N1-L2M092 6TH FLOOR STROBES
- CM N1-L2M093 7TH FLOOR STROBES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
FOURTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME: SOUTHMED4.DWG

FIRE ALARM SYSTEM
FOURTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-4-04


N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

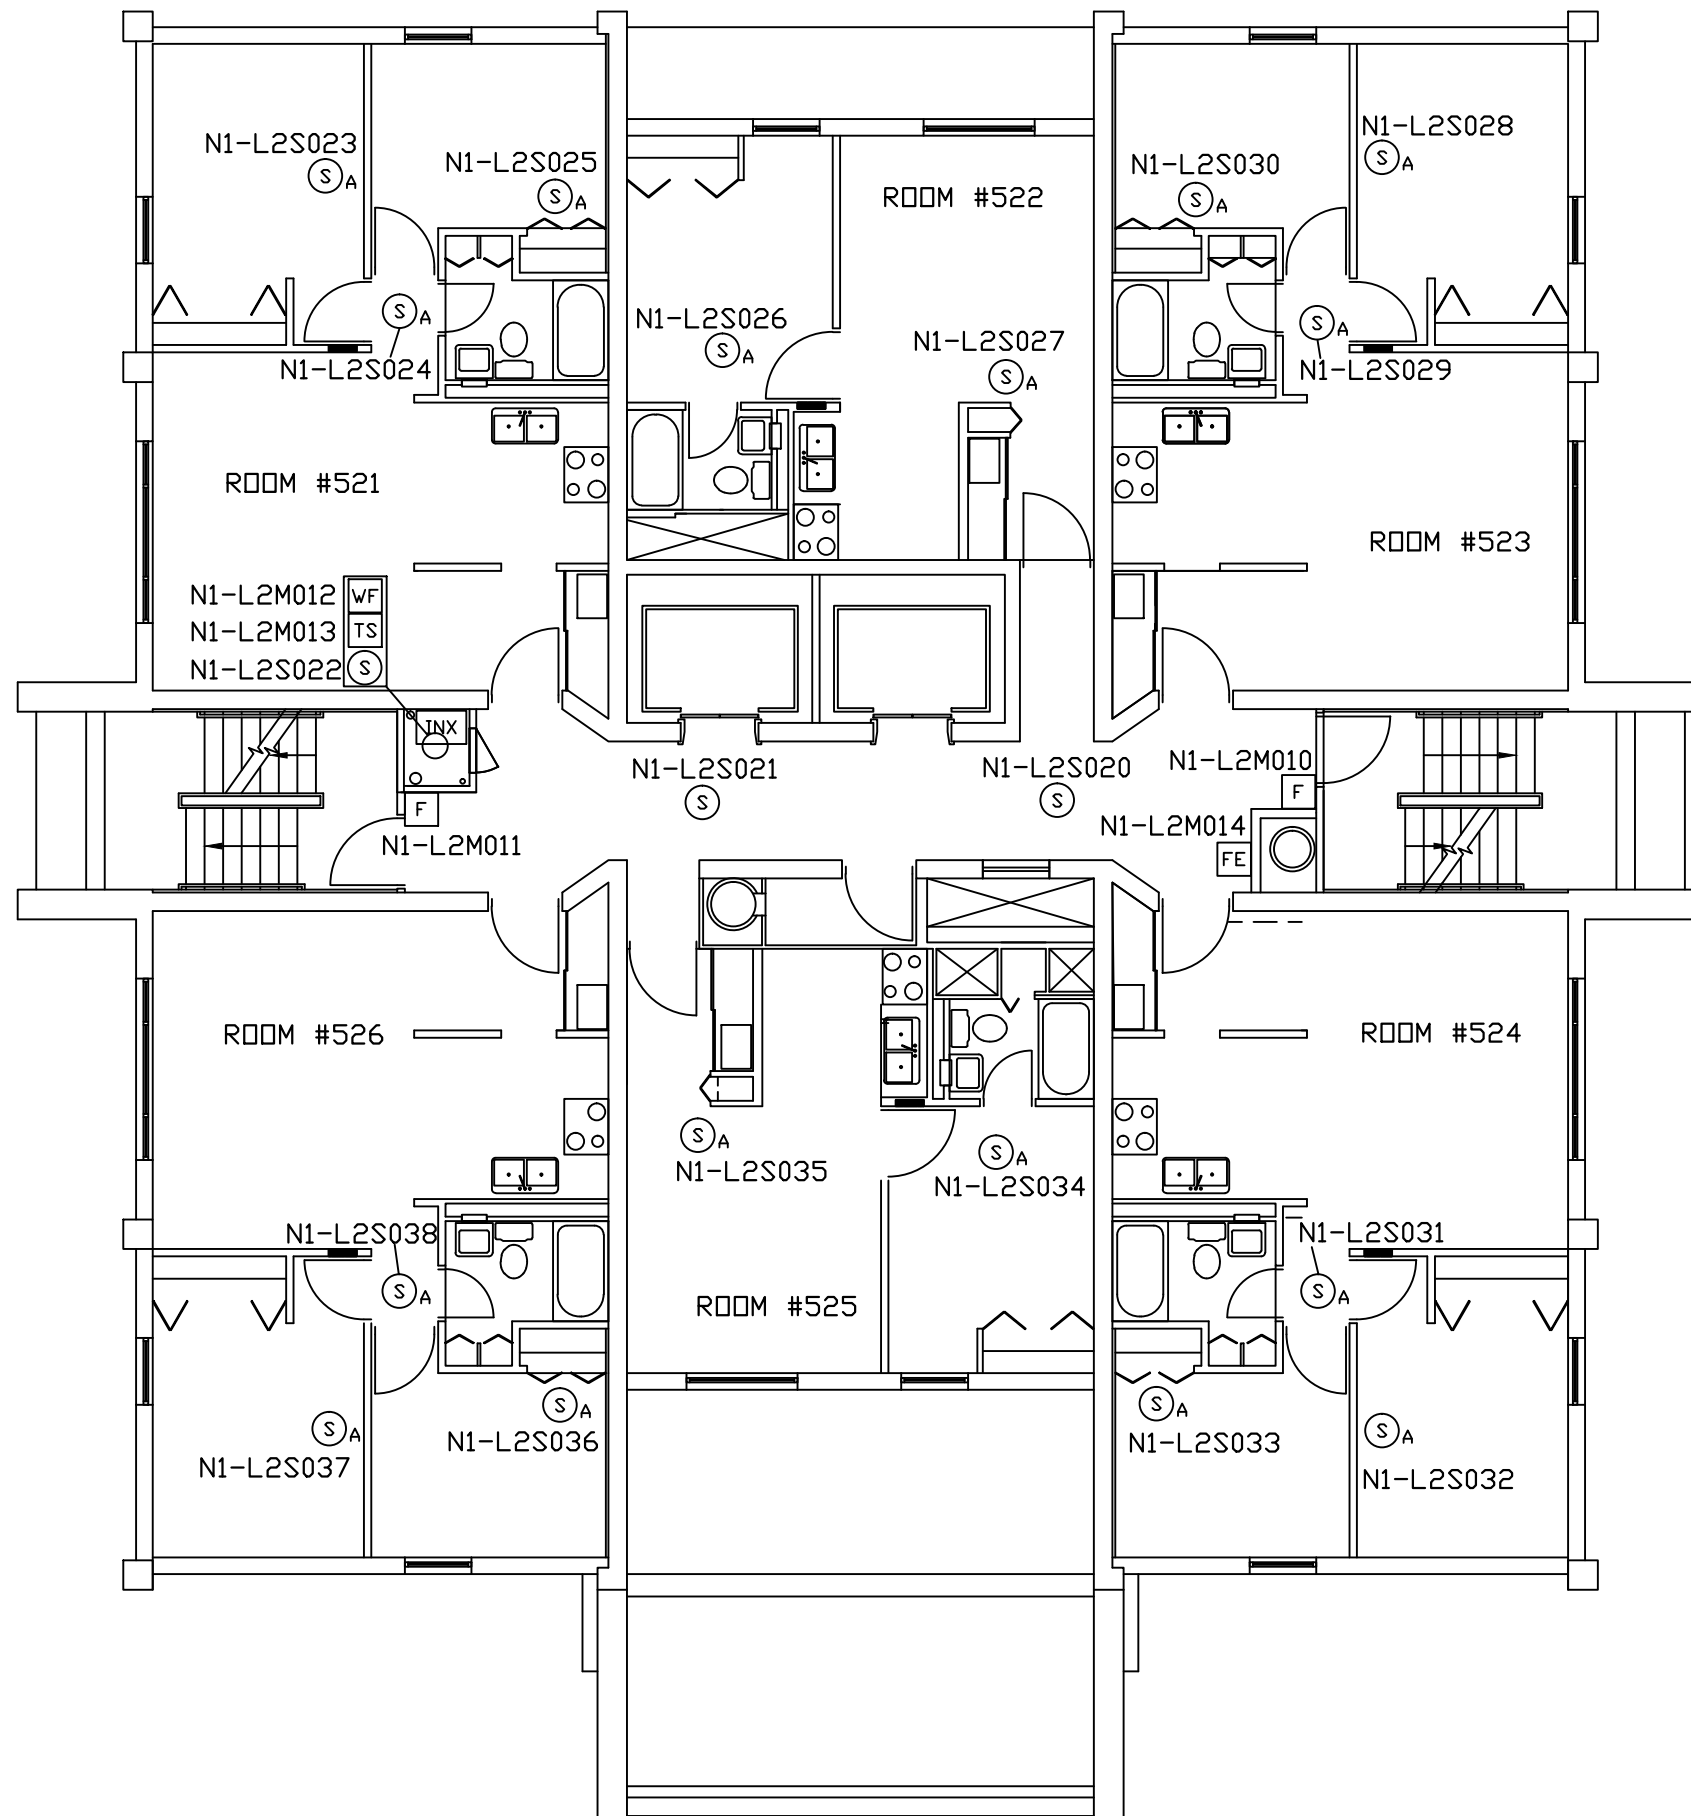

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S)A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN INX PANEL ON THIS FLOOR:

- CM 4TH FLOOR FIREPHONES
- CM 5TH FLOOR FIREPHONES
- CM 6TH FLOOR FIREPHONES
- CM 7TH FLOOR FIREPHONES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
FIFTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME: SOUTHMED5.DWG


FIRE ALARM SYSTEM
FIFTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-5-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

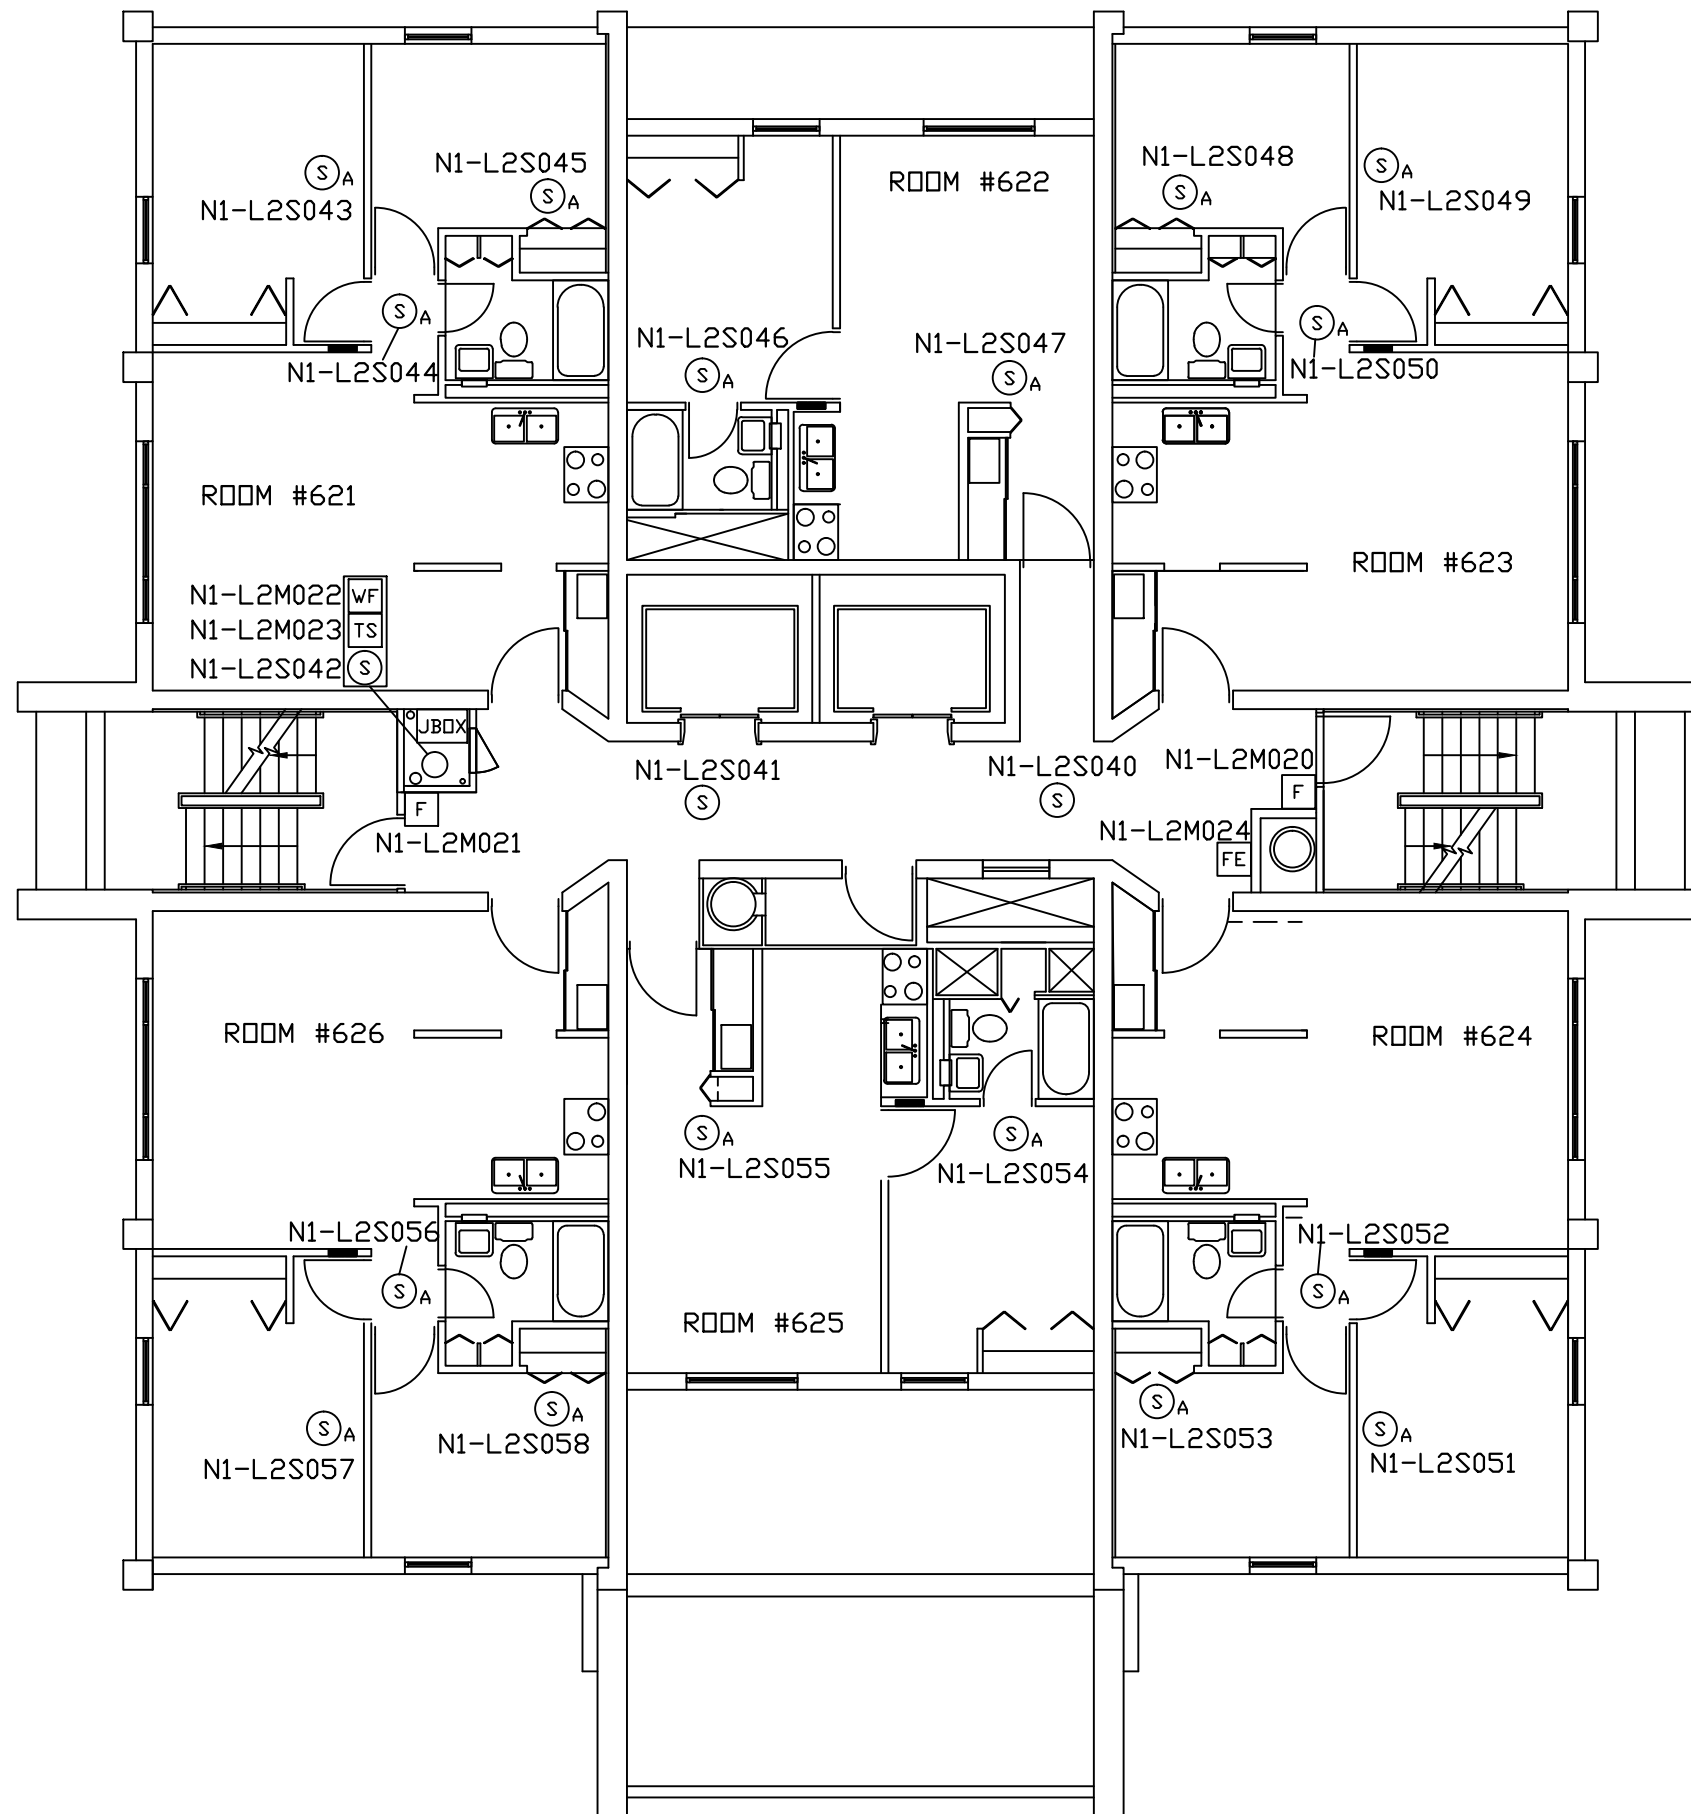

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
CM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
SIXTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: I
DRAWING NAME:
SOUTHMED6.DWG

FIRE ALARM SYSTEM
SIXTH FLOOR
ADDRESSABLE NUMBERS


PAGE:
FA-6-04

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

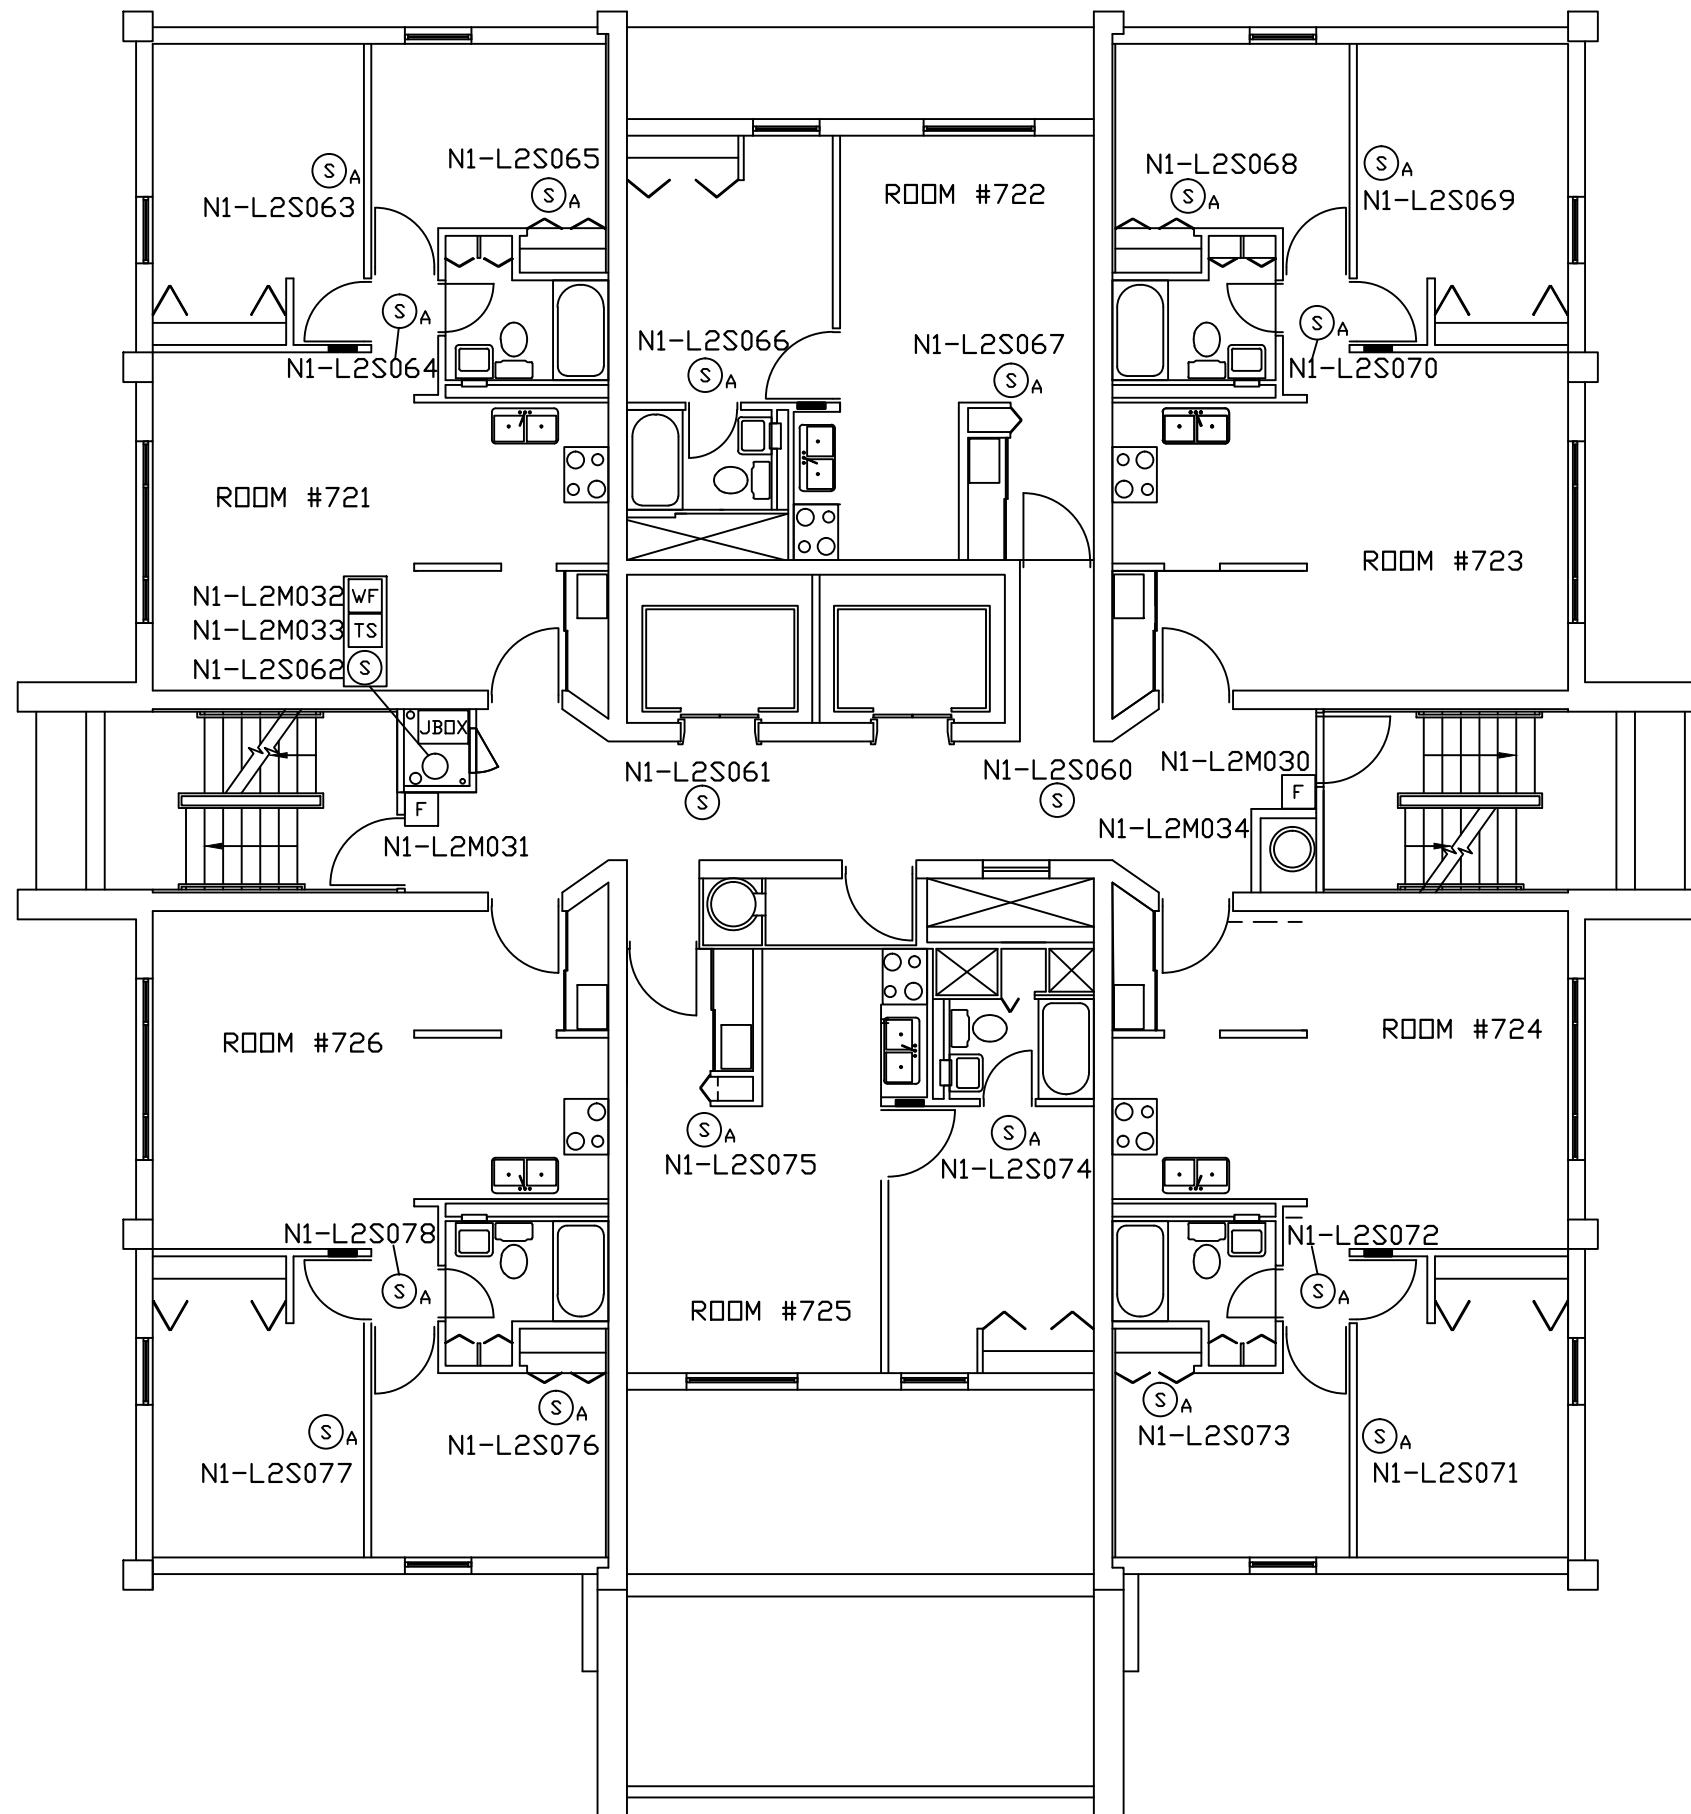

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(S)A	SMOKE DETECTOR WITH SOUNDER BASE
(T)	THERMAL DETECTOR
(F)	MANUAL PULL STATION
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(FE)	FIRE EXTINGUISHER
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL
(INX)	VOICE PANEL

LOCATED IN J-BOX ON THIS FLOOR:
(MM) N1-L2M035 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
SEVENTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME: SOUTHMED7.DWG

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

FIRE ALARM SYSTEM
SEVENTH FLOOR
ADDRESSABLE NUMBERS


PAGE:
FA-7-04

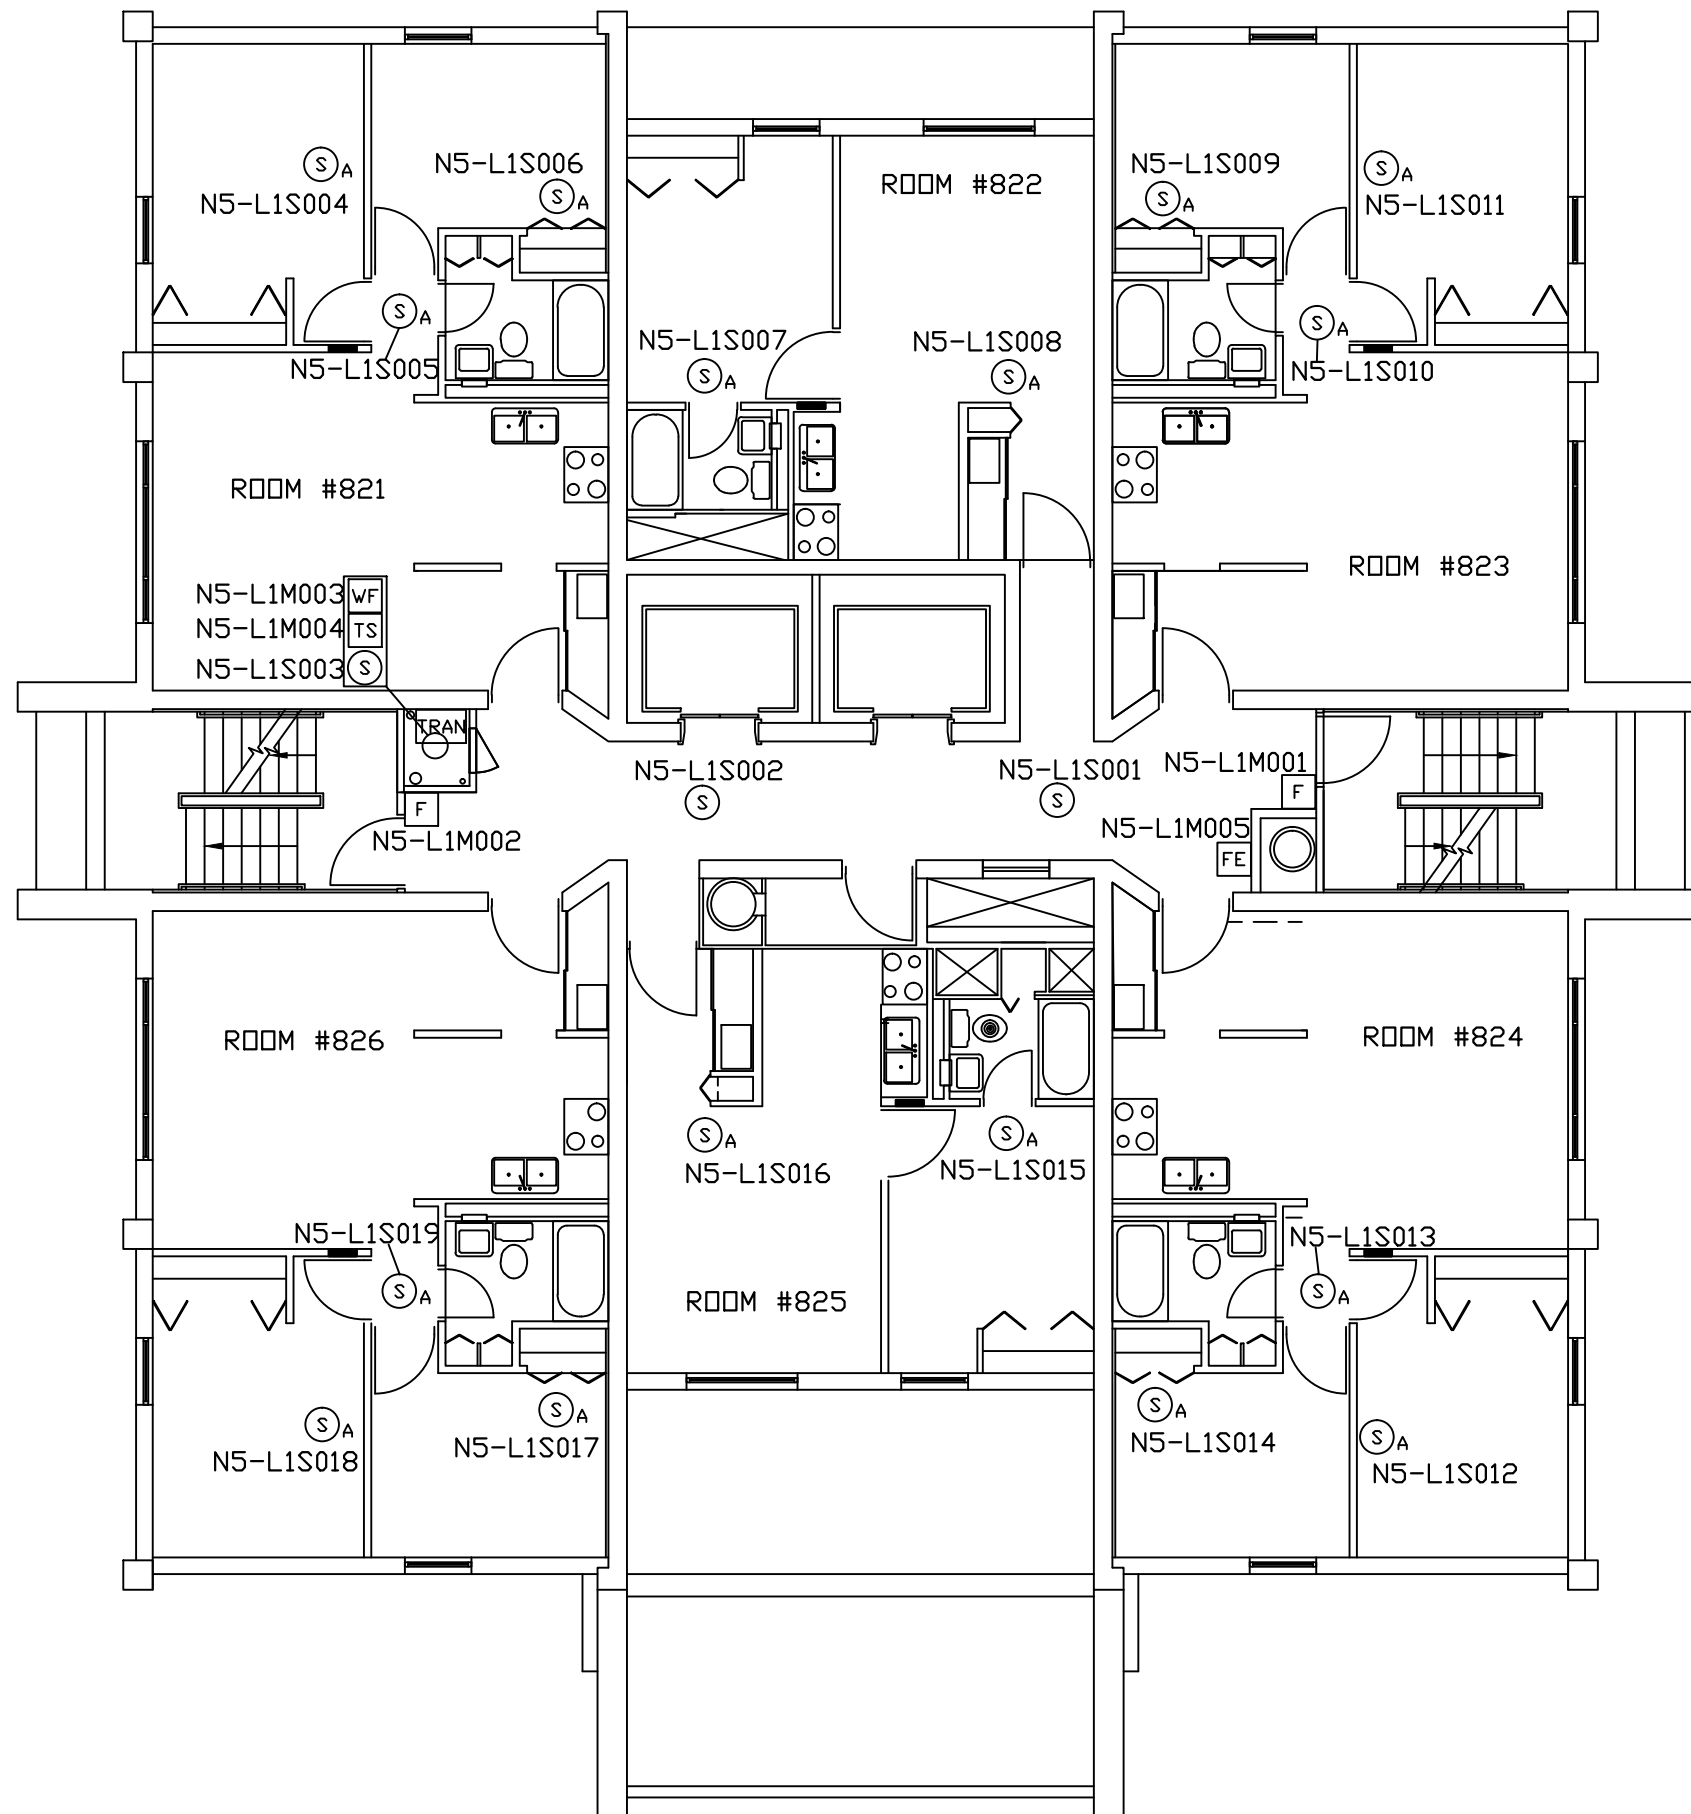

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
CM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
VX	VOICE PANEL

LOCATED IN TRAN ON THIS FLOOR:

- MM N5-L1M006 8TH FLOOR TRANSPONDER
- CM N5-L1M090 8TH FLOOR STROBES
- CM N5-L1M091 9TH FLOOR STROBES
- CM N5-L1M092 10TH FLOOR STROBES
- CM N5-L1M093 11TH FLOOR STROBES



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING AND DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
EIGHTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: I
DRAWING NAME:
SOUTHMED8.DWG

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

FIRE ALARM SYSTEM
EIGHTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-8-04

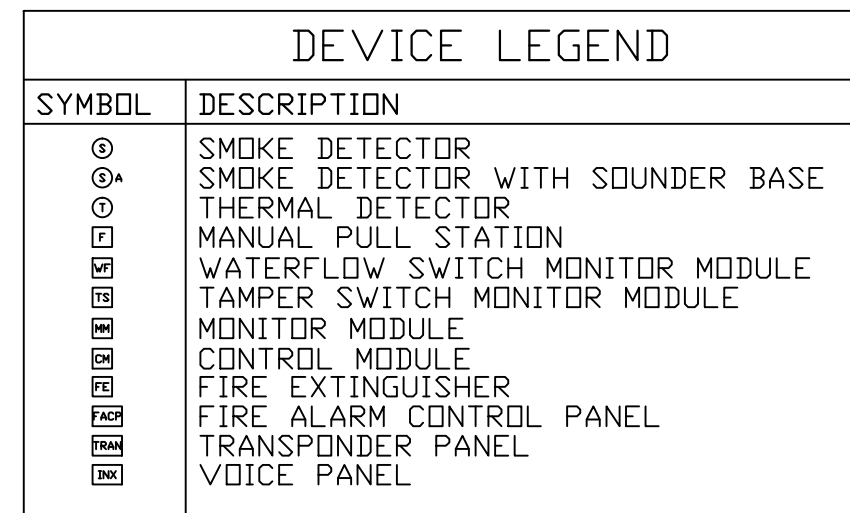

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (AND NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
TENTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	2/2/2008
SCALE:	NTS
PROJECT NO:	0702-13117
REV NO:	1
DRAWING NAME:	
SOUTHMED10.DWG	

FIRE ALARM SYSTEM
TENTH FLOOR
ADDRESSABLE LOOP

PAGE:
FA-10-04


N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

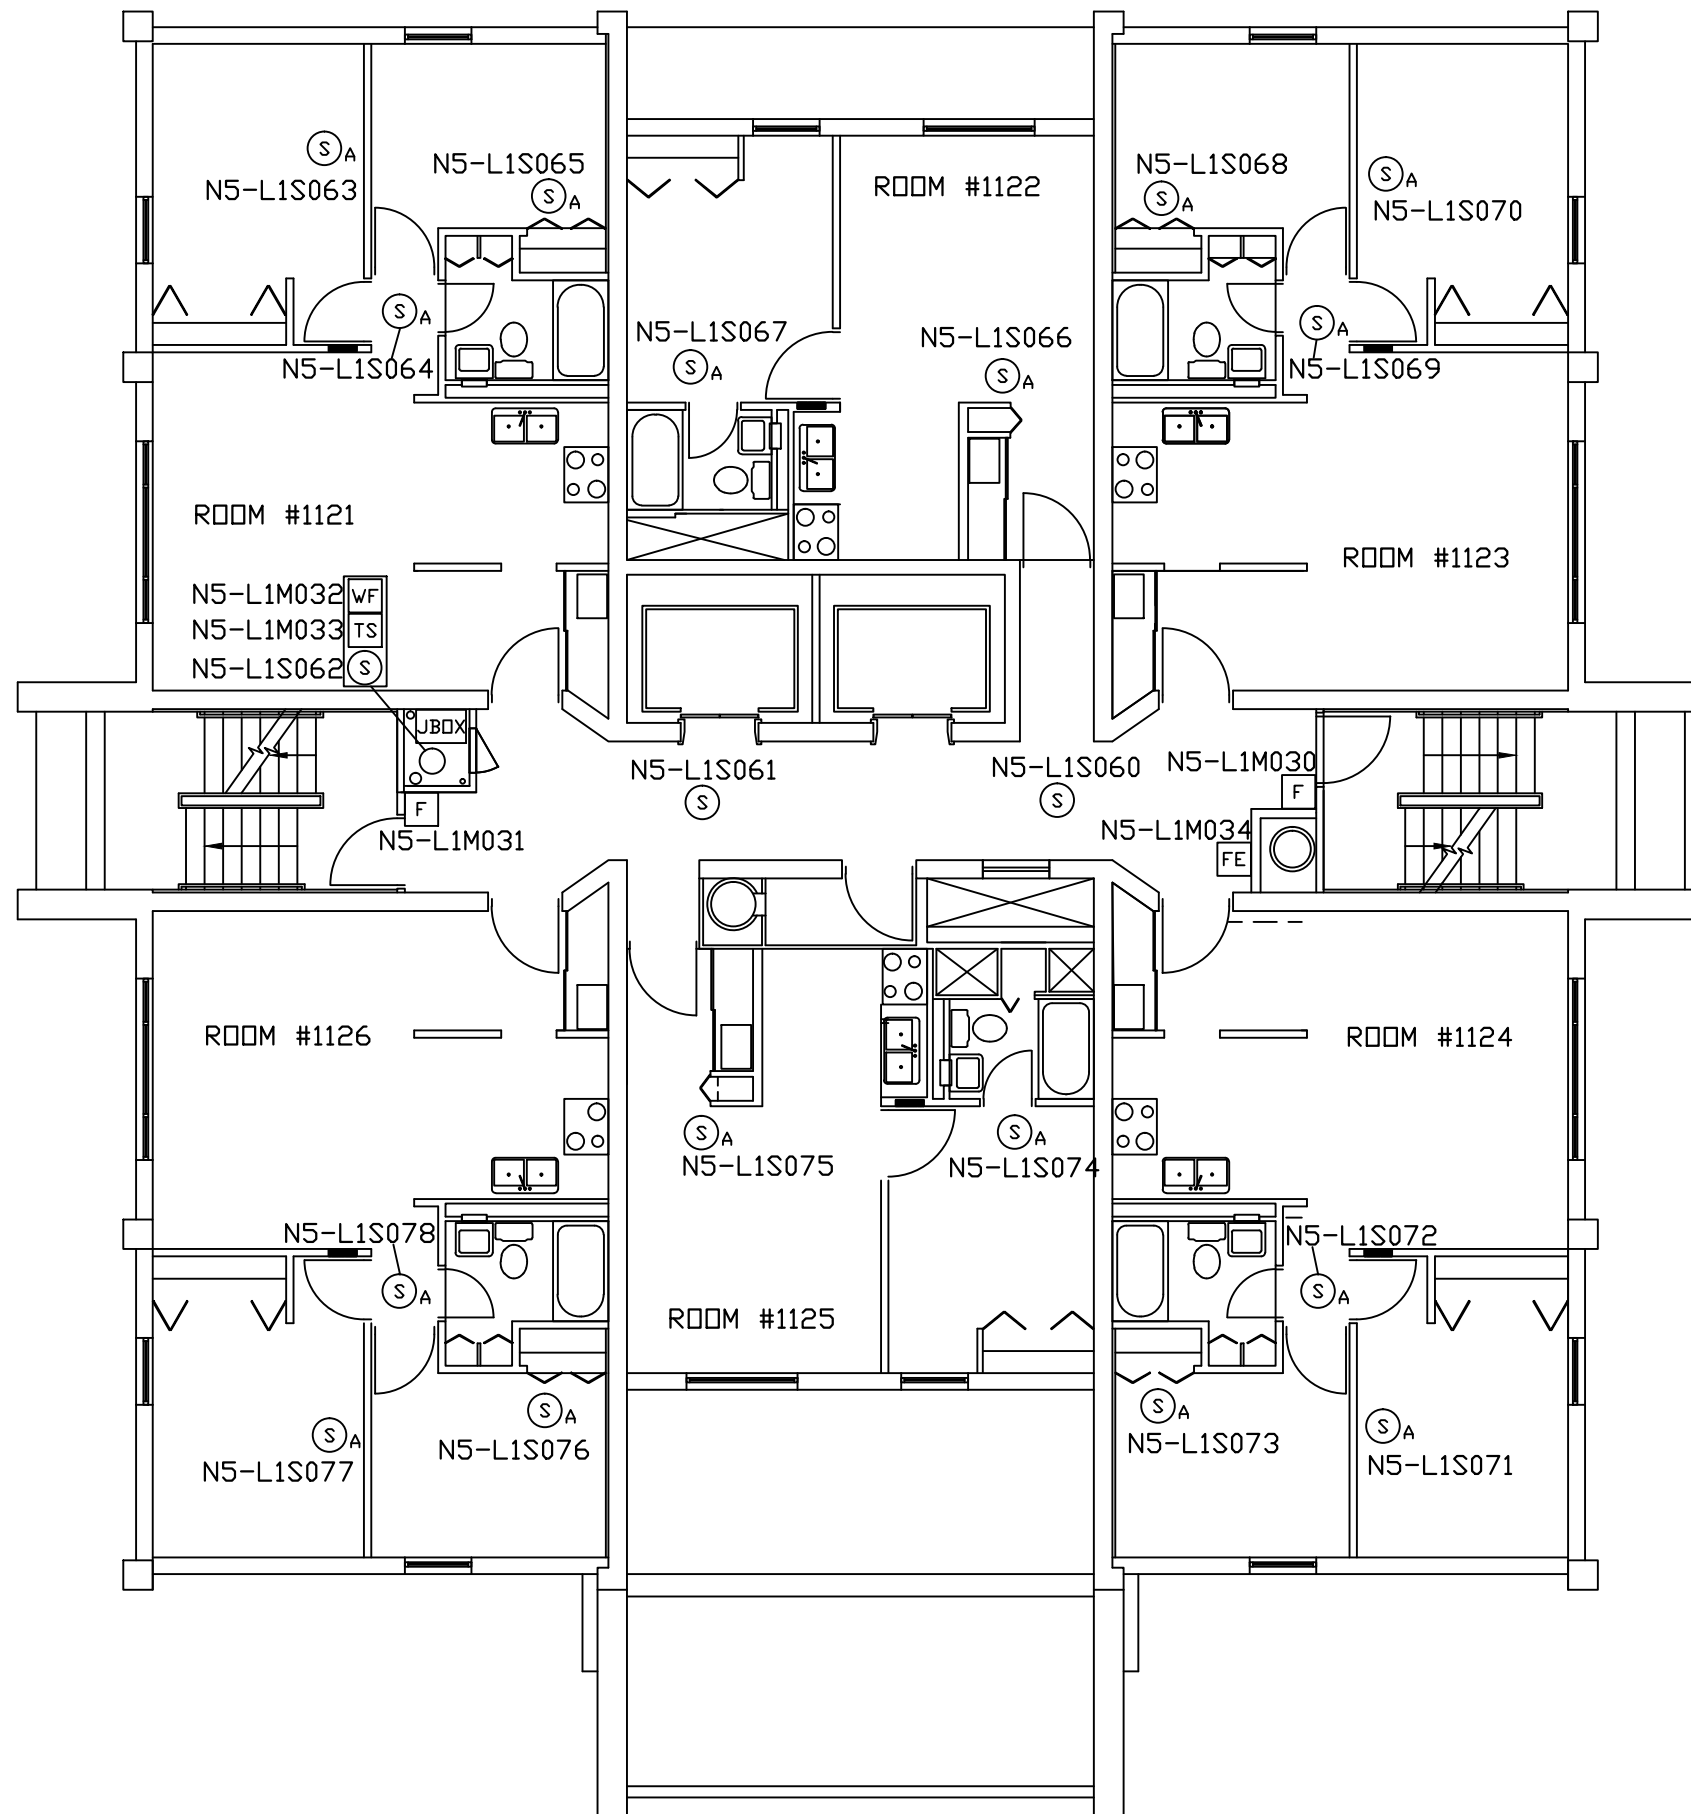

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓢ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
INX	VOICE PANEL

LOCATED IN J-BOX ON THIS FLOOR:

MM N5-L1M035 24VDC POWER SUPERVISION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
ELEVENTH FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: I
DRAWING NAME:
SOUTHMEDII.DWG

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

FIRE ALARM SYSTEM
ELEVENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-II-04

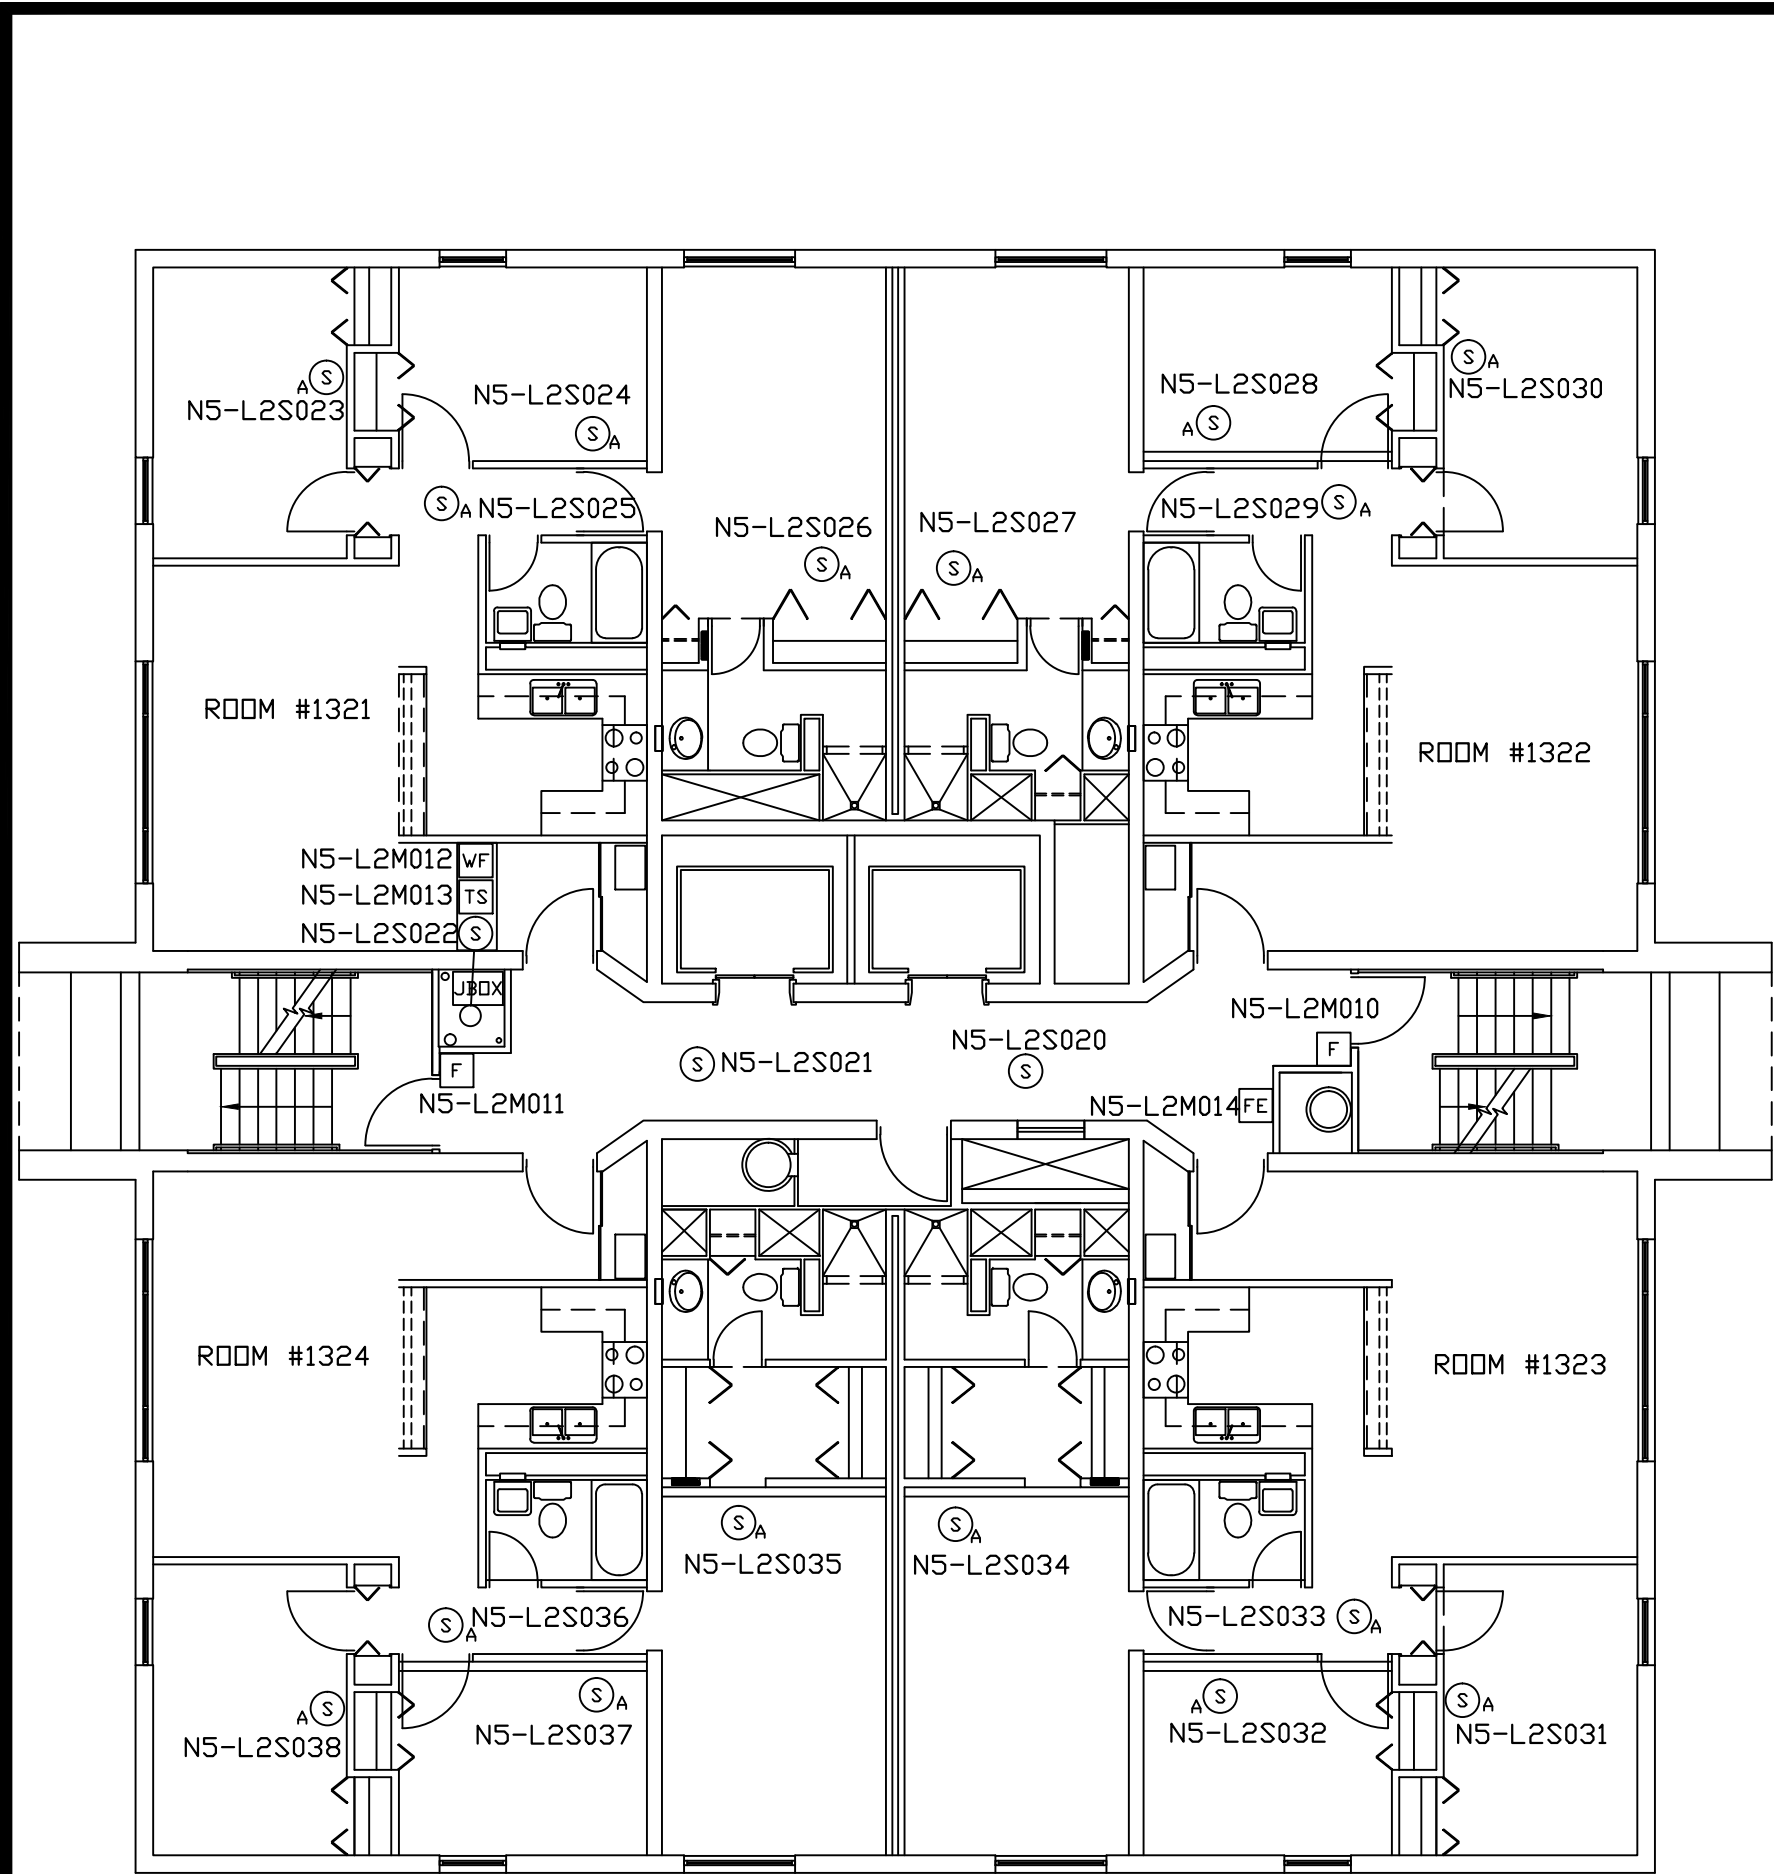


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
ⓈA	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
TNX	VOICE PANEL

LOCATED IN J-BOX PANEL ON THIS FLOOR:

- CM 12TH FLOOR FIREPHONES
- CM 13TH FLOOR FIREPHONES
- CM 14/15TH FLOORS FIREPHONES

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
THIRTEENTH FLOOR
FIRE ALARM SYSTEM


NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME:
SOUTHMED13.DWG

FIRE ALARM SYSTEM
THIRTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-13-04

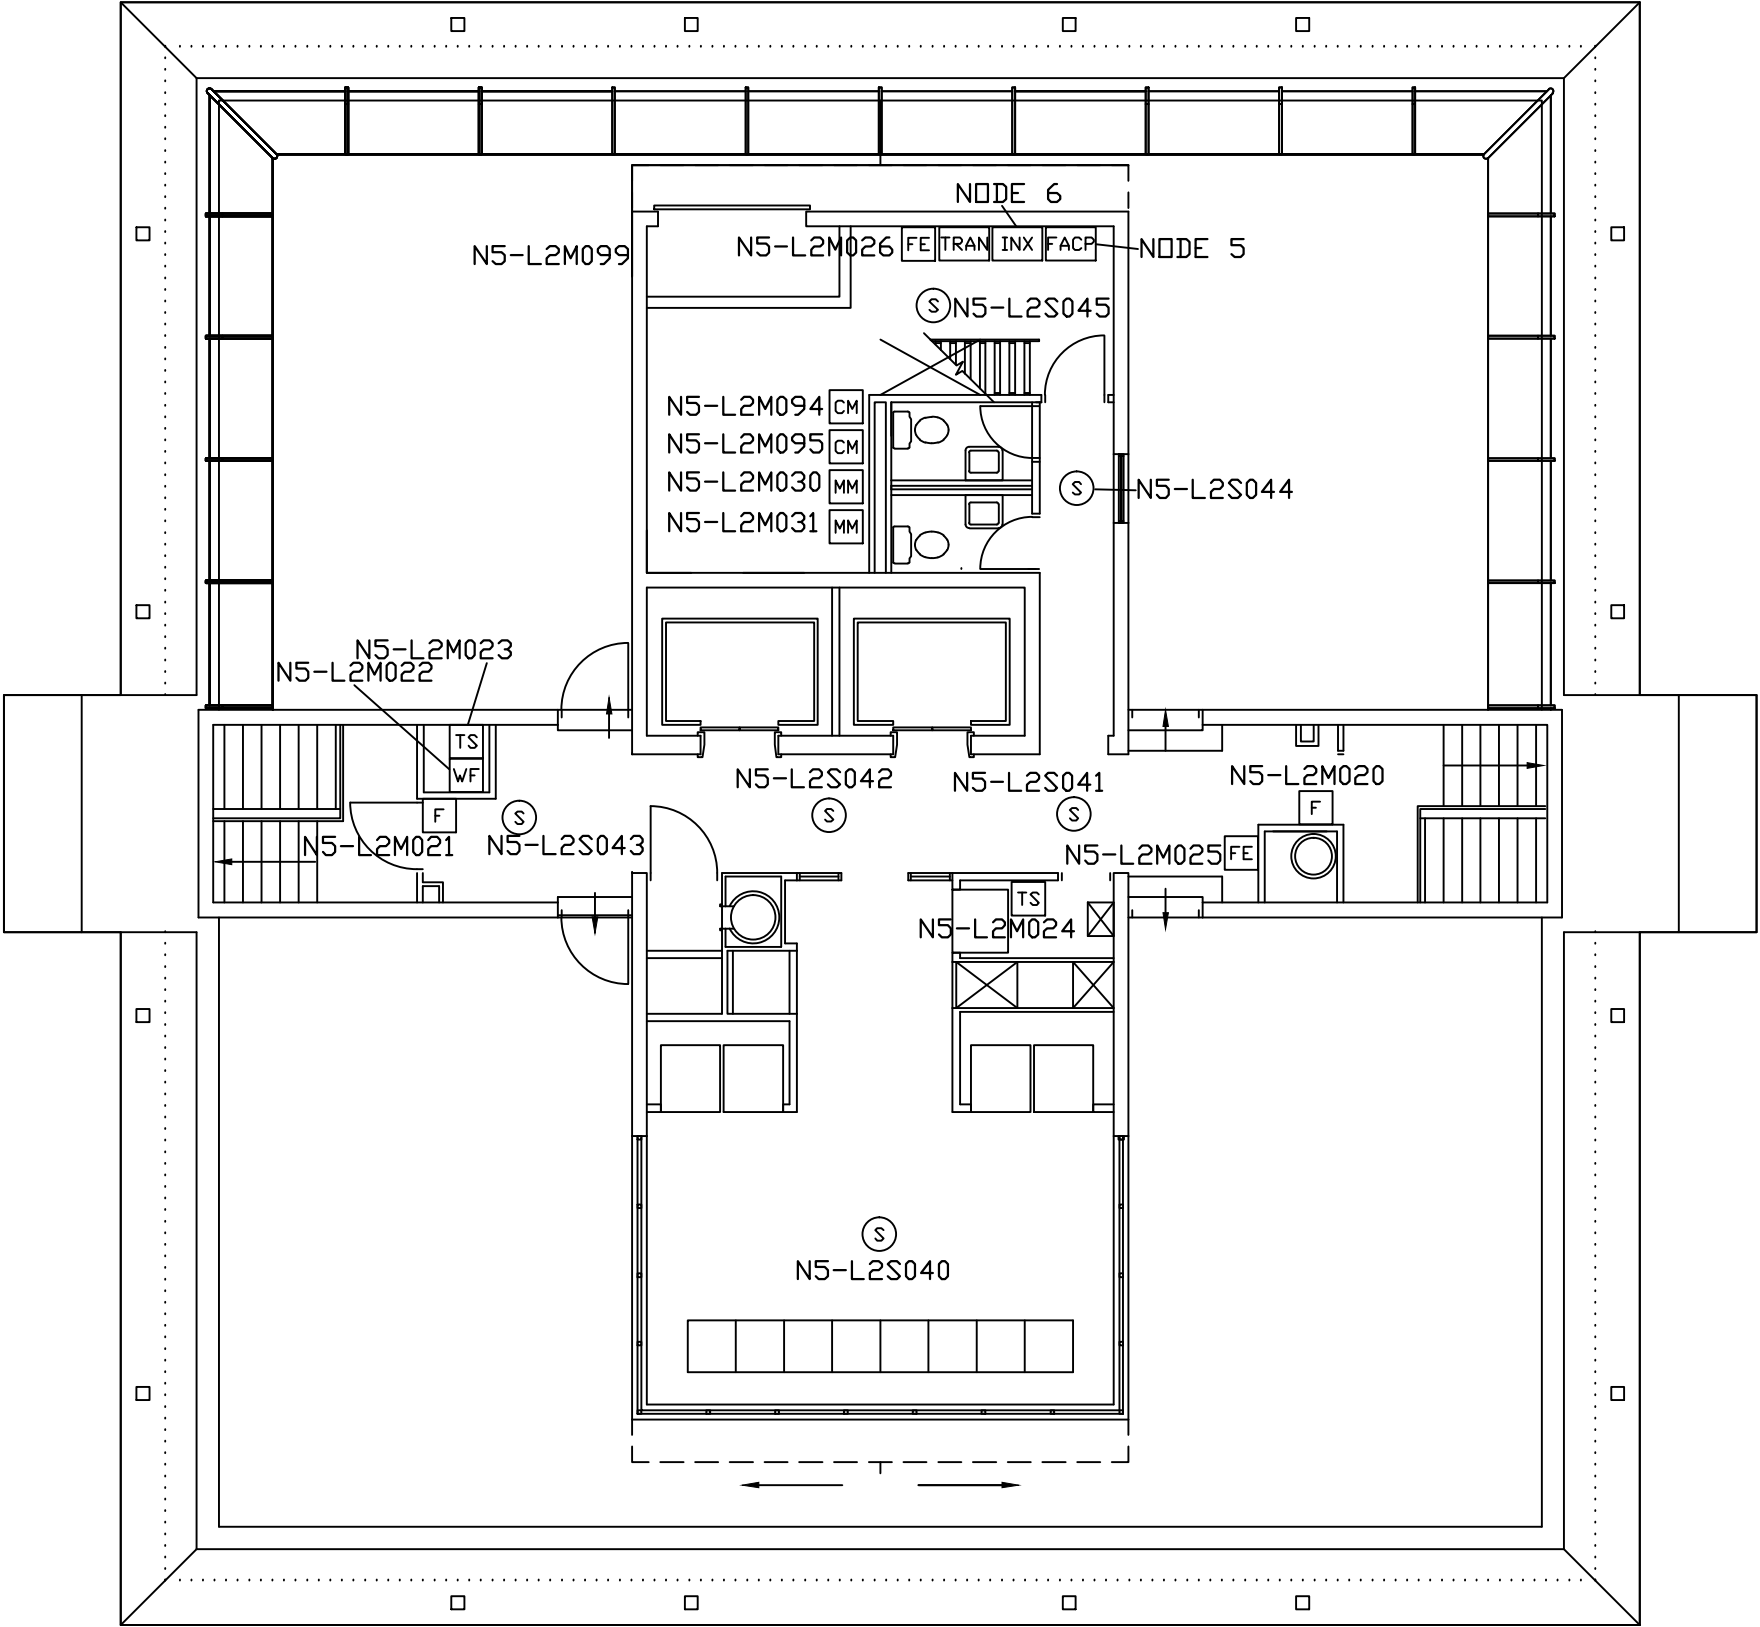


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ ^A	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
INX	VOICE PANEL

LOCATED IN TRAN ON THIS FLOOR:

- MM N5-L2M027 14TH FLOOR TRANSPONDER
- CM N5-L2M090 12TH FLOOR STROBES
- CM N5-L2M091 13TH FLOOR STROBES
- CM N5-L2M092 14TH FLOOR STROBES
- CM N5-L2M093 15TH FLOOR STROBES

N.I.C.E.T.
LEVEL III
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING AND DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
FOURTEENTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: DS
DESIGNED BY: KGE
APPROVED BY: TCT
DATE: 2/2/2008
SCALE: NTS
PROJECT NO: 0702-13117
REV NO: 1
DRAWING NAME: SOUTHMED14.DWG

FIRE ALARM SYSTEM
FOURTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-14-04

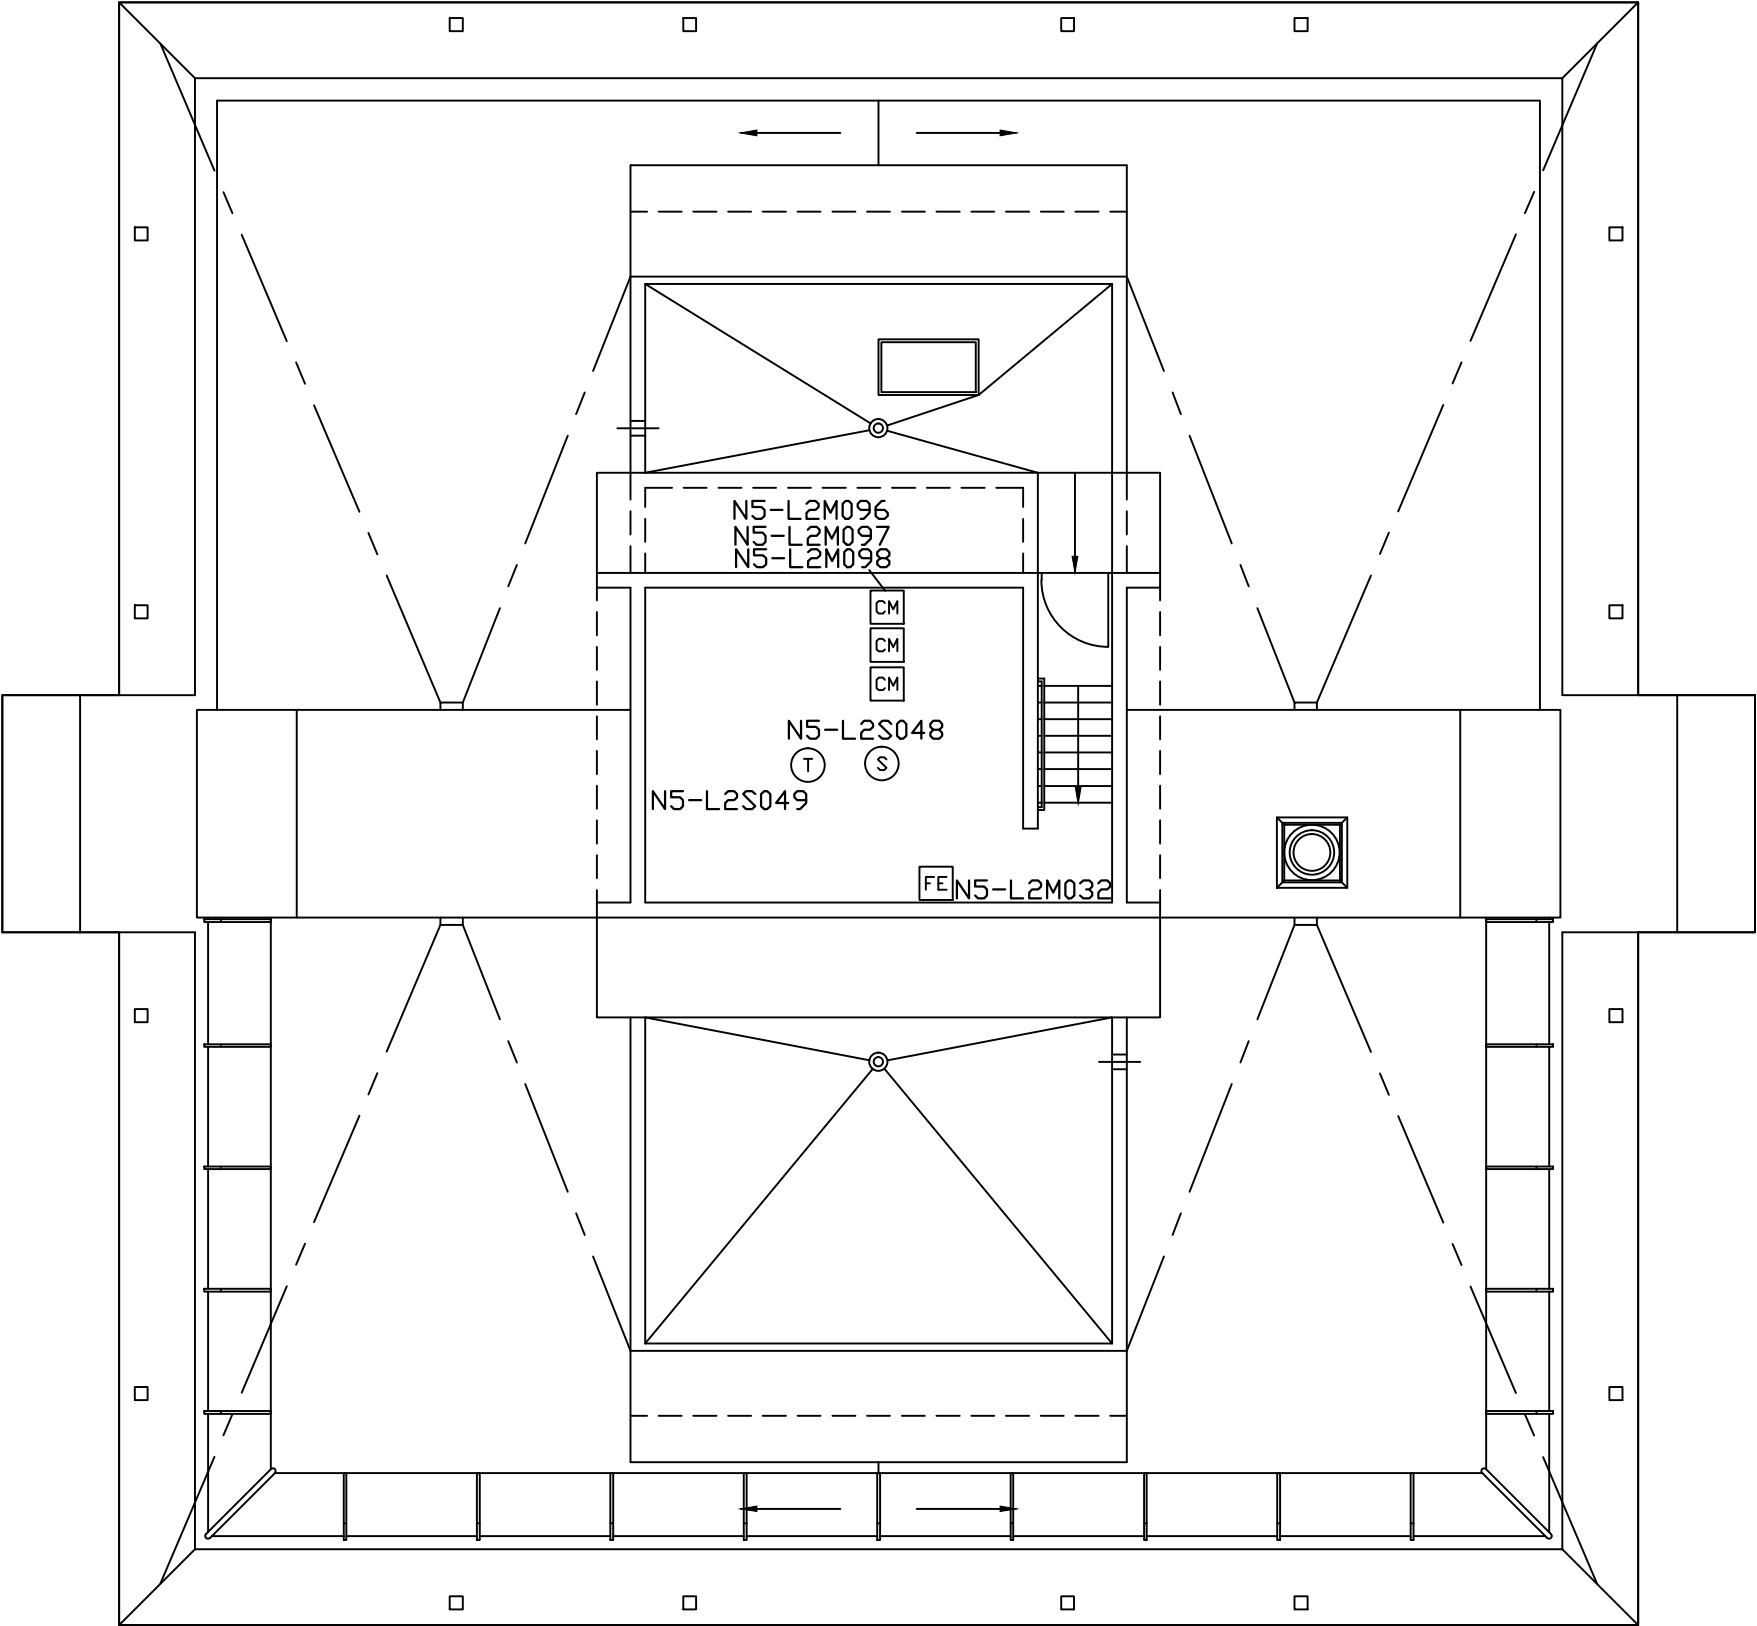

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓢ ^A	SMOKE DETECTOR WITH SOUNDER BASE
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FE	FIRE EXTINGUISHER
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
INX	VOICE PANEL



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

SOUTH MEDICAL TOWER
UNIVERSITY OF UTAH
FIFTEENTH FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	KGE
APPROVED BY:	TCT
DATE:	2/2/2008
SCALE:	NTS
PROJECT NO:	0702-13117
REV NO:	I
DRAWING NAME:	SOUTHMED15.DWG

N.I.C.E.T.
LEVEL III
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396

FIRE ALARM SYSTEM
FIFTEENTH FLOOR
ADDRESSABLE NUMBERS

PAGE:
FA-15-04