

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ. **CLASS "A" WIRING IS REQUIRED.**
2. WIRING DEPICTED ON THESE PLAN IS SCHEMATIC - **ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS.** WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
3. POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
4. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
5. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
6. LOCATE SMOKE DETECTORS A **MINIMUM OF THREE (3) FEET** FROM MECHANICAL DIFFUSERS.
7. **DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.**
8. A SMOKE DETECTOR **MUST BE IN EVERY ROOM** WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
9. FIRE ALARM CKTS **NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS** PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. DEDICATED 120 VAC CKTS SHALL BE MARKED AS **"FIRE ALARM CKT"** AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
11. WHERE LOCATED **WITHIN SEVEN (7) FEET OF THE FLOOR**, FIRE ALARM CABLES SHALL BE **SECURELY FASTENED** IN AN APPROVED MANNER **AND PROTECTED FROM PHYSICAL DAMAGE.**
12. **DAMP OR WET LOCATION PROTECTION:** BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED **DRAINAGE OPENINGS BETWEEN 3/8" AND 1/4"** SHALL BE PERMITTED.
13. **CLASS 'A' CIRCUITS** USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. **MINIMUM SEPARATION** TO PREVENT PHYSICAL DAMAGE IS **12" VERTICALLY AND 48" HORIZONTALLY.** THE **OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:**
- 13.1. DISTANCE **NOT TO EXCEED 10'** WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
- 13.2. **SINGLE DROPS** INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
- 13.3. IN A **SINGLE ROOM NOT EXCEEDING 1000 SQ. FT.**, A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT **DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.**

SYSTEM NOTES:

- 1 TO FACU LOCATED IN ELEC. 8
- 2 120 VAC w/GROUND TO FACU




WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	WATERFLOW HORN/STROBE CKT	4 #14'S
D	120 VAC w/GROUND	3 #12'S
*	SEE RISER FOR INTERCONNECT DETAILS	

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
1	(S)	SMOKE DETECTOR
2	(T)	HEAT DETECTOR
2	F	MANUAL PULL STATION
3	MM	MONITOR MODULE
2	TS	TAMPER SWITCH MONITOR
1	WF	WATER FLOW SWITCH MONITOR
1	SN	SPRINKLER NOTIFICATION MODULE
1	L	STROBE ONLY- WALL
1	HS	HORN/STROBE- WALL
1	HS _{WP}	WEATHERPROOF HORN/STROBE
1	FACU	FIRE ALARM CONTROL UNIT



WEST VILLAGE HOUSING - CENTRAL PLANT BLDG

KEY PLAN

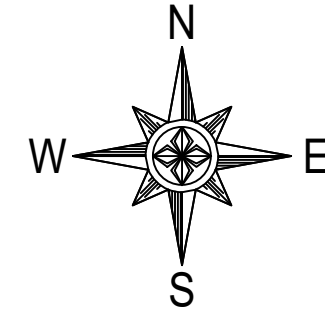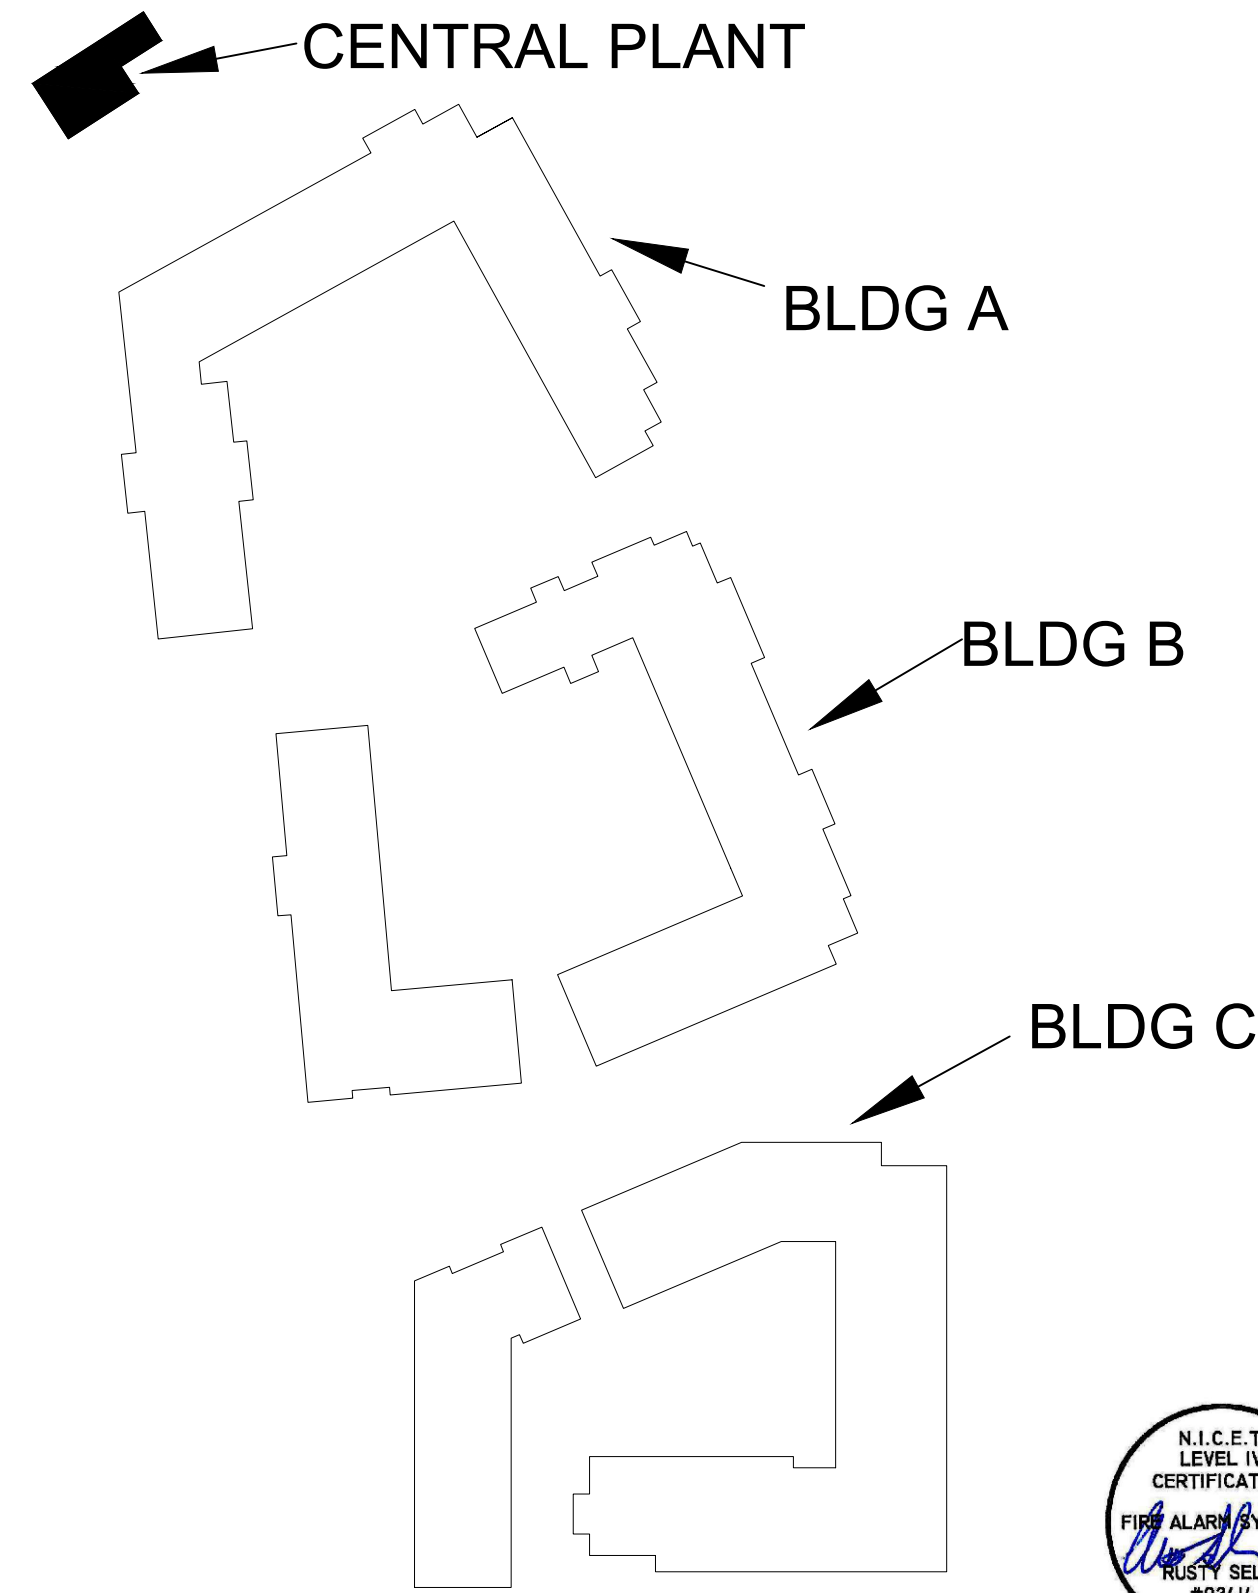

NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

WEST VILLAGE HOUSING - CENTRAL PLANT
UNIVERSITY OF UTAH
SUNNYSIDE AVENUE AND FOOTHILL DRIVE
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 6/1/2023 12:01:04 PM
SCALE: (ANSI B) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
WHV CENTRAL PLANT.DWG

NELSON FIRE SYSTEMS

MAIN LEVEL
ADDRESSABLE & NOTIFICATION

PAGE:

FA-1-01

