

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
DAYCARE PHASE 2
FIRE ALARM SYSTEM

BUILDING/JOB SUMMARY

-DFCM PROJECT
-BUILDING LEVELS: 1
-BUILDING SPRINKLERED: YES
-BUILDING FACU LOCATION: IDF ROOM
-BUILDING FACU MONITORING COMPANY: UNIVERSITY DISPATCH
-BUILDING OCCUPANCY TYPE: I-4
-BUILDING SQUARE FOOTAGE: 7,600 FT²
-DESIGN IS IN ACCORDANCE WITH THE 2021 IFC AND THE 2019 NFPA 72

INDEX OF DRAWINGS

PAGE	SHEET #	SHEET CONTENTS
1	FA-C-01	PROJECT COVER SHEET / INDEX OF DRAWINGS
2	FA-R-01	FIRE ALARM BUILDING RISER DIAGRAM / MATRIX
3	FA-1-01	INITIATION CIRCUIT
4	FA-1-02	NOTIFICATION CIRCUIT

DEVICE SCHEDULE

COUNTS	SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENT
14	⊙	SMOKE DETECTOR w/BASE	ASD-PL3 w/B300-6	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
3	F	MANUAL PULL STATION	MS-7AF	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
1	TS	TAMPER SWITCH MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" DEEP BOX MINIMUM
1	WF	WATER FLOW SWITCH MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" DEEP BOX MINIMUM
1	SN	SPRINKLER NOTIFICATION MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" DEEP BOX MINIMUM
16	L _C	STROBE ONLY-CEILING	SCWL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
5	HS _C	HORN/STROBE-CEILING	PC2WL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
6	HS _{LF}	HORN/STROBE-LOW FREQUENCY	P2WL-LF	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
1	HS _{WP}	WEATHERPROOF HORN/STROBE- WALL	P2RK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	RA	REMOTE ANNUNCIATOR	E3BB-B2A	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	FACU	FIRE ALARM CONTROL UNIT	S3BB-RB	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	TRAN	TRANSPONDER PANEL	PS-10	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
DAYCARE PHASE 2
SUNNYSIDE AVENUE AND FOOTHILL DRIVE
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS

DRAWN BY: LT
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 5/29/2024 3:51:05 PM
SCALE: (ANSI B) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
WVH P2 DAYCARE COVER.DWG

NELSON FIRE SYSTEMS

PROJECT COVER SHEET

PAGE:

FA-C-01



GENERAL NOTES:


1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLAN IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
3. POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25' AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
4. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
5. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
6. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
7. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
8. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
9. FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
11. WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
12. DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN $\frac{1}{8}$ " AND $\frac{1}{4}$ " SHALL BE PERMITTED.
13. CLASS 'A' CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - 13.1. DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - 13.2. SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - 13.3. IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

SYSTEM NOTES:

① TO FACU LOCATED IN IDF E2

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	WATERFLOW HORN CKT	4 #14'S
D	REMOTE ANNUNCIATOR	3 PAIR #14'S TWISTED
*	SEE RISER FOR INTERCONNECT DETAILS	

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
14	Ⓢ	SMOKE DETECTOR
3	F	MANUAL PULL STATION
1	TS	TAMPER SWITCH MONITOR
1	WF	WATER FLOW SWITCH MONITOR
1	SN	SPRINKLER NOTIFICATION
	L _C	STROBE ONLY-CEILING
	HS _C	HORN/STROBE-CEILING
	HS _{LF}	HORN/STROBE-LOW FREQUENCY
	HS _{WP}	WEATHERPROOF HORN/STROBE
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL

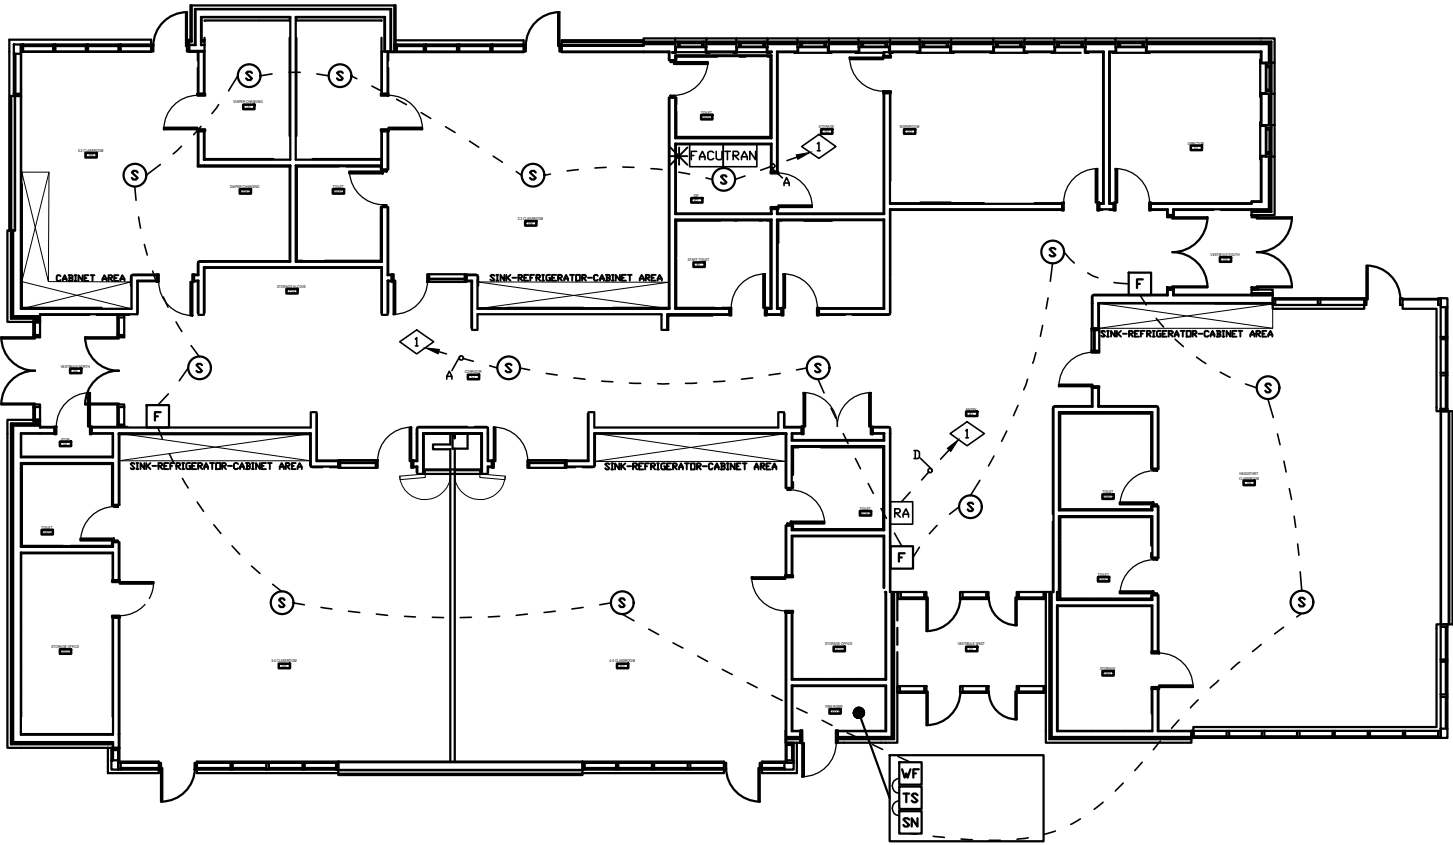

U OF U WEST VILLAGE HOUSING P2 - DAYCARE



NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2
DAYCARE
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: LT
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 5/29/2024 4:02:07 PM
SCALE: (ANSI B) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
WVH P2 DAYCARE.DWG

NELSON FIRE SYSTEMS

MAIN LEVEL
INITIATION

PAGE:

FA-1-01



GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLAN IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
3. POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25' AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
4. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
5. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
6. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
7. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
8. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
9. FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
11. WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
12. DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN $\frac{1}{8}$ " AND $\frac{1}{4}$ " SHALL BE PERMITTED.
13. CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - 13.1. DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - 13.2. SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - 13.3. IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

SYSTEM NOTES:


① TO FACU LOCATED IN IDF E2

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S
C	WATERFLOW HORN CKT	4 #14'S
D	REMOTE ANNUNCIATOR	3 PAIR #14'S TWISTED
*	SEE RISER FOR INTERCONNECT DETAILS	

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
	Ⓢ	SMOKE DETECTOR
	F	MANUAL PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATER FLOW SWITCH MONITOR
	SN	SPRINKLER NOTIFICATION
16	L _C	STROBE ONLY-CEILING
5	HS _C	HORN/STROBE-CEILING
6	HS _{LF}	HORN/STROBE-LOW FREQUENCY
1	HS _{WP}	WEATHERPROOF HORN/STROBE
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL

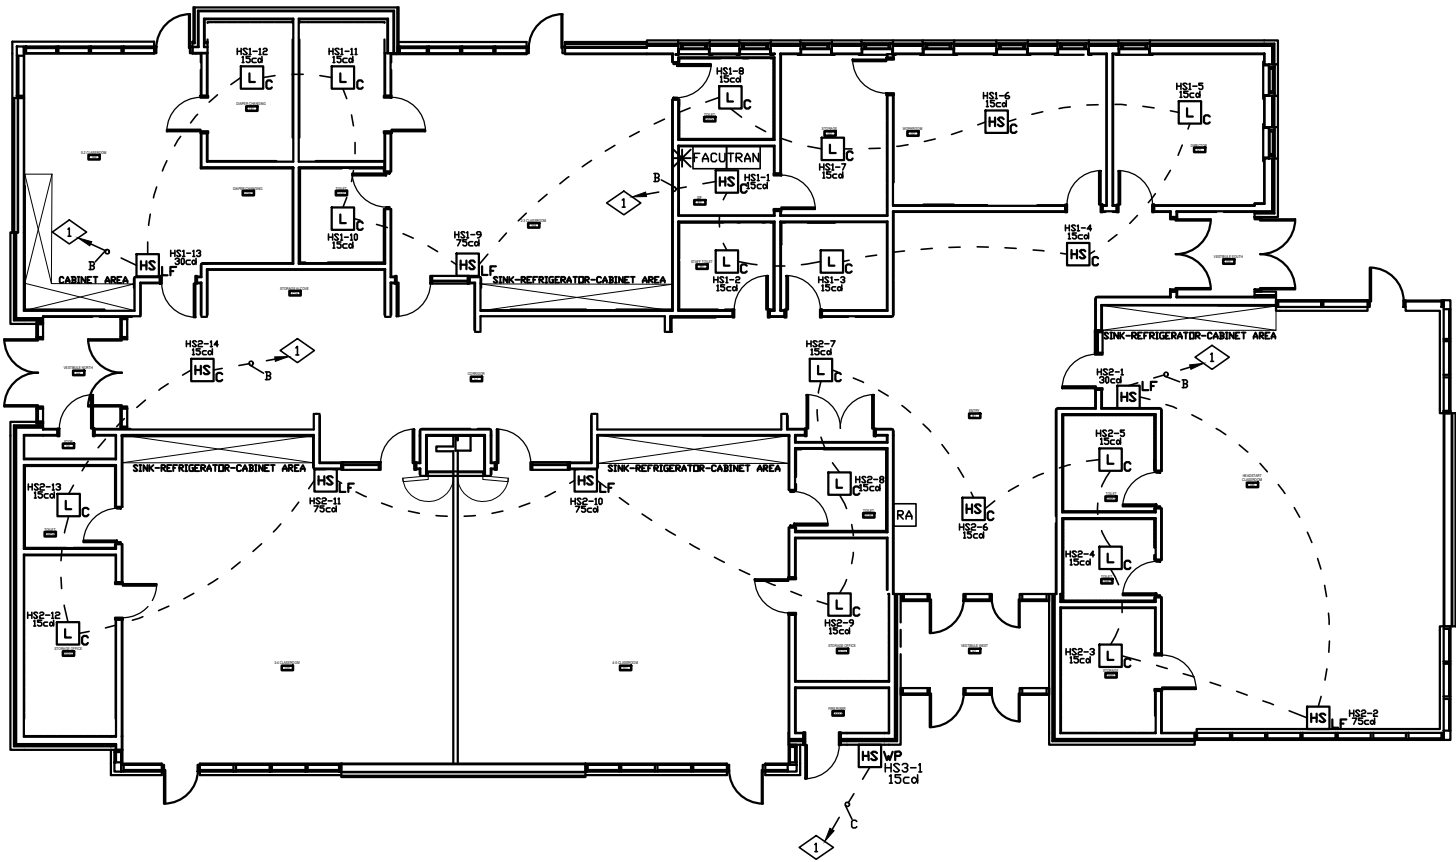

U OF U WEST VILLAGE HOUSING P2 - DAYCARE



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2
DAYCARE
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: LT
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 5/29/2024 4:02:07 PM
SCALE: (ANSI B) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
WVH P2 DAYCARE.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NOTIFICATION

PAGE:
FA-1-02

