

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM
DFCM PROJECT

BUILDING CONSTRUCTION TYPE: IIB
BUILDING SQUARE FOOTAGE: 141,856 FT²

INDEX OF DRAWINGS

PAGE	SHEET #	LEVEL	SHEET CONTENTS
1	FA-C-01		PROJECT COVER SHEET / INDEX OF DRAWINGS
2	FA-R-01		FIRE ALARM BUILDING RISER DIAGRAM / MATRIX
3	FA-1-01	FIRST	INITIATION CIRCUITS
4	FA-1-02	FIRST	NOTIFICATION CIRCUITS
5	FA-1-03	FIRST	INITIATION DEVICE NUMBERS
6	FA-2-01	SECOND	INITIATION CIRCUITS
7	FA-2-02	SECOND	NOTIFICATION CIRCUITS
8	FA-2-03	SECOND	INITIATION DEVICE NUMBERS
9	FA-3-01	THIRD	INITIATION CIRCUITS
10	FA-3-02	THIRD	NOTIFICATION CIRCUITS
11	FA-3-03	THIRD	INITIATION DEVICE NUMBERS
12	FA-4-01	FOURTH & ROOF	INITIATION CIRCUITS
13	FA-4-02	FOURTH & ROOF	NOTIFICATION CIRCUITS
14	FA-4-03	FOURTH & ROOF	INITIATION DEVICE NUMBERS

DEVICE SCHEDULE

COUNTS	SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENT
135	Ⓢ	SMOKE DETECTOR w/BASE	ASD-PL3 w/B300-6	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
348	Ⓢ _A	SMOKE DETECTOR w/AUDIBLE BASE	ASD-PL3 w/B200S-6	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
5	F	MANUAL PULL STATION	MS-7AF	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
16	MM	MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" DEEP BOX MINIMUM
3	CM	OUTPUT RELAY CONTROL MODULE	AOM-2RF	4 SQ. 2-1/8" DEEP BOX MINIMUM
5	CM	SUPERVISED CONTROL MODULE	AOM-2SF	4 SQ. 2-1/8" DEEP BOX MINIMUM
5	R	MULTI-VOLTAGE RELAY	PR-3	4 SQ. 2-1/8" DEEP BOX MINIMUM
12	L	STROBE ONLY- WALL	SWL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
28	L _C	STROBE ONLY- CEILING	SCWL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/3/O MUD RING
8	L _{WP}	STROBE ONLY- WALL	SWK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
4	HS	HORN/STROBE- WALL	P2WL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
68	HS _C	HORN/STROBE- CEILING	PC2WL	4 SQ. 2-1/8" DEEP BOX MINIMUM w/SINGLE GANG MUD RING
1	B _{WP}	WATER FLOW BELL	P2RK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	RA	REMOTE ANNUNCIATOR	E3-BB-BA2	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	FACU	FIRE ALARM CONTROL UNIT	E3-BB-BD	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
4	TRAN	TRANSPONDER PANEL	SBB-C4	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	TRAN	TRANSPONDER PANEL	SBB-D4	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
1	ERC	ELEVATOR RECALL CABINET	ERC	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS.
21	FSD	FIRE/SMOKE DAMPER	PROVIDED BY OTHERS	PROVIDED BY OTHERS

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 1/26/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
UNIVERSITY OF UTAH WEST VILLAGE P2 BLDG C COVER.DWG


NELSON FIRE SYSTEMS


PROJECT COVER SHEET

PAGE:

FA-C-01




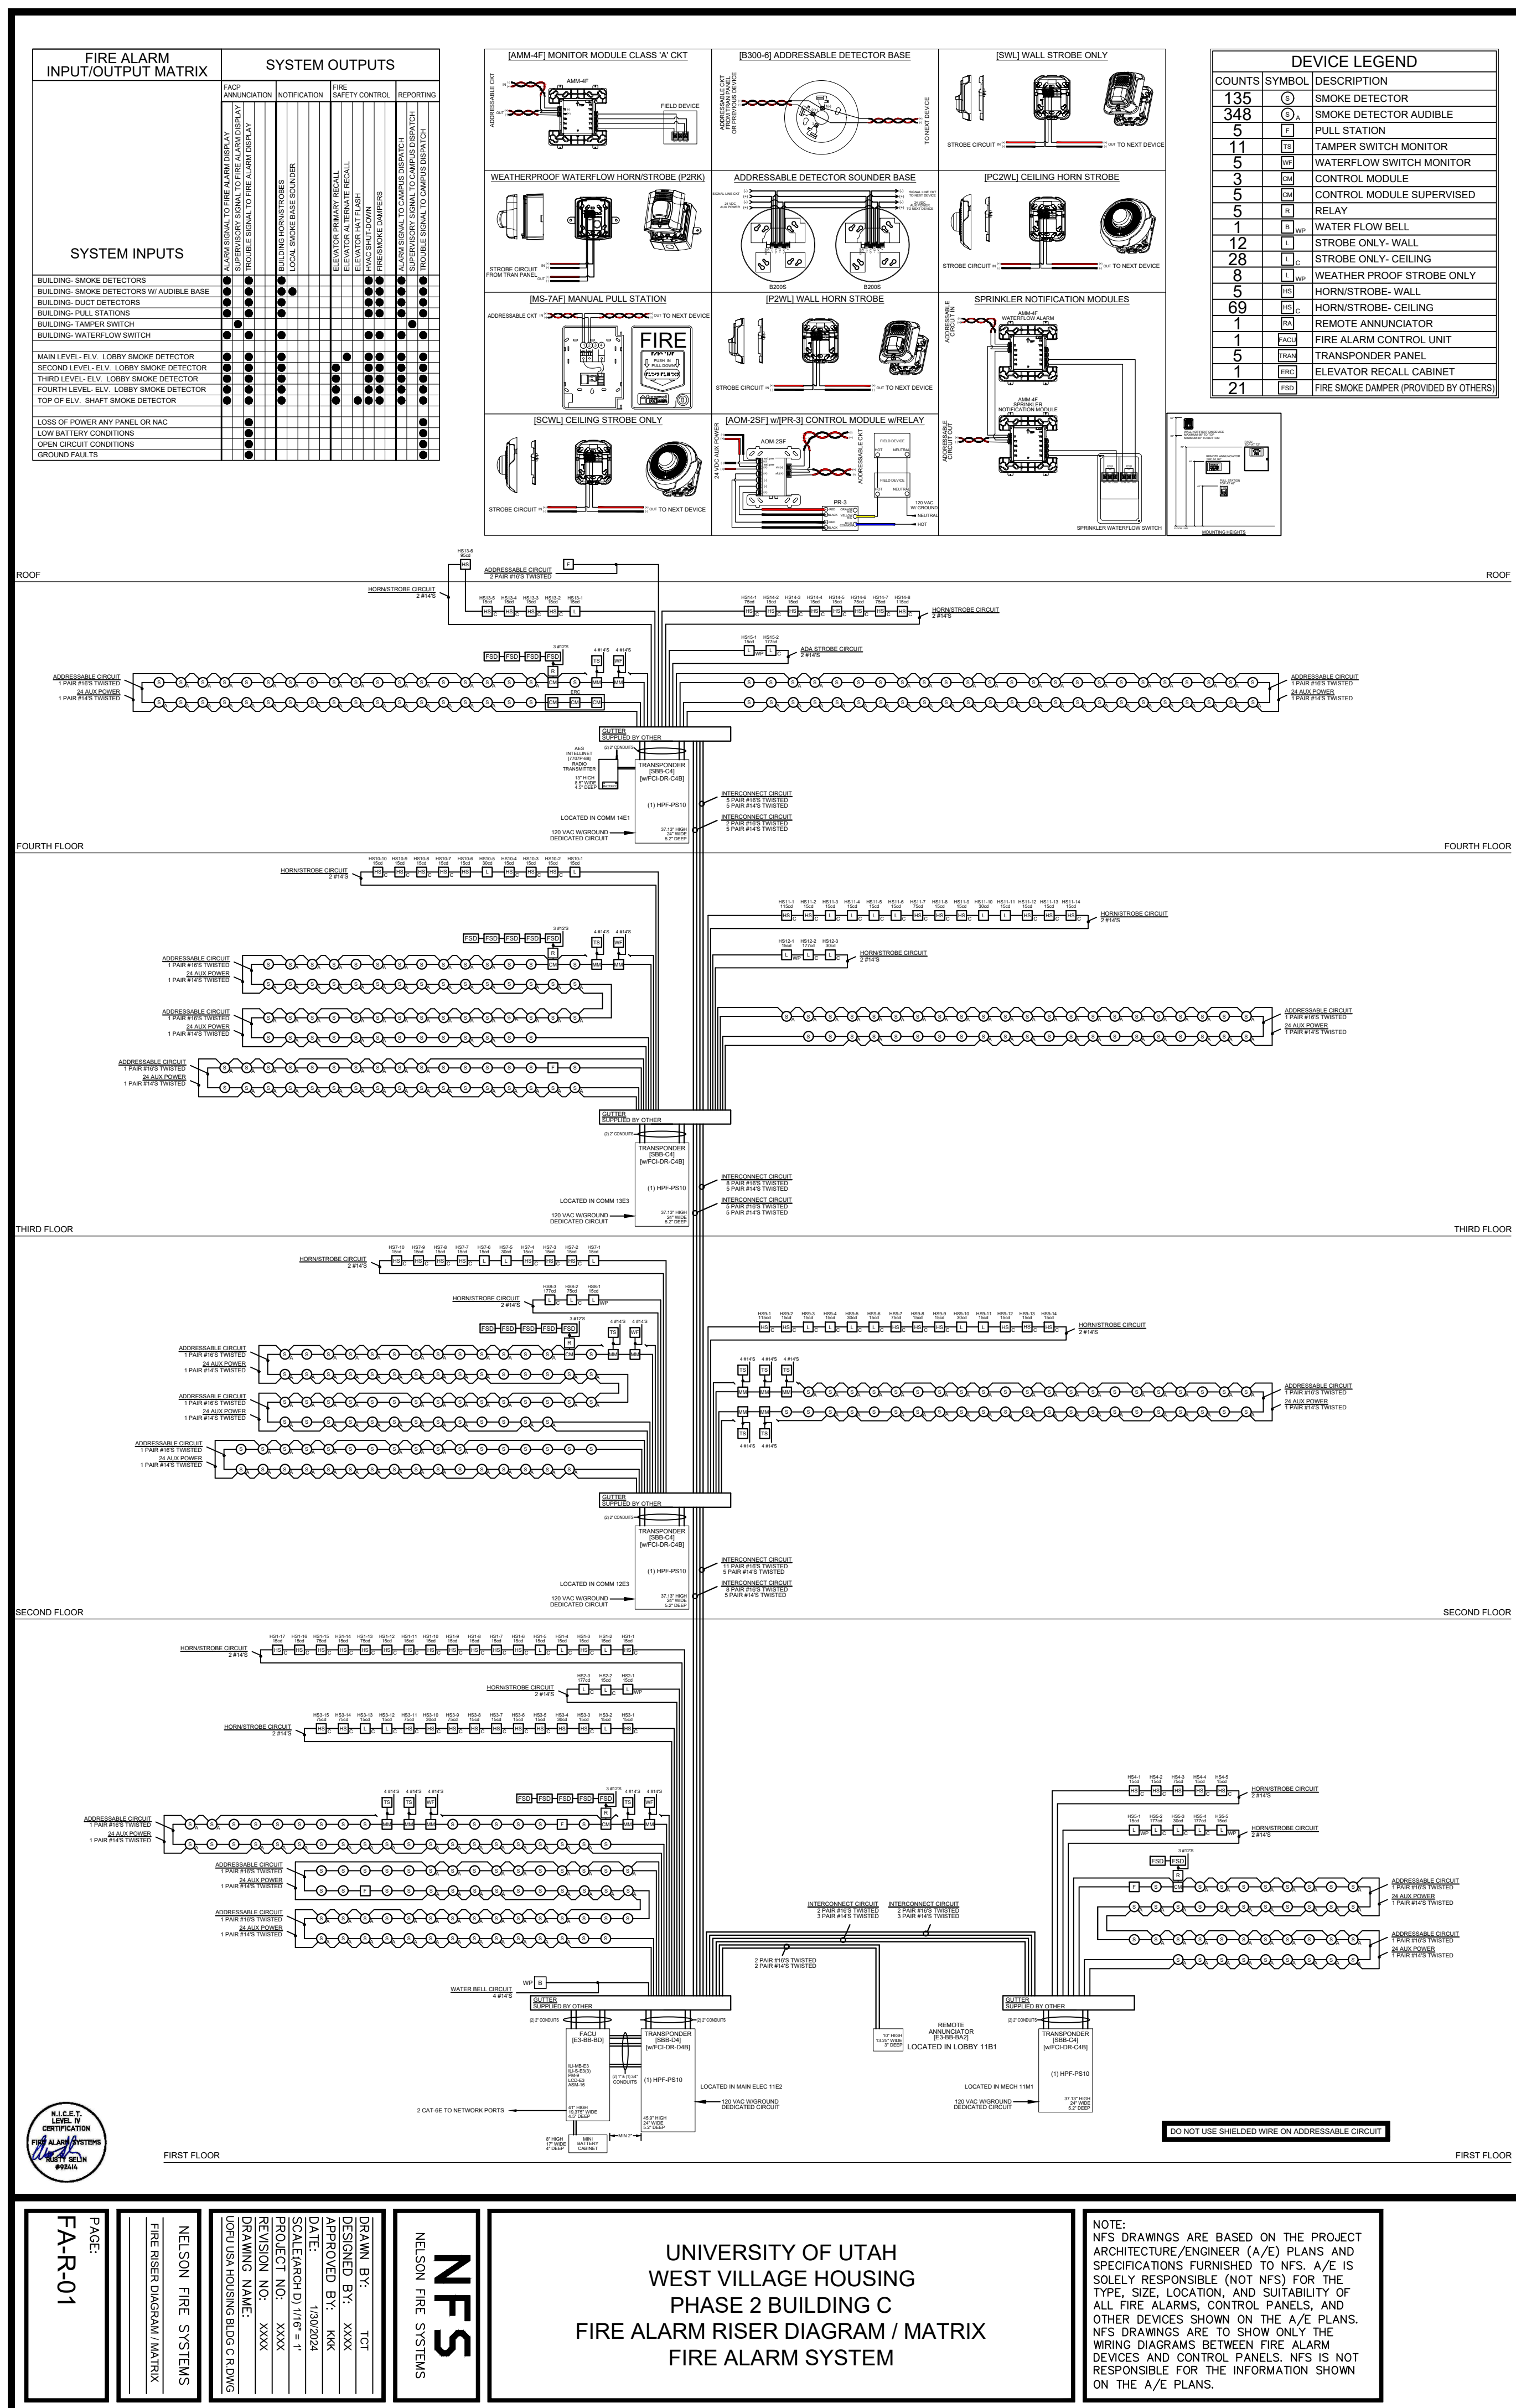

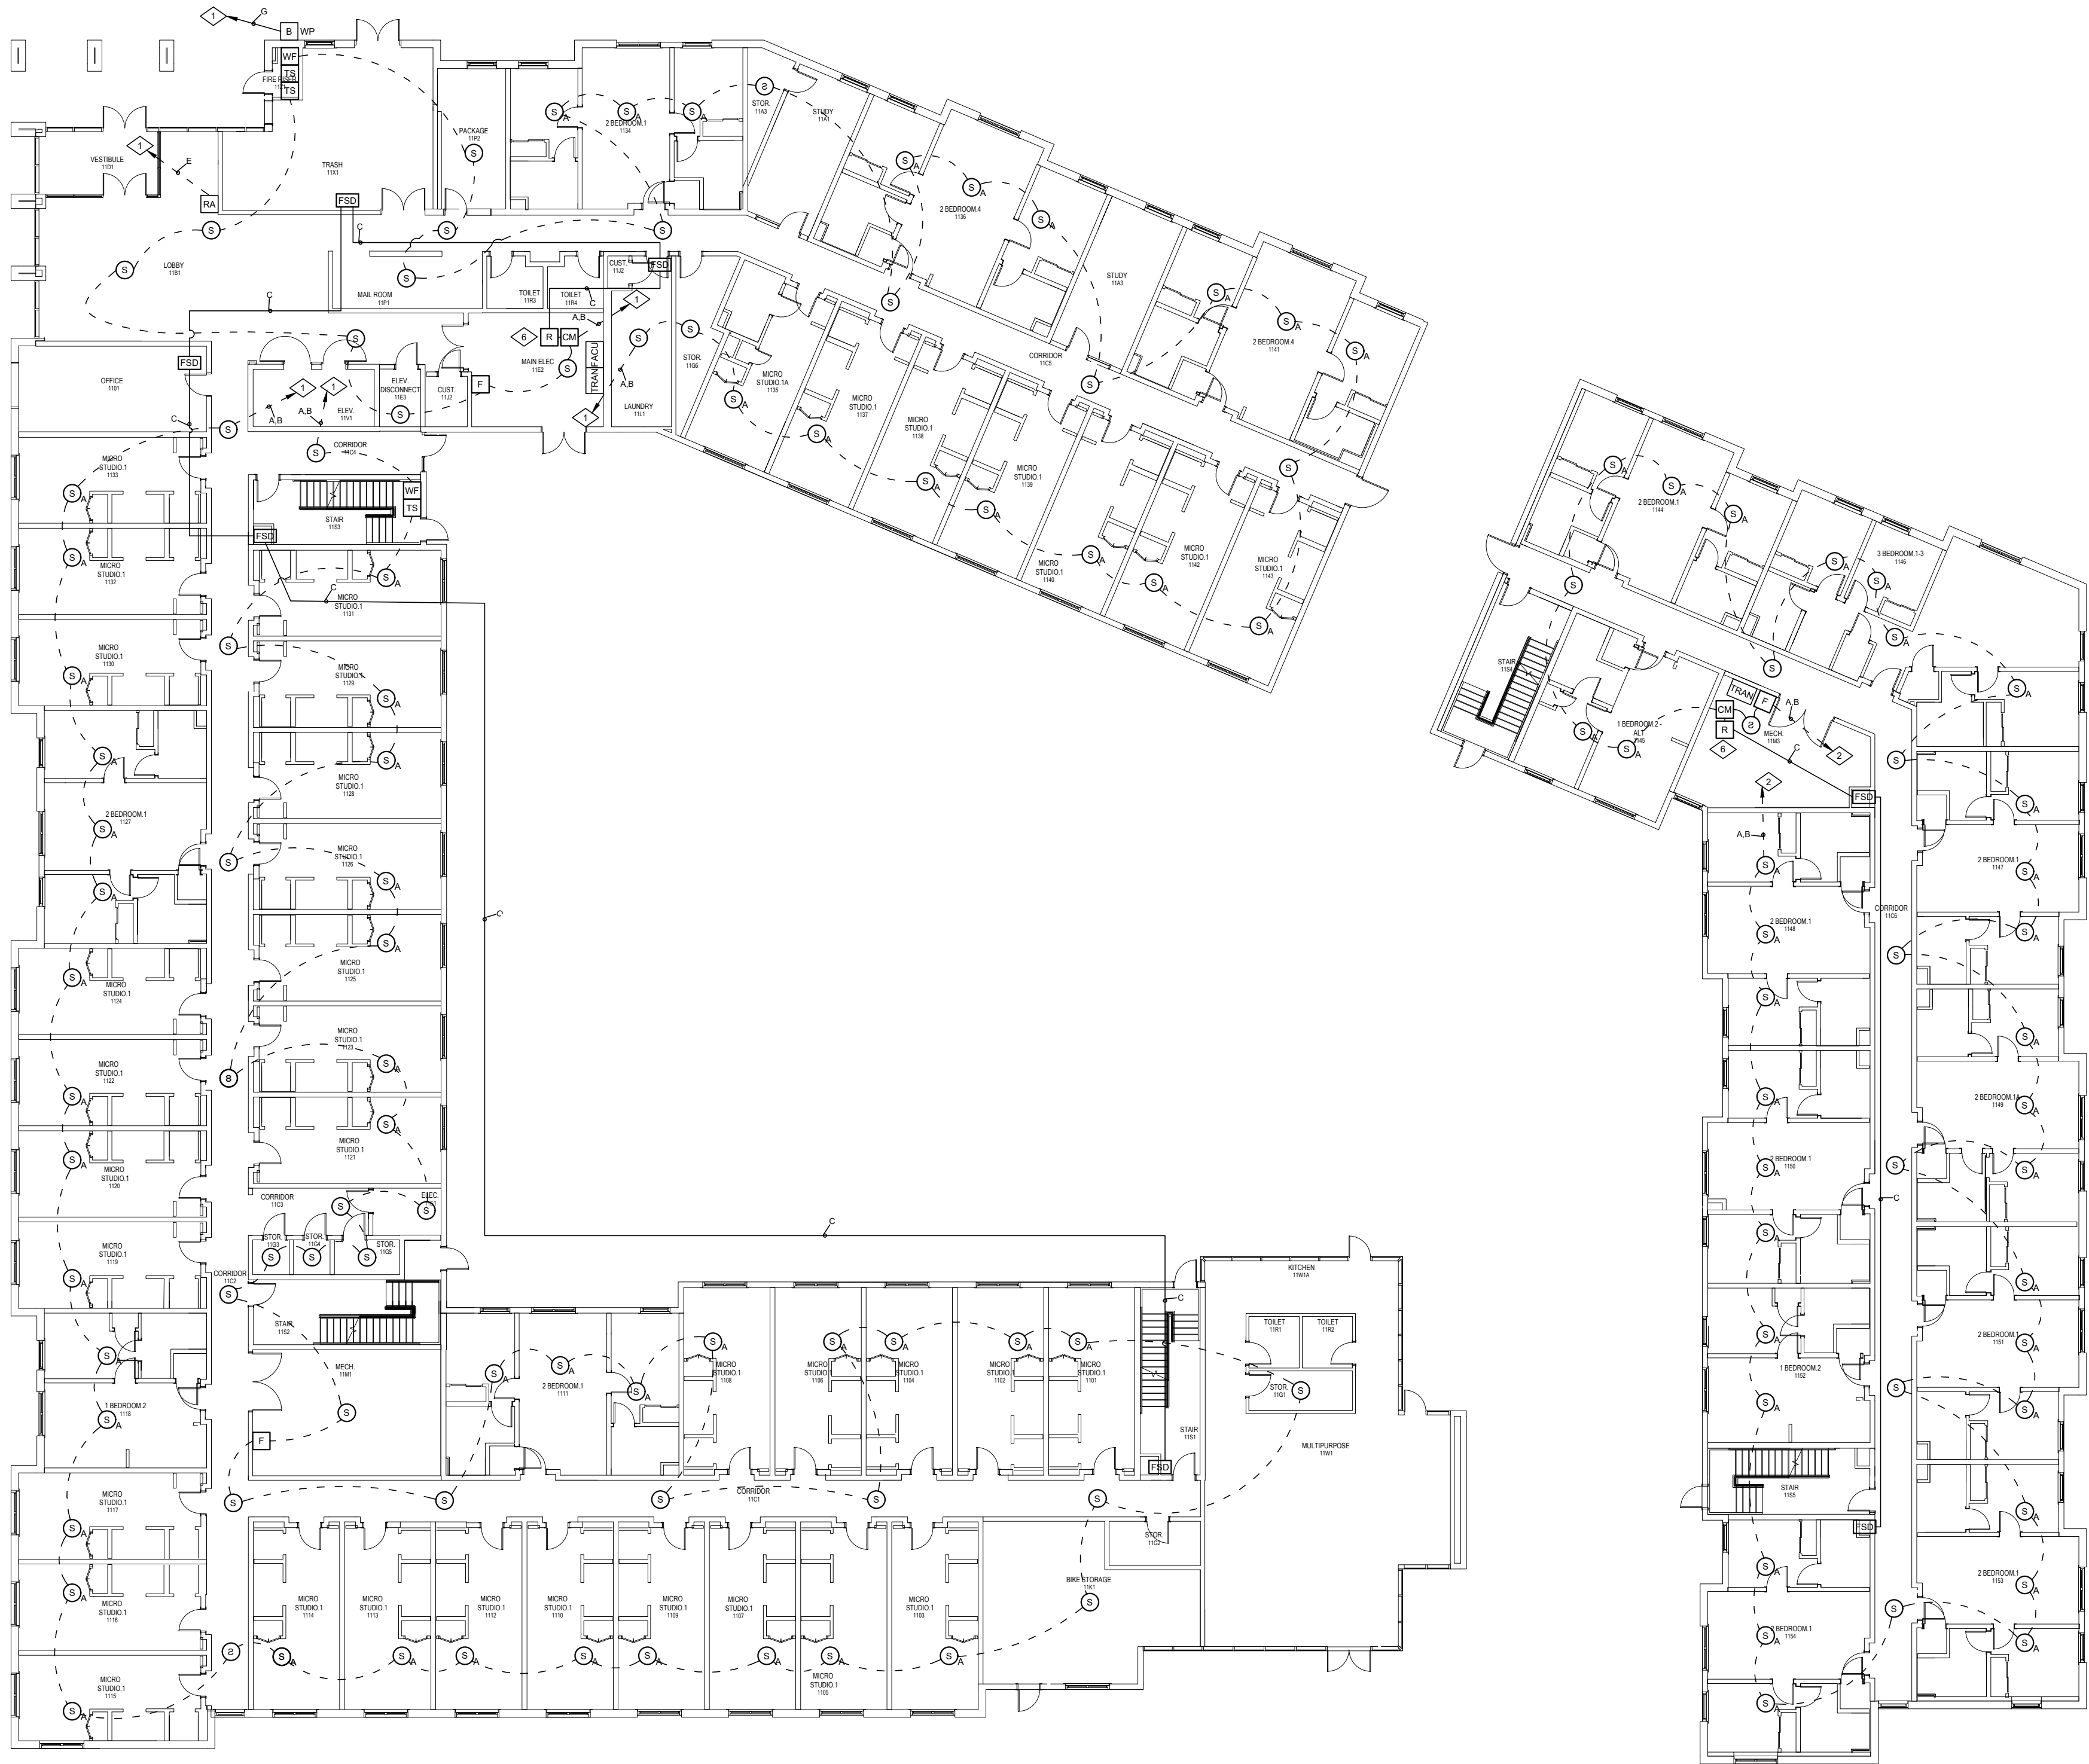


U of U WEST VILLAGE HOUSING - BLDG 'C'
MAIN FLOOR

KEY PLAN

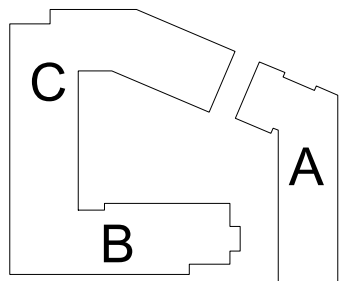

BLDG C



SYSTEM NOTES:

- TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
- TO TRANSPONDER LOCATED IN MECH 11M1
- TO TRANSPONDER LOCATED IN COMM 12E3
- TO TRANSPONDER LOCATED IN COMM 13E3
- TO TRANSPONDER LOCATED IN COMM 14E1
- CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
- TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
46	SD	SMOKE DETECTOR
86	SA	SMOKE DETECTOR AUDIBLE
3	F	PULL STATION
3	TS	TAMPER SWITCH MONITOR
2	WF	WATERFLOW SWITCH MONITOR
3	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
2	R	RELAY
1	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
2	FRAN	TRANSPONDER PANEL
1	ERC	ELEVATOR RECALL CABINET
7	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

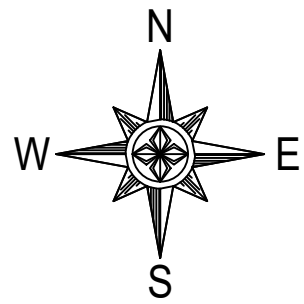

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING C PHASE 2
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: UO U WEST VILLAGE P2 BLDG C 1ST.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
INITIATION

PAGE:
FA-1-01



SYSTEM NOTES:

- 1 TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
2 TO TRANSPONDER LOCATED IN MECH 11M1
3 TO TRANSPONDER LOCATED IN COMM 12E3
4 TO TRANSPONDER LOCATED IN COMM 12E3
5 TO TRANSPONDER LOCATED IN COMM 14E1
6 CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
7 TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
	S	SMOKE DETECTOR
	S _A	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
2	L _{WP}	STROBE ONLY- WALL
9	L _C	STROBE ONLY- CEILING
4	L _{WP}	WEATHER PROOF STROBE ONLY
2	HS	HORN/STROBE- WALL
29	HS _C	HORN/STROBE- CEILING
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
1	ERC	ELEVATOR RECALL CABINET
7	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS 'A' WIRING IS REQUIRED.** WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.** A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION:** BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN $\frac{1}{4}$ " AND $\frac{1}{2}$ " SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS** USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

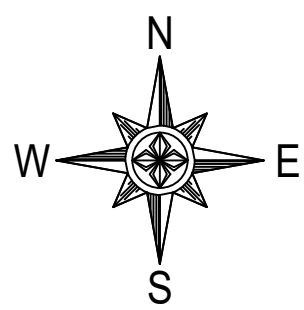

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING C PHASE 2
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:


NELSON FIRE SYSTEMS
MAIN LEVEL
NOTIFICATION

PAGE:
FA-1-02



U of U WEST VILLAGE HOUSING - BLDG 'C'
MAIN FLOOR

KEY PLAN

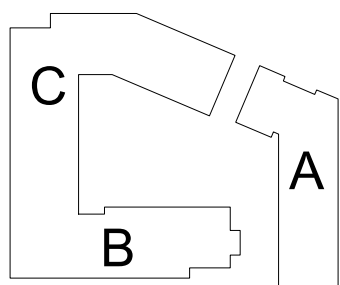

BLDG C



SYSTEM NOTES:

- 1 TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
2 TO TRANSPONDER LOCATED IN MECH 11M1
3 TO TRANSPONDER LOCATED IN COMM 12E3
4 TO TRANSPONDER LOCATED IN COMM 13E3
5 TO TRANSPONDER LOCATED IN COMM 14E1
6 CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
7 TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A/(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
46	SD	SMOKE DETECTOR
86	SA	SMOKE DETECTOR AUDIBLE
3	F	PULL STATION
3	TS	TAMPER SWITCH MONITOR
2	WF	WATERFLOW SWITCH MONITOR
3	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
	R	RELAY
1	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
2	FRAN	TRANSPONDER PANEL
1	ERC	ELEVATOR RECALL CABINET
7	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- WIRING IS REQUIRED.
- WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

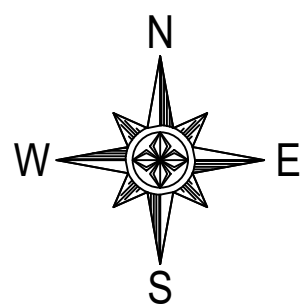

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING C PHASE 2
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: U of U WEST VILLAGE P2 BLDG C 1ST.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-1-03




U of U WEST VILLAGE HOUSING - BLDG 'C'
MAIN FLOOR

NODE 2
LOOP 1


NODE 1
LOOP 1

NODE 1
LOOP 2

KEY PLAN

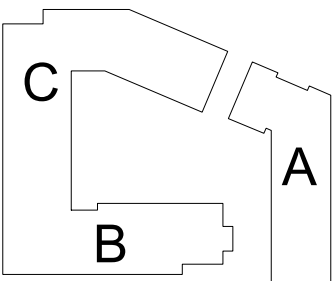

BLDG C



SYSTEM NOTES:

- ① TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
② TO TRANSPONDER LOCATED IN MECH 11M1
③ TO TRANSPONDER LOCATED IN COMM 12E3
④ TO TRANSPONDER LOCATED IN COMM 13E3
⑤ TO TRANSPONDER LOCATED IN COMM 14E1
⑥ CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
⑦ TO ELEVATOR CONTROLS

REVISION NOTES:

- △ ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
34	①	SMOKE DETECTOR
99	②A	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
1	R	RELAY
	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	FRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

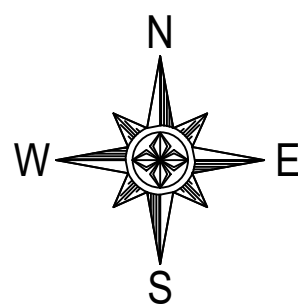

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:

NELSON FIRE SYSTEMS

SECOND LEVEL
INITIATION


PAGE:

FA-2-01



U of U WEST VILLAGE HOUSING - BLDG 'C'
SECOND FLOOR

KEY PLAN

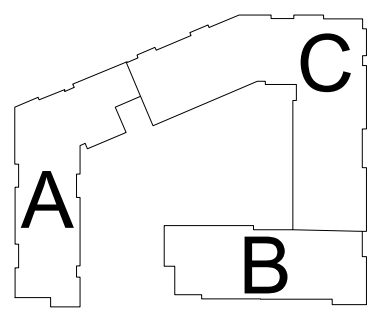

BLDG C

SYSTEM NOTES:

- ① TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
② TO TRANSPONDER LOCATED IN MECH 11M1
③ TO TRANSPONDER LOCATED IN COMM 12E3
④ TO TRANSPONDER LOCATED IN COMM 13E3
⑤ TO TRANSPONDER LOCATED IN COMM 14E1
⑥ CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
⑦ TO ELEVATOR CONTROLS

REVISION NOTES:

- △ ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
	①	SMOKE DETECTOR
	②A	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
5	L	STROBE ONLY- WALL
6	L	STROBE ONLY- CEILING
1	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
15	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- WIRING IS REQUIRED.
- WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

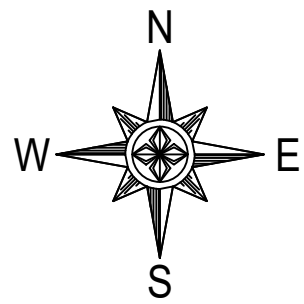

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:


NELSON FIRE SYSTEMS
SECOND LEVEL
NOTIFICATION

PAGE:
FA-2-02



U of U WEST VILLAGE HOUSING - BLDG 'C'
SECOND FLOOR

KEY PLAN

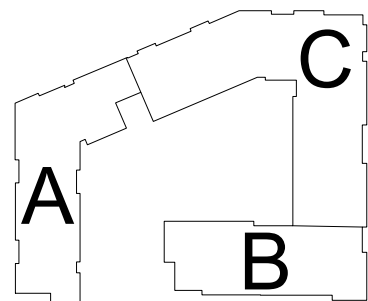

BLDG C

SYSTEM NOTES:

- 1 TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
2 TO TRANSPONDER LOCATED IN MECH 11M1
3 TO TRANSPONDER LOCATED IN COMM 12E3
4 TO TRANSPONDER LOCATED IN COMM 13E3
5 TO TRANSPONDER LOCATED IN COMM 14E1
6 CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
7 TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
34	SD	SMOKE DETECTOR
99	SA	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	FRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

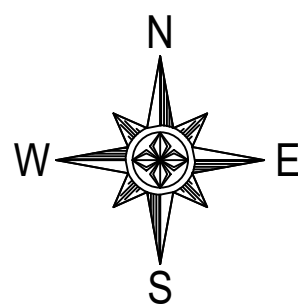

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: U of U WEST VILLAGE P2 BLDG C 2ND.DWG


NELSON FIRE SYSTEMS
SECOND LEVEL
NUMBERS

PAGE:
FA-2-03



U of U WEST VILLAGE HOUSING - BLDG 'C'
SECOND FLOOR

KEY PLAN

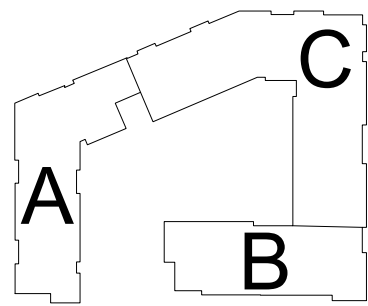

BLDG C

NODE 3
LOOP 1

NODE 3
LOOP 2

NODE 2
LOOP 2

SYSTEM NOTES:

- TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
- TO TRANSPONDER LOCATED IN MECH 11M1
- TO TRANSPONDER LOCATED IN COMM 12E3
- TO TRANSPONDER LOCATED IN COMM 13E3
- TO TRANSPONDER LOCATED IN COMM 14E1
- CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
- TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW (8/1/2022)

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S


WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
35	SD	SMOKE DETECTOR
99	SA	SMOKE DETECTOR AUDIBLE
1	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
1	R	RELAY
	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	FRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)


GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

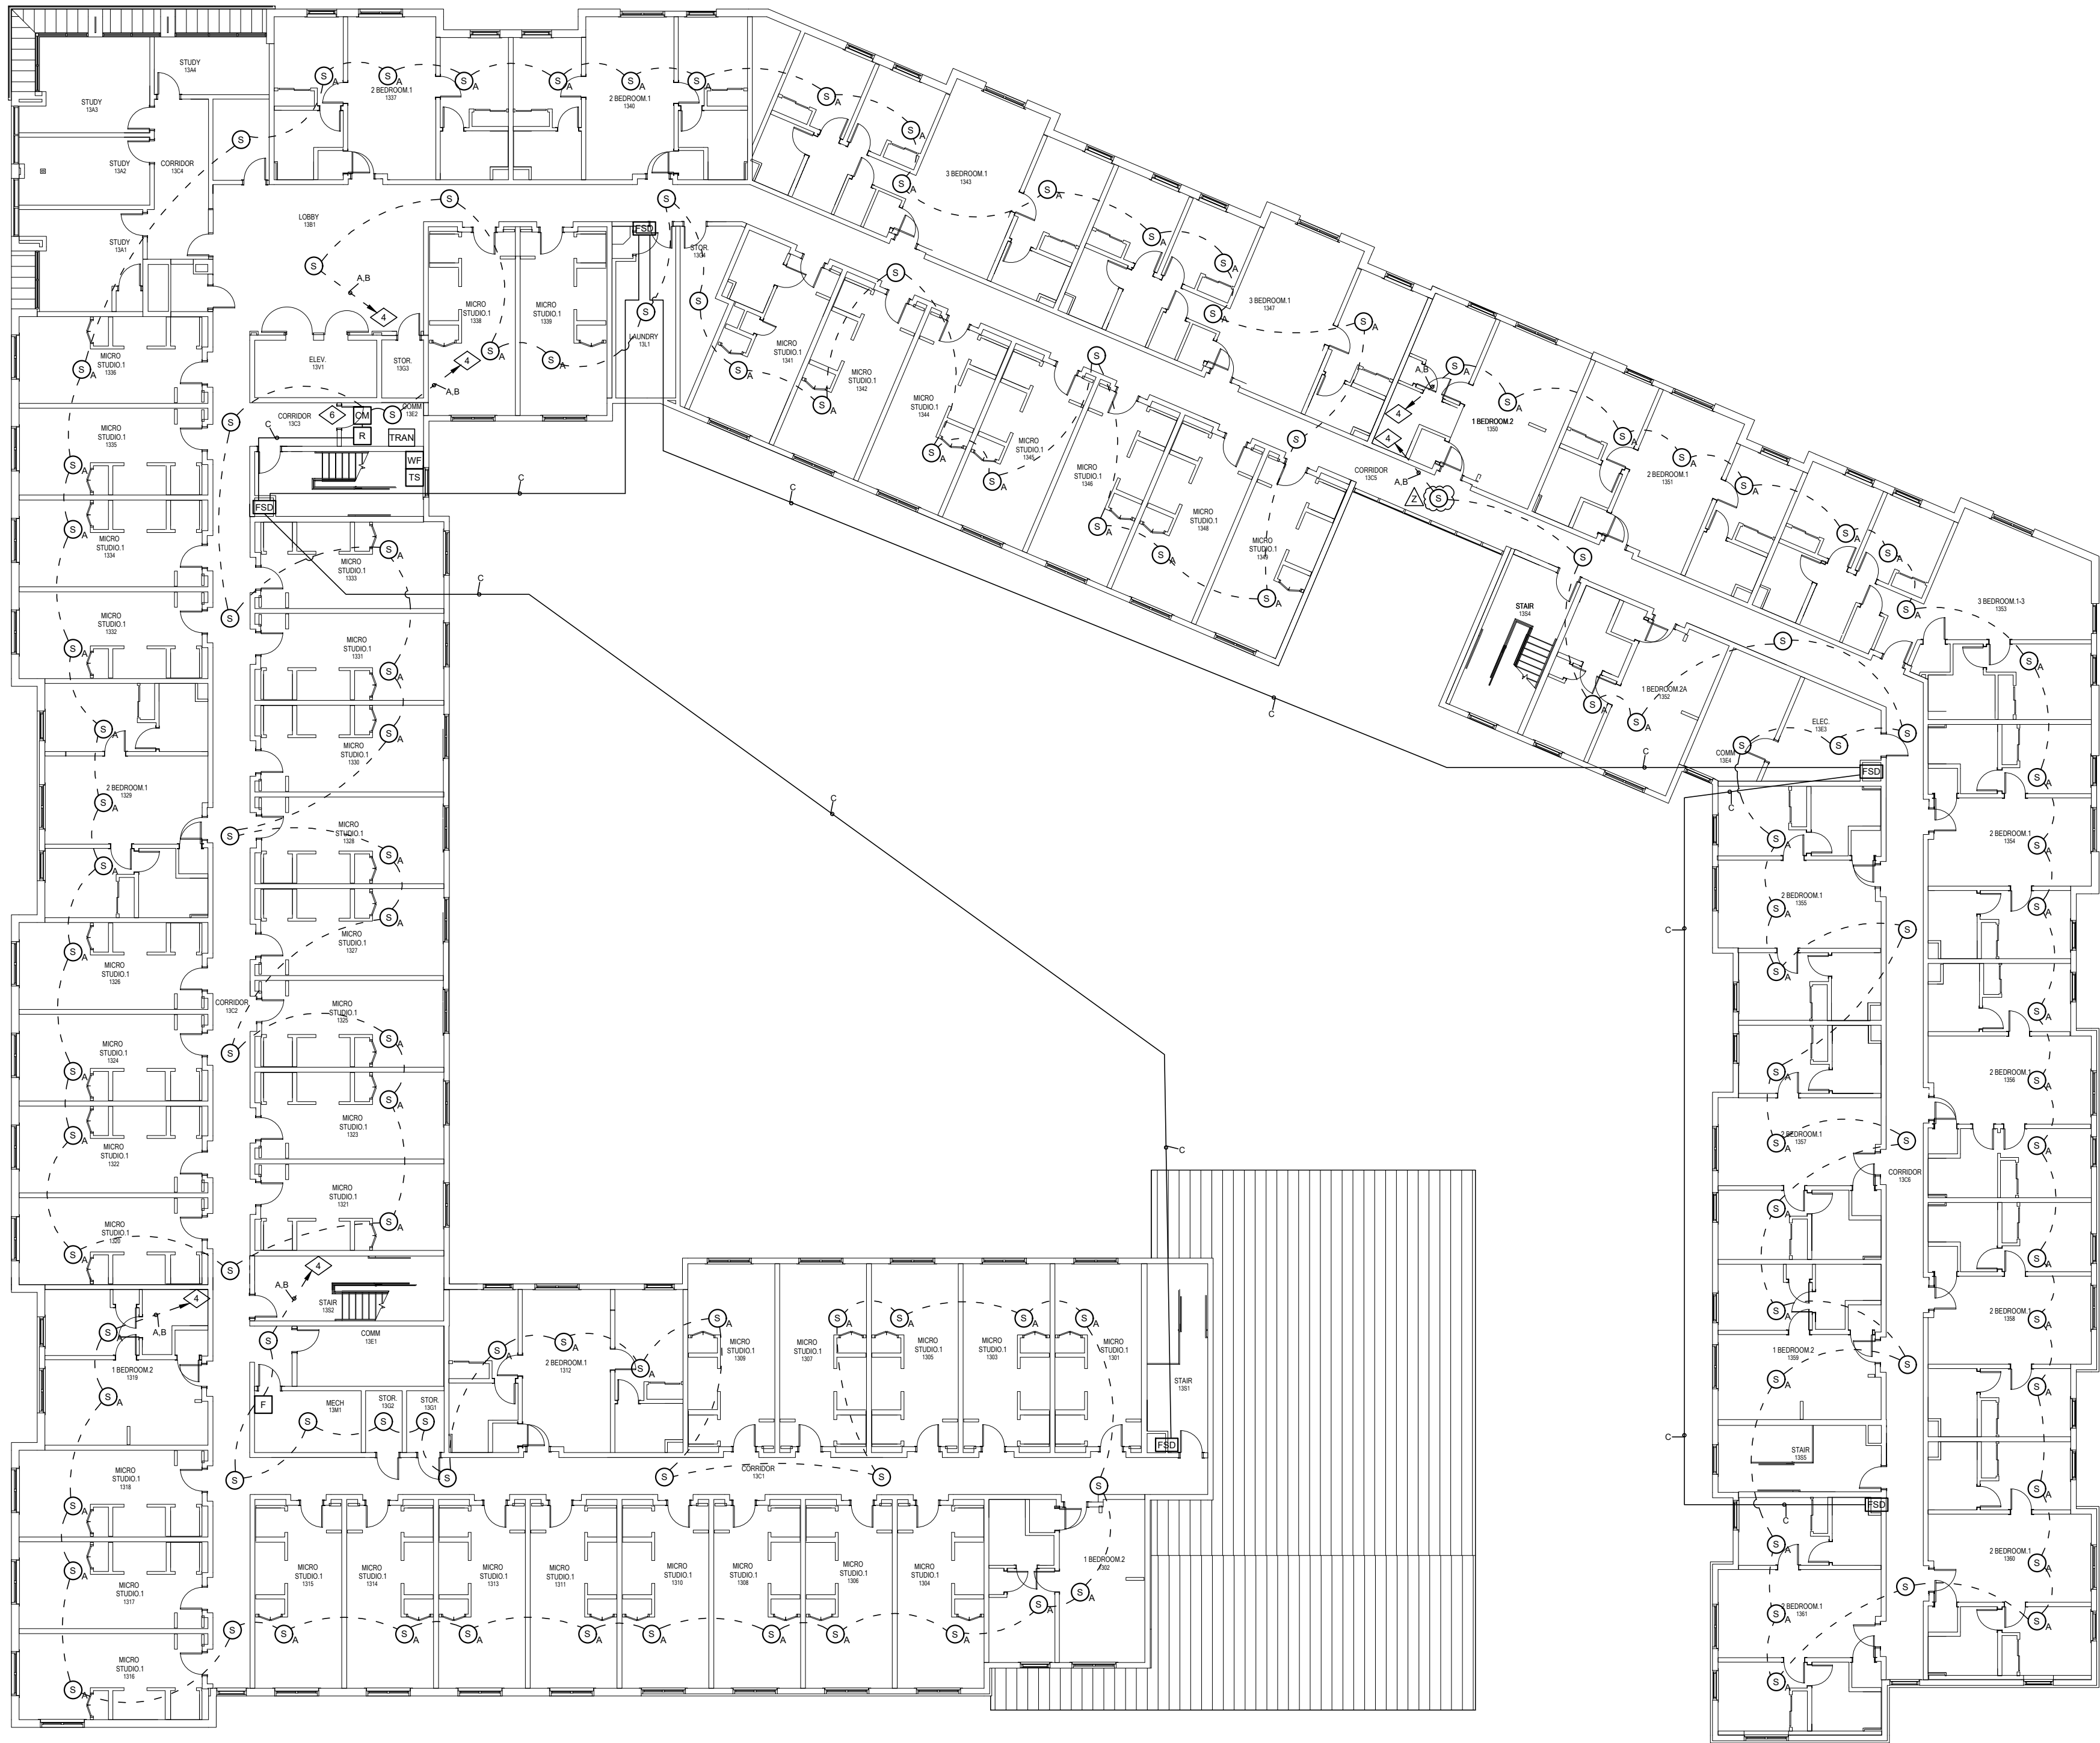


U of U WEST VILLAGE HOUSING - BLDG 'C'
THIRD FLOOR

KEY PLAN

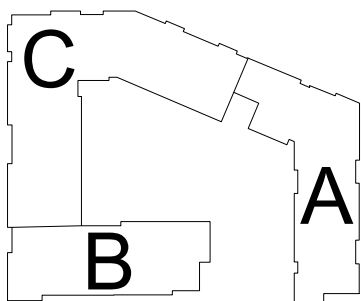

BLDG C

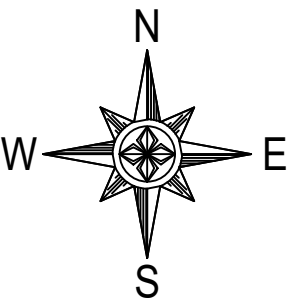

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: UOPJ WEST VILLAGE P2 BLDG C 3RD.DWG

NELSON FIRE SYSTEMS
THIRD LEVEL
ADDRESSABLE

PAGE:
FA-3-01



SYSTEM NOTES:

- ① TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
② TO TRANSPONDER LOCATED IN MECH 11M1
③ TO TRANSPONDER LOCATED IN COMM 12E3
④ TO TRANSPONDER LOCATED IN COMM 13E3
⑤ TO TRANSPONDER LOCATED IN COMM 14E1
⑥ CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
⑦ TO ELEVATOR CONTROLS

REVISION NOTES:

- △ ADDED PER FIRE MARSHAL REVIEW (8/1/2022)

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S

WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
	①	SMOKE DETECTOR
	②A	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
4	L	STROBE ONLY- WALL
6	L	STROBE ONLY- CEILING
1	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
15	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	FRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- WIRING IS REQUIRED.
- WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: UOPJ WEST VILLAGE P2 BLDG C 3RD.DWG

NELSON FIRE SYSTEMS
THIRD LEVEL
NOTIFICATION

PAGE:
FA-3-02



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.



U of U WEST VILLAGE HOUSING - BLDG 'C'
THIRD FLOOR

KEY PLAN

BLDG C

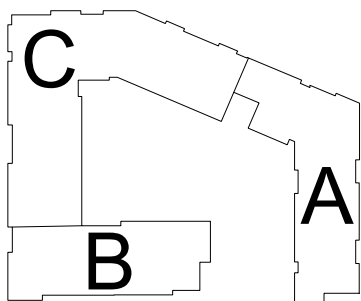

SYSTEM NOTES:

- 1 TO TRANSPONDER LOCATED IN MAIN ELEC 11E2
2 TO TRANSPONDER LOCATED IN MECH 11M1
3 TO TRANSPONDER LOCATED IN COMM 12E3
4 TO TRANSPONDER LOCATED IN COMM 14E1
5 TO TRANSPONDER LOCATED IN COMM 14E1
6 CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
7 TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW (8/1/2022)

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S

WIRING NOTE DESCRIPTION


A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
35	SD	SMOKE DETECTOR
99	SDA	SMOKE DETECTOR AUDIBLE
1	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	L	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	FRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
5	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

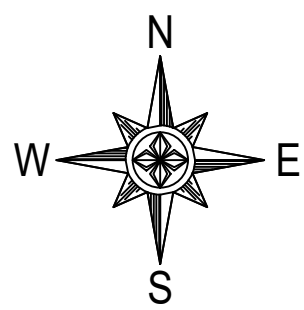

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/03/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: UOP U WEST VILLAGE P2 BLDG C 3RD.DWG


NELSON FIRE SYSTEMS
THIRD LEVEL
NUMBERS

PAGE:
FA-3-03

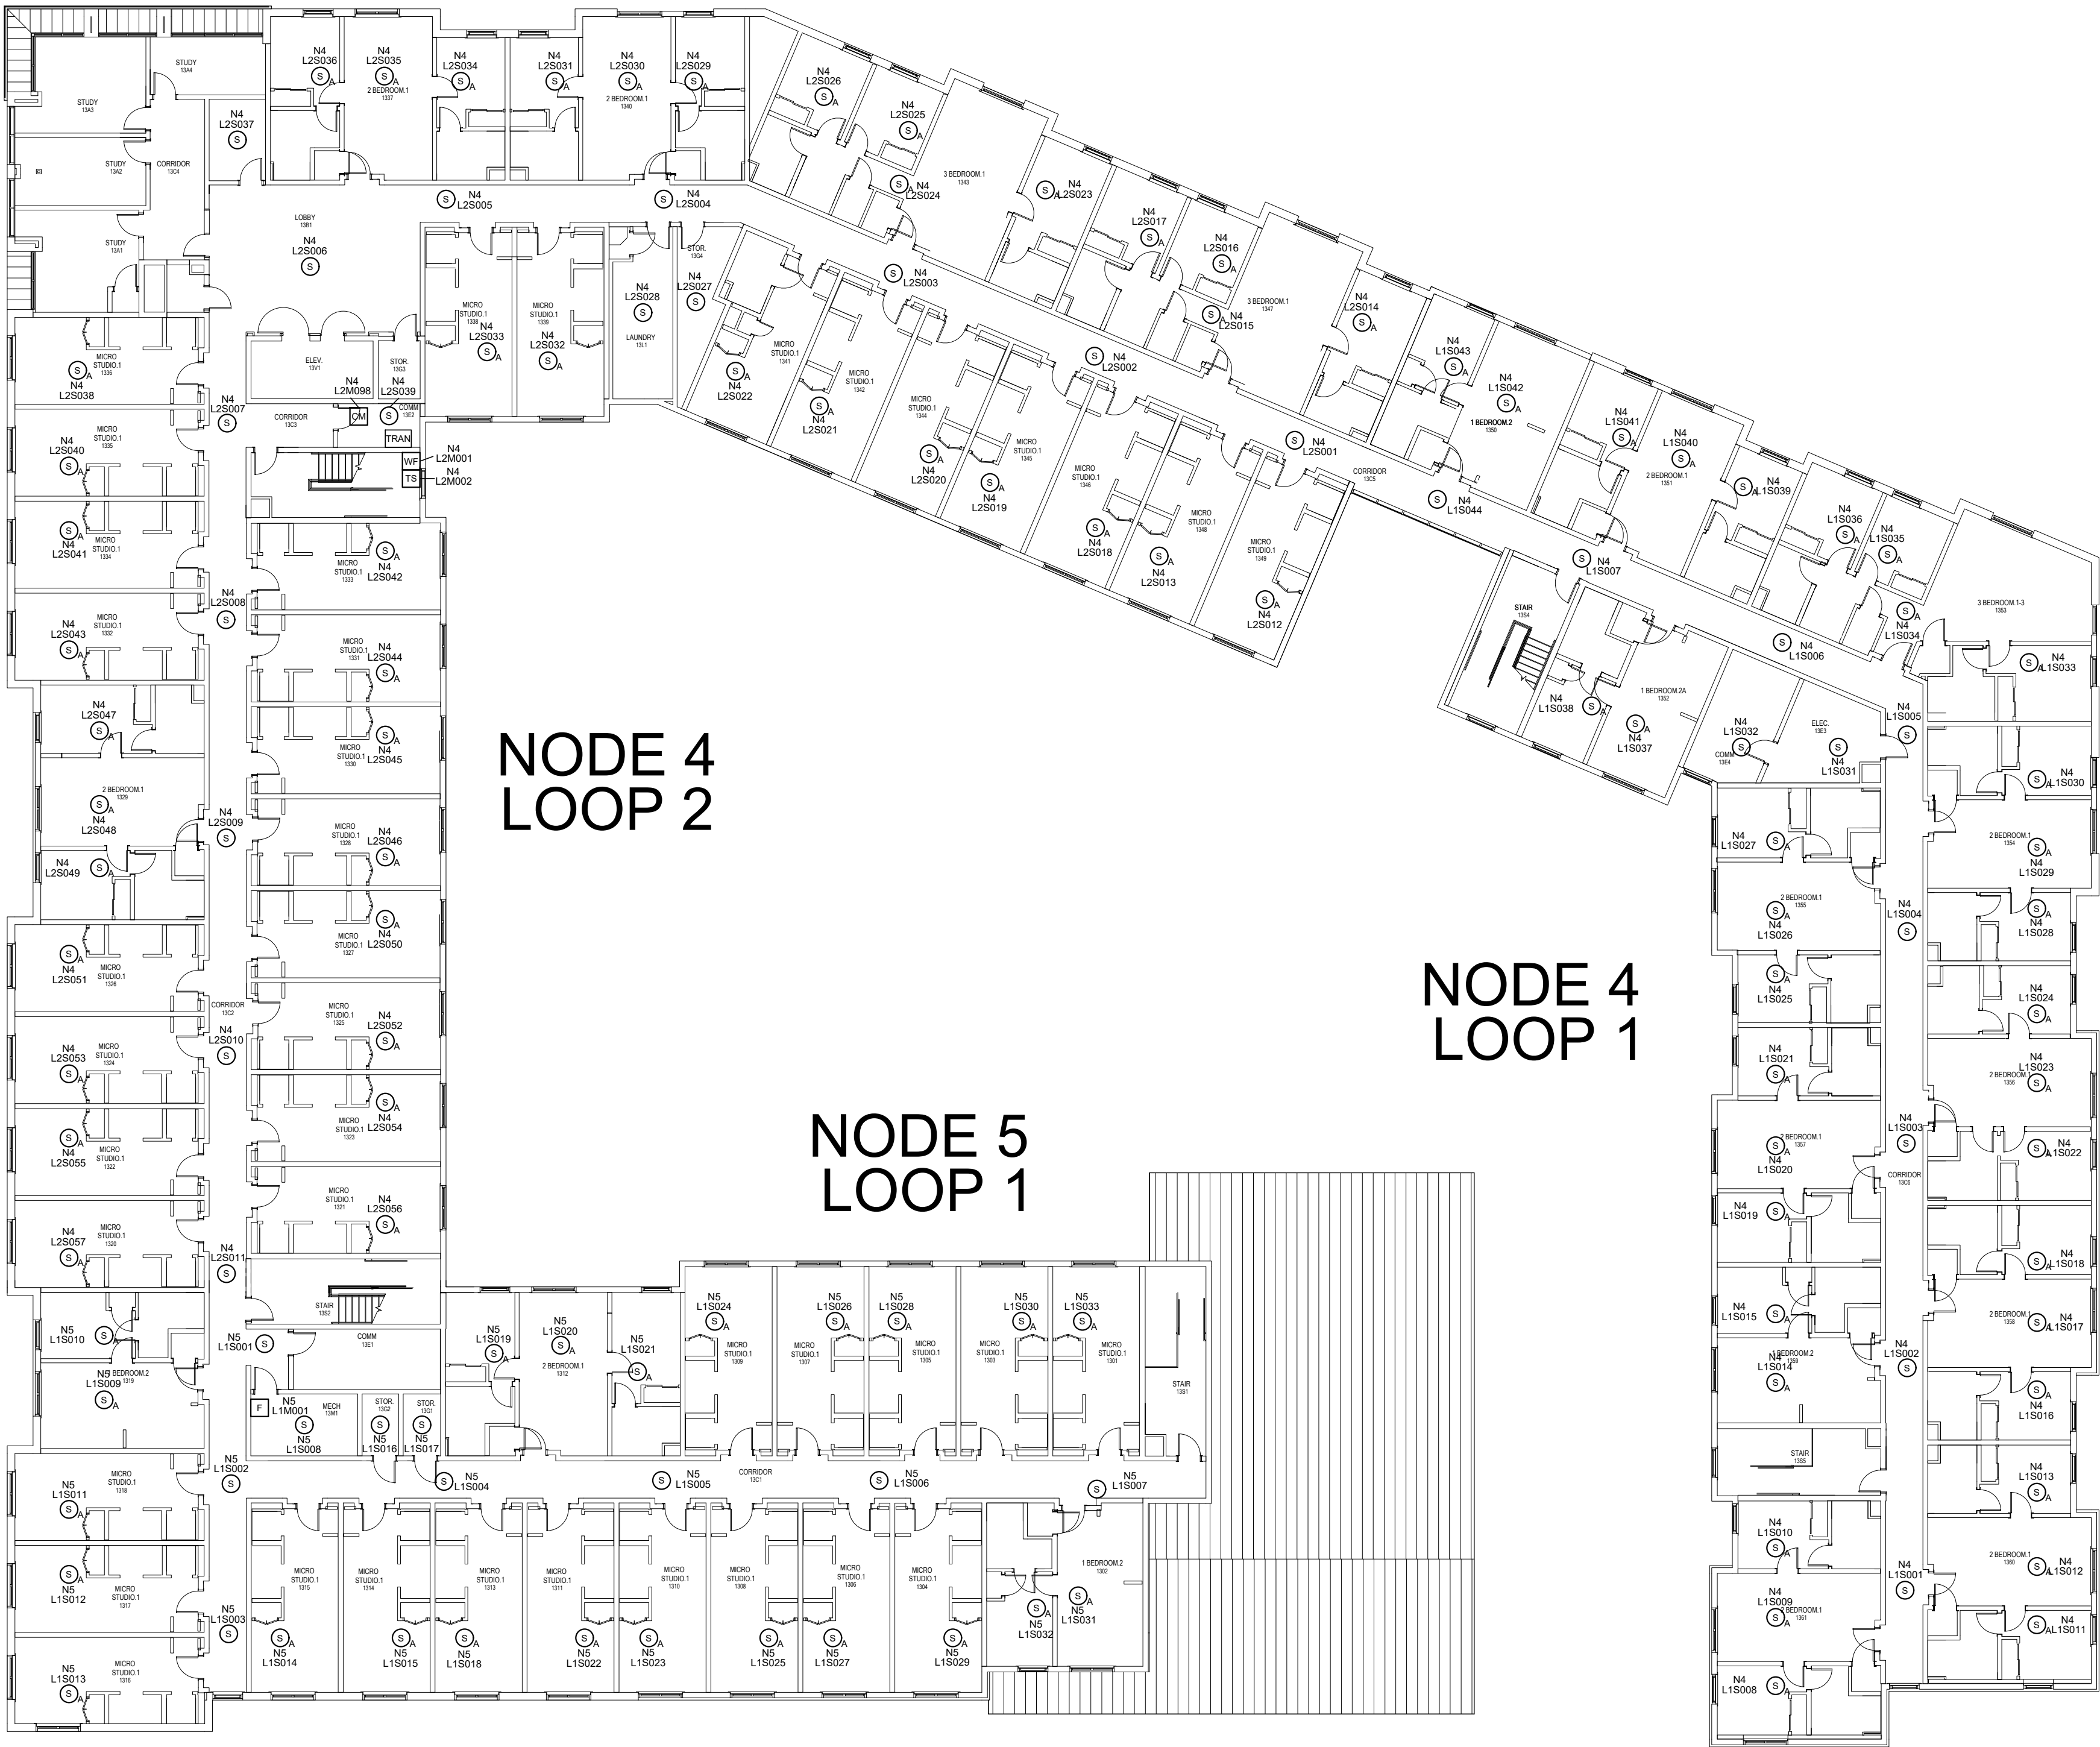


U of U WEST VILLAGE HOUSING - BLDG 'C'

ROOF

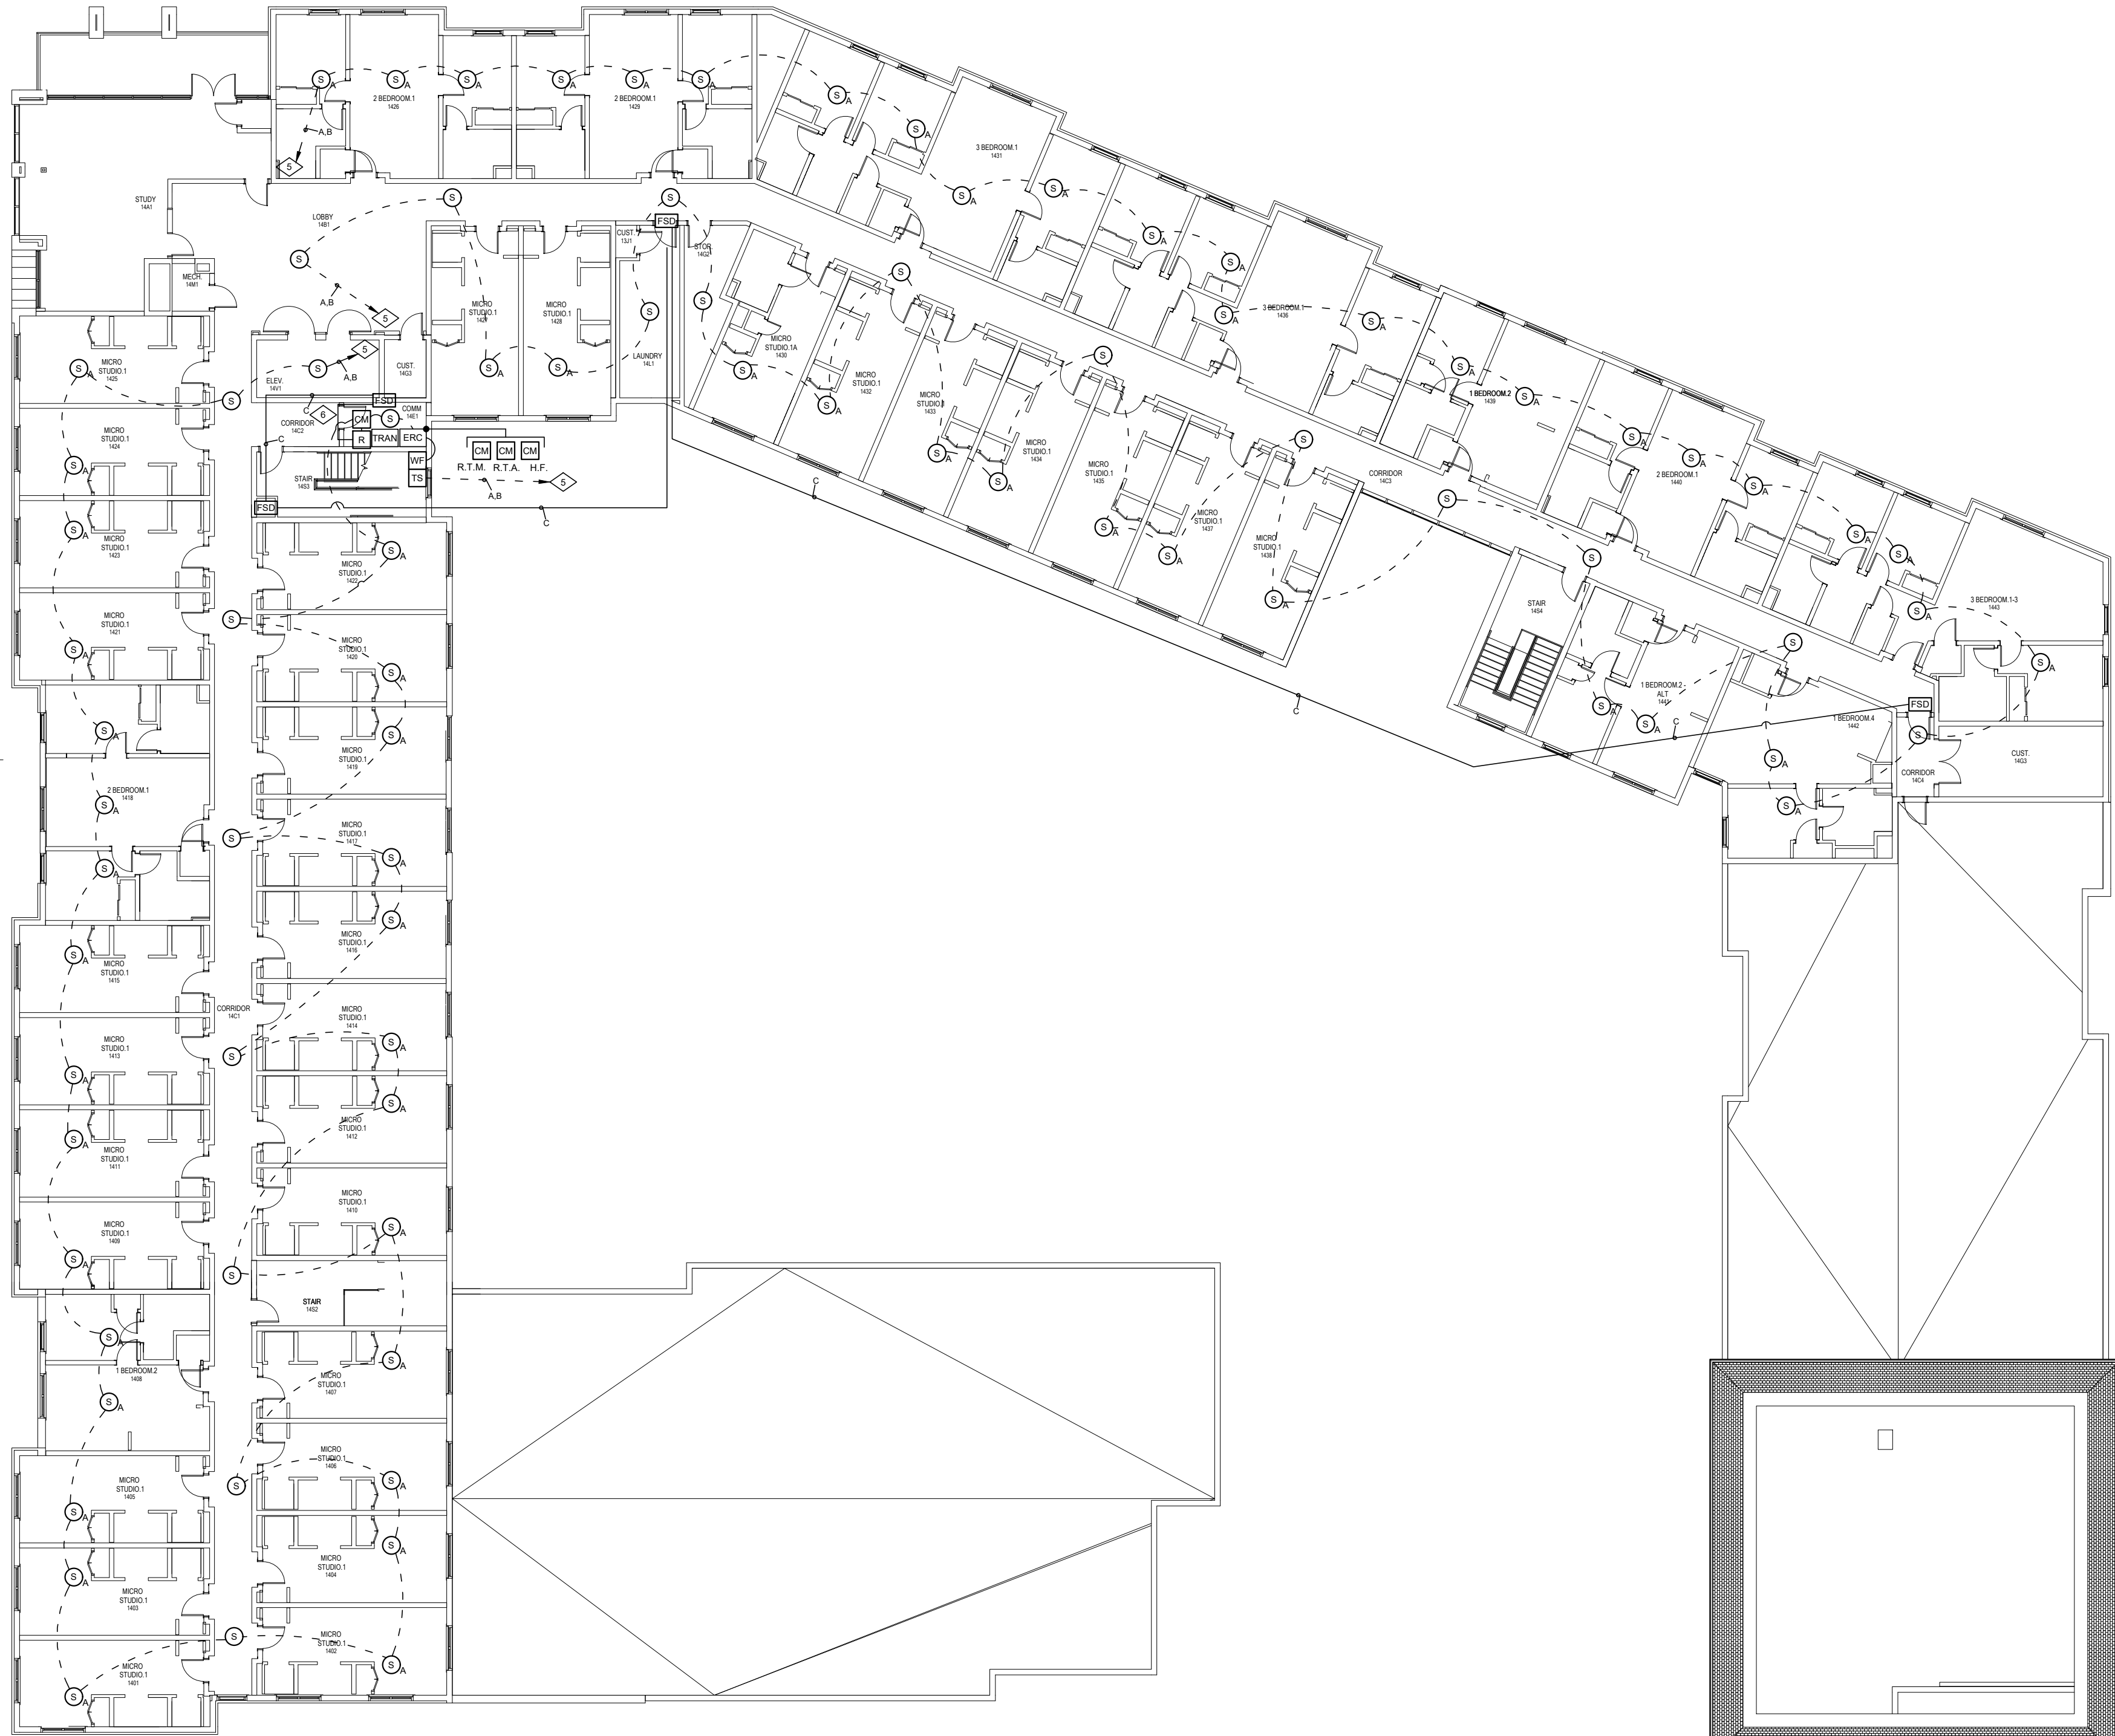

U of U WEST VILLAGE HOUSING - BLDG 'C'
FOURTH FLOOR

KEY PLAN

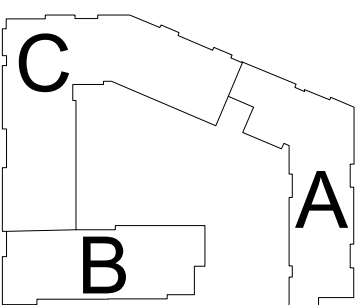

BLDG C

SYSTEM NOTES:

- TO TRANSponder LOCATED IN MAIN ELEC 81E2
- TO TRANSponder LOCATED IN MECH 11M1
- TO TRANSponder LOCATED IN COMM 12E3
- TO TRANSponder LOCATED IN COMM 13E3
- TO TRANSponder LOCATED IN COMM 14E1
- CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
- TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S

WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
21	S	SMOKE DETECTOR
64	S _A	SMOKE DETECTOR AUDIBLE
1	F	PULL STATION
1	TS	TAMPER SWITCH MONITOR
1	WF	WATERFLOW SWITCH MONITOR
1	CM	CONTROL MODULE
1	SM	CONTROL MODULE SUPERVISED
1	R	RELAY
1	B _{WF}	WATER FLOW BELL
1	L _{WF}	STROBE ONLY- WALL
1	L _C	STROBE ONLY- CEILING
1	L _{WF}	WEATHER PROOF STROBE ONLY
1	HS _C	HORN/STROBE- WALL
1	HS _C	HORN/STROBE- CEILING
1	RA	REMOTE ANNUNCIATOR
1	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL
4	ERC	ELEVATOR RECALL CABINET
4	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS 'A' WIRING IS REQUIRED.** WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. **DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.**
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.** A SMOKE DETECTOR **MUST BE IN EVERY ROOM** WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS **NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS** PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION:** BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS 'A' CIRCUITS** USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT **DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.**

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/3/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: U of U WEST VILLAGE P2 BLDG C 4TH.DWG

NELSON FIRE SYSTEMS
FOURTH LEVEL AND ROOF
INITIATION

PAGE:
FA-4-01




U of U WEST VILLAGE HOUSING - BLDG 'C'

ROOF

U of U WEST VILLAGE HOUSING - BLDG 'C'
FOURTH FLOOR

KEY PLAN

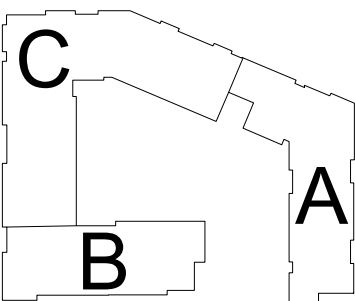

BLDG C

SYSTEM NOTES:

- TO TRANSPONDER LOCATED IN MAIN ELEC 81E2
- TO TRANSPONDER LOCATED IN MECH 11M1
- TO TRANSPONDER LOCATED IN COMM 12E3
- TO TRANSPONDER LOCATED IN COMM 12E3
- TO TRANSPONDER LOCATED IN COMM 14E1
- CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
- TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S

WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
	SD	SMOKE DETECTOR
	SDA	SMOKE DETECTOR AUDIBLE
	F	PULL STATION
	TS	TAMPER SWITCH MONITOR
	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B	WATER FLOW BELL
1	L	STROBE ONLY- WALL
1	L	STROBE ONLY- CEILING
1	L	WEATHER PROOF STROBE ONLY
12	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL
4	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/3/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:

NELSON FIRE SYSTEMS
FOURTH LEVEL AND ROOF
NOTIFICATION

PAGE:
FA-4-02



U of U WEST VILLAGE HOUSING - BLDG 'C'


ROOF

NODE 6
LOOP 1

NODE 5
LOOP 2

U of U WEST VILLAGE HOUSING - BLDG 'C'
FOURTH FLOOR

KEY PLAN

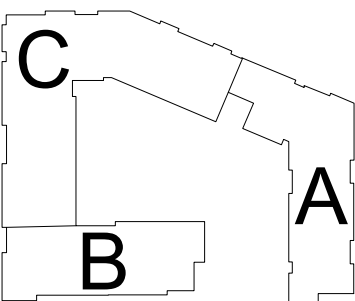

BLDG C

SYSTEM NOTES:

- TO TRANSPONDER LOCATED IN MAIN ELEC 81E2
- TO TRANSPONDER LOCATED IN MECH 11M1
- TO TRANSPONDER LOCATED IN COMM 12E3
- TO TRANSPONDER LOCATED IN COMM 13E3
- TO TRANSPONDER LOCATED IN COMM 14E1
- CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPER
- TO ELEVATOR CONTROLS

REVISION NOTES:

- ADDED PER FIRE MARSHAL REVIEW

WIRE SCHEDULE

NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	HORN/STROBE CIRCUIT	2 #14'S
E	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
F	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
G	WATER BELL CIRCUIT	4 #14'S

WIRING NOTE DESCRIPTION
A = 2 TOTAL CONDUCTORS
(2)A = 4 TOTAL CONDUCTORS
A,(2)B = 6 TOTAL CONDUCTORS

DEVICE LEGEND

COUNTS	SYMBOL	DESCRIPTION
21	Ⓢ	SMOKE DETECTOR
64	Ⓢ _A	SMOKE DETECTOR AUDIBLE
1	F	PULL STATION
1	TS	TAMPER SWITCH MONITOR
1	WF	WATERFLOW SWITCH MONITOR
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
	R	RELAY
	B _{WF}	WATER FLOW BELL
	L _C	STROBE ONLY- WALL
	L _C	STROBE ONLY- CEILING
	L _{WF}	WEATHER PROOF STROBE ONLY
	HS	HORN/STROBE- WALL
	HS _C	HORN/STROBE- CEILING
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
1	TRAN	TRANSPONDER PANEL
4	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE SMOKE DAMPER (PROVIDED BY OTHERS)

GENERAL NOTES:

- INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AHJ.
- CLASS "A" WIRING IS REQUIRED.
- WIRING LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITION ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER CABLES ARE IN THE RACEWAY.
- POWER-LIMITED (PL) AND NONPOWER-LIMITED (NPL) CKT WIRING MUST REMAIN SEPARATED IN CABINET. ALL PL CKT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NPL CKT. FURTHERMORE, ALL PL AND NPL CKT WIRING MUST ENTER AND EXIT THE CABINET THROUGH A DIFFERENT KNOCKOUT AND/OR SEPARATE CONDUIT.
- ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. DO NOT USE 110V OR HIGHER IN FIRE ALARM CONDUIT.
- SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
- LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
- DO NOT USE SHIELDED WIRE ON ADDRESSABLE CKTS.
- A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT OR POWER SUPPLY.
- FIRE ALARM CKTS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
- DEDICATED 120 VAC CKTS SHALL BE MARKED AS "FIRE ALARM CKT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CKTS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.
- WHERE LOCATED WITHIN SEVEN (7) FEET OF THE FLOOR, FIRE ALARM CABLES SHALL BE SECURELY FASTENED IN AN APPROVED MANNER AND PROTECTED FROM PHYSICAL DAMAGE.
- DAMP OR WET LOCATION PROTECTION: BOXES, CONDUIT BODIES, OUTLET BOXES AND FITTING SHALL BE PLACED OR EQUIPPED TO PREVENT MOISTURE FROM ENTERING OR ACCUMULATING IN THEM AND SHALL BE LISTED FOR THAT USE. APPROVED DRAINAGE OPENINGS BETWEEN 1/4" AND 1/2" SHALL BE PERMITTED.
- CLASS "A" CIRCUITS USING PHYSICAL CONDUCTORS SHALL BE INSTALLED SO THAT THE OUTGOING AND RETURN ARE ROUTED SEPARATELY. MINIMUM SEPARATION TO PREVENT PHYSICAL DAMAGE IS 12" VERTICALLY AND 48" HORIZONTALLY. THE OUTGOING AND RETURN CIRCUIT CONDUCTORS SHALL BE PERMITTED IN THE SAME CABLE ASSEMBLY, ENCLOSURE, OR RACEWAY ONLY UNDER THE FOLLOWING CONDITIONS:
 - DISTANCE NOT TO EXCEED 10' WHERE THE OUTGOING AND RETURN CONDUCTORS ENTER OR EXIT THE DEVICE.
 - SINGLE DROPS INSTALLED IN A RACEWAY TO INDIVIDUAL DEVICES OR APPLIANCES.
 - IN A SINGLE ROOM NOT EXCEEDING 1000 SQ. FT., A DROP INSTALLED IN THE RACEWAY TO MULTIPLE DEVICES OR APPLIANCES THAT DOES NOT INCLUDE ANY EMERGENCY CONTROL FUNCTION DEVICES.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
PHASE 2 BUILDING C
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: TCT
DESIGNED BY: XXXX
APPROVED BY: KKK
DATE: 6/3/2024
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: U of U WEST VILLAGE P2 BLDG C 4TH.DWG

NELSON FIRE SYSTEMS
FOURTH LEVEL AND ROOF
NUMBERS

PAGE:
FA-4-03

