


SYSTEM NOTES:

- ① TO TRANSPONDER LOCATED IN ELEC 21E1
② TO TRANSPONDER LOCATED IN ELEC 21E2
③ TO TRANSPONDER LOCATED IN COMM 22E1
④ TO TRANSPONDER LOCATED IN COMM 22E2
⑤ TO TRANSPONDER LOCATED IN ELEC 23E1
⑥ TO TRANSPONDER LOCATED IN ELEC 23E2
⑦ TO TRANSPONDER LOCATED IN COMM 24E1
⑧ TO TRANSPONDER LOCATED IN ELEC 24E2
⑨ TO TRANSPONDER LOCATED IN ELEC 25E1
⑩ TO TRANSPONDER LOCATED IN ELEC 25E2
⑪ REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
⑫ TO 1ST FLOOR ELEVATOR DOOR HOLDERS
⑬ CONTROL MODULE FOR FIRE SMOKE DAMPERS

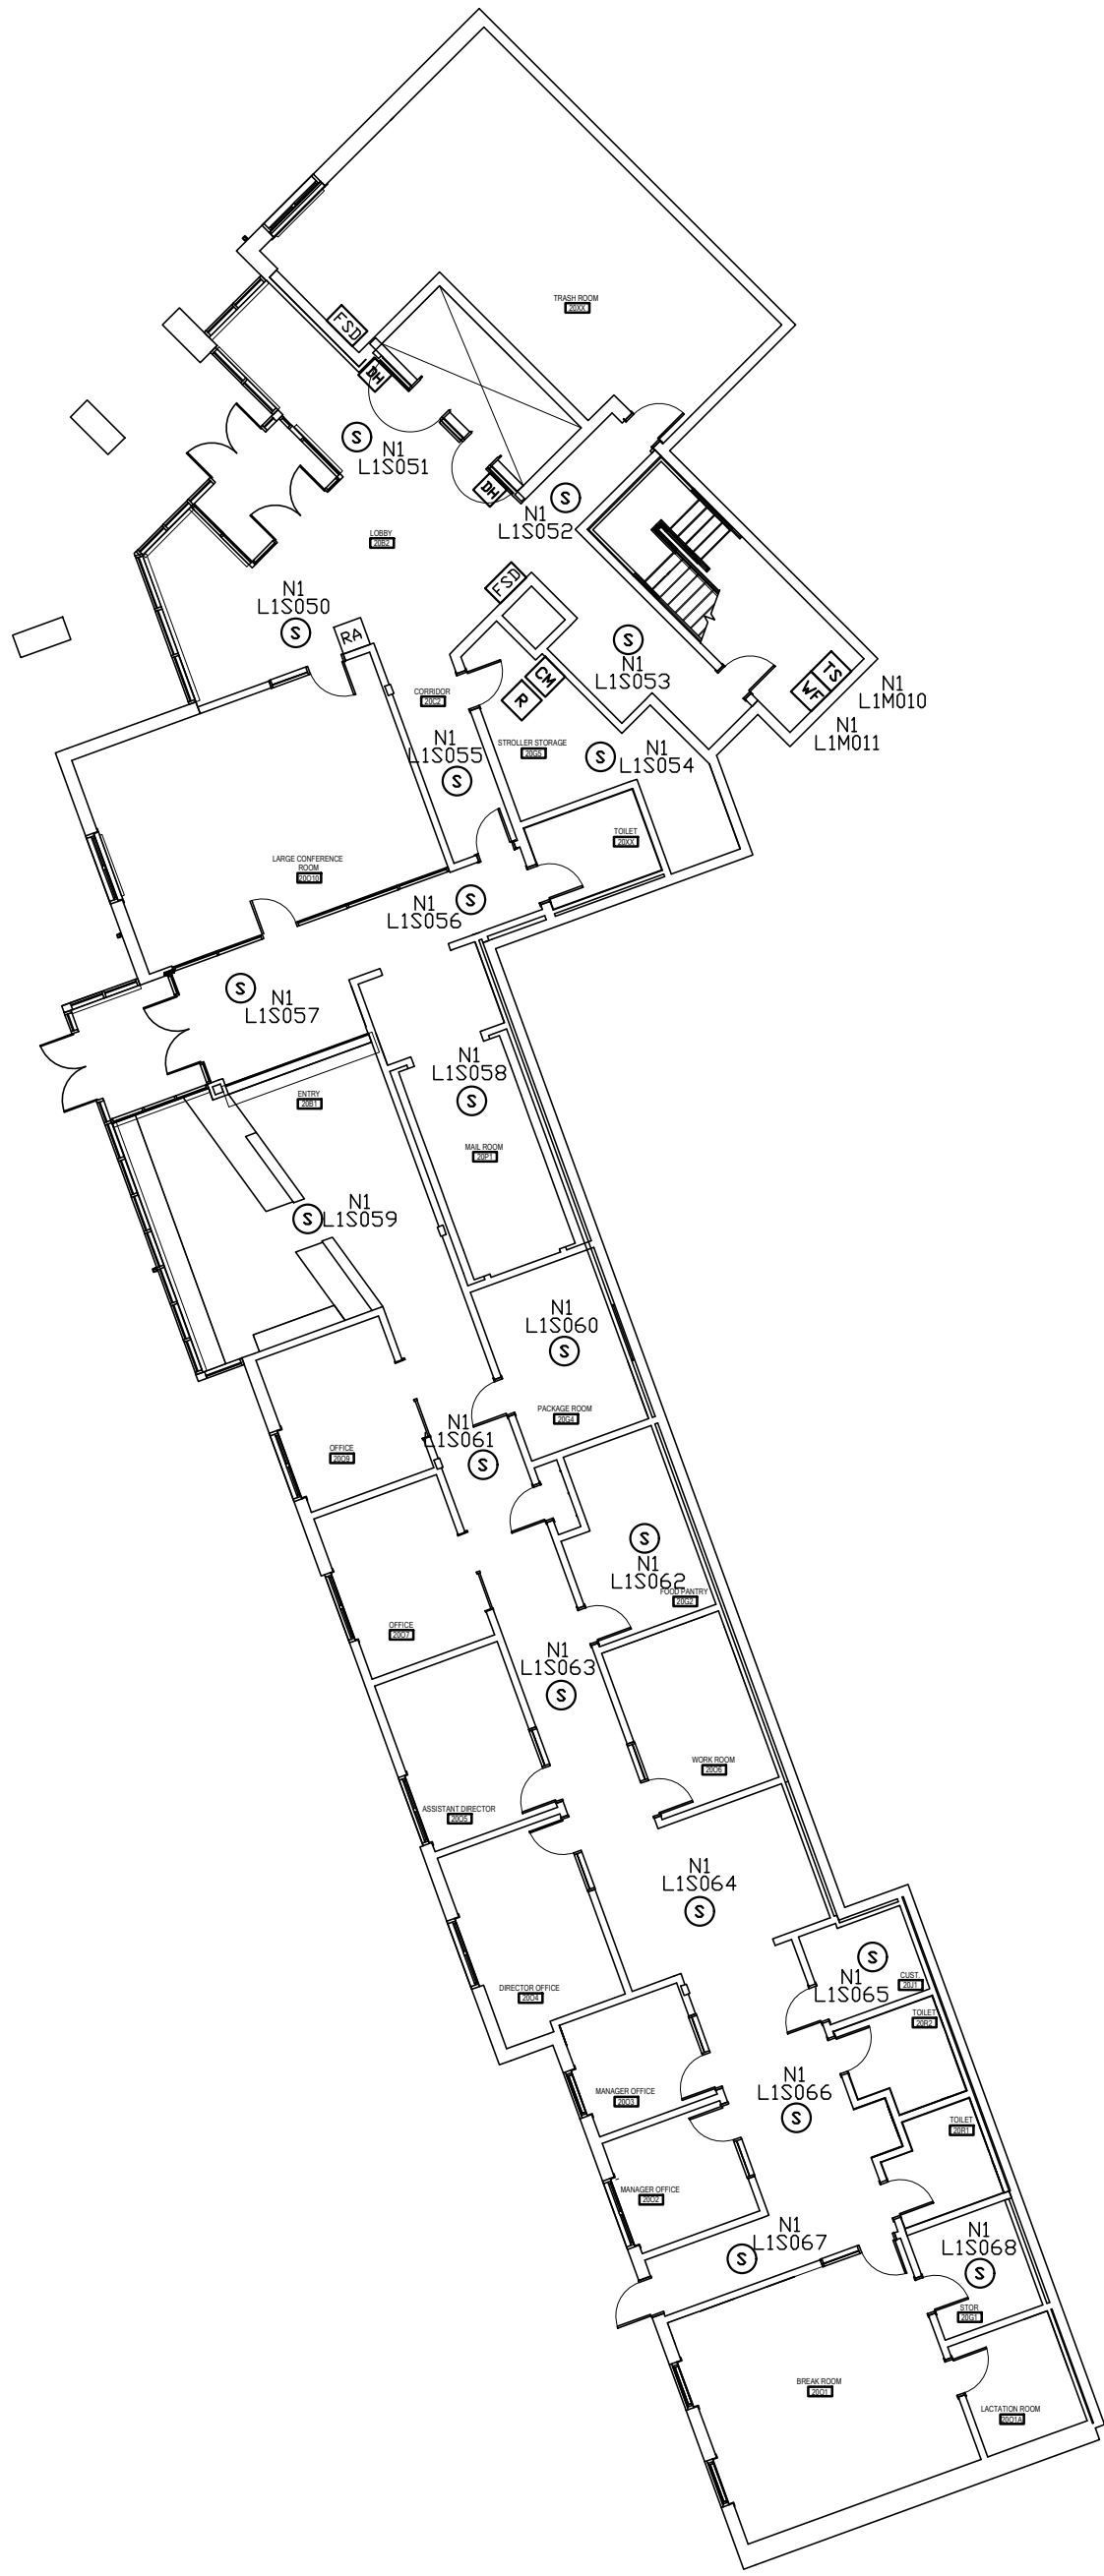

U of U WEST VILLAGE HOUSING - BLDG 'E'
BASEMENT

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
19	⑤	SMOKE DETECTOR
	⑤ _R	SMOKE DETECTOR ROOM
	F	PULL STATION
1	TS	TAMPER SWITCH MONITOR
1	WF	WATERFLOW SWITCH MONITOR
	SN	SPRINKLER NOTIFICATION
	CM	CONTROL MODULE
1	CM	CONTROL MODULE SUPERVISED
1	R	RELAY
2	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	L _C	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HS _C	HORN/STROBE- CEILING
	L _{VP}	WEATHERPROOF STROBE
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE/SMOKE DAMPER
ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	⑤	REMOVED SMOKE DETECTOR
	⑤	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
BASEMENT
FIRE ALARM SYSTEM



NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	LT
DESIGNED BY:	XXXX
APPROVED BY:	TCT/KKK
DATE:	11/19/2024 9:54:18 AM
SCALE:	(ARCH D) 1/16" = 1'
PROJECT NO:	XXXX
REVISION NO:	XXXX
DRAWING NAME:	BLDG E BASEMENT.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-B-03

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.



- SYSTEM NOTES:
- TO TRANSPONDER LOCATED IN ELEC 21E1
 - TO TRANSPONDER LOCATED IN ELEC 21E2
 - TO TRANSPONDER LOCATED IN COMM 22E1
 - TO TRANSPONDER LOCATED IN COMM 22E2
 - TO TRANSPONDER LOCATED IN ELEC 23E1
 - TO TRANSPONDER LOCATED IN ELEC 23E2
 - TO TRANSPONDER LOCATED IN COMM 24E1
 - TO TRANSPONDER LOCATED IN ELEC 24E2
 - TO TRANSPONDER LOCATED IN ELEC 25E1
 - TO TRANSPONDER LOCATED IN ELEC 25E2
 - REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
 - TO 2ND FLOOR ELEVATOR DOOR HOLDERS
 - TO BASEMENT ELEVATOR DOOR HOLDERS
 - CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPERS. 120VAC NEEDED

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S
H	WATERFLOW BELL	4 #14'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
79	SD	SMOKE DETECTOR
114	SDR	SMOKE DETECTOR ROOM
3	F	PULL STATION
4	TS	TAMPER SWITCH MONITOR
3	WFM	WATERFLOW SWITCH MONITOR
1	SN	SPRINKLER NOTIFICATION
	CM	CONTROL MODULE
3	CM	CONTROL MODULE SUPERVISED
3	R	RELAY
4	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	Lc	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HSc	HORN/STROBE- CEILING
	LVP	WEATHERPROOF STROBE
1	RA	REMOTE ANNUNCIATOR
2	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
15	FSD	FIRE/SMOKE DAMPER
1	BVP	WATERFLOW BELL
ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	SD	REMOVED SMOKE DETECTOR
	SD	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
FIRST FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: KT
DESIGNED BY: XXXX
APPROVED BY: TCT/KKK
DATE: 2/20/2025 11:09:01 AM
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: BLDG E 1ST FLOOR.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-1-03

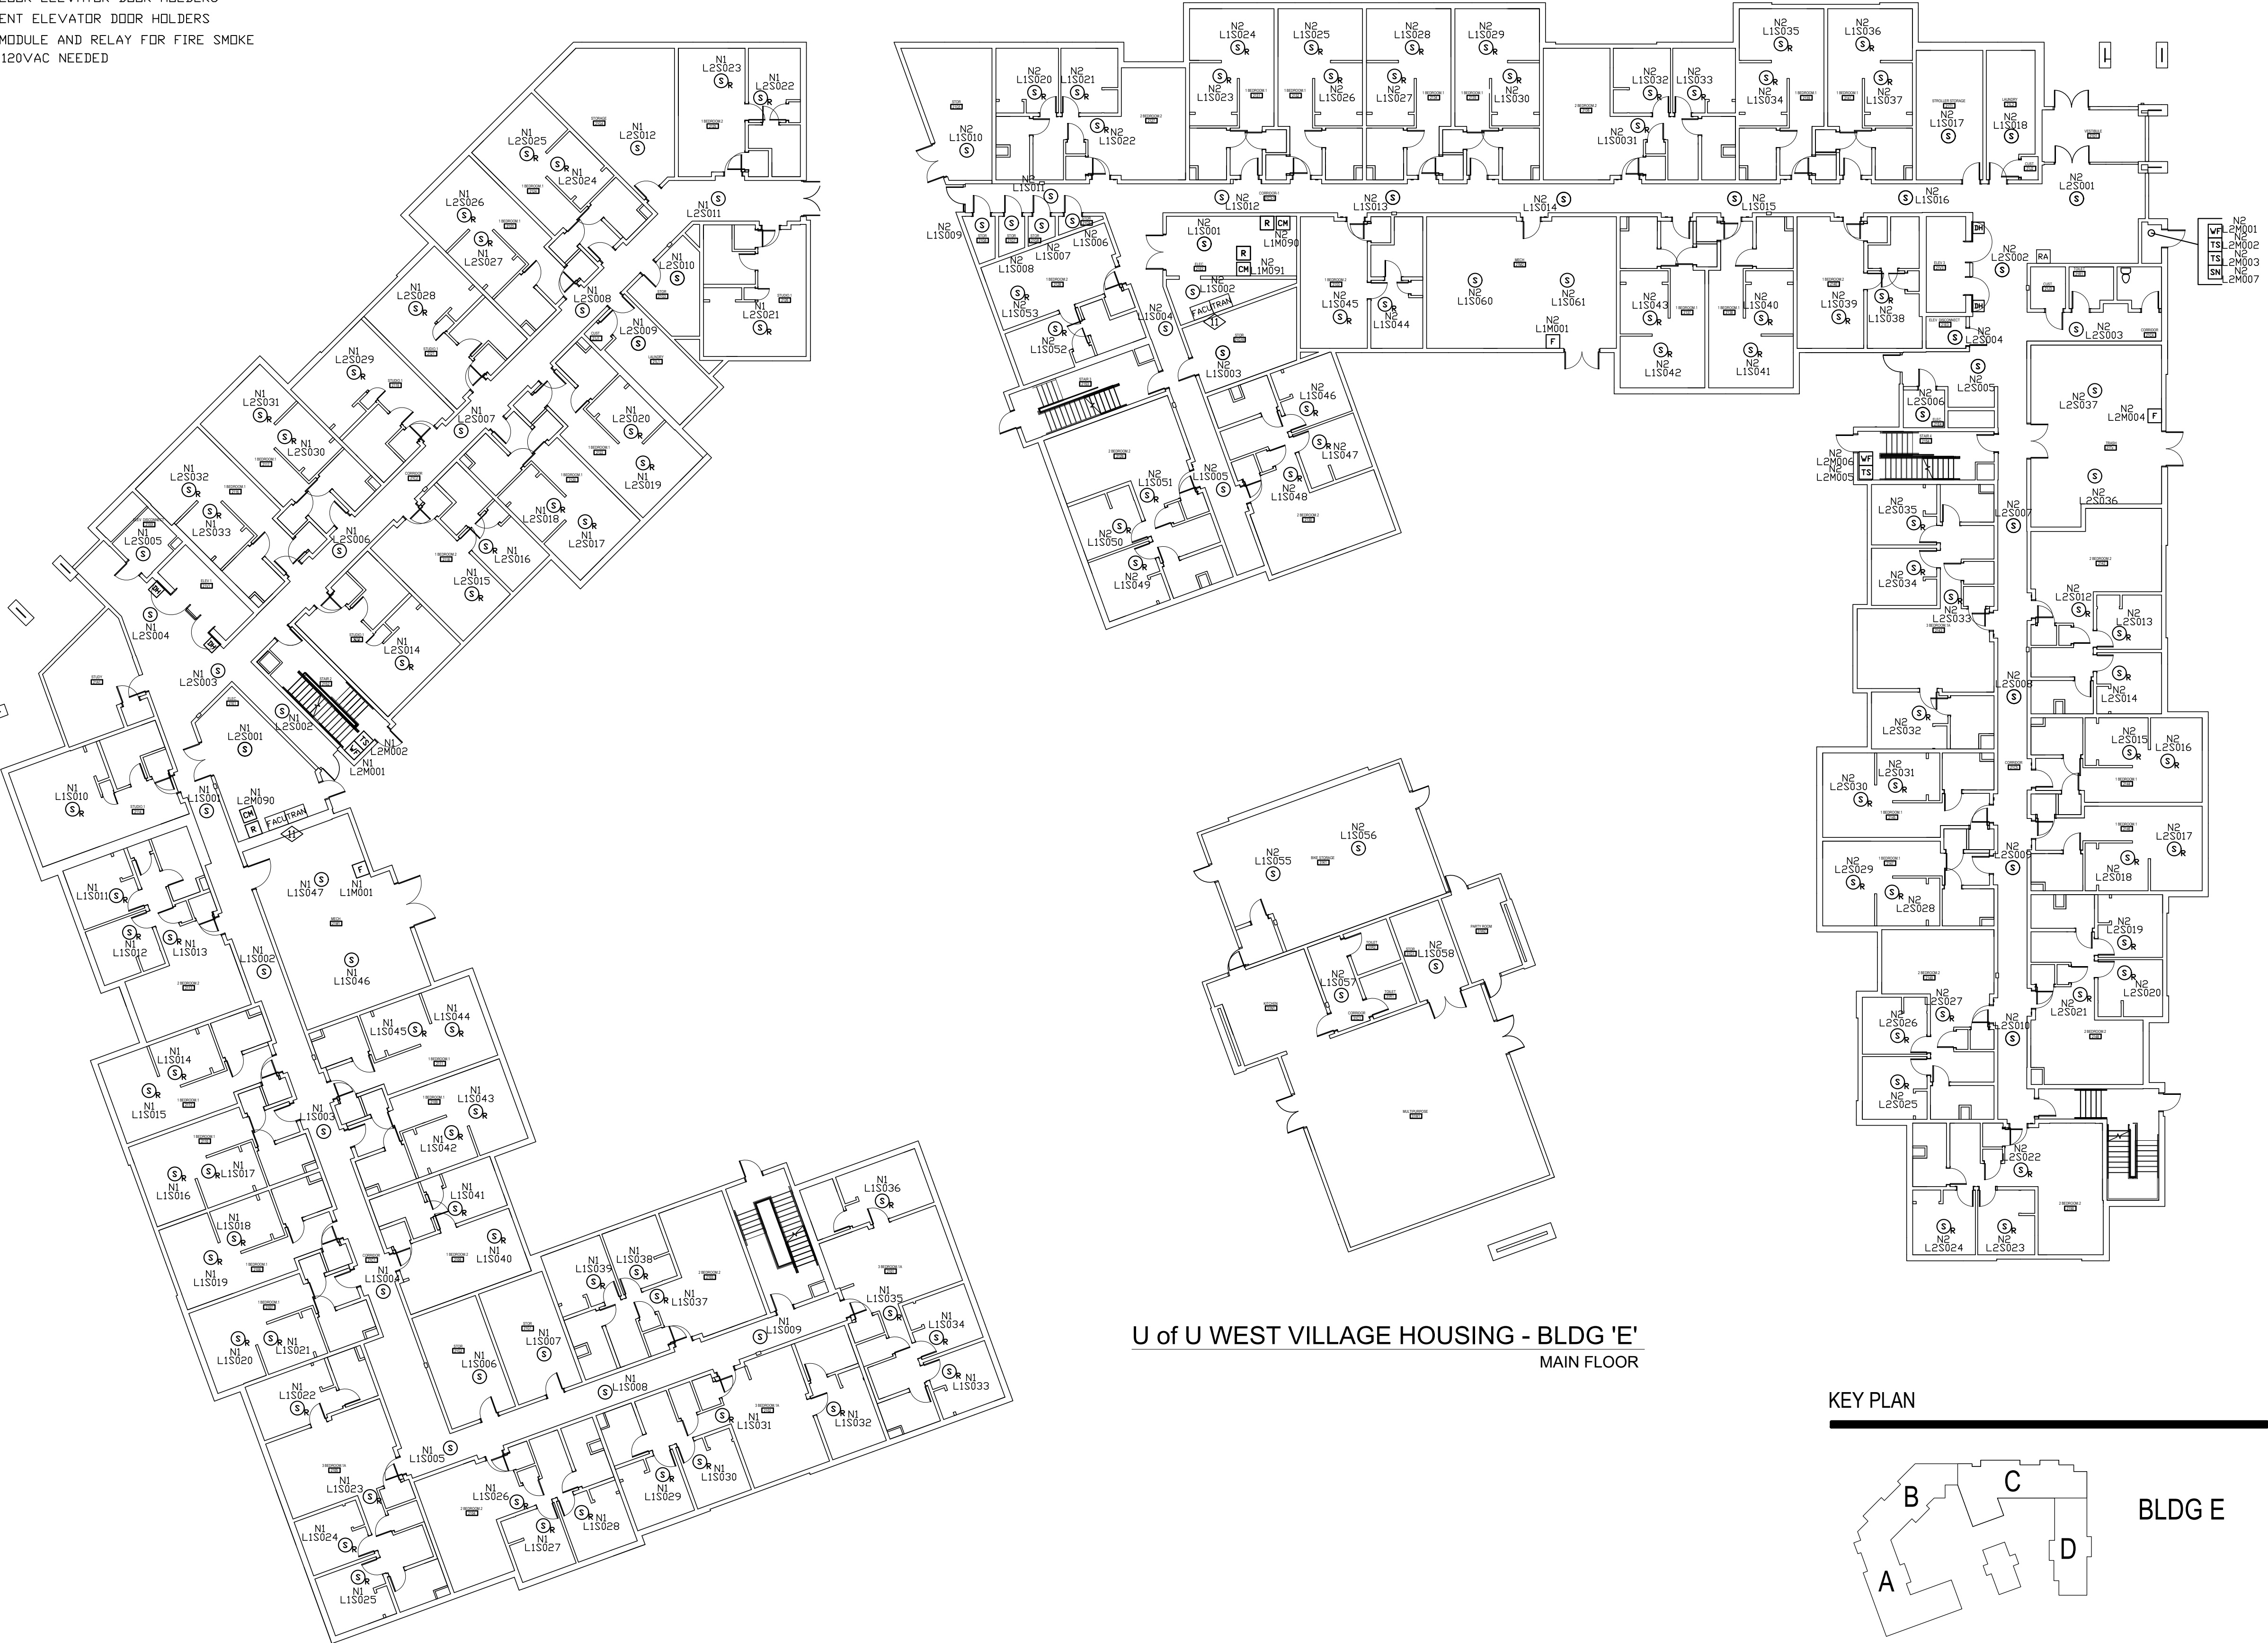

U of U WEST VILLAGE HOUSING - BLDG 'E'
MAIN FLOOR

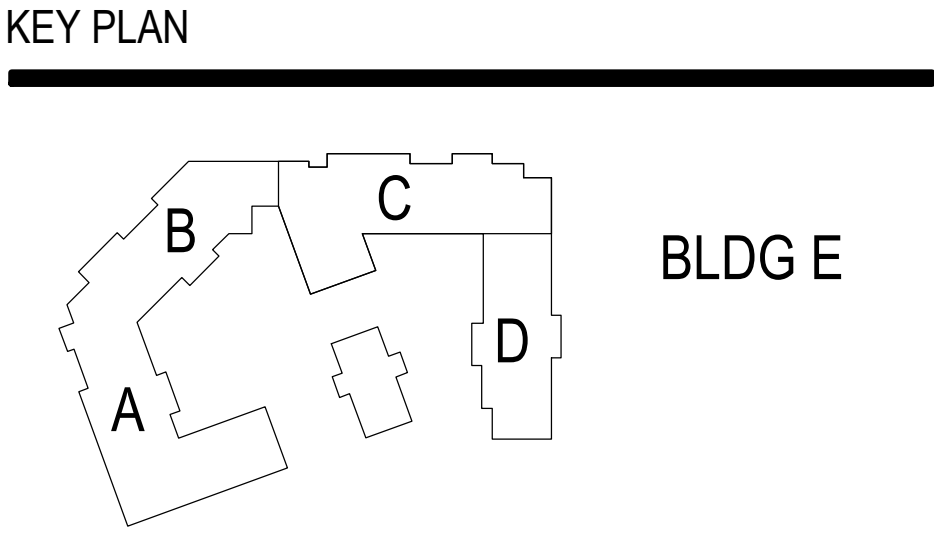

- SYSTEM NOTES:
- TO TRANSPONDER LOCATED IN ELEC 21E1
 - TO TRANSPONDER LOCATED IN ELEC 21E2
 - TO TRANSPONDER LOCATED IN COMM 22E1
 - TO TRANSPONDER LOCATED IN COMM 22E2
 - TO TRANSPONDER LOCATED IN ELEC 23E1
 - TO TRANSPONDER LOCATED IN ELEC 23E2
 - TO TRANSPONDER LOCATED IN COMM 24E1
 - TO TRANSPONDER LOCATED IN ELEC 24E2
 - TO TRANSPONDER LOCATED IN ELEC 25E1
 - TO TRANSPONDER LOCATED IN ELEC 25E2
 - REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
 - TO 3ED FLOOR ELEVATOR DOOR HOLDERS
 - TO 1ST FLOOR ELEVATOR DOOR HOLDERS
 - CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPERS. 120VAC NEEDED

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
49	S	SMOKE DETECTOR
128	S _R	SMOKE DETECTOR ROOM
	F	PULL STATION
6	TS	TAMPER SWITCH MONITOR
2	WF	WATERFLOW SWITCH MONITOR
	SN	SPRINKLER NOTIFICATION
	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
	R	RELAY
4	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	L _C	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HS _C	HORN/STROBE- CEILING
	L _{WP}	WEATHERPROOF STROBE
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
	ENC	ELEVATOR RECALL CABINET
	FSD	FIRE/SMOKE DAMPER
ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	S	REMOVED SMOKE DETECTOR
	S	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
SECOND FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: KT
DESIGNED BY: XXXX
APPROVED BY: TCT/KKK
DATE: 2/13/2025 4:57:19 PM
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: BLDG E 2ND FLOOR.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-2-03

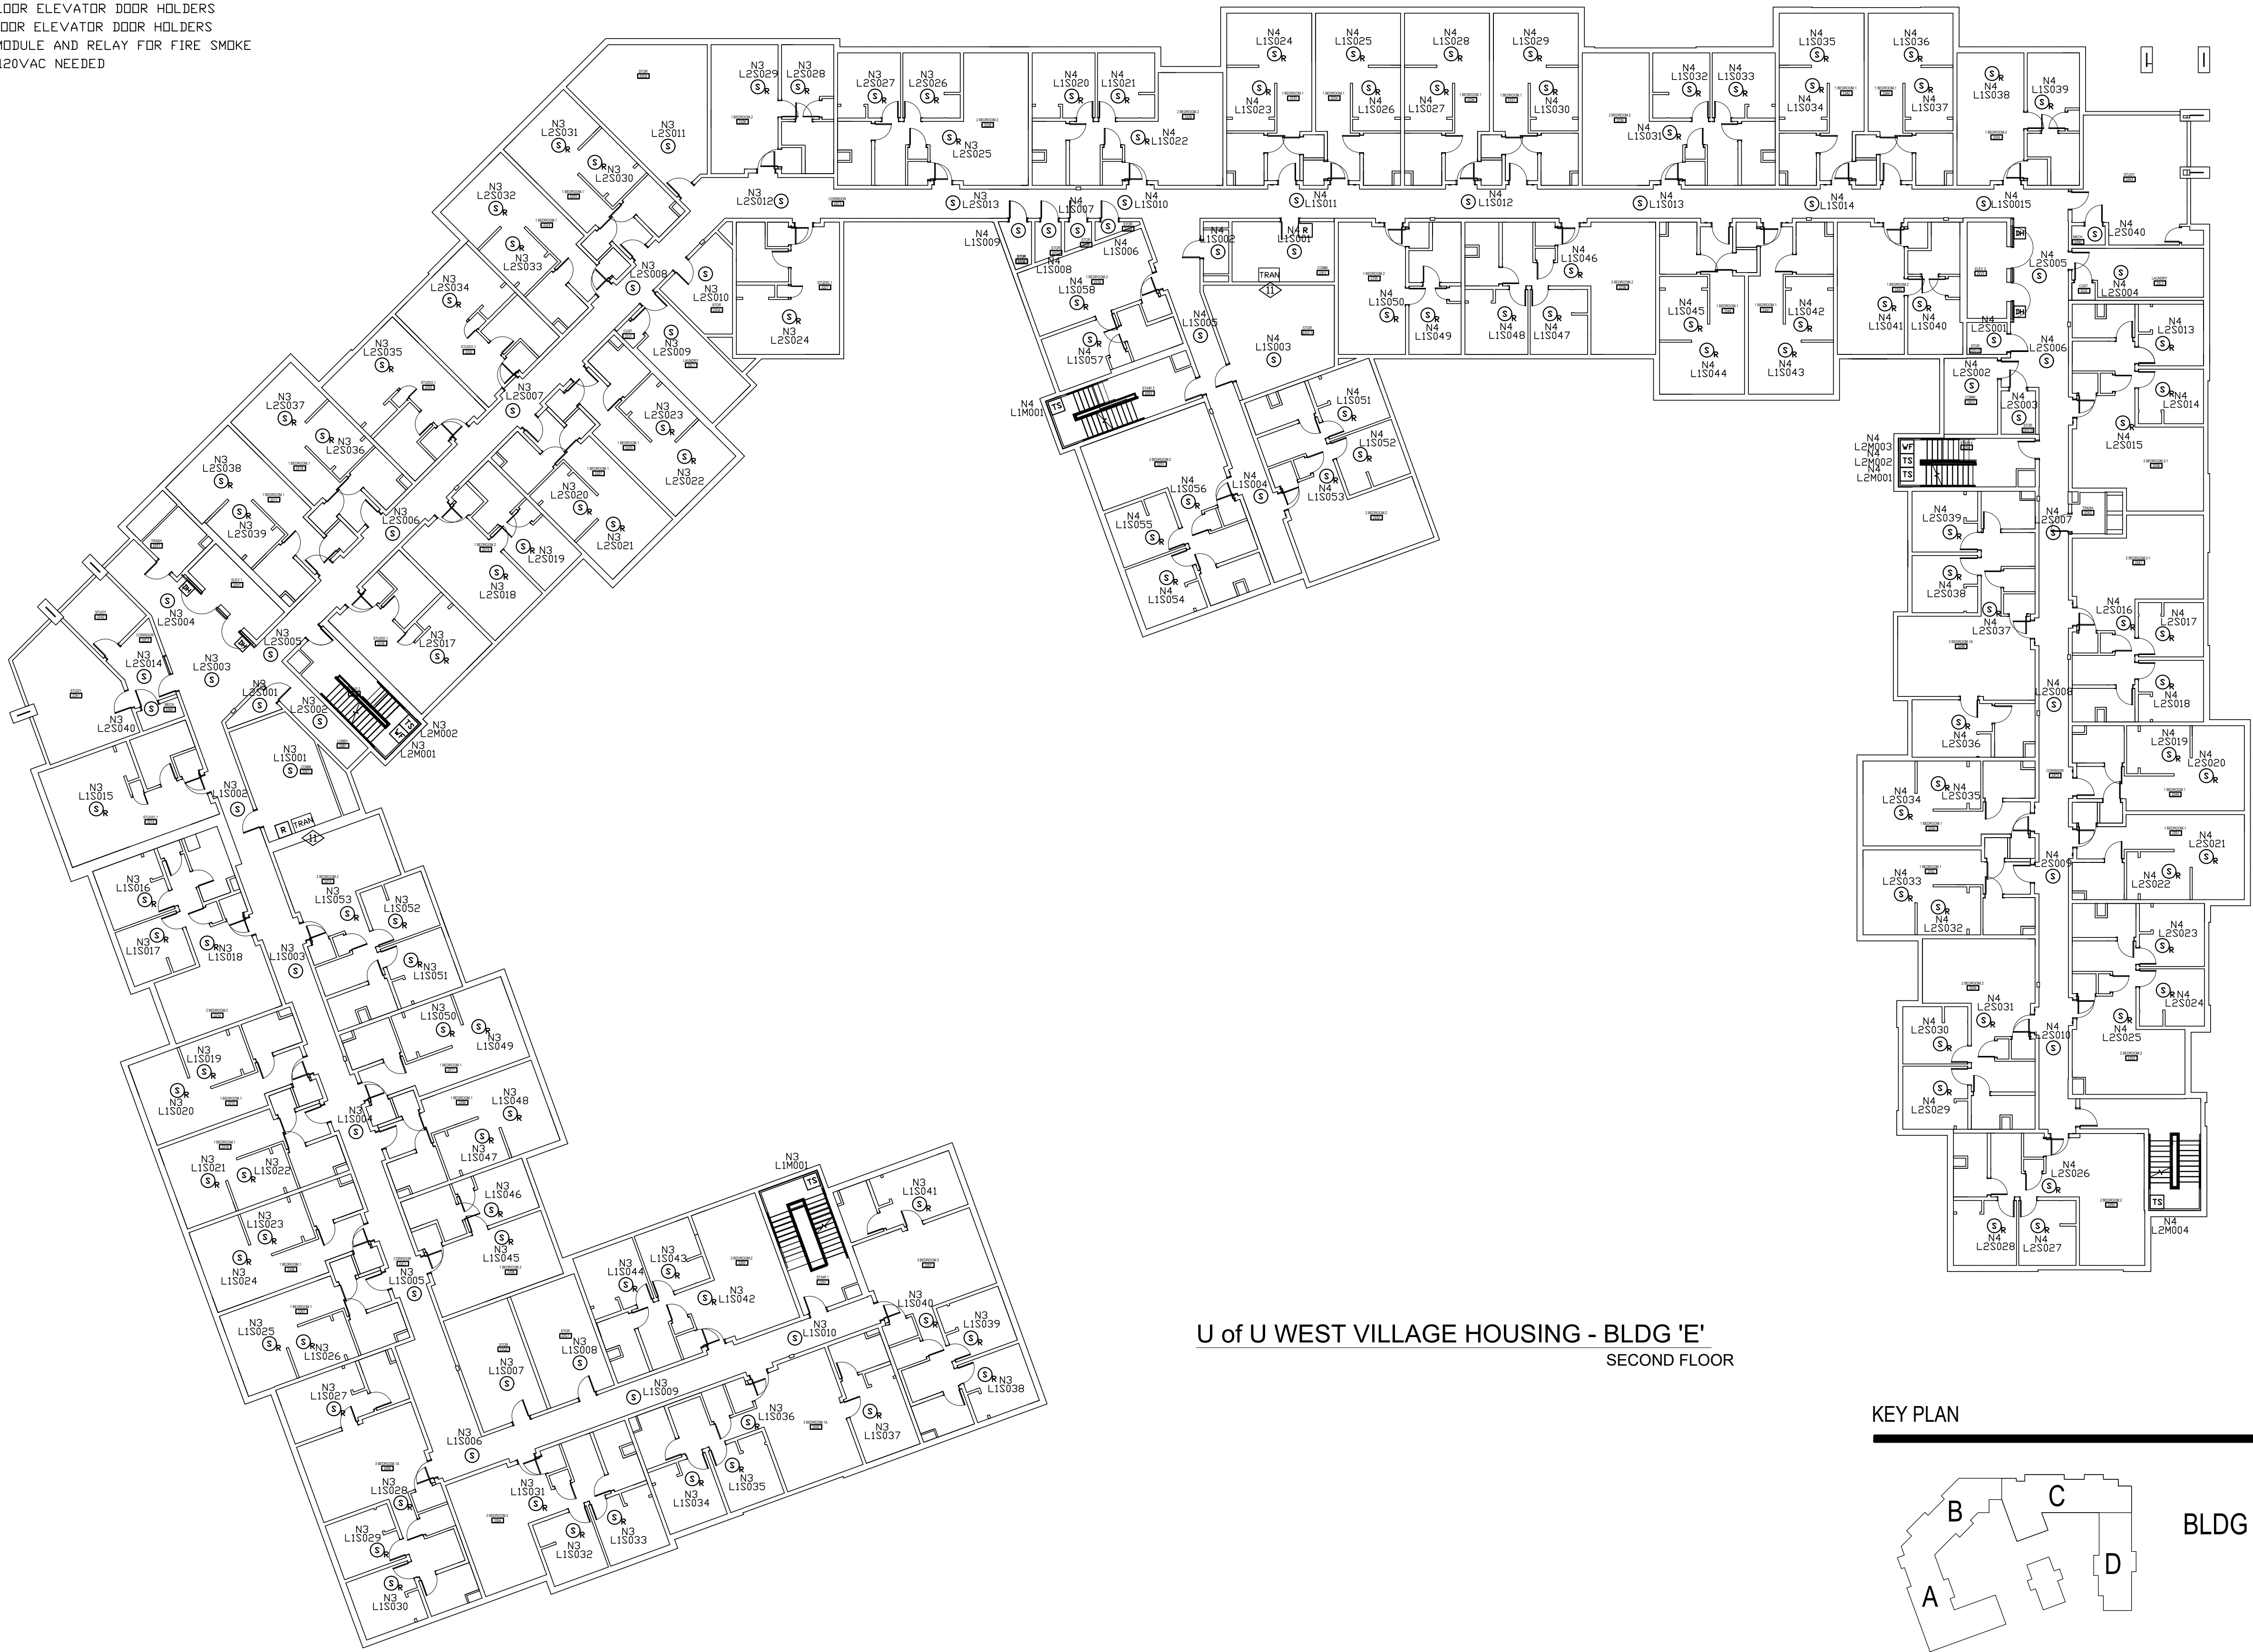

U of U WEST VILLAGE HOUSING - BLDG 'E'
SECOND FLOOR

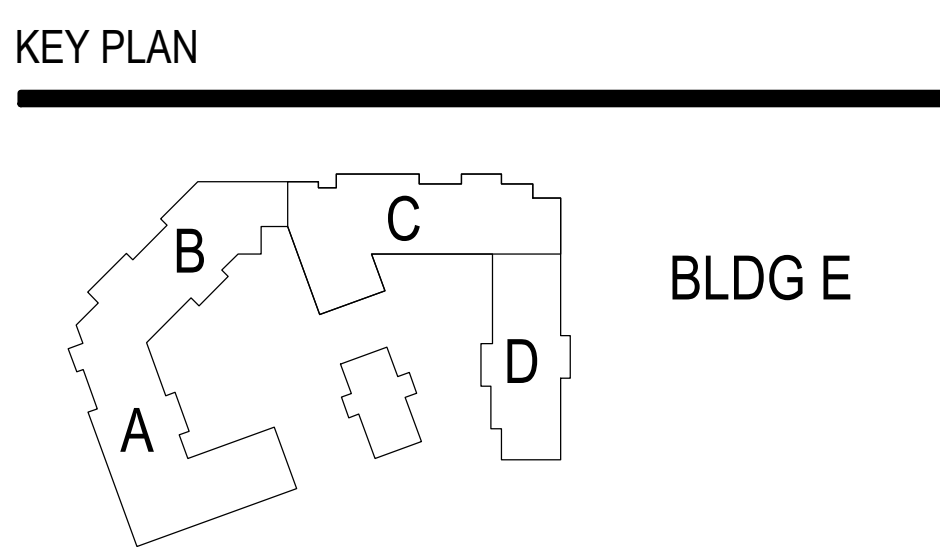

SYSTEM NOTES:
TO TRANSPONDER LOCATED IN ELEC 21E1
TO TRANSPONDER LOCATED IN ELEC 21E2
TO TRANSPONDER LOCATED IN COMM 22E1
TO TRANSPONDER LOCATED IN COMM 22E2
TO TRANSPONDER LOCATED IN ELEC 23E1
TO TRANSPONDER LOCATED IN ELEC 23E2
TO TRANSPONDER LOCATED IN COMM 24E1
TO TRANSPONDER LOCATED IN ELEC 24E2
TO TRANSPONDER LOCATED IN ELEC 25E1
TO TRANSPONDER LOCATED IN ELEC 25E2
REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
TO 4TH FLOOR ELEVATOR DOOR HOLDERS
TO 2ND FLOOR ELEVATOR DOOR HOLDERS
CONTROL MODULE ARE RELAY FOR FIRE SMOKE DAMPERS. 120VAC NEEDED

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VDC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
54	SD	SMOKE DETECTOR
128	SDR	SMOKE DETECTOR ROOM
	FS	PULL STATION
2	TS	TAMPER SWITCH MONITOR
2	WM	WATERFLOW SWITCH MONITOR
	SN	SPRINKLER NOTIFICATION
	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
4	R	RELAY
	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	LC	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HC	HORN/STROBE- CEILING
	LEVP	WEATHERPROOF STROBE
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE/SMOKE DAMPER

ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	SD	REMOVED SMOKE DETECTOR
	SD	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
THIRD FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: KT
DESIGNED BY: XXXX
APPROVED BY: TCT/KKK
DATE: 2/19/2025 12:39:40 PM
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
BLDG E 3RD FLOOR.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-3-03

U of U WEST VILLAGE HOUSING - BLDG 'E'
THIRD FLOOR

KEY PLAN

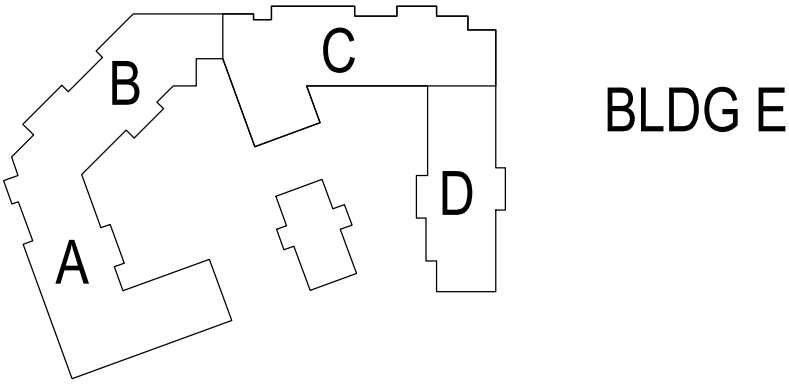

- SYSTEM NOTES:
- 1 TO TRANSPONDER LOCATED IN ELEC 21E1
 - 2 TO TRANSPONDER LOCATED IN ELEC 21E2
 - 3 TO TRANSPONDER LOCATED IN COMM 22E1
 - 4 TO TRANSPONDER LOCATED IN COMM 22E2
 - 5 TO TRANSPONDER LOCATED IN ELEC 23E1
 - 6 TO TRANSPONDER LOCATED IN ELEC 23E2
 - 7 TO TRANSPONDER LOCATED IN COMM 24E1
 - 8 TO TRANSPONDER LOCATED IN ELEC 24E2
 - 9 TO TRANSPONDER LOCATED IN ELEC 25E1
 - 10 TO TRANSPONDER LOCATED IN ELEC 25E2
 - 11 REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
 - 12 TO 5TH FLOOR ELEVATOR DOOR HOLDERS
 - 13 TO 3RD FLOOR ELEVATOR DOOR HOLDERS
 - 14 CONTROL MODULE AND RELAY FOR FIRE SMOKE DAMPERS, 120VAC NEEDED

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED 2 PAIR #14'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
51	SD	SMOKE DETECTOR
128	SDR	SMOKE DETECTOR ROOM
	PS	PULL STATION
2	TS	TAMPER SWITCH MONITOR
2	WFS	WATERFLOW SWITCH MONITOR
	SN	SPRINKLER NOTIFICATION
	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
2	R	RELAY
4	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	LC	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HSC	HORN/STROBE- CEILING
	LWS	WEATHERPROOF STROBE
	RA	REMOTE ANNUNCIATOR
	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE/SMOKE DAMPER
ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	SD	REMOVED SMOKE DETECTOR
	SD	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
FOURTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KT
DESIGNED BY: XXXX
APPROVED BY: TCT/KKK
DATE: 2/19/2025 1:17:44 PM
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: BLDG E 4TH FLOOR.DWG


NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-4-03

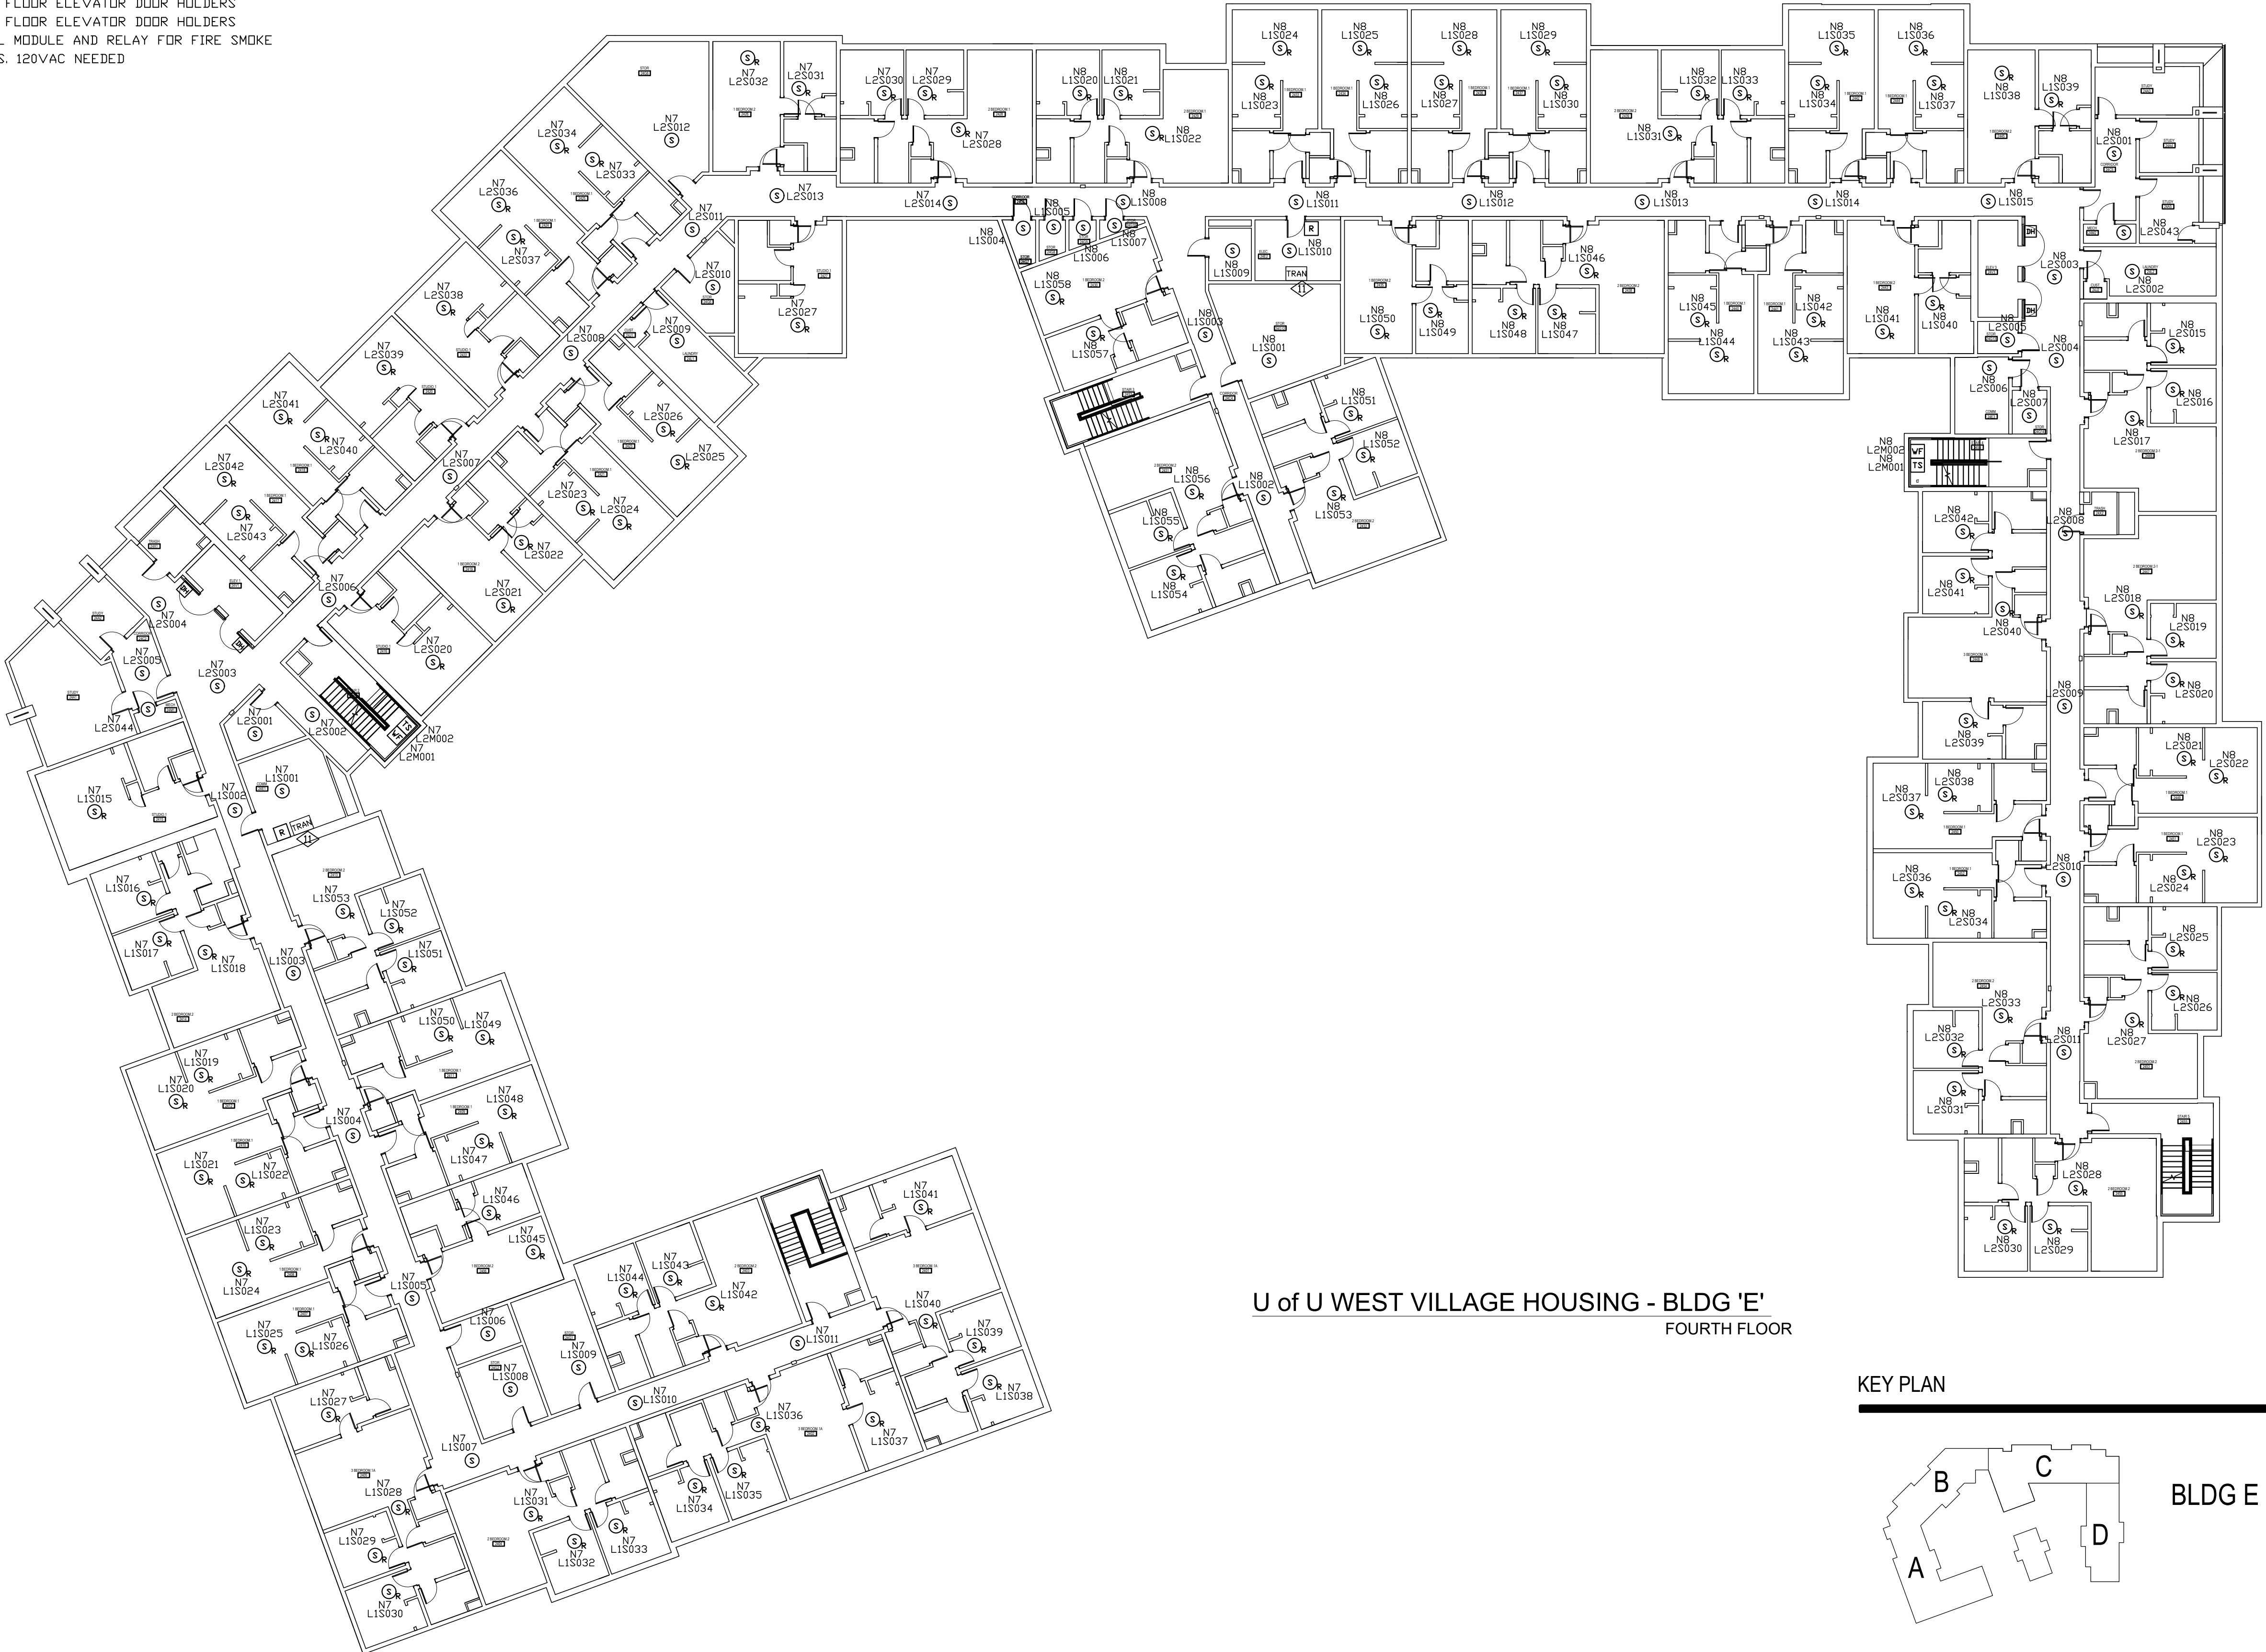

U of U WEST VILLAGE HOUSING - BLDG 'E'
FOURTH FLOOR

KEY PLAN

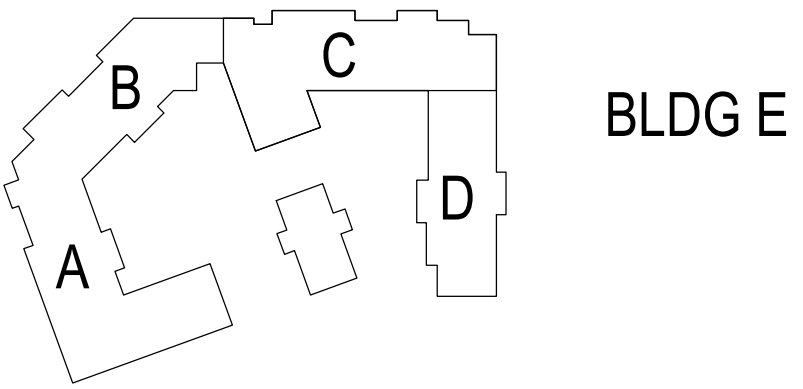

- SYSTEM NOTES:
- ① TO TRANSPONDER LOCATED IN ELEC 21E1
 - ② TO TRANSPONDER LOCATED IN ELEC 21E2
 - ③ TO TRANSPONDER LOCATED IN CDM 22E1
 - ④ TO TRANSPONDER LOCATED IN CDM 22E2
 - ⑤ TO TRANSPONDER LOCATED IN ELEC 23E1
 - ⑥ TO TRANSPONDER LOCATED IN ELEC 23E2
 - ⑦ TO TRANSPONDER LOCATED IN CDM 24E1
 - ⑧ TO TRANSPONDER LOCATED IN ELEC 24E2
 - ⑨ TO TRANSPONDER LOCATED IN ELEC 25E1
 - ⑩ TO TRANSPONDER LOCATED IN ELEC 25E2
 - ⑪ REFER TO RISER FA-R-01 FOR 120VAC, FSD, ADA WIRING.
 - ⑫ TO 4TH FLOOR ELEVATOR DOOR HOLDERS
 - ⑬ CONTROL MODULE AND RELAY FIRE SMOKE DAMPERS. 120VAC NEEDED

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #16'S TWISTED
B	24 VDC AUX POWER	1 PAIR #14'S TWISTED
C	120 VAC POWER	3 #12'S
D	DOOR HOLDER CIRCUIT	2 #14'S
E	HORN/STROBE CIRCUIT	2 #14'S
F	REMOTE ANNUNCIATOR	2 PAIR #16'S TWISTED
G	ELEVATOR CONTROL CIRCUIT	4 PAIR #16'S

DEVICE LEGEND		
COUNTS	SYMBOL	DESCRIPTION
43	Ⓢ	SMOKE DETECTOR
90	Ⓢ	SMOKE DETECTOR ROOM
1	F	PULL STATION
2	TS	TAMPER SWITCH MONITOR
2	WF	WATERFLOW SWITCH MONITOR
2	SN	SPRINKLER NOTIFICATION
2	CM	CONTROL MODULE
2	CM	CONTROL MODULE SUPERVISED
4	R	RELAY
	DH	DOOR HOLDER
	L	STROBE ONLY- WALL
	L	STROBE ONLY- CEILING
	HS	HORN/STROBE- WALL
	HS	HORN/STROBE- CEILING
	L _{WP}	WEATHERPROOF STROBE
	RA	REMOTE ANNUNCIATOR
2	FACU	FIRE ALARM CONTROL UNIT
2	TRAN	TRANSPONDER PANEL
	ERC	ELEVATOR RECALL CABINET
	FSD	FIRE/SMOKE DAMPER

ADDED OR REMOVED DEVICES (ADJUSTMENT ACCOUNTED FOR IN COUNTS ABOVE)		
COUNTS	SYMBOL	DESCRIPTION
	Ⓢ	REMOVED SMOKE DETECTOR
	Ⓢ	ADDED SMOKE DETECTOR
	HS	REMOVED HORN/STROBE- WALL
	HS	ADDED HORN/STROBE- WALL

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
WEST VILLAGE HOUSING
BUILDING E PHASE 2
FIFTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KT
DESIGNED BY: XXXX
APPROVED BY: TCT/KKK
DATE: 2/20/2025 11:09:06 AM
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: BLDG E 5TH FLOOR.DWG

NELSON FIRE SYSTEMS
MAIN LEVEL
NUMBERS

PAGE:
FA-5-03

U of U WEST VILLAGE HOUSING - BLDG 'E'
FIFTH FLOOR

KEY PLAN

