



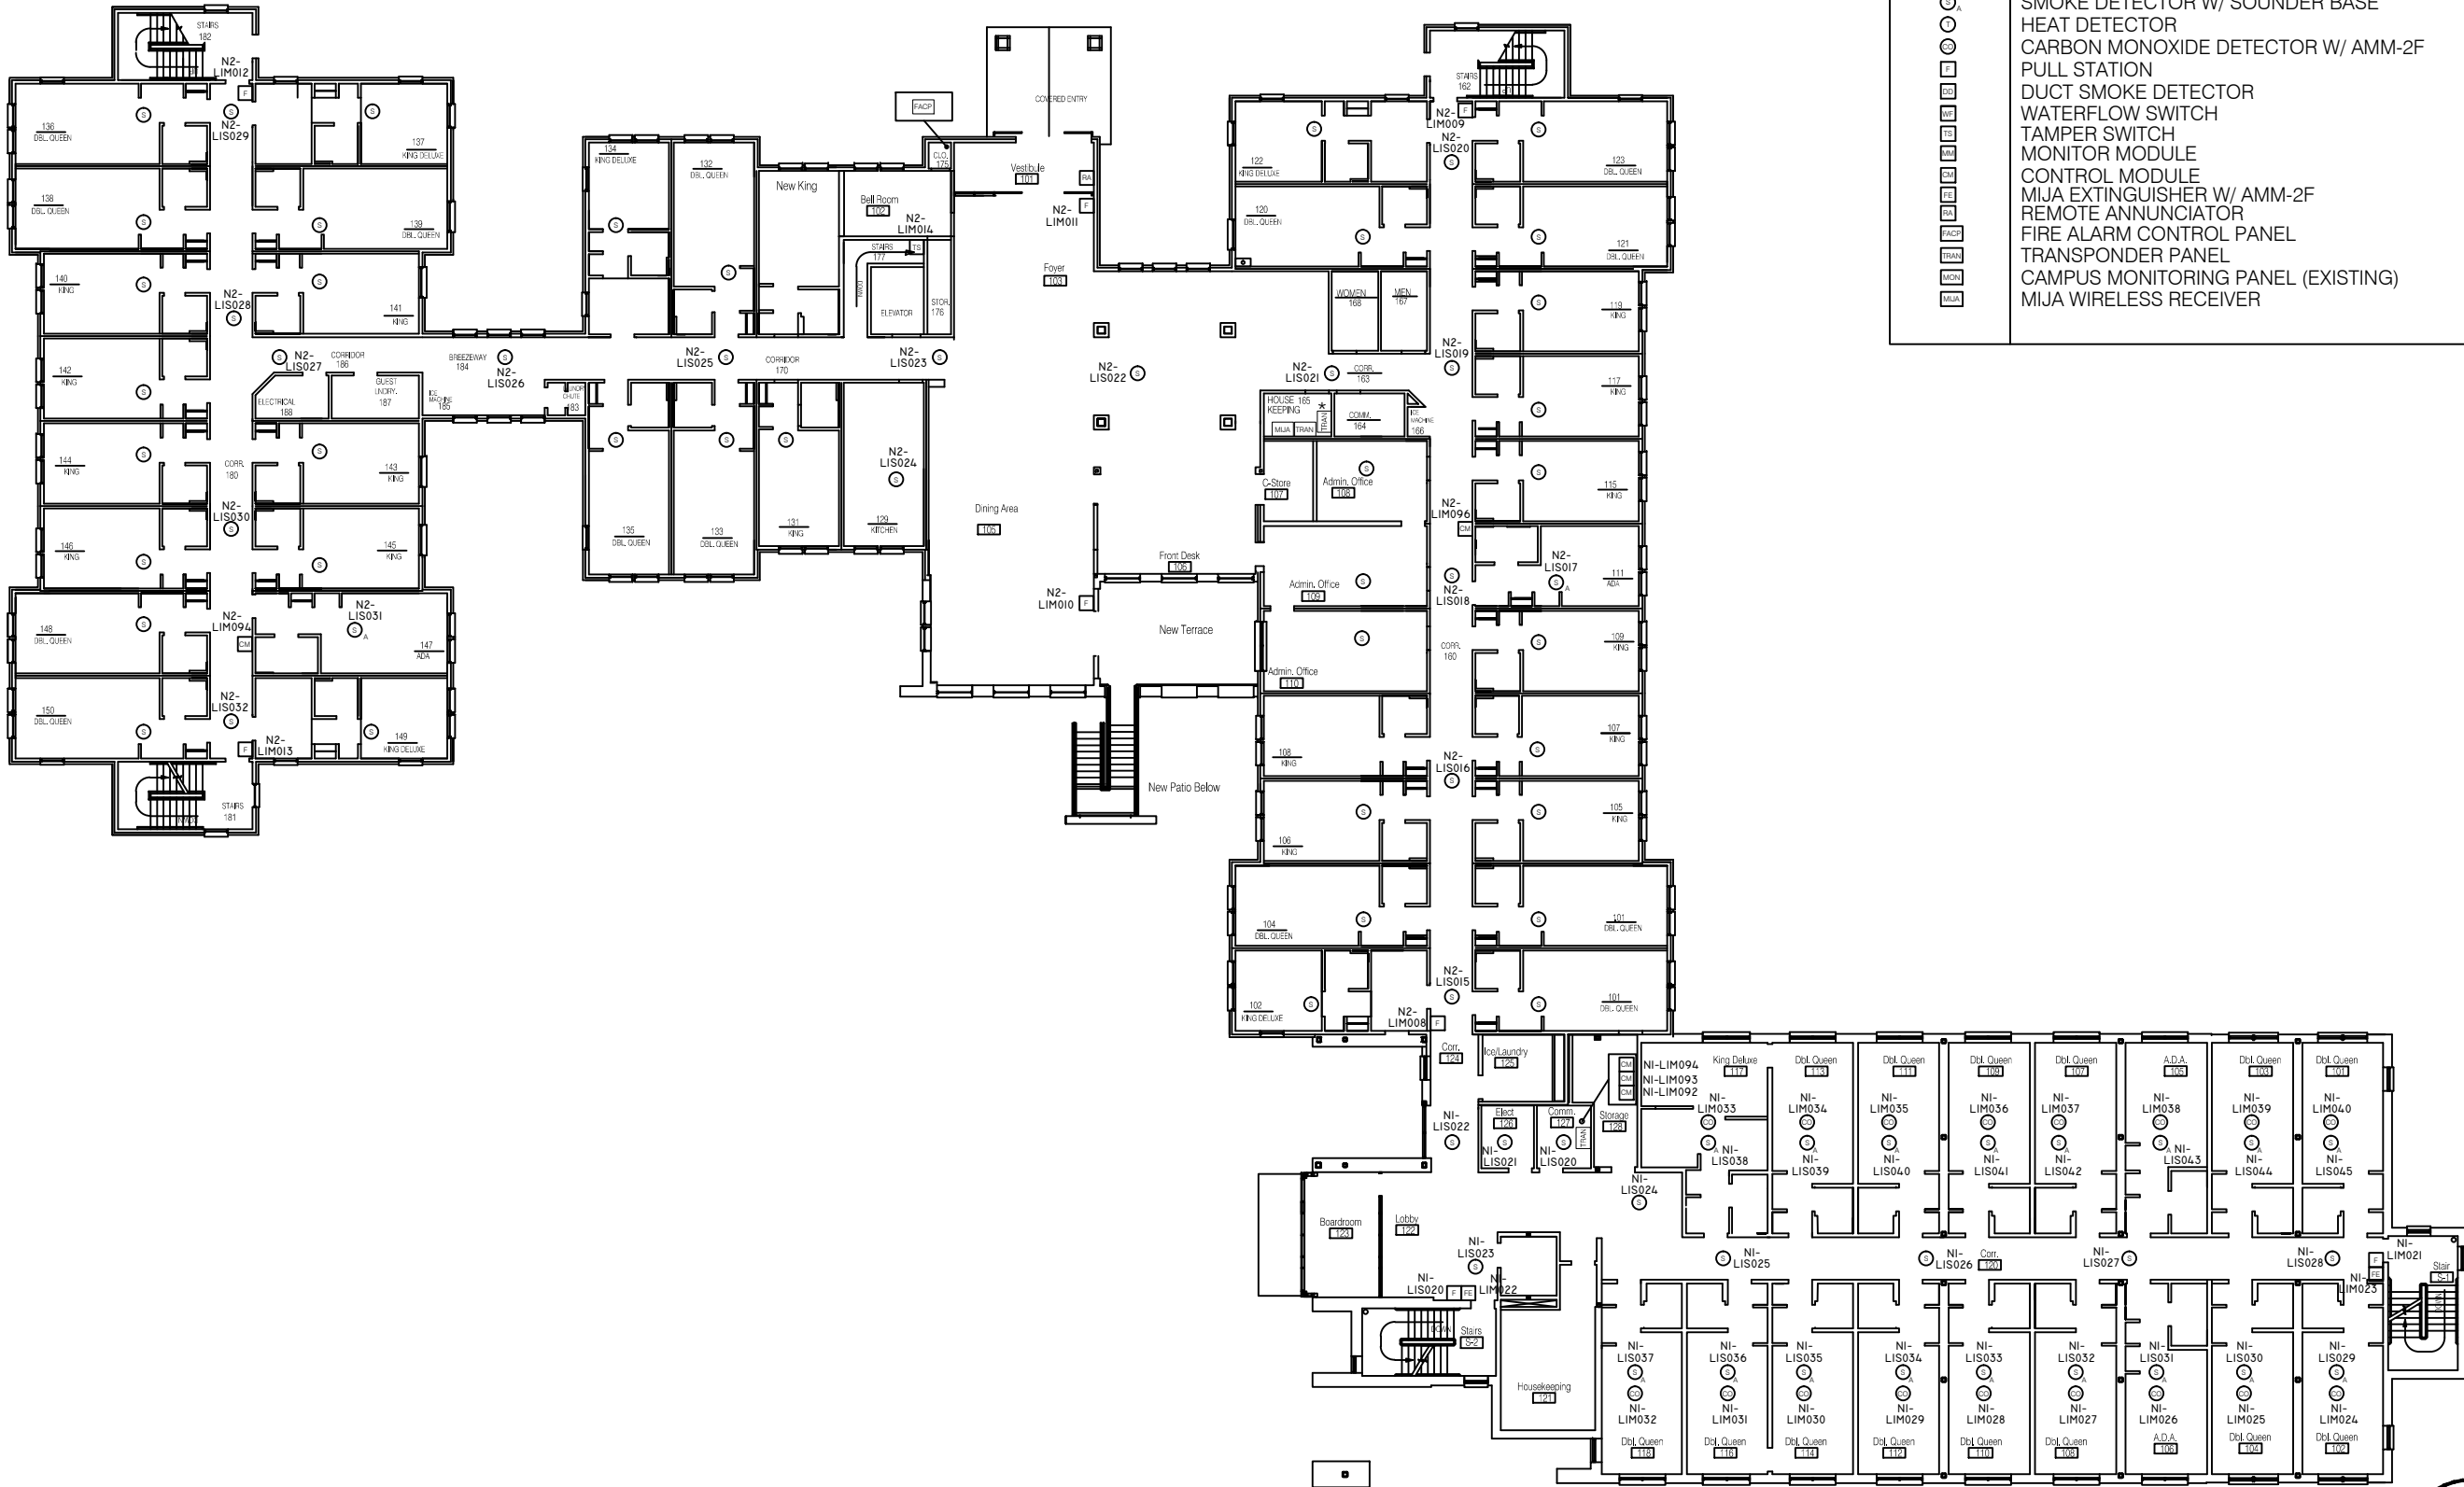

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	SMOKE DETECTOR W/ SOUNDER BASE
	HEAT DETECTOR
	CARBON MONOXIDE DETECTOR W/ AMM-2F
	PULL STATION
	DUCT SMOKE DETECTOR
	WATERFLOW SWITCH
	TAMPER SWITCH
	MONITOR MODULE
	CONTROL MODULE
	MIJA EXTINGUISHER W/ AMM-2F
	REMOTE ANNUNCIATOR
	FIRE ALARM CONTROL PANEL
	TRANSPONDER PANEL
	CAMPUS MONITORING PANEL (EXISTING)
	MIJA WIRELESS RECEIVER



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

LEVEL I
GUESTHOUSE ADDITION AND REMODEL
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	DPS
CHECKED BY:	DPS
DATE:	I/II/12
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	GUESTHOUSE I FINAL.DWG


FIRE ALARM SYSTEM
ADDRESSES
LEVEL I

NFS
FA-I

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	SMOKE DETECTOR W/ SOUNDER BASE
	HEAT DETECTOR
	CARBON MONOXIDE DETECTOR W/ AMM-2F
	PULL STATION
	DUCT SMOKE DETECTOR
	WATERFLOW SWITCH
	TAMPER SWITCH
	MONITOR MODULE
	CONTROL MODULE
	MIJA EXTINGUISHER W/ AMM-2F
	REMOTE ANNUNCIATOR
	FIRE ALARM CONTROL PANEL
	TRANSPONDER PANEL
	CAMPUS MONITORING PANEL (EXISTING)
	MIJA WIRELESS RECEIVER



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

LEVEL 2
GUESTHOUSE ADDITION AND REMODEL
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: JJC
DESIGNED BY: DPS
CHECKED BY: DPS
DATE: 1/11/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
GUESTHOUSE 2 FINAL.DWG

FIRE ALARM SYSTEM
ADDRESSES
LEVEL 2


NFS

FA-2

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

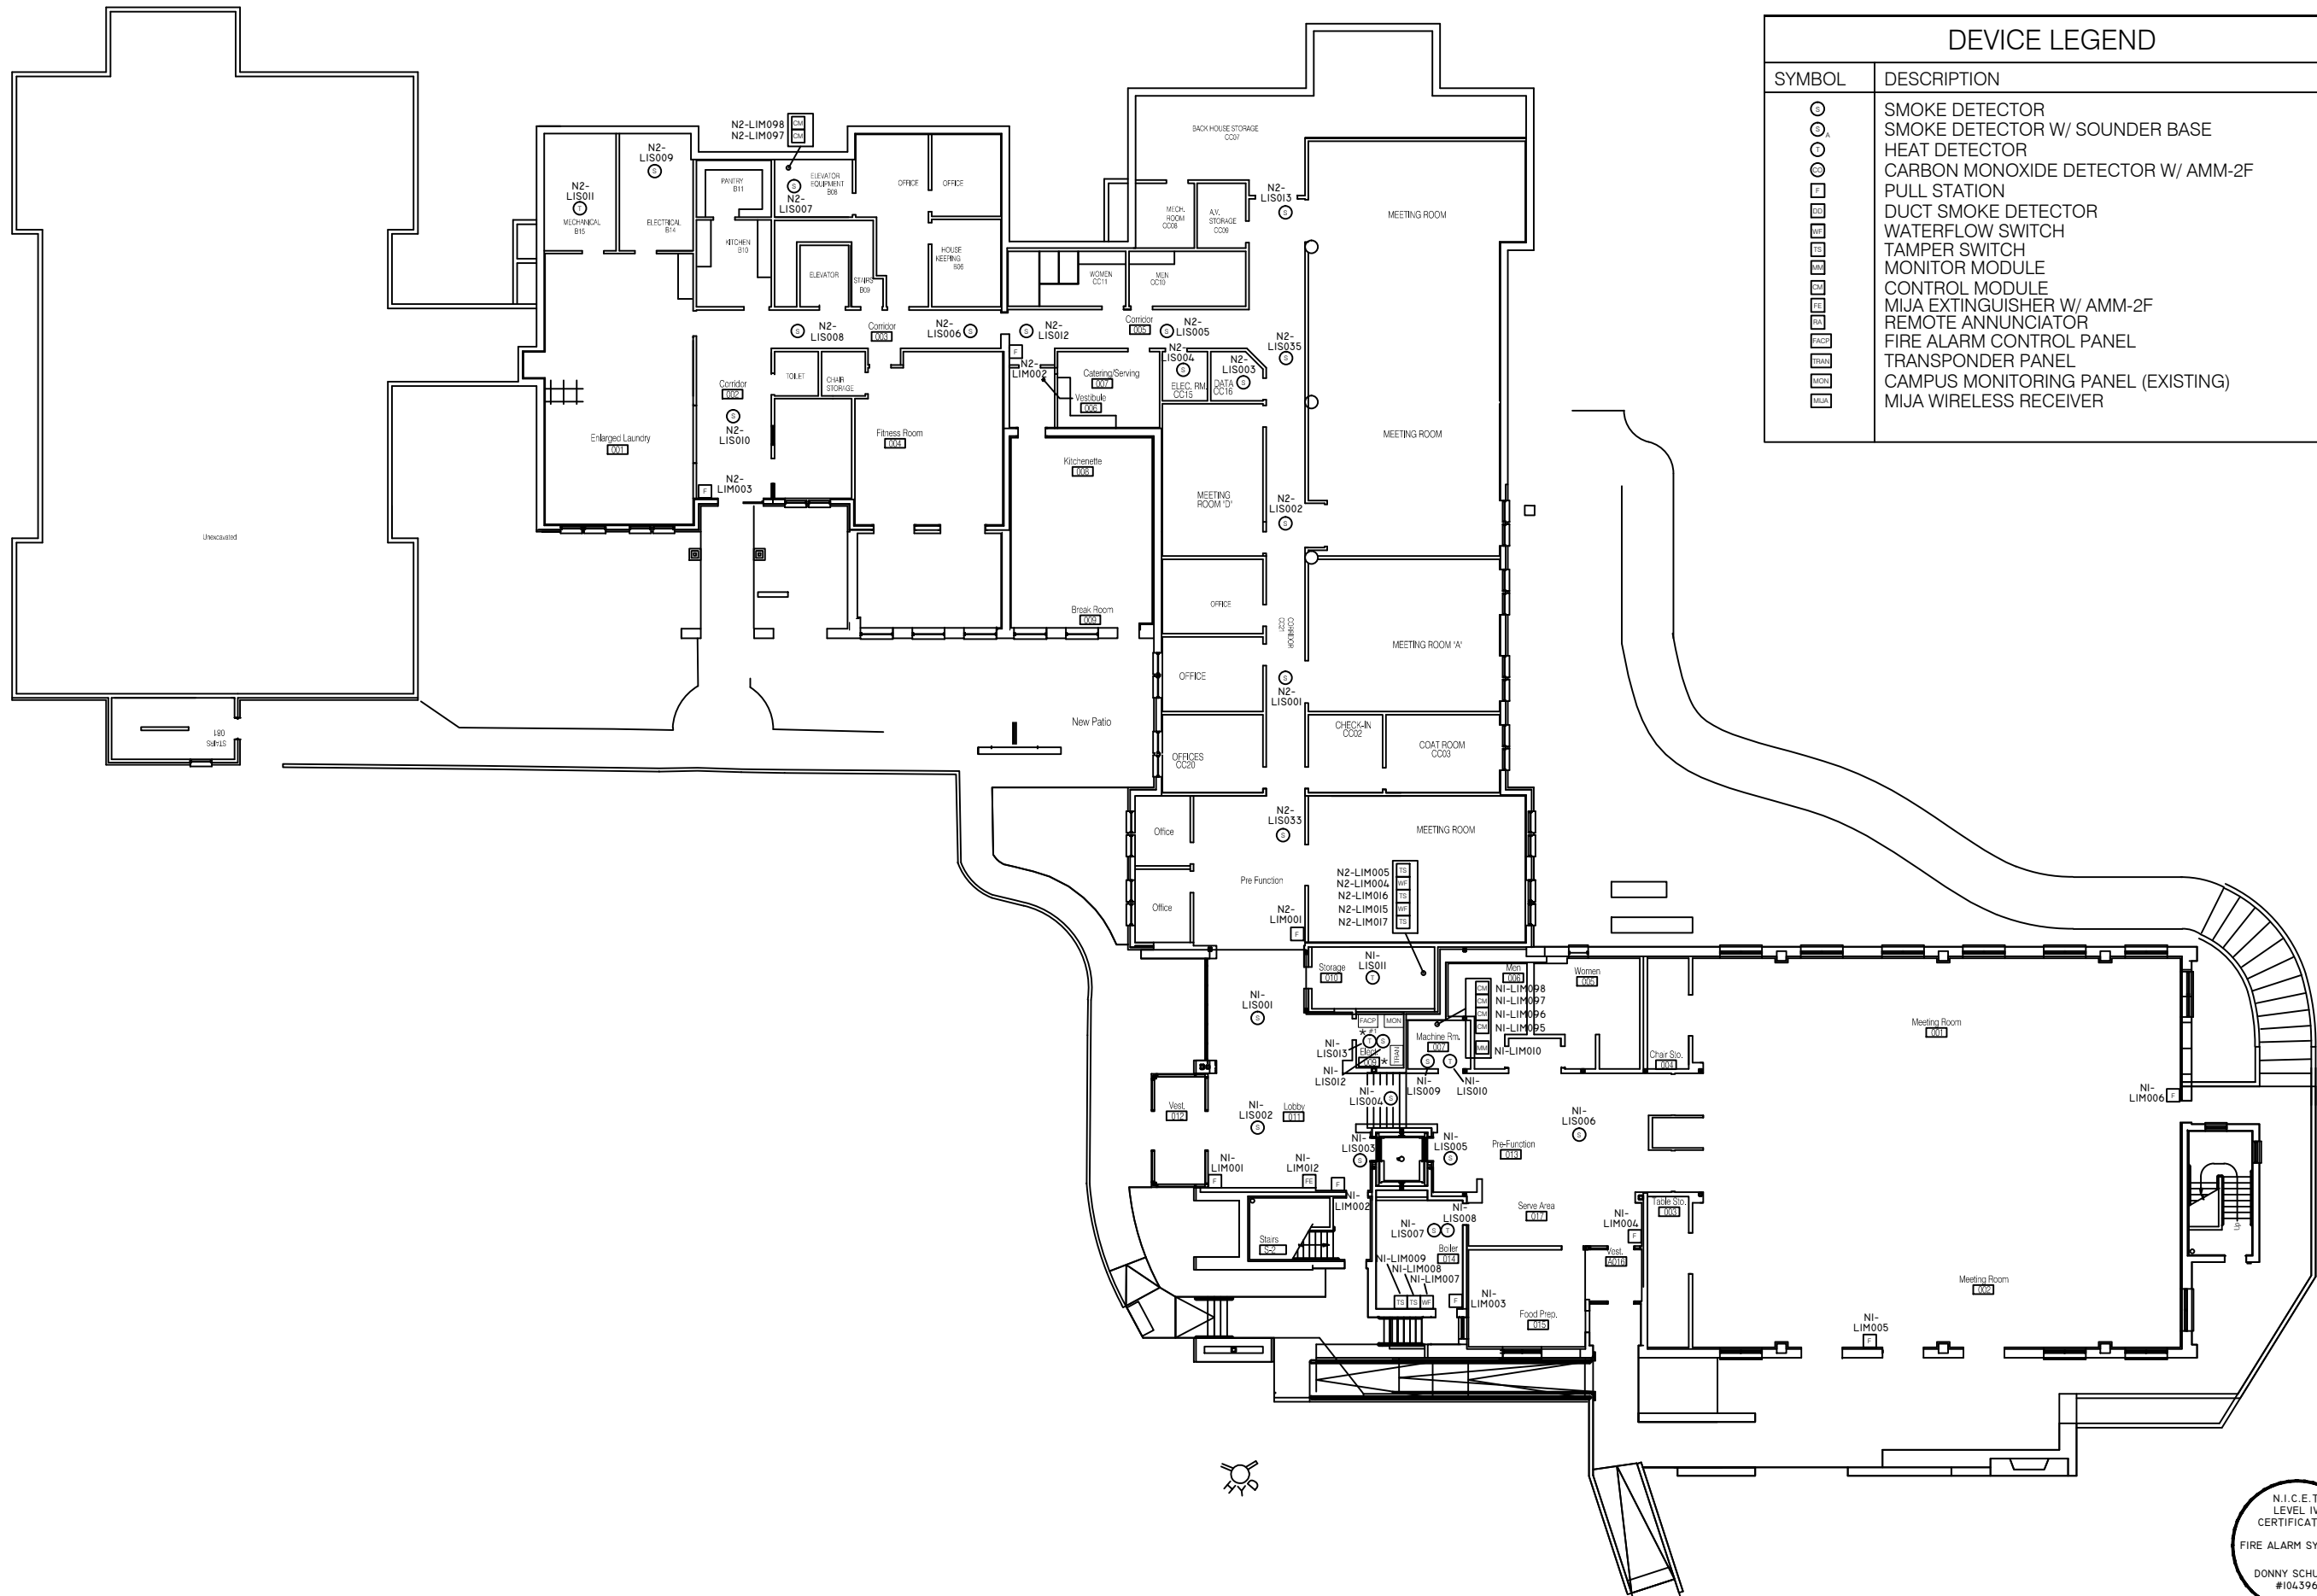

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	SMOKE DETECTOR W/ SOUNDER BASE
	HEAT DETECTOR
	CARBON MONOXIDE DETECTOR W/ AMM-2F
	PULL STATION
	DUCT SMOKE DETECTOR
	WATERFLOW SWITCH
	TAMPER SWITCH
	MONITOR MODULE
	CONTROL MODULE
	MIJA EXTINGUISHER W/ AMM-2F
	REMOTE ANNUNCIATOR
	FIRE ALARM CONTROL PANEL
	TRANSPONDER PANEL
	CAMPUS MONITORING PANEL (EXISTING)
	MIJA WIRELESS RECEIVER



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

LEVEL G
GUESTHOUSE ADDITION AND REMODEL
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: DPS
CHECKED BY: DPS
DATE: 1/11/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
GUESTHOUSE G FINAL.DWG

FIRE ALARM SYSTEM
ADDRESSES
LEVEL G

NFS

FA-G

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	SMOKE DETECTOR w/AUDIBLE BASE
	PULL STATION
	DUCT DETECTOR
	WATER FLOW SWITCH MODULE
	TAMPER SWITCH MODULE
	CONTROL MODULE
	REMOTE ANNUNCIATOR
	TRANSPONDER PANEL
	TWO-WAY COMM. PANEL
	TWO-WAY COMM. STATION

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION, AND SUITABILITY OF ALL FIRE ALARMS,
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.

UNIVERSITY OF UTAH GUESTHOUSE FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: XXXX
DESIGNED BY: XXXX
APPROVED BY: XXXX
DATE: XX-XX-XX
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
GUESTHOUSE ADDITION G.DWG

NELSON FIRE SYSTEMS
GROUND LEVEL

PAGE:
FINAL MAP



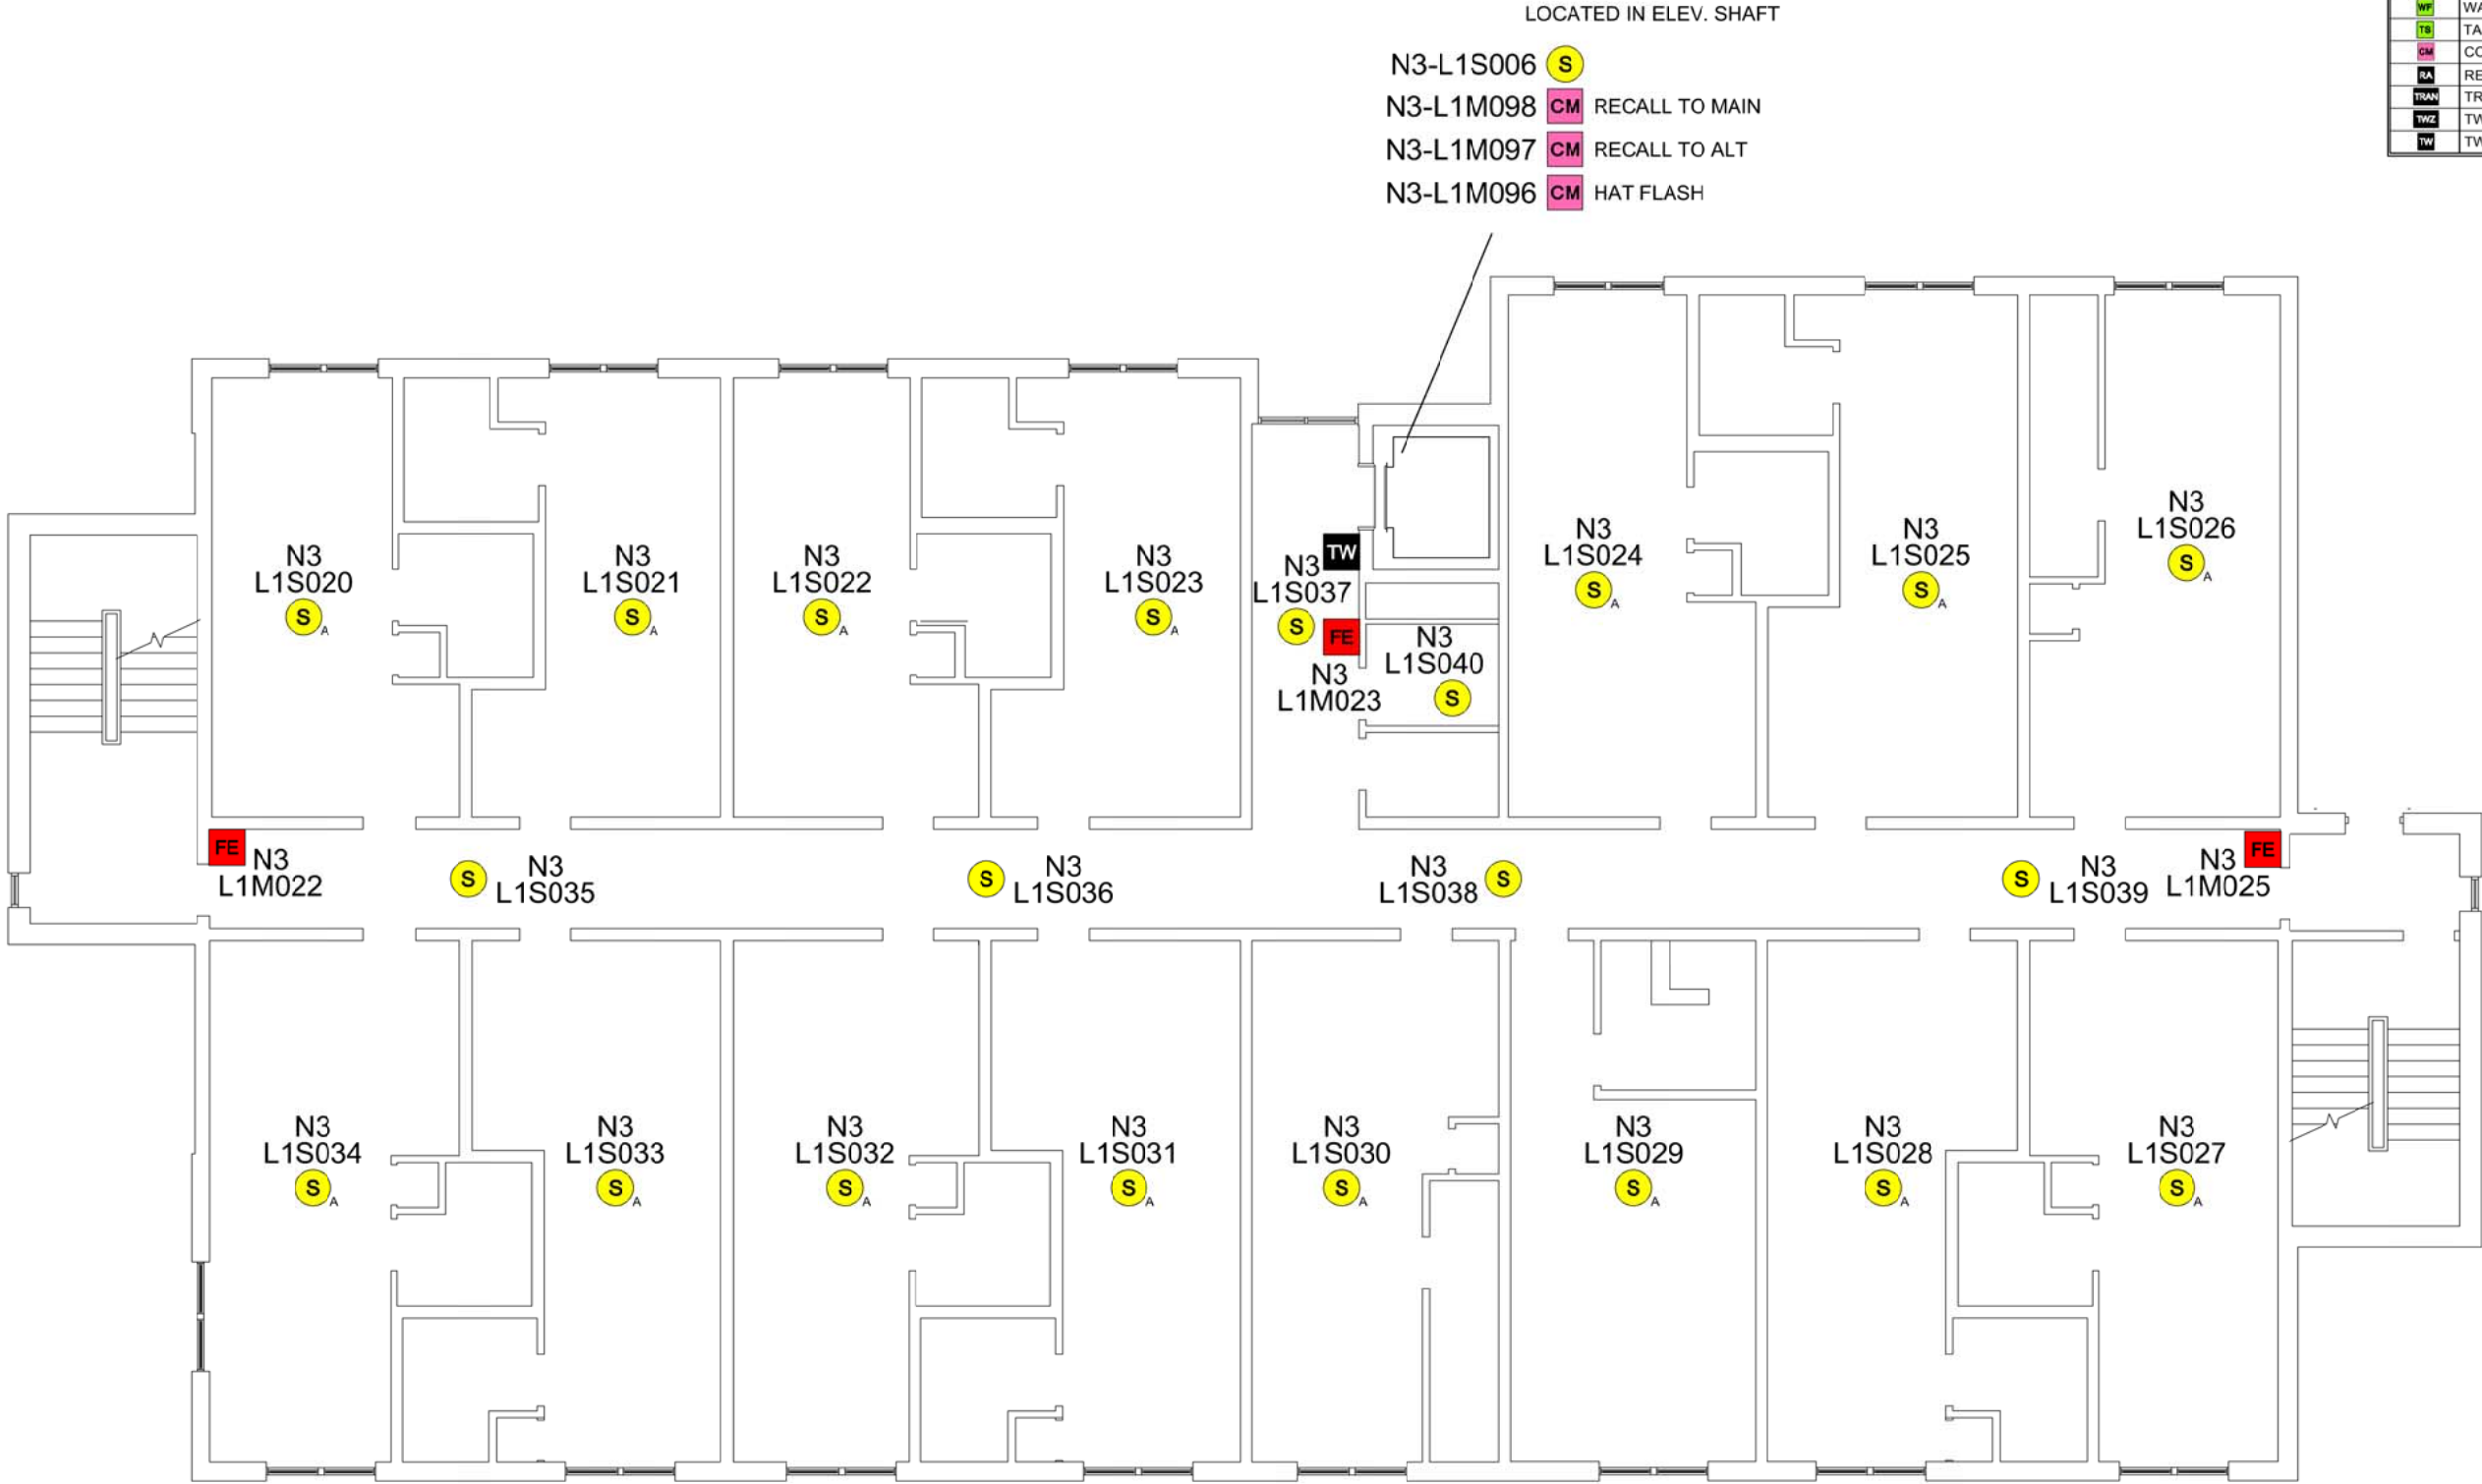



DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	SMOKE DETECTOR w/AUDIBLE BASE
	PULL STATION
	DUCT DETECTOR
	WATER FLOW SWITCH MODULE
	TAMPER SWITCH MODULE
	CONTROL MODULE
	REMOTE ANNUNCIATOR
	TRANSPONDER PANEL
	TWO-WAY COMM. PANEL
	TWO-WAY COMM. STATION

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION, AND SUITABILITY OF ALL FIRE ALARMS,
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.

UNIVERSITY OF UTAH GUESTHOUSE FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	XXXX
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	XX-XX-XX
SCALE:	N.T.S.
PROJECT NO:	XXXX
REVISION NO:	XXXX
DRAWING NAME:	GUESTHOUSE ADDITION 2.DWG

NELSON FIRE SYSTEMS
LEVEL 2

PAGE:
FINAL MAP

