



# FIRST FLOOR

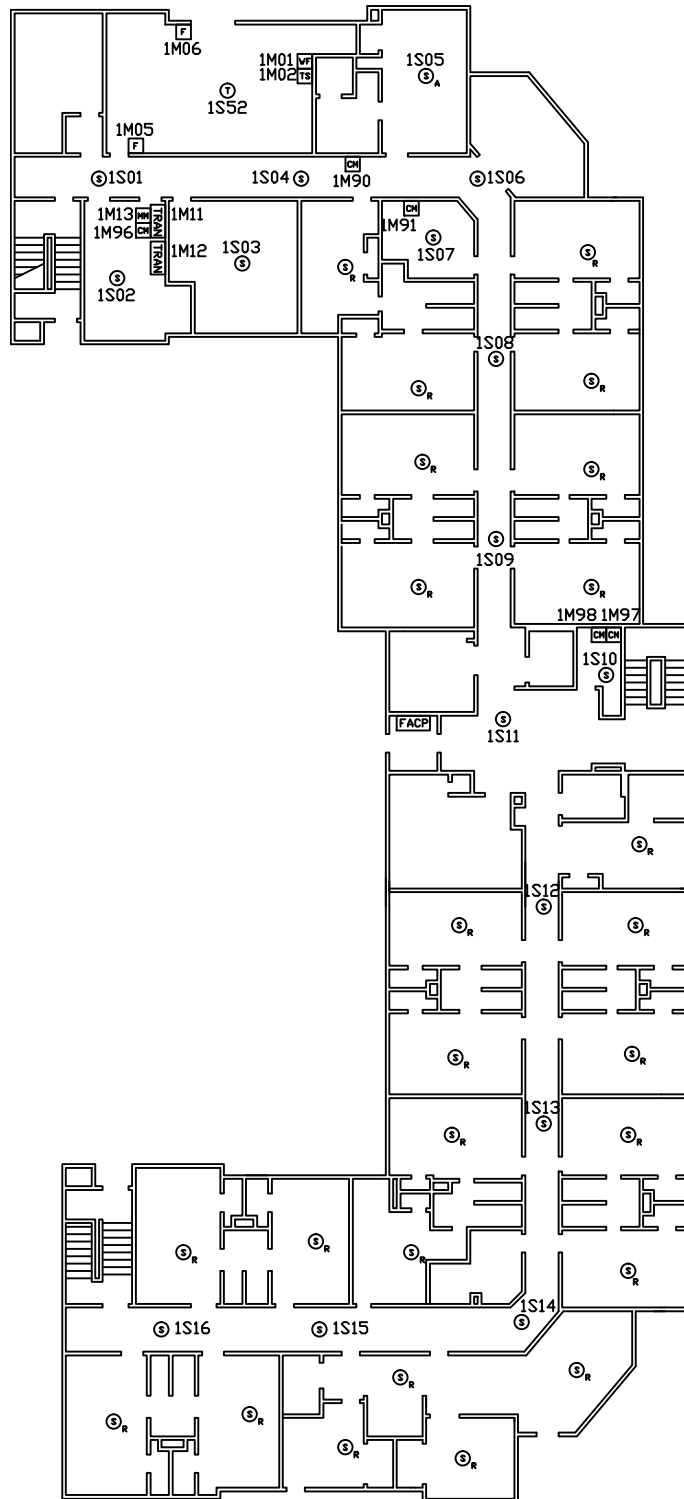

# SECOND FLOOR

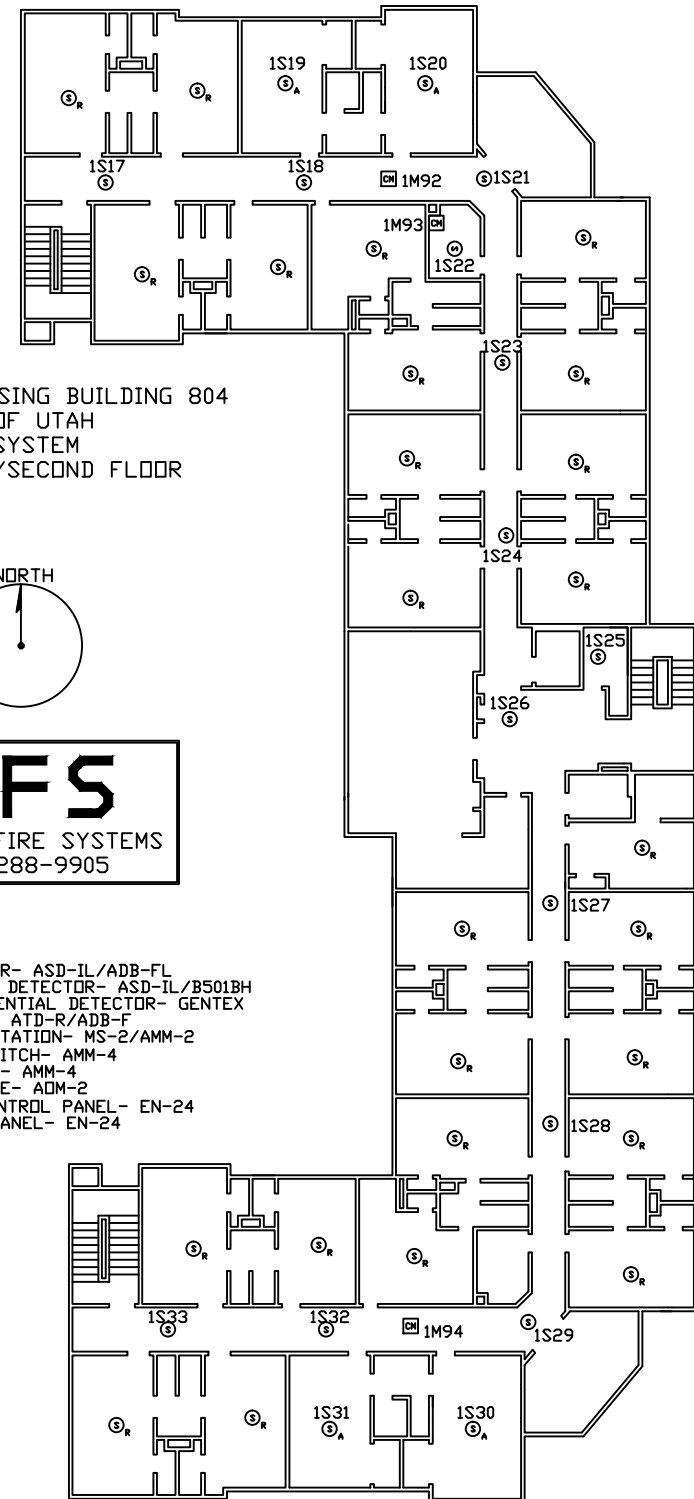

STUDENT HOUSING BUILDING 804  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
FIRST FLOOR/SECOND FLOOR  
JULY 6, 2010  
80412.DWG




**NFS**  
NELSON FIRE SYSTEMS  
801-288-9905

## LEGEND

- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- ⊙ AUDIBLE SMOKE DETECTOR- ASD-IL/B501BH
- ⊙ 120 VAC RESIDENTIAL DETECTOR- GENTEX
- ⊙ HEAT DETECTOR ATD-R/ADB-F
- ⊙ MANUAL PULL STATION- MS-2/AMM-2
- ⊙ WATERFLOW SWITCH- AMM-4
- ⊙ TAMPER SWITCH- AMM-4
- ⊙ CONTROL MODULE- ADM-2
- ⊙ FIRE ALARM CONTROL PANEL- EN-24
- ⊙ TRANSPONDER PANEL- EN-24

# THIRD FLOOR

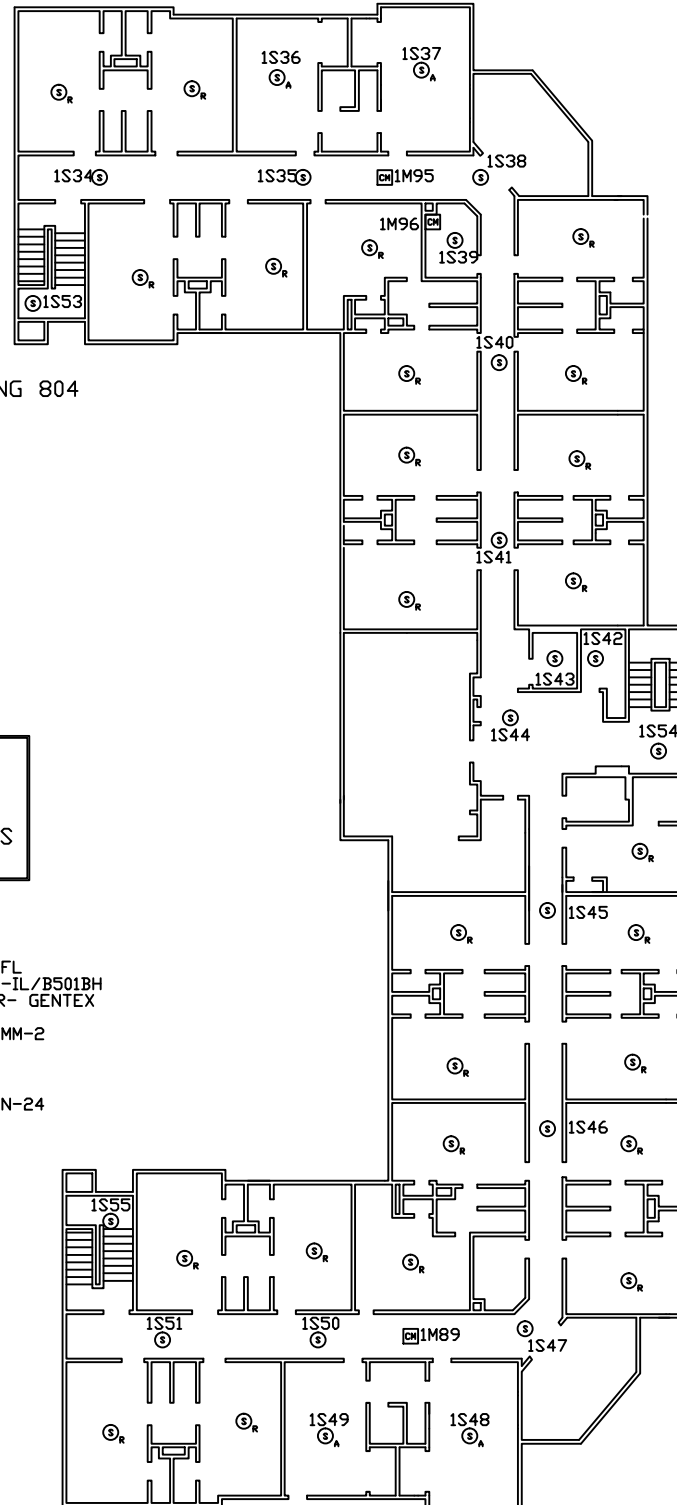

STUDENT HOUSING BUILDING 804  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
THIRD FLOOR  
APRIL 18, 2000  
8043A.DWG



## LEGEND

- SD SMOKE DETECTOR- ASD-IL/ADB-FL
- ASD AUDIBLE SMOKE DETECTOR- ASD-IL/B501BH
- 120 VAC RESIDENTIAL DETECTOR- GENTEX
- ATD-R/ADB-F HEAT DETECTOR
- MS-2/AMM-2 MANUAL PULL STATION
- WS-4 WATERFLOW SWITCH
- TS-4 TAMPER SWITCH
- ADM-2 CONTROL MODULE
- EN-24 FIRE ALARM CONTROL PANEL
- EN-24 TRANSPONDER PANEL