




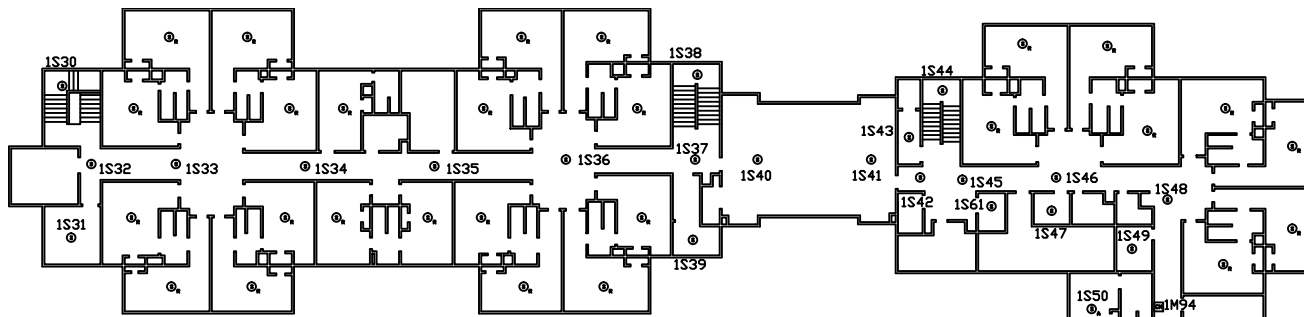


2ND FLOOR

BUILDING 807 STUDENT HOUSING
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
JULY 6, 2010
807.DWG

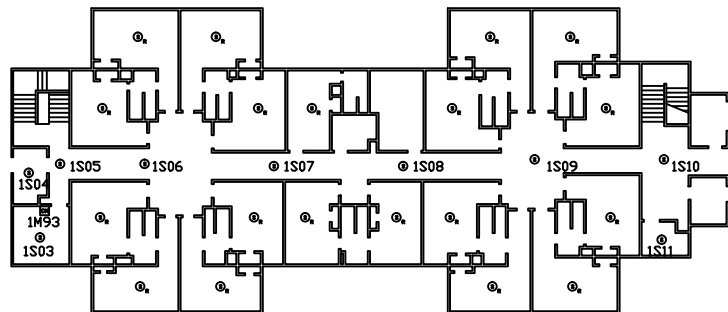

1ST FLOOR

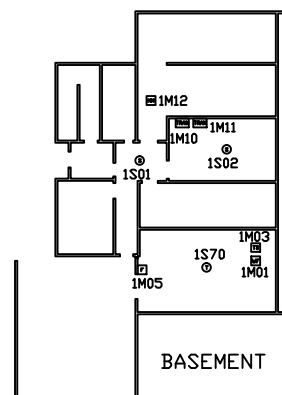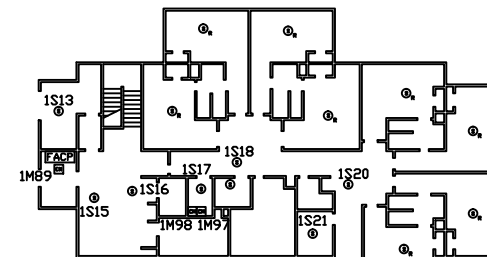

BASEMENT

LEGEND

- ⊙ SMOKE DETECTOR ASD-1/ADB-F
- ⊙ AUDIBLE SMOKE DETECTOR ASD-1/BS01BH
- ⊙ 120 VAC RESIDENTIAL DETECTOR FIREX
- ⊙ HEAT DETECTOR ATD-R/ADB-F
- ⊙ MANUAL PULL STATION- MS-2/AMM-2
- ⊙ WATERFLOW SWITCH- AMM-4
- ⊙ TAMPER SWITCH- AMM-4
- ⊙ STROBE/HORN- P2475FC
- ⊙ STROBE- S2475FC
- ⊙ CONTROL MODULE- ADM-2
- ⊙ RELAY- ARB-C
- ⊙ FIRE ALARM CONTROL PANEL- EN-24
- ⊙ TRANSPONDER PANEL- EN-24

NFS
NELSON FIRE SYSTEMS
801-288-9905