


LEGEND

- ⊙ SMOKE DETECTOR
- ⊙ AUDIBLE SMOKE DETECTOR
- ⊙ 120 VAC RESIDENTIAL DETECTOR
- ⊙ HEAT DETECTOR
- ⊙ MANUAL PULL STATION
- ⊙ WATERFLOW SWITCH
- ⊙ TAMPER SWITCH
- ⊙ CONTROL MODULE
- ⊙ FIRE ALARM CONTROL PANEL
- ⊙ TRANSPONDER PANEL


BUILDING 810 STUDENT HOUSING
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
JULY 6, 2010
810-1.DWG




NFS
NELSON FIRE SYSTEMS
801-288-9905

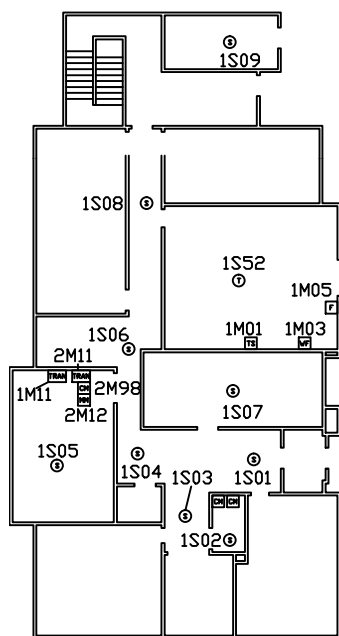


BASEMENT

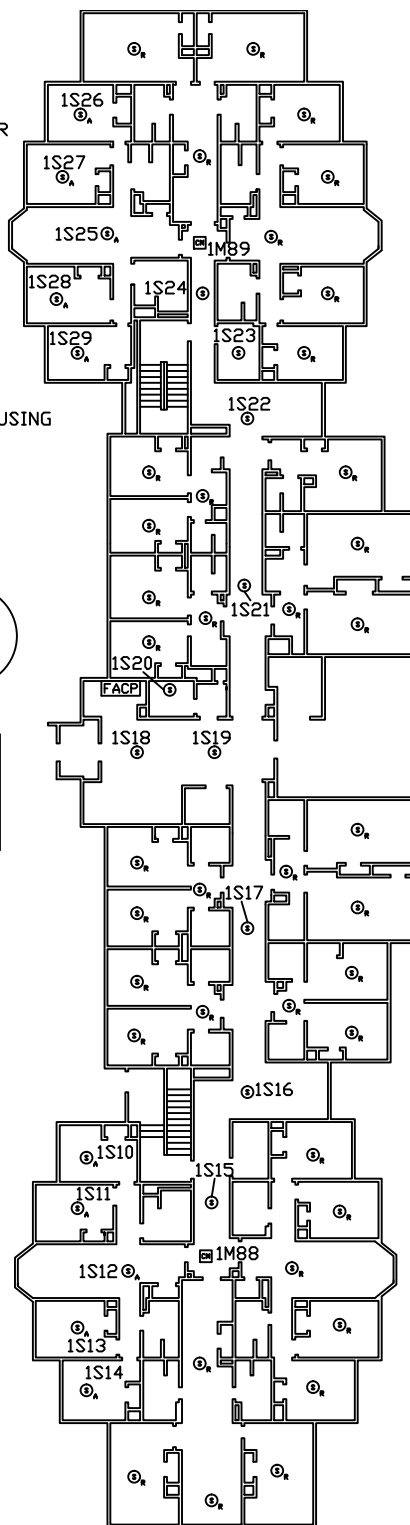

1ST FLOOR

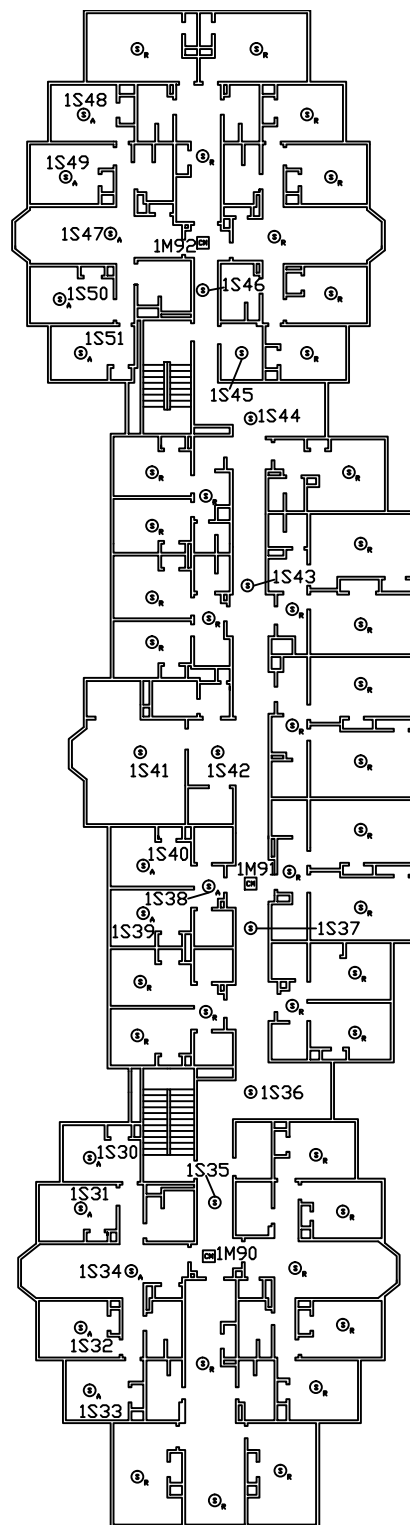

2ND FLOOR

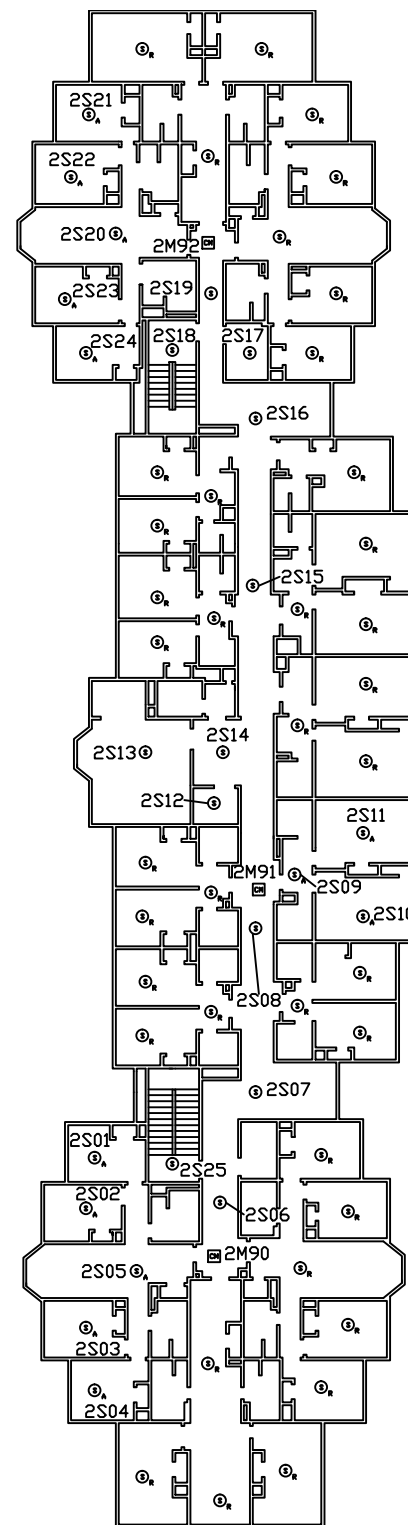

3RD FLOOR