



# FIRST FLOOR

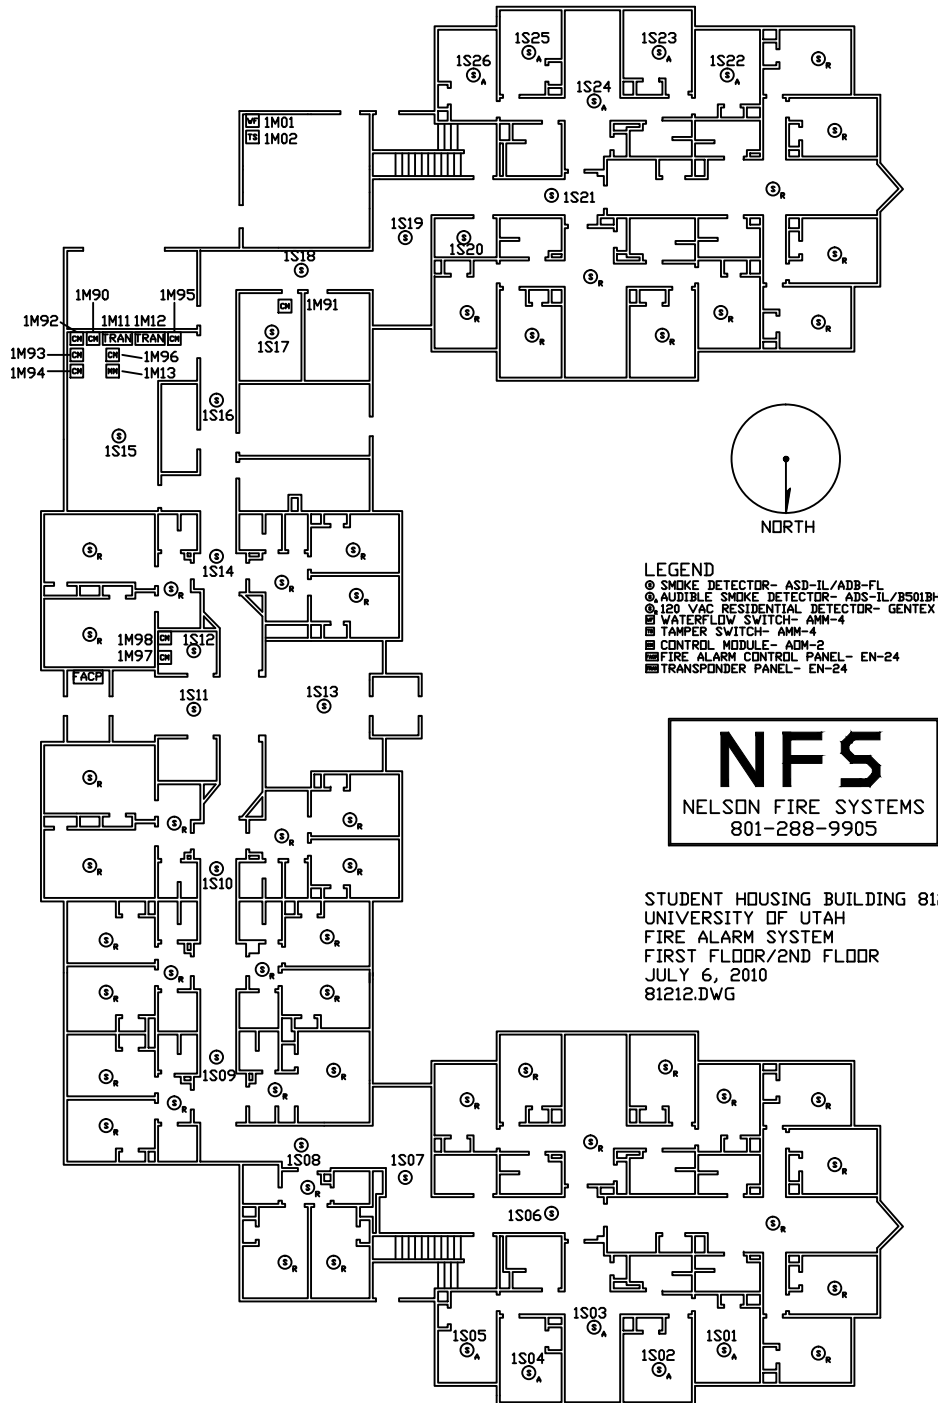

# SECOND FLOOR


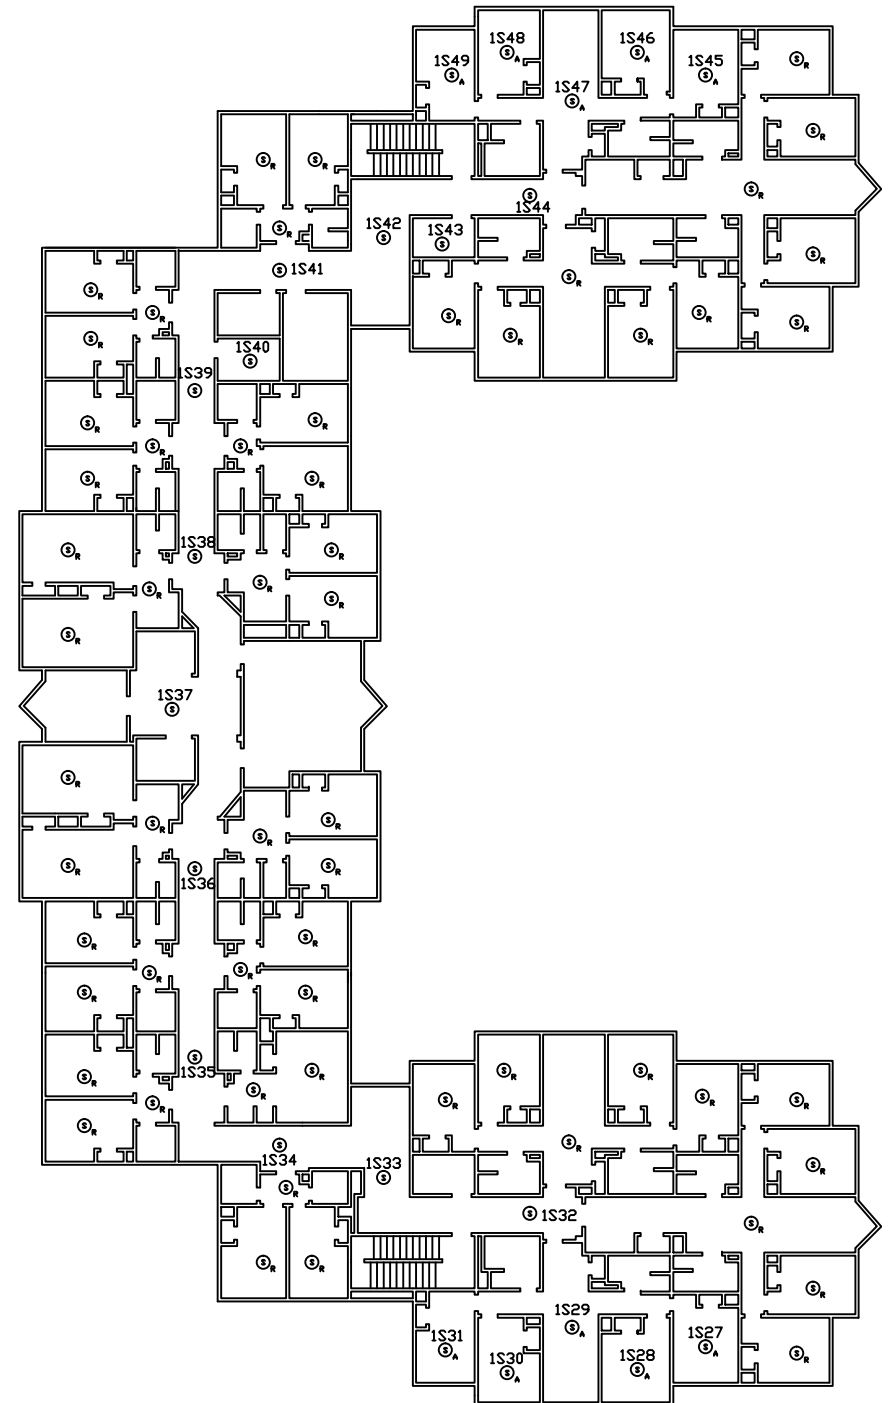


**NFS**

NELSON FIRE SYSTEMS  
801-288-9905

STUDENT HOUSING BUILDING 812  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
FIRST FLOOR/2ND FLOOR  
JULY 6, 2010  
81212.DWG

# THIRD FLOOR

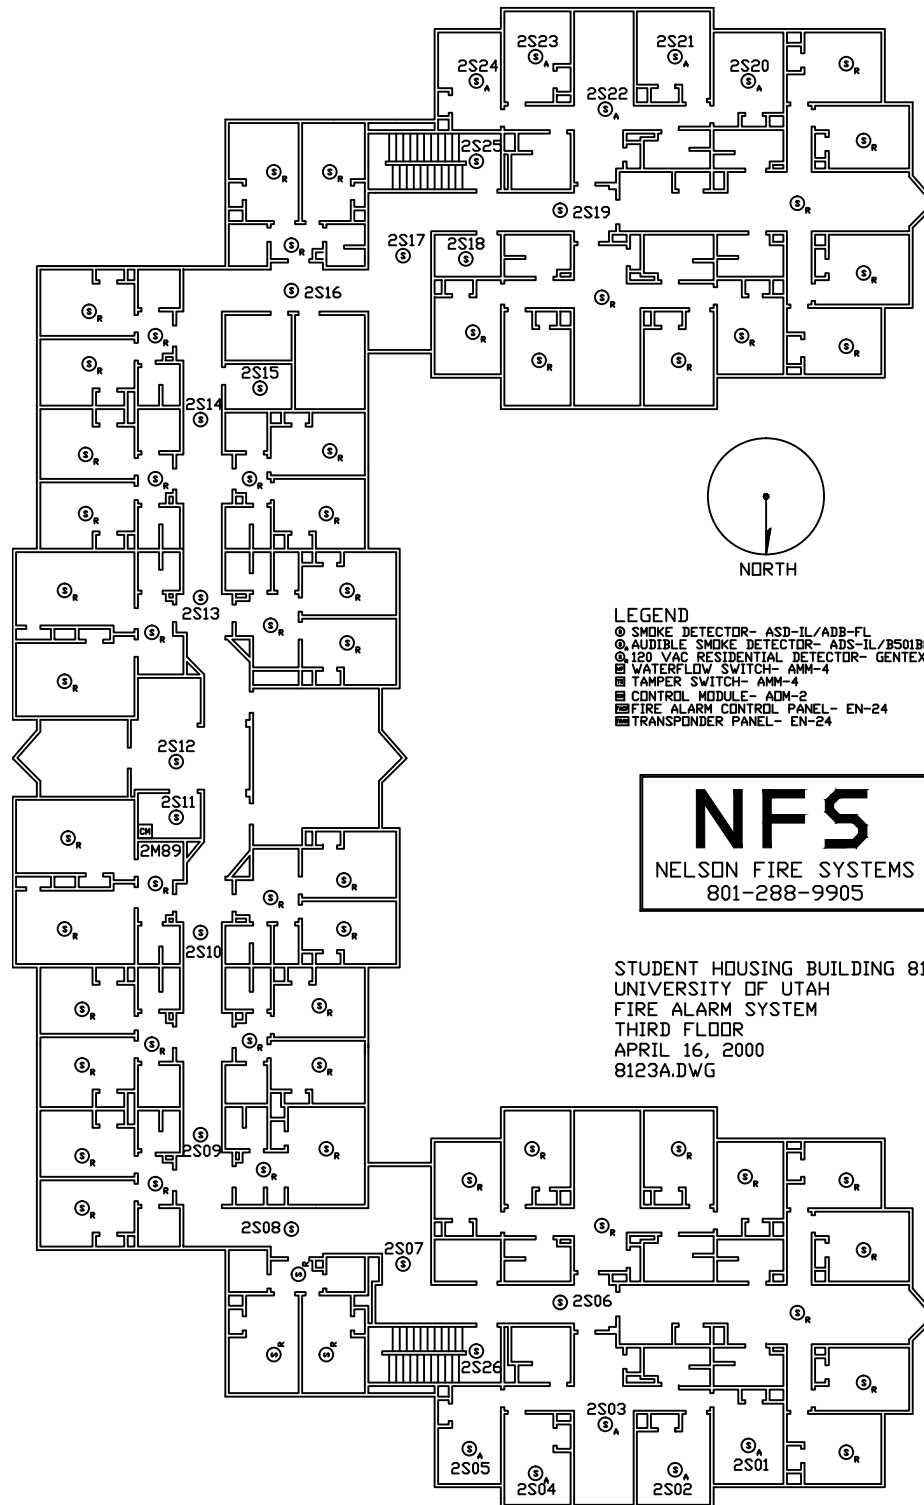

## LEGEND

- ① SMOKE DETECTOR- ASD-IL/ADB-FL
- ② AUDIBLE SMOKE DETECTOR- ADS-IL/B501BH
- ③ 120 VAC RESIDENTIAL DETECTOR- GENTEX
- ④ WATERFLOW SWITCH- AMM-4
- ⑤ TAMPER SWITCH- AMM-4
- ⑥ CONTROL MODULE- ADM-2
- ⑦ FIRE ALARM CONTROL PANEL- EN-24
- ⑧ TRANSPONDER PANEL- EN-24



STUDENT HOUSING BUILDING 812  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
THIRD FLOOR  
APRIL 16, 2000  
8123A.DWG