



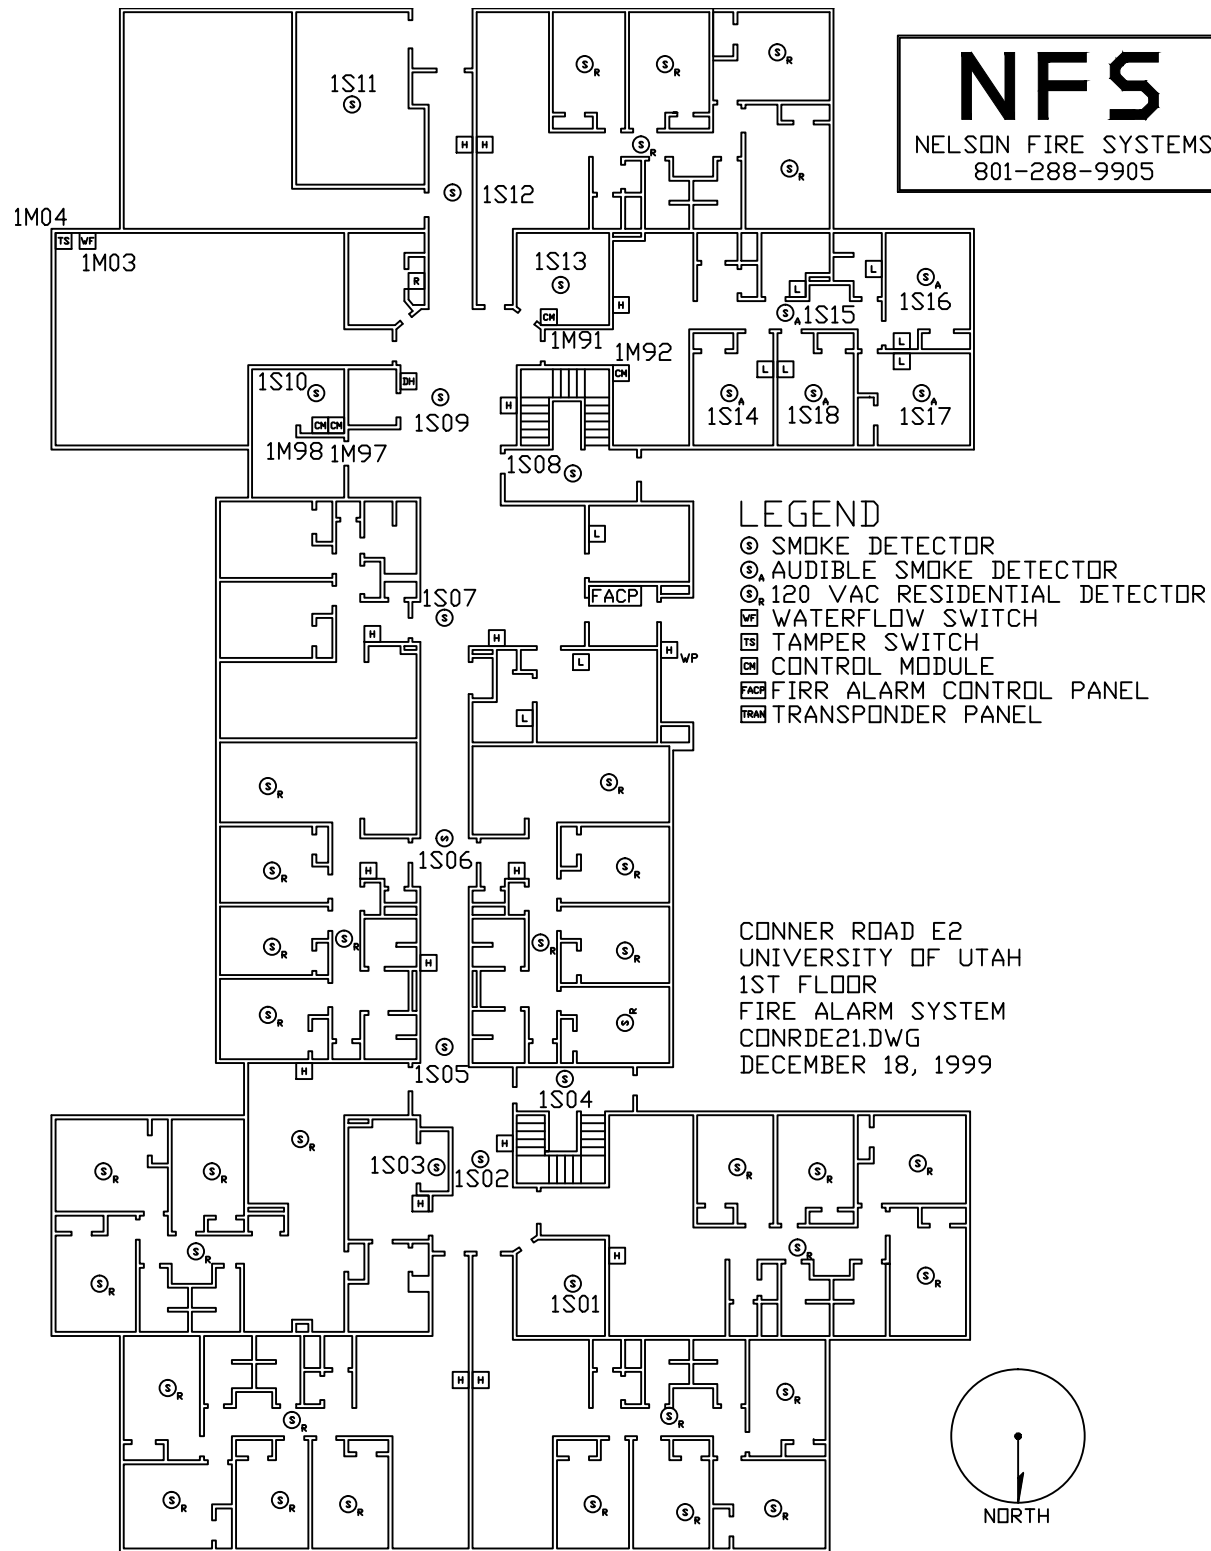

SECOND FLOOR

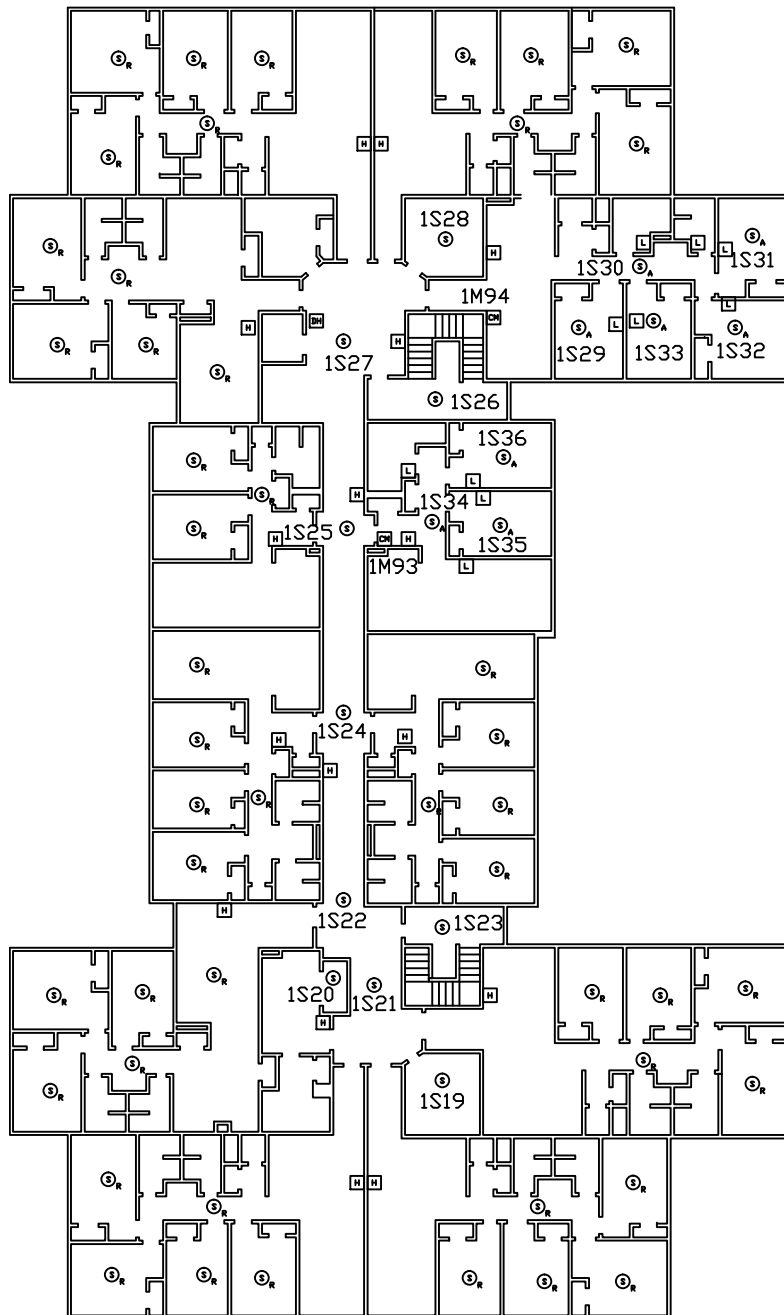

LEGEND

- ⊙ SMOKE DETECTOR
- ⊙_A AUDIBLE SMOKE DETECTOR
- ⊙_{120V} 120 VAC RESIDENTIAL DETECTOR
- WF WATERFLOW SWITCH
- TS TAMPER SWITCH
- CM CONTROL MODULE
- FACP FIRE ALARM CONTROL PANEL
- TRM TRANSPONDER PANEL

CONNOR ROAD E2
UNIVERSITY OF UTAH
2ND & 3RD FLOOR
FIRE ALARM SYSTEM
CRDE223.DWG
DECEMBER 18, 1999



THIRD FLOOR

