


FIRST FLOOR

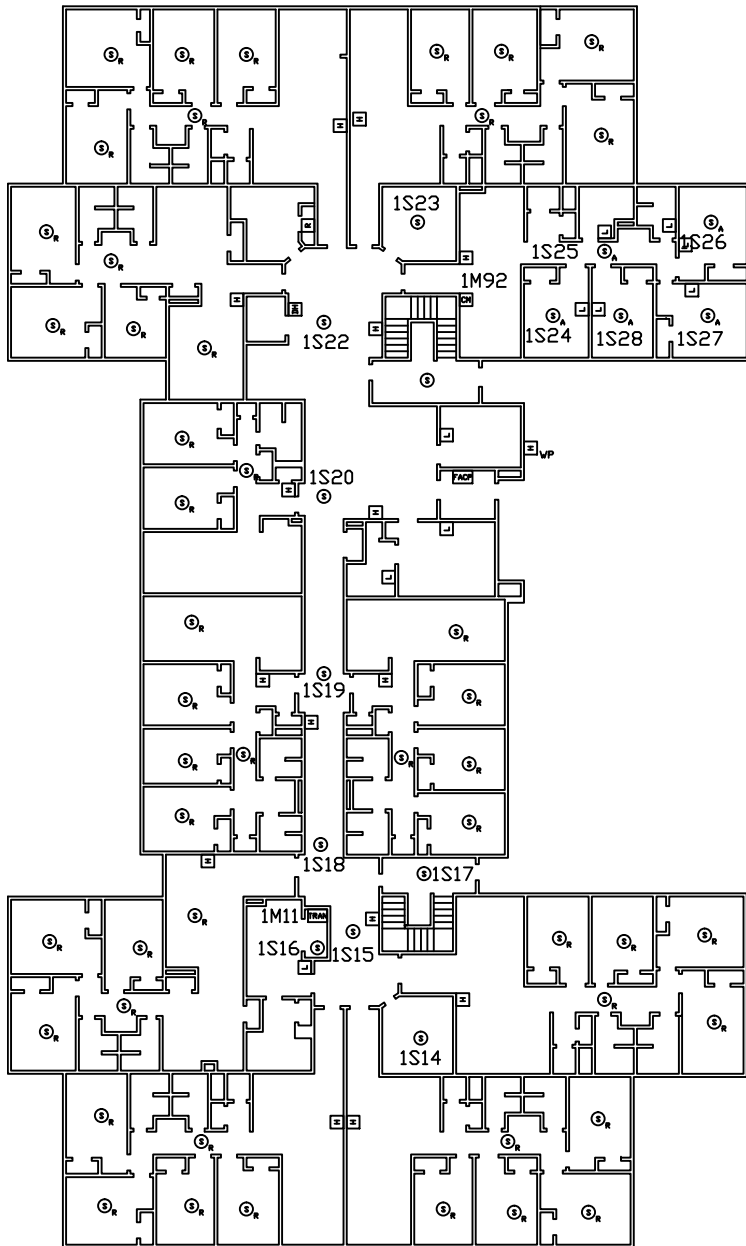

LEGEND


- ⊙ SMOKE DETECTOR
- ⊙ AUDIBLE SMOKE DETECTOR
- ⊙ 120 VAC RESIDENTIAL DETECTOR
- ⊙ WATERFLOW SWITCH
- ⊙ TAMPER SWITCH
- ⊙ PRESSURE SWITCH
- ⊙ LOW AIR SWITCH
- ⊙ MONITOR MODULE
- ⊙ CONTROL MODULE
- FACP FIRE ALARM CONTROL PANEL- EN-4
- TRAN TRANSPONDER PANEL- EN-24

NFS


NELSON FIRE SYSTEMS
801-288-9905

BUILDING 822
1ST & 2ND FLOOR
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
FEBRUARY 8, 2000
822-1.DWG

SECOND FLOOR

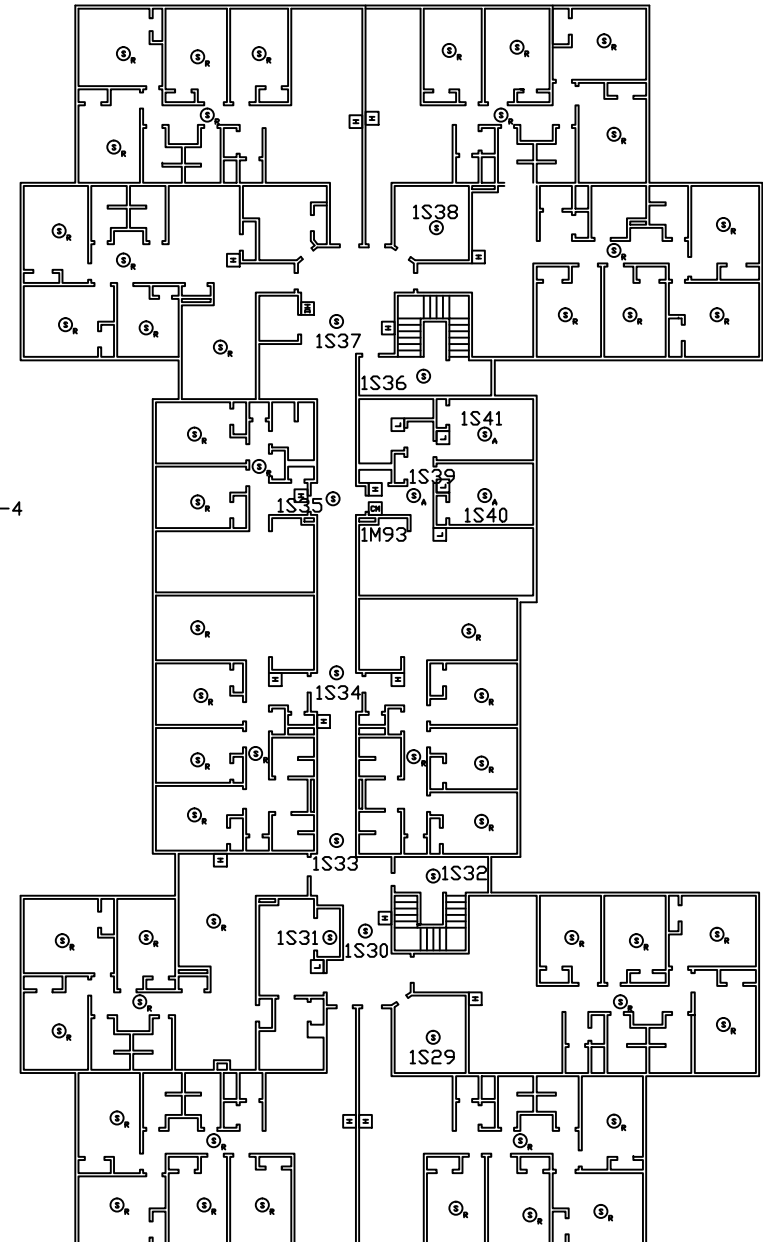

BASEMENT

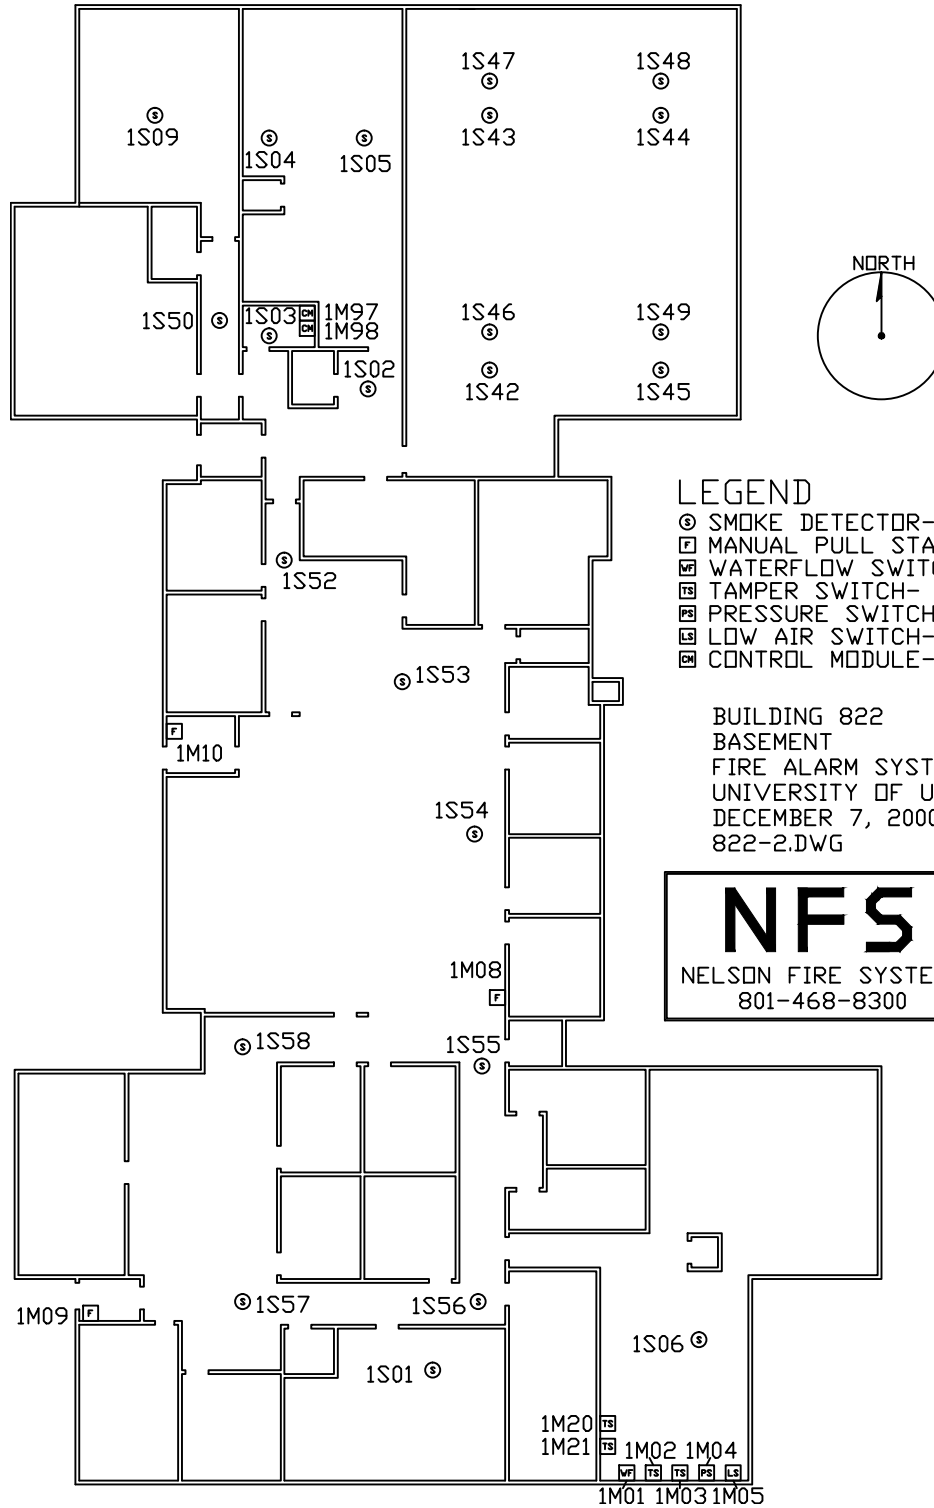

LEGEND

- ⊙ SMOKE DETECTOR- ASD-IL/ADB-FL
- MANUAL PULL STATION- MS-2/AMM-2
- ▣ WATERFLOW SWITCH- AMM-4
- ▤ TAMPER SWITCH- AMM-4
- ▥ PRESSURE SWITCH- AMM-4
- ▧ LOW AIR SWITCH- AMM-4
- ▨ CONTROL MODULE- ADM-2

BUILDING 822
BASEMENT
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
DECEMBER 7, 2000
822-2.DWG

NFS

NELSON FIRE SYSTEMS
801-468-8300