



1ST FLOOR

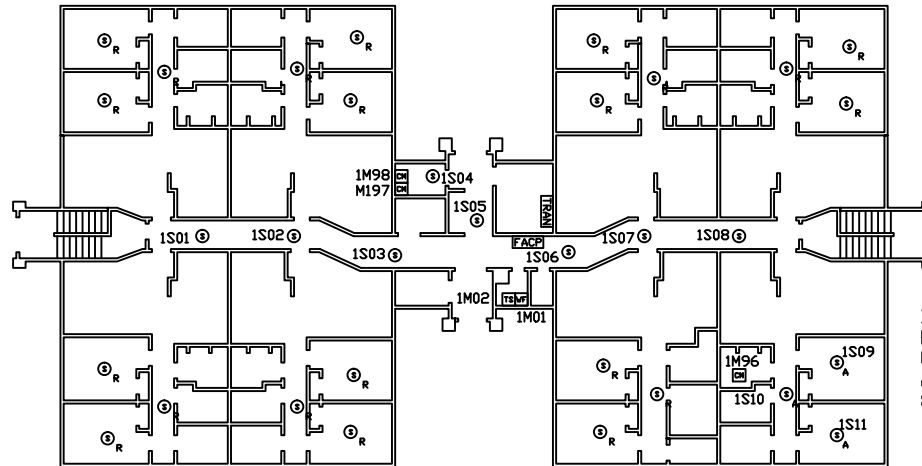

BUILDING 825
FORT DOUGLAS STUDENT HOUSING
UNIVERSITY OF UTAH
AUGUST 31, 1999
825.DWG

SECOND FLOOR

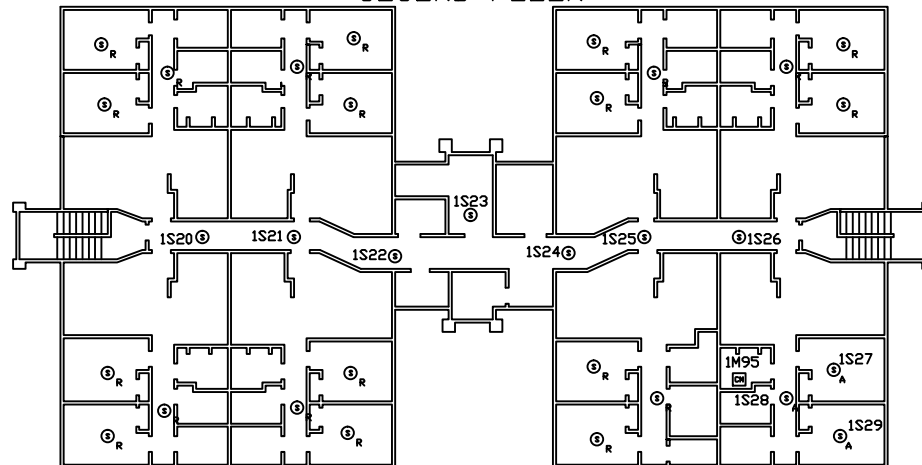

LEGEND

- Ⓐ AUDIBLE SMOKE DETECTOR
- Ⓡ RESIDENTIAL SMOKE DETECTOR
- Ⓜ MANUAL PULL STATION
- Ⓦ WATERFLOW SWITCH
- Ⓣ TAMPER SWITCH
- Ⓢ STROBE/HORN
- Ⓢ STROBE
- Ⓜ MONITOR MODULE
- Ⓜ CONTROL MODULE
- Ⓢ RELAY
- Ⓜ FIRE ALARM CONTROL PANEL
- Ⓜ TRANSPONDER PANEL

NFS

NELSON FIRE SYSTEMS
801-288-9905

THIRD FLOOR

