


[illegible]

## MEZZANINE

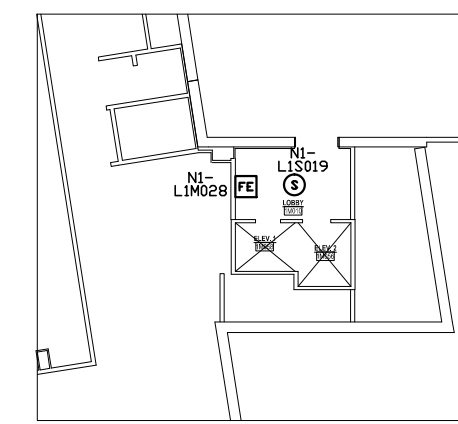

| DEVICE LEGEND                                                                       |                          |
|-------------------------------------------------------------------------------------|--------------------------|
| SYMBOL                                                                              | DESCRIPTION              |
|  | SMOKE DETECTOR           |
|  | HEAT DETECTOR            |
|  | MANUAL PULL STATION      |
|  | DUCT DETECTOR            |
|  | TAMPER SWITCH            |
|  | WATERFLOW SWITCH         |
|  | PRESSURE SWITCH          |
|  | LOW AIR SWITCH           |
|  | ENGAGE FIRE EXTINGUISHER |
|  | MONITOR MODULE           |
|  | CONTROL MODULE           |
|  | REMOTE ANNUNCIATOR       |
|  | TRANSPONDER PANEL        |
|  | FIRE ALARM CONTROL PANEL |

NOTE:  
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE, (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS.  
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH  
SCHOOL OF DENTISTRY  
BASEMENT & LEVEL 1  
530 SOUTH WAKARA WAY  
SALT LAKE CITY, UTAH 84108  
FIRE ALARM SYSTEM



**NFS**

NELSON FIRE SYSTEMS  
801-468-8300

|               |                   |
|---------------|-------------------|
| DRAWN BY:     | AK                |
| DESIGNED BY:  | XXXX              |
| APPROVED BY:  | DPS               |
| DATE:         | 1/26/15           |
| SCALE:        | (ARCH D) 1/16"=1' |
| PROJECT NO:   | XXXX              |
| REV NO:       | XXXX              |
| DRAWING NAME: | DENTISTRY I.DWG   |


FIRE ALARM SYSTEM  
BASEMENT & LEVEL I  
NUMBERS

PAGE:  
FA-I-03

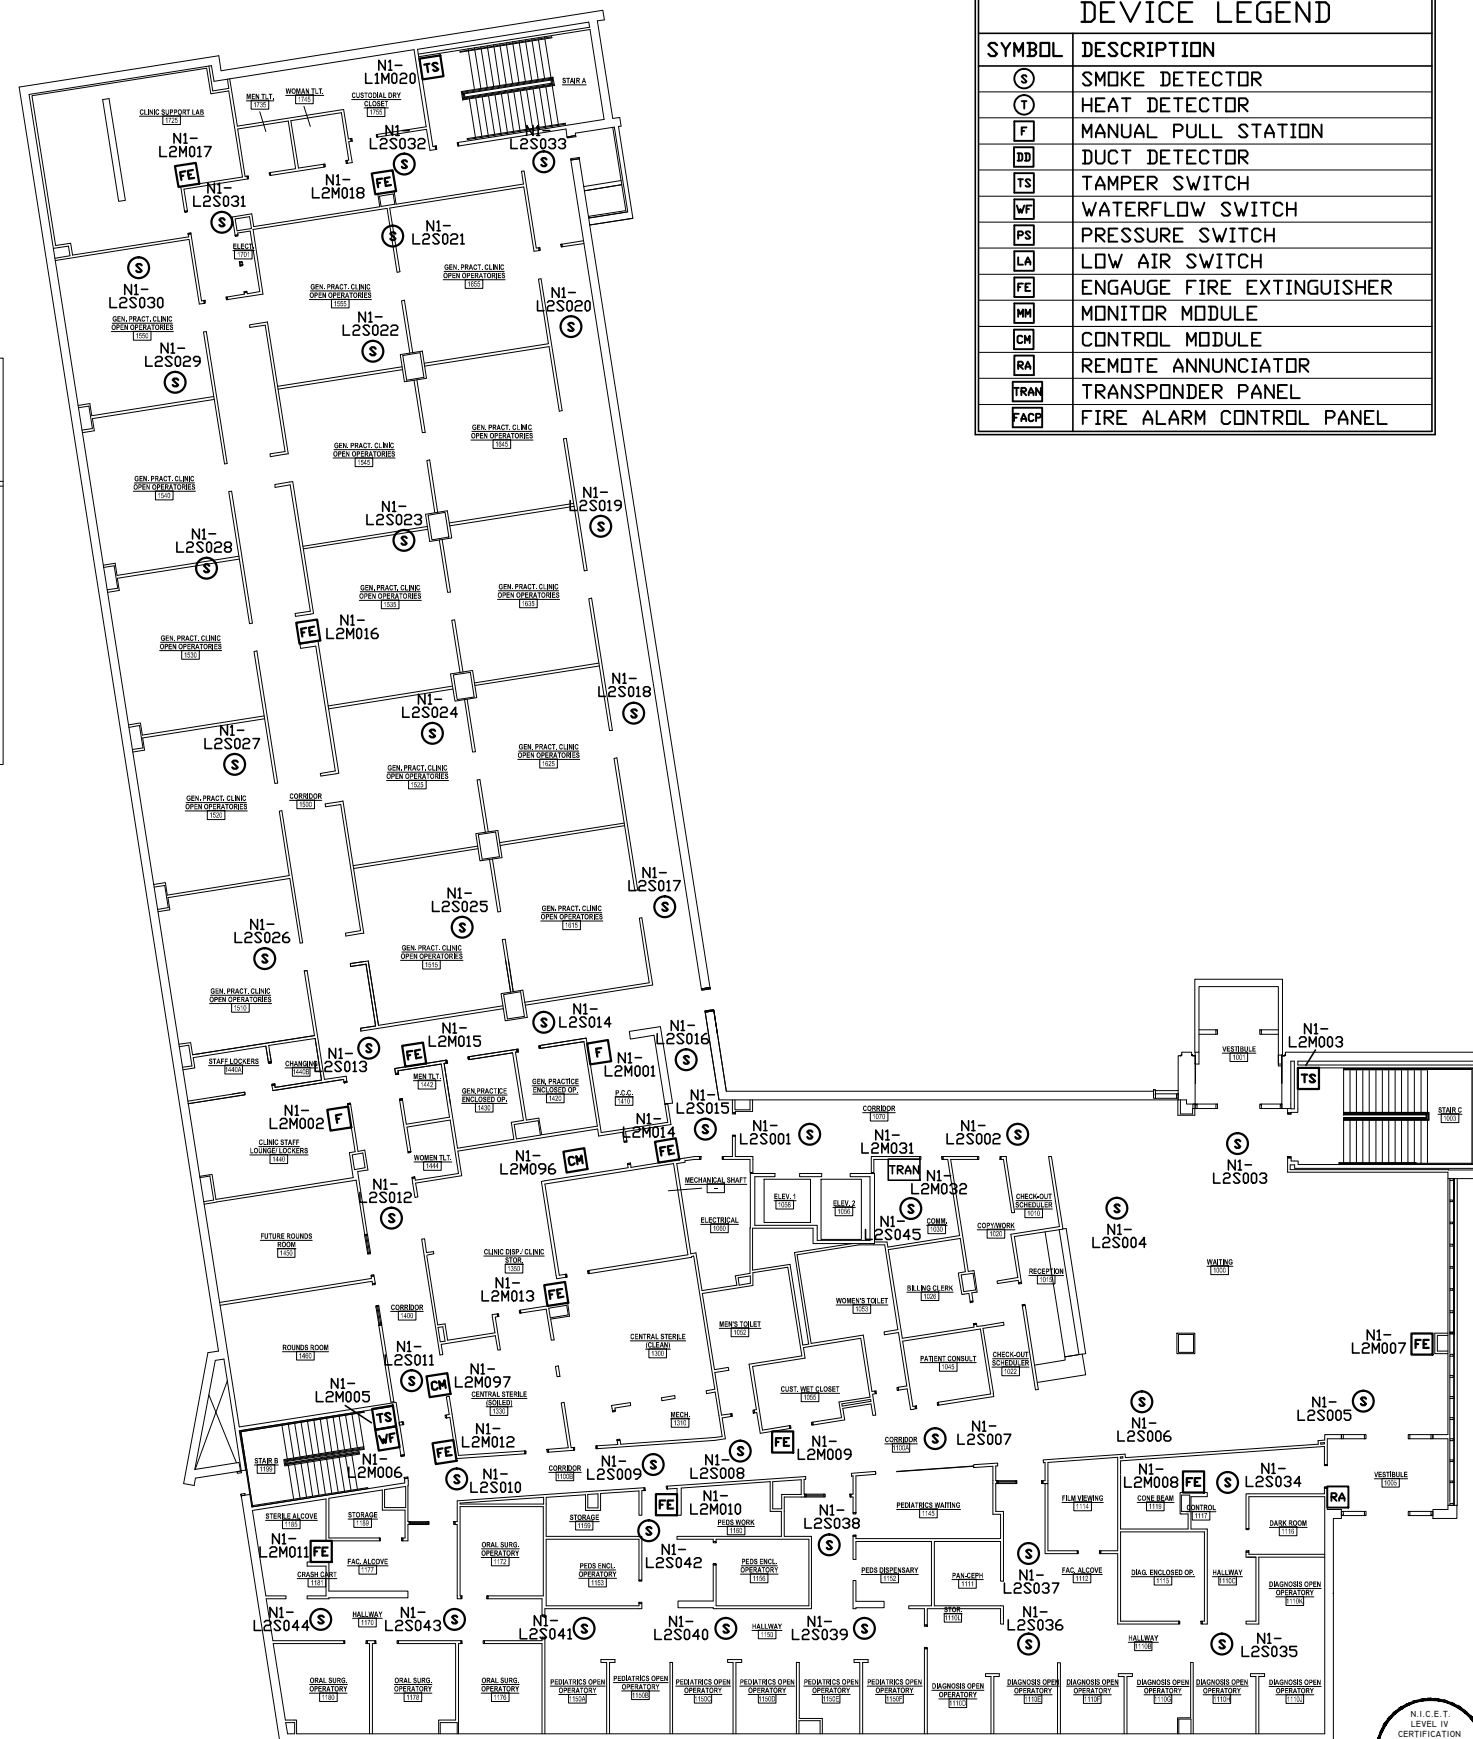


N.I.C.E.T.  
LEVEL IV  
CERTIFICATION  
FIRE ALARM SYSTEMS  
DONNY SCHULTZ  
#106396


LEVEL 2



LEVEL 3

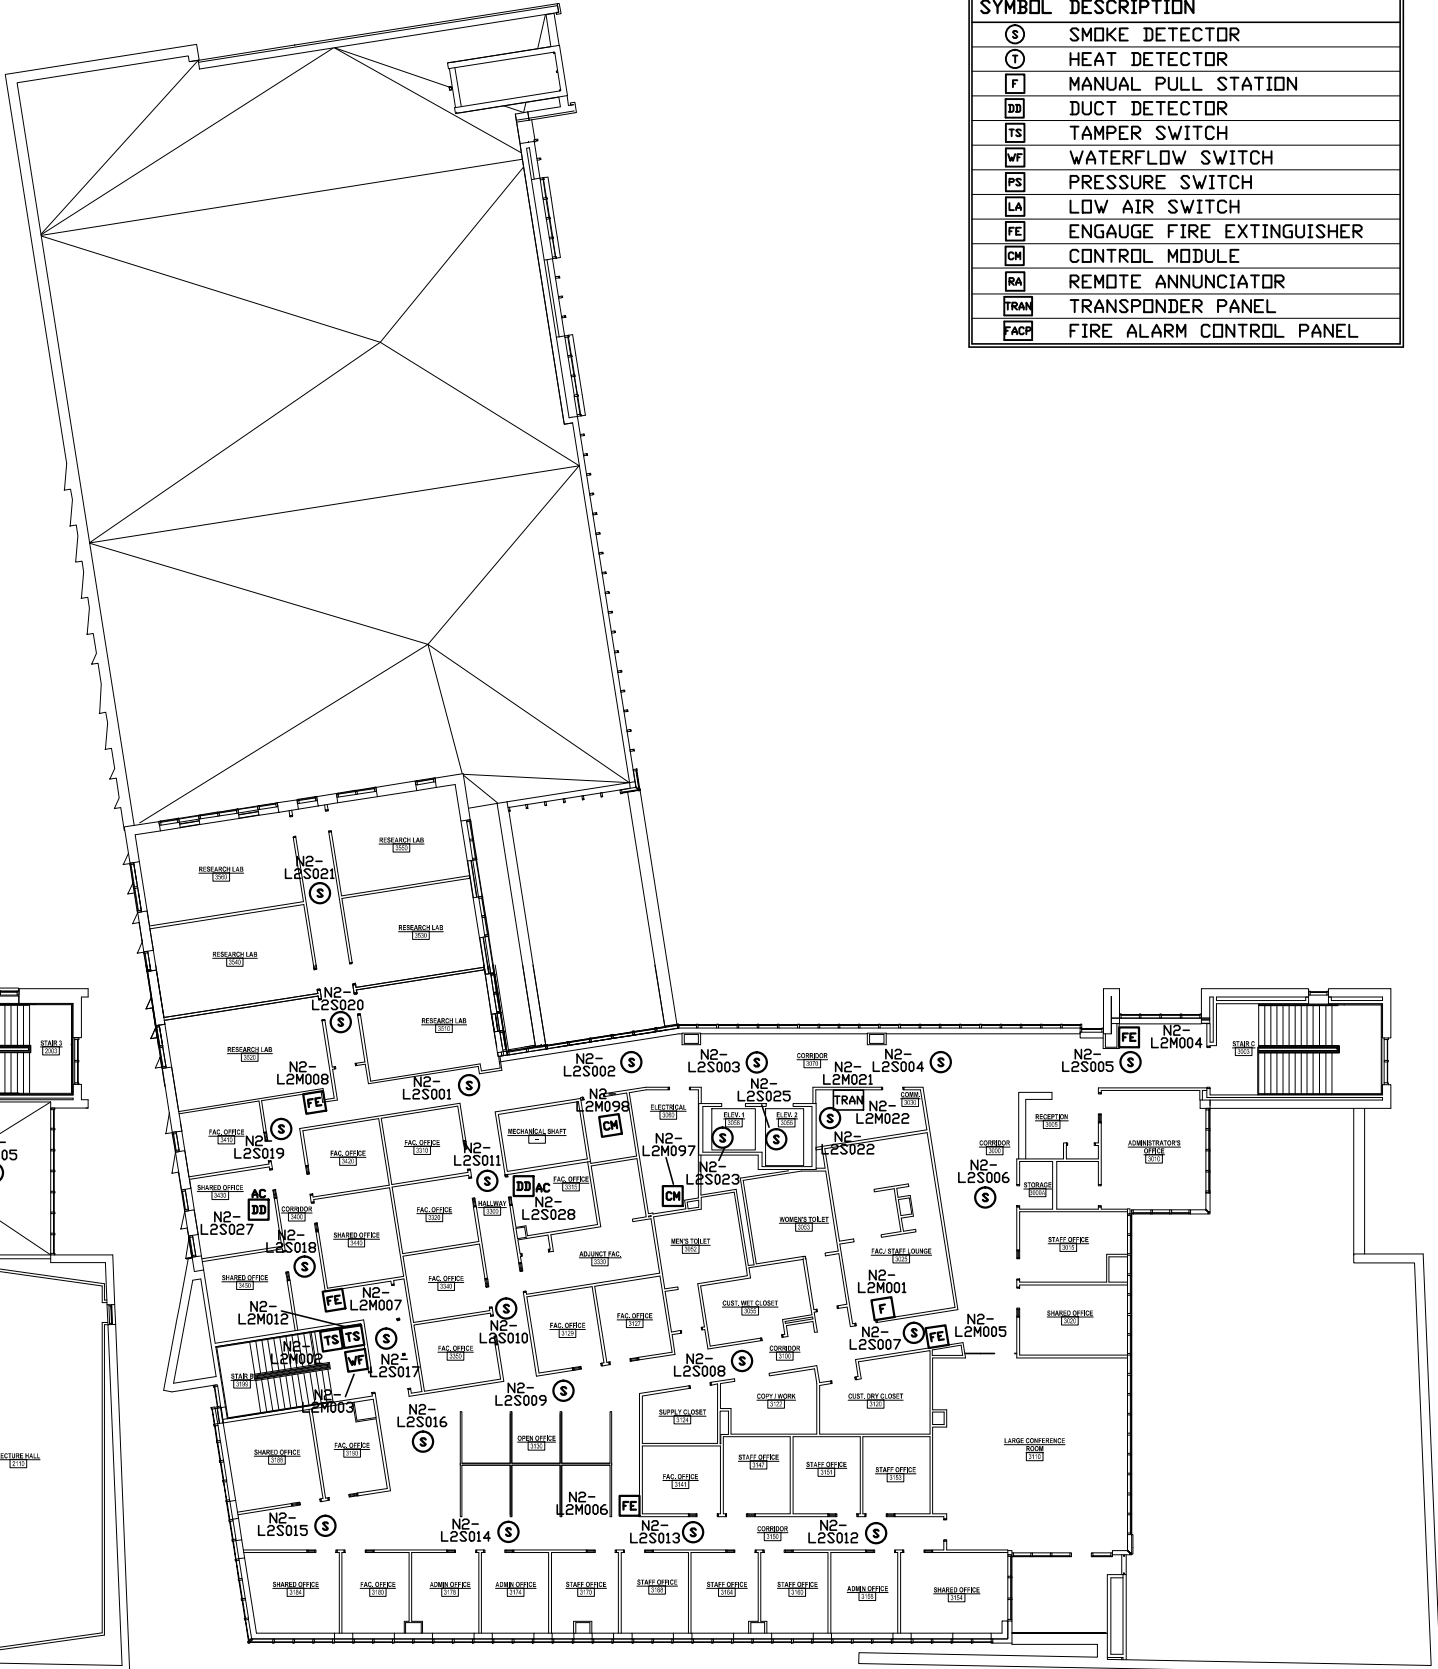

| DEVICE LEGEND |                          |
|---------------|--------------------------|
| SYMBOL        | DESCRIPTION              |
|               | SMOKE DETECTOR           |
|               | HEAT DETECTOR            |
|               | MANUAL PULL STATION      |
|               | DUCT DETECTOR            |
|               | TAMPER SWITCH            |
|               | WATERFLOW SWITCH         |
|               | PRESSURE SWITCH          |
|               | LOW AIR SWITCH           |
|               | ENGAGE FIRE EXTINGUISHER |
|               | CONTROL MODULE           |
|               | REMOTE ANNUNCIATOR       |
|               | TRANSPONDER PANEL        |
|               | FIRE ALARM CONTROL PANEL |



NOTE:  
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH  
SCHOOL OF DENTISTRY  
LEVEL 2 & LEVEL 3  
530 SOUTH WAKARA WAY  
SALT LAKE CITY, UTAH 84108  
FIRE ALARM SYSTEM

**NFS**  
NELSON FIRE SYSTEMS  
801-468-8300

DRAWN BY: AK  
DESIGNED BY: XXXX  
APPROVED BY: DPS  
DATE: 11/17/14  
SCALE: (ARCH D) 1/16"=1'  
PROJECT NO: XXXX  
REV NO: XXXX  
DRAWING NAME: DENTISTRY 2.DWG

FIRE ALARM SYSTEM  
LEVELS 2 & 3  
NUMBERS

PAGE:  
FA-2-03

