

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓜ	DUCT DETECTOR
Ⓜ	MANUAL PULL STATION
Ⓜ	CONTROL MODULE
Ⓜ	TAMPER SWITCH
Ⓜ	WATERFLOW SWITCH
Ⓜ	FIRE ALARM CONTROL PANEL
Ⓜ	TRANSPONDER PANEL
Ⓜ	RADIONICS MONITORING PANEL


ADDRESS LABEL CLARIFICATION

ADDRESSABLE LOOP NUMBER
SENSOR ('M' MONITOR)
DEVICE NUMBER

IS01



NOTES: DRAWINGS ARE BASED ON THE PROJECT ARCHITECT'S (ARCHITECT'S) PLANS AND SPECIFICATIONS. THE ARCHITECT'S PLANS AND SPECIFICATIONS SHALL BE THE FINAL AUTHORITY FOR THE PROJECT. THE ARCHITECT'S PLANS AND SPECIFICATIONS SHALL BE THE FINAL AUTHORITY FOR THE PROJECT. THE ARCHITECT'S PLANS AND SPECIFICATIONS SHALL BE THE FINAL AUTHORITY FOR THE PROJECT.

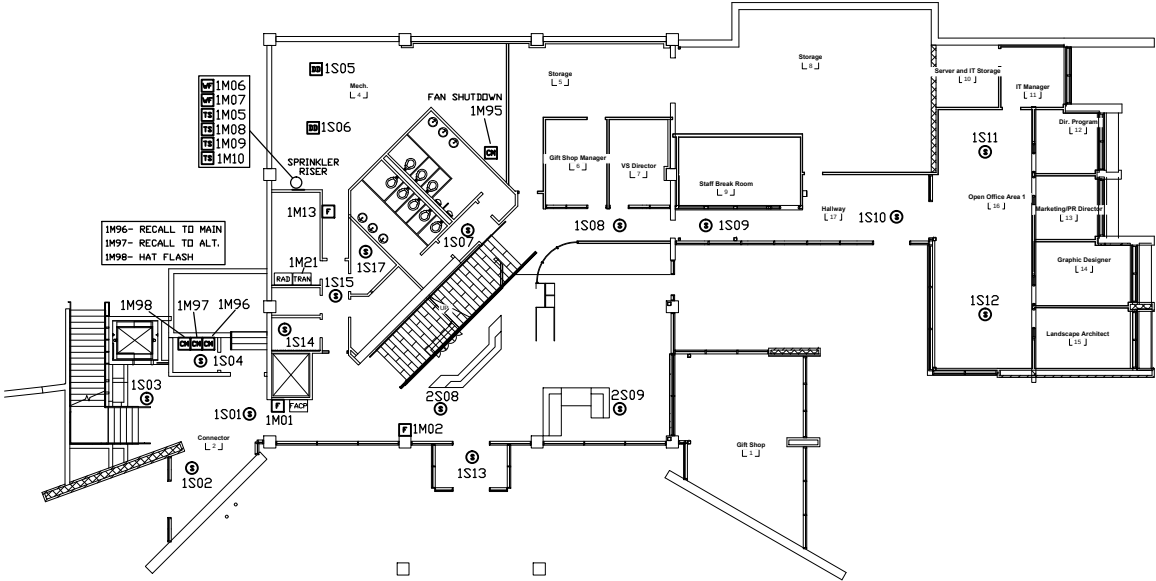

N.I.C.E.T.
LEVEL IV
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#001306

NFS
NELSON FIRE SYSTEMS
801-468-8300



DRAWN BY: AN
DESIGNED BY: XXXX
CHECKED BY: DS
DATE: 1/3/12
SCALE: 1/8"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME: RED BUTTE ROSE HOUSE MAIN.DWG

FIRE ALARM SYSTEM
NUMBERS

PAGE: FA-1-03

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	HEAT DETECTOR
DD	DUCT DETECTOR
F	MANUAL PULL STATION
CM	CONTROL MODULE
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
RAD	RADIONICS MONITORING PANEL

ADDRESS LABEL CLARIFICATION

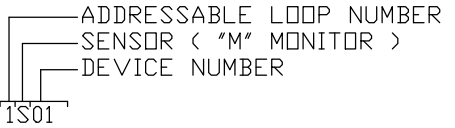

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


RED BUTTE GARDEN & ARBORETUM
VISITOR CENTER
UPPER LEVEL
UNIVERSITY OF UTAH

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	XXXX
CHECKED BY:	DS
DATE:	10/18/2010
SCALE:	1/8"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	RED BUTTE UPPER.DWG

FIRE ALARM SYSTEM
NUMBERS

PAGE:
FA-2-03

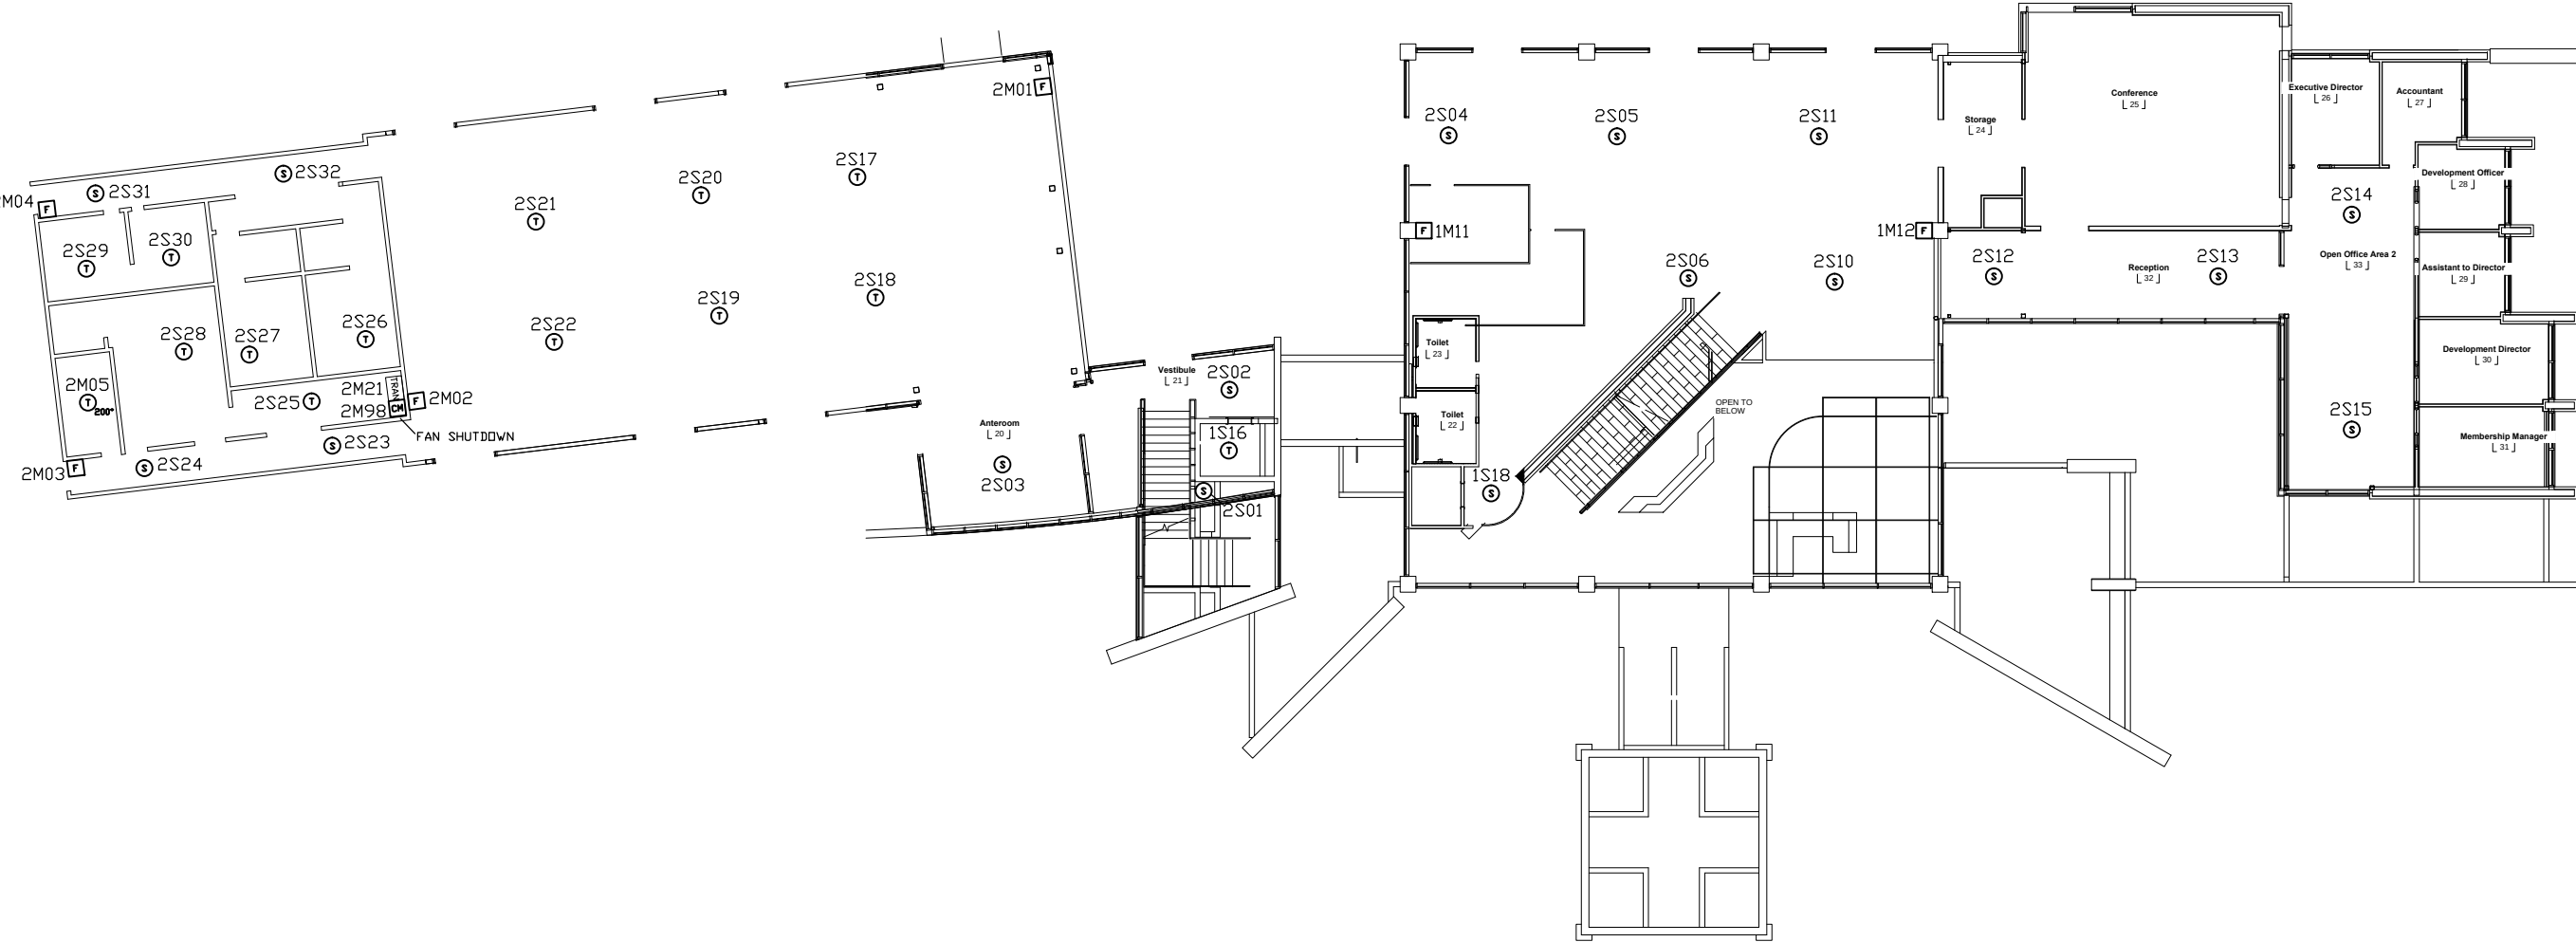

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396