

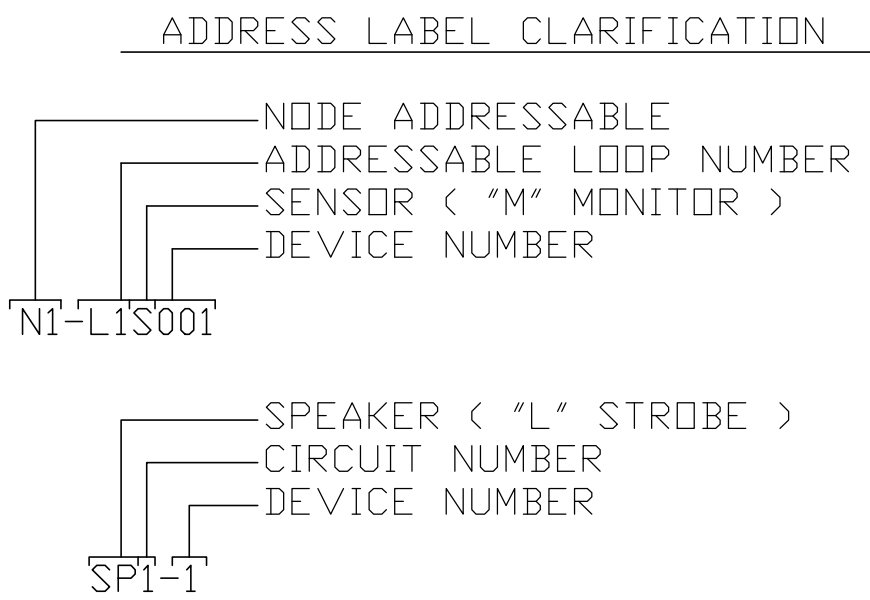


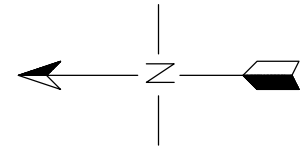

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
MM	MONITOR MODULE
CM	CONTROL MODULE
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FCC	FIRE COMMAND CENTER PANEL
SCP	SMOKE CONTROL PANEL
MDN	FIRE ALARM MONITORING PANEL
ASD	VESDA AIR SAMPLING DETECTOR

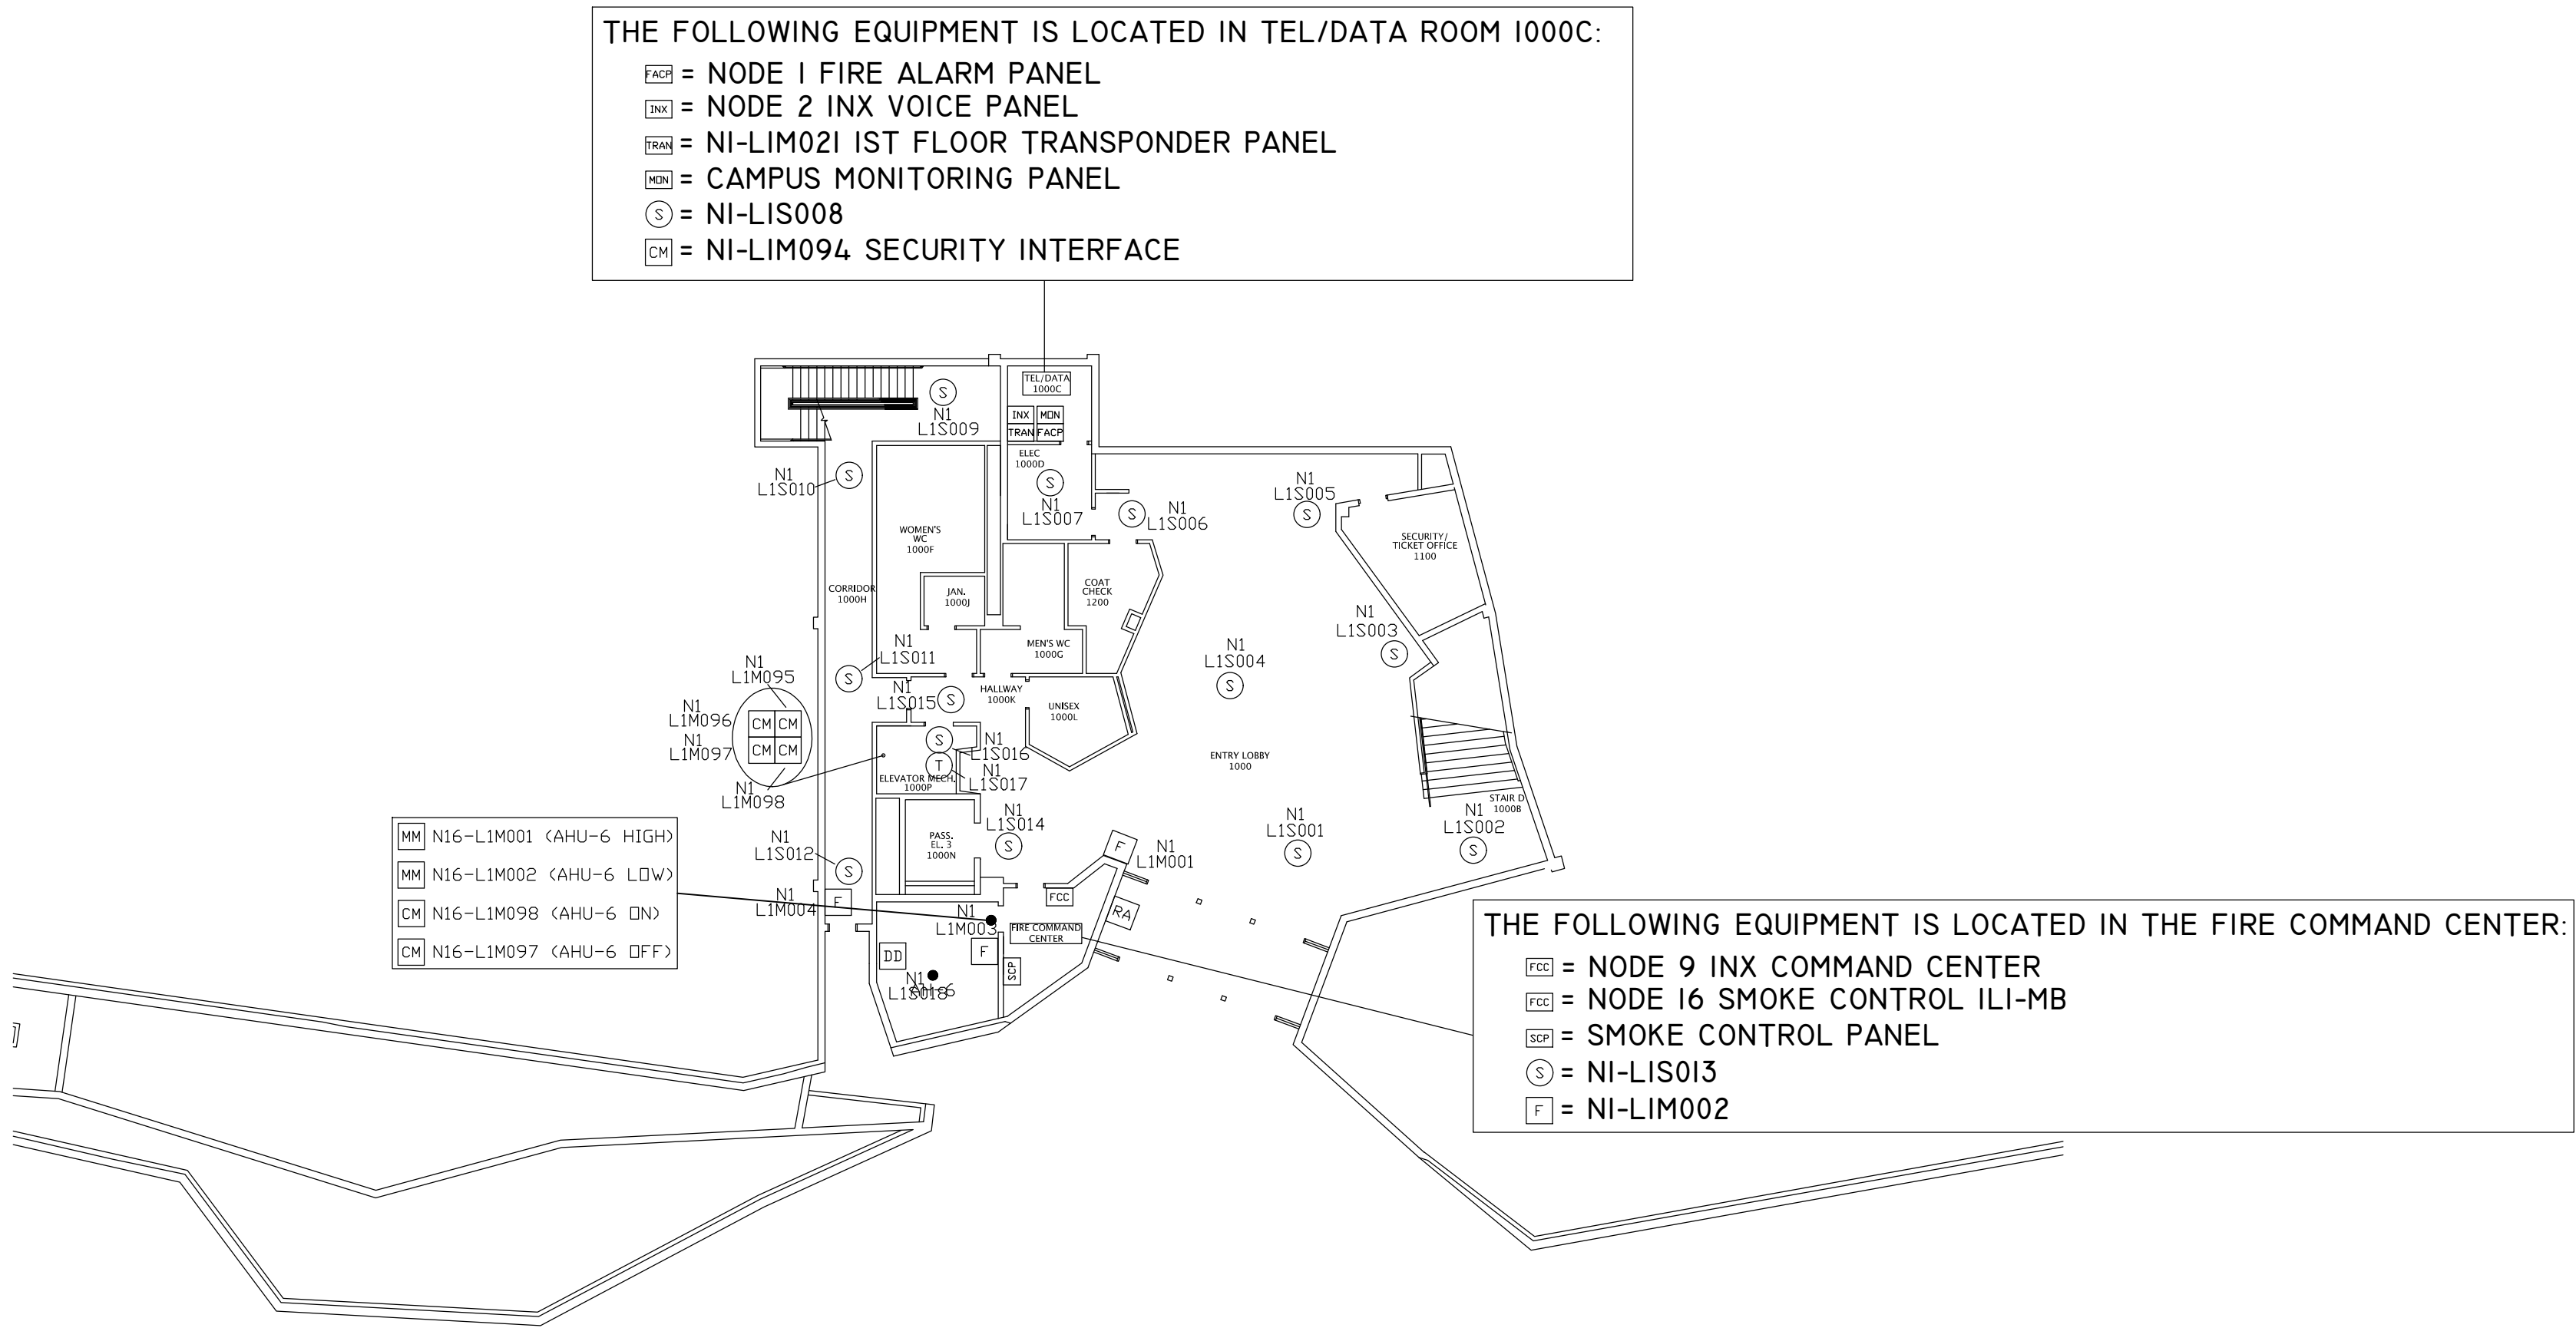

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL I
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
LEVEL I.DWG


FIRE ALARM SYSTEM

SMOKE CONTROL DEVICE
DEVI



PAGE:

NFS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

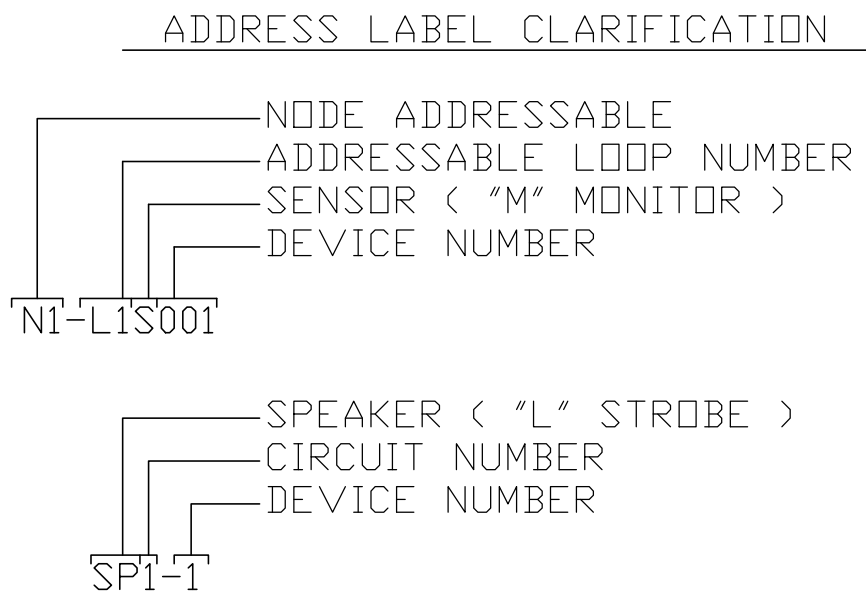

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
Ⓜ	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
MM	MONITOR MODULE
CM	CONTROL MODULE
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FCC	FIRE COMMAND CENTER PANEL
SCP	SMOKE CONTROL PANEL
MDN	FIRE ALARM MONITORING PANEL
ASD	VESDA AIR SAMPLING DETECTOR

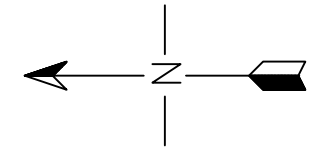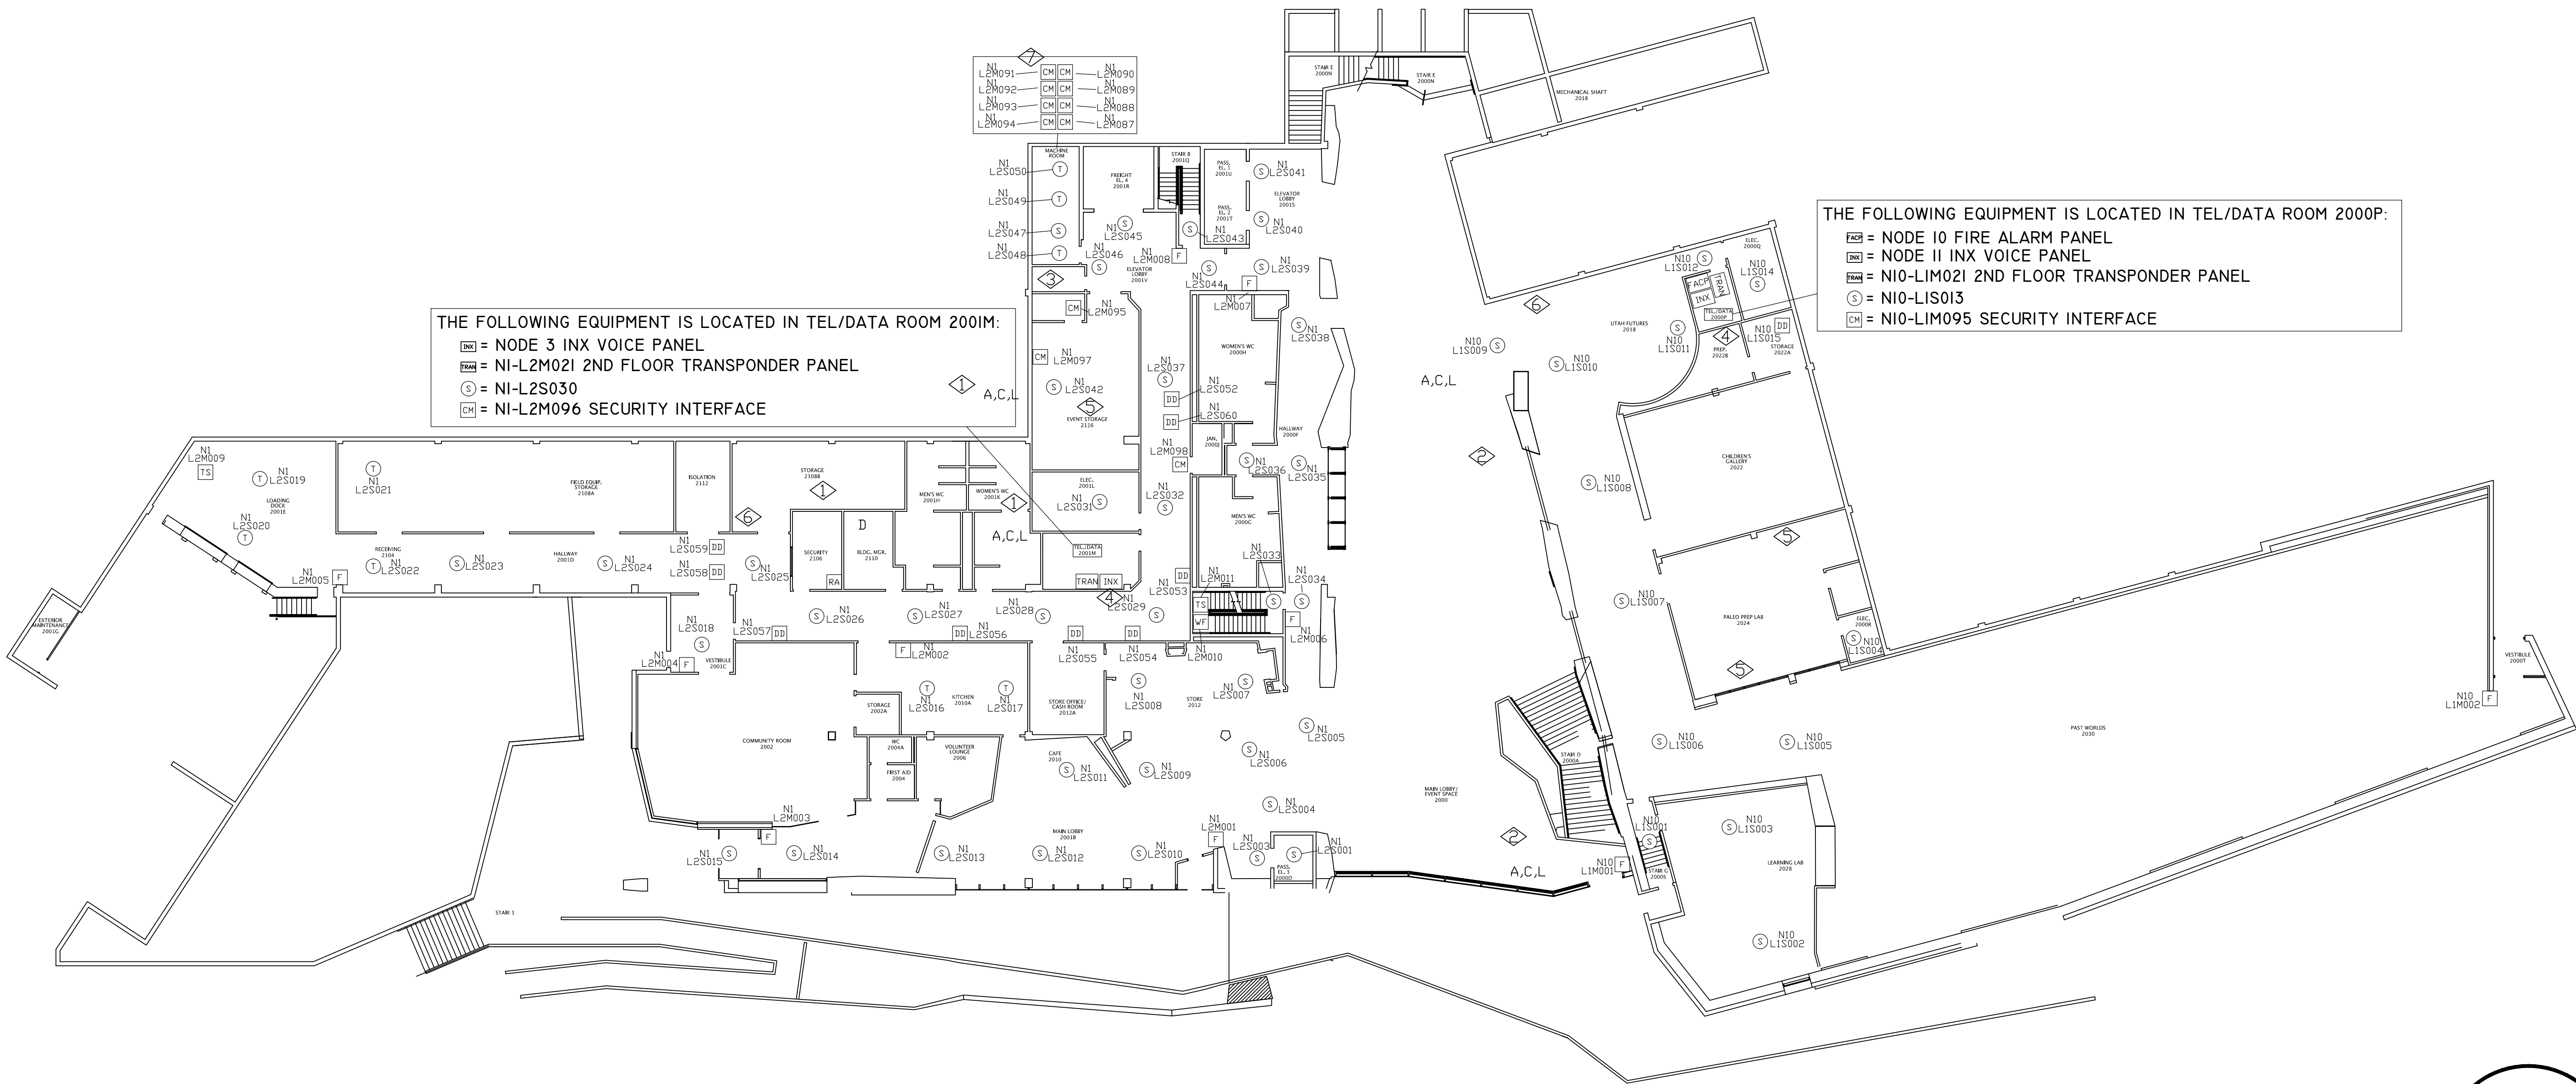

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 2
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJC
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
LEVEL 2.DWG


FIRE ALARM SYSTEM

FIRE ALARM DEVICE
NUMBERS



PAGE:

NFS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

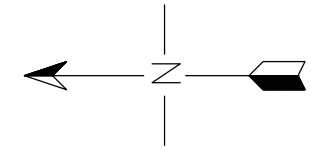

ADDRESS LABEL CLARIFICATION

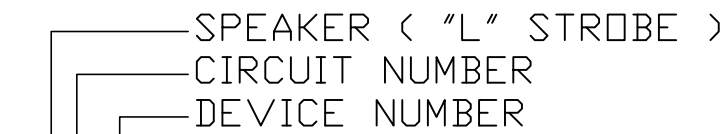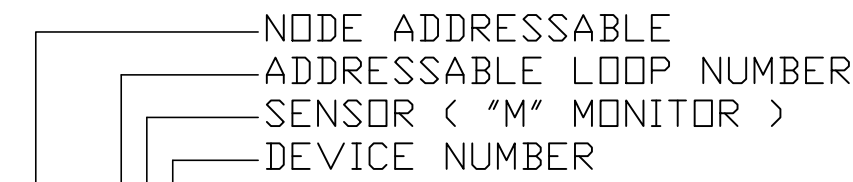

DEVICE LEGEND

SYMBOL	DESCRIPTION
S	SMOKE DETECTOR
T	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
MM	MONITOR MODULE
CM	CONTROL MODULE
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FCC	FIRE COMMAND CENTER PANEL
SCP	SMOKE CONTROL PANEL
MDN	FIRE ALARM MONITORING PANEL
ASD	VESDA AIR SAMPLING DETECTOR

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM 3000L:

- FACP = NODE 4 FIRE ALARM PANEL
MM = NODE 5 INX VOICE PANEL
MM = N4-LIM021 3RD FLOOR TRANSPONDER PANEL
S = N4-LIS034
CM = N4-LIM094 SECURITY INTERFACE

THE FOLLOWING DEVICES ARE LOCATED IN TEL/DATA ROOM 3000L:

MM N16-L2M015 (SMD-06 OPEN)	MM N16-L2M017 (SMF-06 HIGH)
MM N16-L2M016 (SMD-06 CLOSED)	MM N16-L2M018 (SMF-06 LOW)
CM N16-L2M088 (SMD-06 OPEN)	CM N16-L2M087 (SMF-06 DN)
MM N16-L2M013 (SMD-05 OPEN)	MM N16-L2M021 (SMF-05 HIGH)
MM N16-L2M014 (SMD-05 CLOSED)	MM N16-L2M022 (SMF-05 LOW)
CM N16-L2M089 (SMD-05 OPEN)	CM N16-L2M083 (SMF-05 DN)
MM N16-L2M011 (SMD-04 OPEN)	MM N16-L2M019 (SMF-04 HIGH)
MM N16-L2M012 (SMD-04 CLOSED)	MM N16-L2M020 (SMF-04 LOW)
CM N16-L2M090 (SMD-04 OPEN)	CM N16-L2M085 (SMF-04 DN)
MM N16-L2M007 (SMD-03 OPEN)	MM N16-L2M029 (SMF-03 HIGH)
MM N16-L2M008 (SMD-03 CLOSED)	MM N16-L2M030 (SMF-03 LOW)
CM N16-L2M094 (SMD-03 OPEN)	CM N16-L2M078 (SMF-03 DN)
MM N16-L2M005 (SMD-02 OPEN)	MM N16-L2M077 (SMF-03 OFF)
MM N16-L2M006 (SMD-02 CLOSED)	MM N16-L2M009 (SMF-02 HIGH)
CM N16-L2M095 (SMD-02 OPEN)	MM N16-L2M010 (SMF-02 LOW)
MM N16-L2M003 (SMD-01 OPEN)	CM N16-L2M092 (SMF-02 DN)
MM N16-L2M004 (SMD-01 CLOSED)	CM N16-L2M093 (SMF-02 OFF)
CM N16-L2M096 (SMD-01 OPEN)	MM N16-L2M001 (SMF-01 HIGH)
	MM N16-L2M002 (SMF-01 LOW)
	CM N16-L2M098 (SMF-01 DN)
	CM N16-L2M097 (SMF-01 OFF)

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM 3000L:

- MM = NODE 12 INX VOICE PANEL
TRAN = N10-L2M021 3RD FLOOR TRANSPONDER PANEL
= N10-L2S008
= N10-L2M095 SECURITY INTERFACE

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 3
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JGG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:

LEVEL 3.DWG

FIRE ALARM SYSTEM

FROM: 1.0001 TO: 1.0002
DEV: 1.0001

PAGE:

NFS



N.I.C.E.T.
LEVEL IV
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396

SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
ⓕ	MANUAL PULL STATION
ⓓⓓ	DUCT SMOKE DETECTOR
ⓈⓈ	SPEAKER/STROBE
ⓈⓈ ^{VP}	WEATHERPROOF SPEAKER/STROBE
ⓈⓈ ^C	CONCEAL SPEAKER/STROBE
ⓂⓂ	MONITOR MODULE
ⒸⓂ	CONTROL MODULE
Ⓡ	RELAY
Ⓡⓐ	REMOTE ANNUNCIATOR
ⓕⓐⒸⓕ	FIRE ALARM CONTROL PANEL
ⓉⓇⓐⓃ	TRANSPONDER PANEL
ⒻⒸⒸ	FIRE COMMAND CENTER PANEL
ⓈⒸⓅ	SMOKE CONTROL PANEL

SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	REMOTE ANNUNCIATOR	3 PAIR #14 TWISTED
E	SPEAKER CKT 1 / STROBE CKT 1,2,3	1 PAIR #14 TWISTED SHIELDED & 4 #14'S
F	SPEAKER CKT 2 / STROBE CKT 4	1 PAIR #14 TWISTED SHIELDED & 2 #14'S
G	SPEAKER CKT 3 / STROBE CKT 5	1 PAIR #14 TWISTED SHIELDED & 2 #14'S
H	SPEAKER CKT 4 / STROBE CKT 6,7	1 PAIR #14 TWISTED SHIELDED & 2 #14'S
I	SPEAKER CKT 5 / STROBE CKT 8,9,10	1 PAIR #14 TWISTED SHIELDED & 4 #14'S
J	120 VAC POWER WITH GROUND	3 #12'S

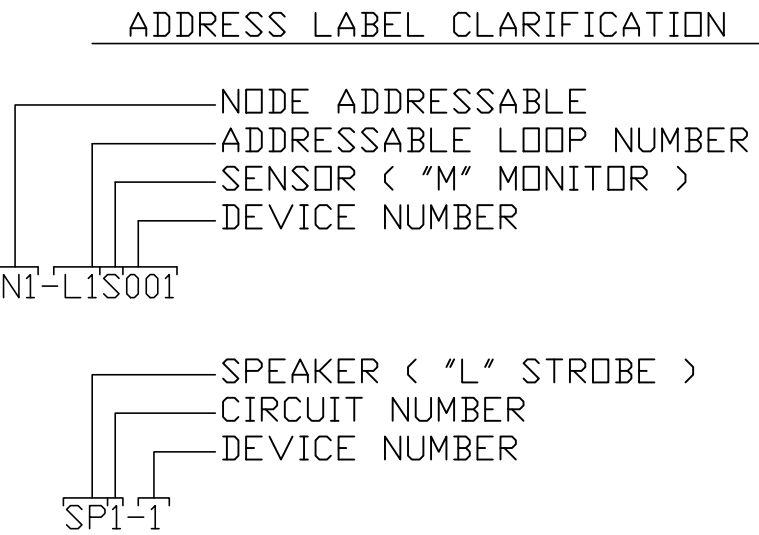

NOTE: NFPS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFPS. A/E IS SOLELY RESPONSIBLE (NOT NFPS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFPS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFPS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
FIRE ALARM SYSTEM
LEVEL 3

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	TCT
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	9/3/2010
SCALE:	1/16" = 1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	LEVEL 3.DWG

FIRE ALARM SYSTEM

PAGE:

FA-3-04

* NOTE: REFER TO RISER FA-R-01 FOR WIRING INFO

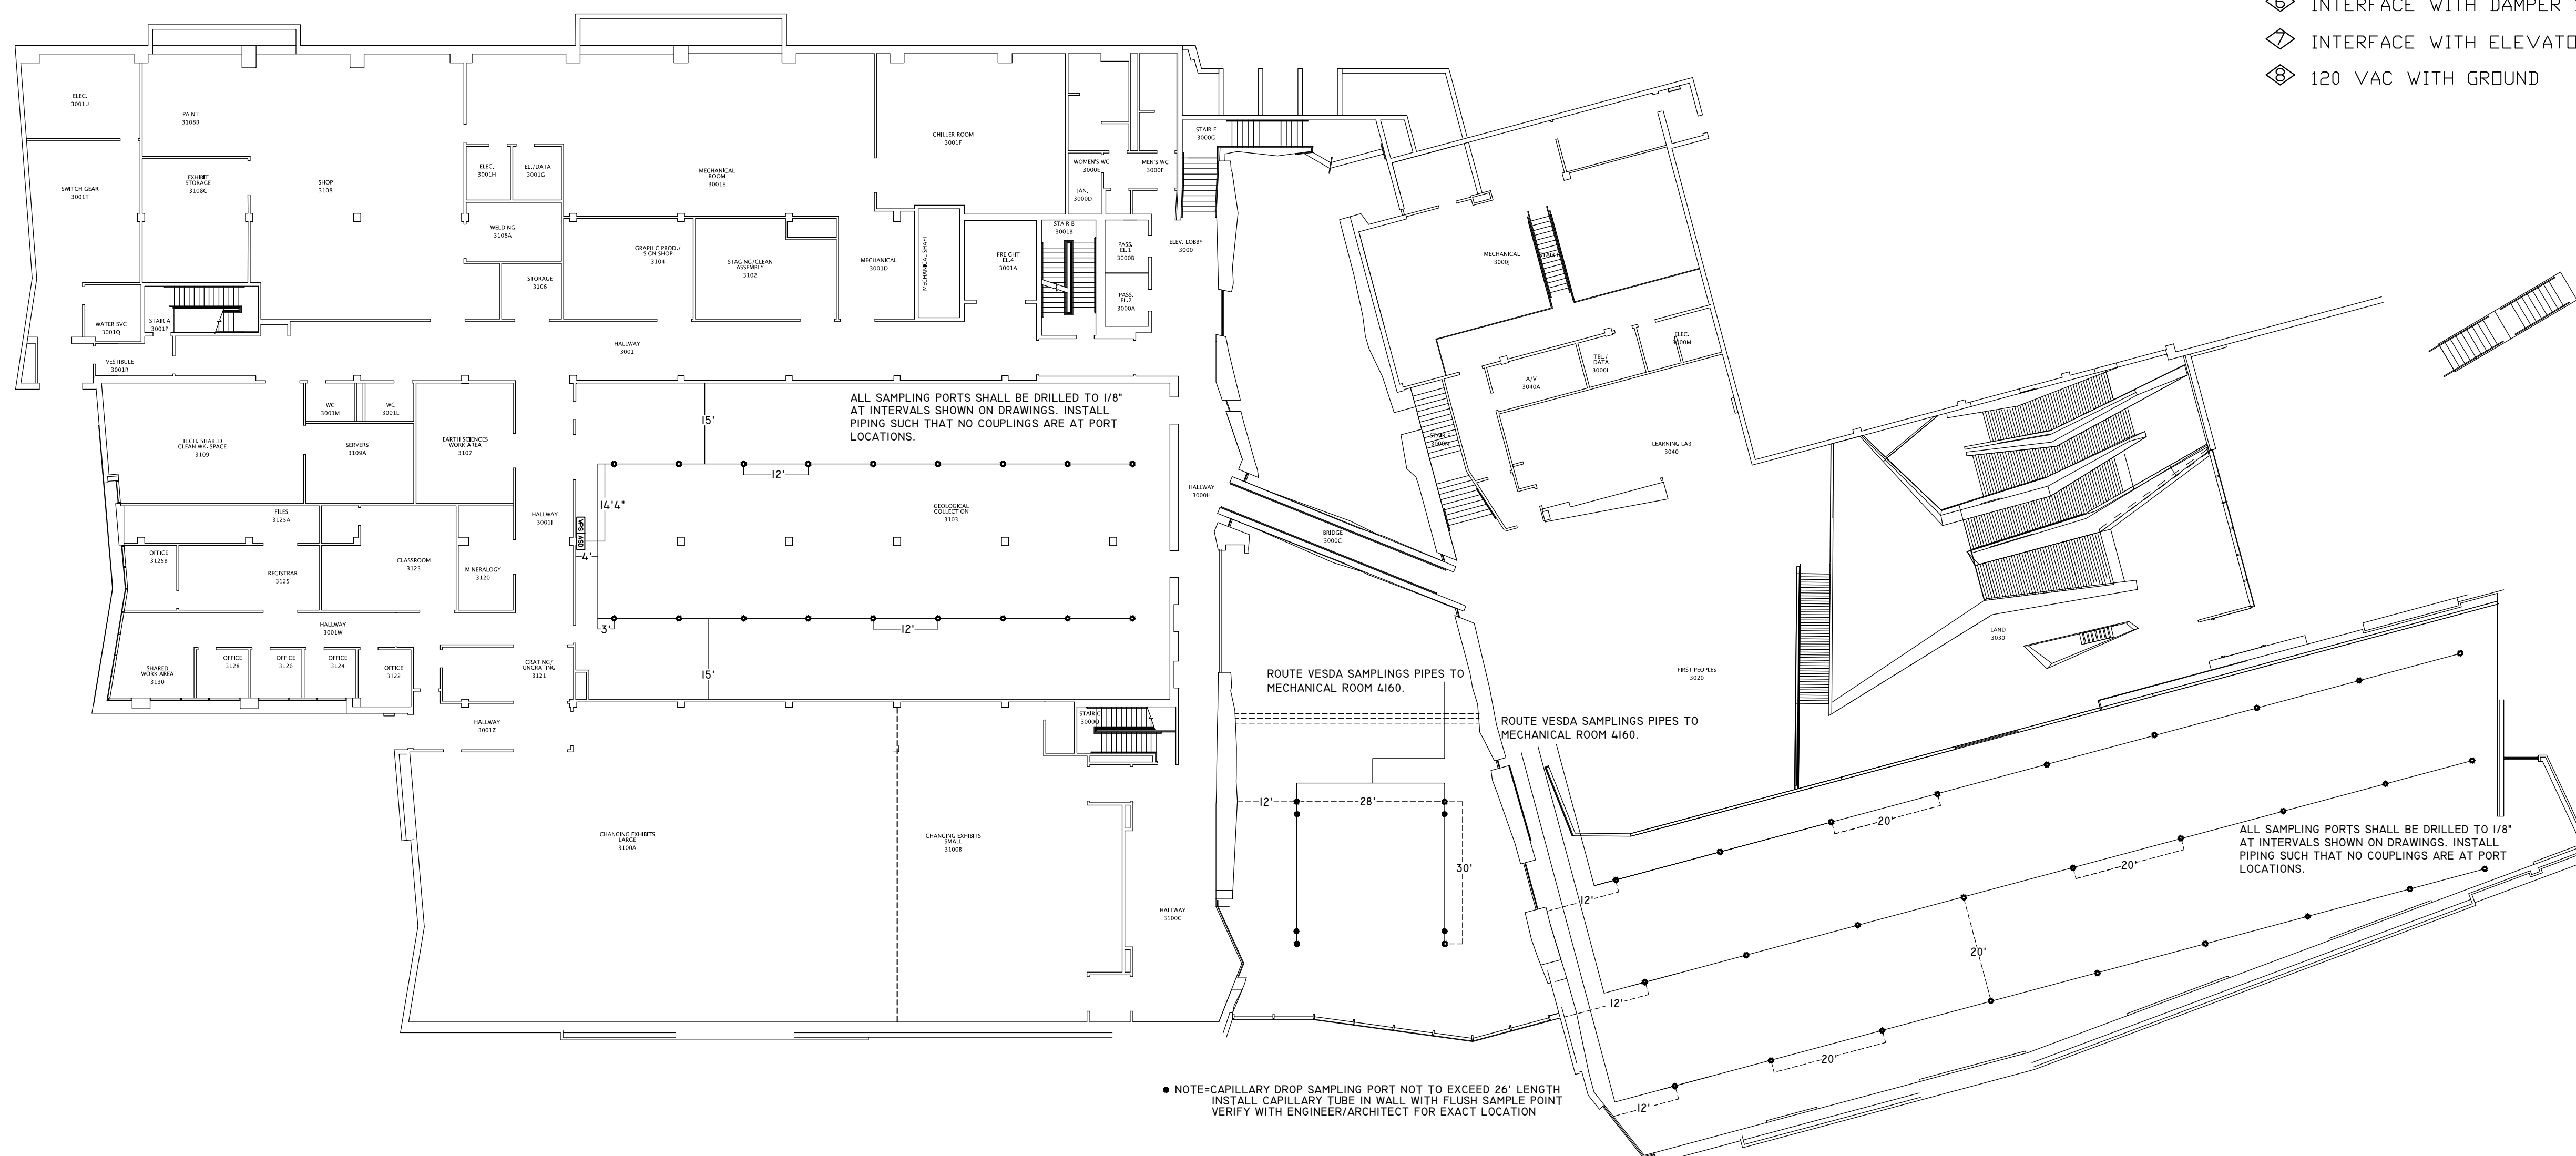


SYSTEM NOTES:

- ① TO LEVEL 2 NORTH TRANSPONDER PANEL
- ② TO LEVEL 2 SOUTH TRANSPONDER PANEL
- ③ INTERFACE WITH SOUND SYSTEM
- ④ INTERFACE WITH SECURITY DOOR RELEASE
- ⑤ INTERFACE WITH FAN FOR SHUTDOWN
- ⑥ INTERFACE WITH DAMPER 120VAC
- ⑦ INTERFACE WITH ELEVATOR EQUIPMENT
- ⑧ 120 VAC WITH GROUND

N.I.C.E.T.
LEVEL IV
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396

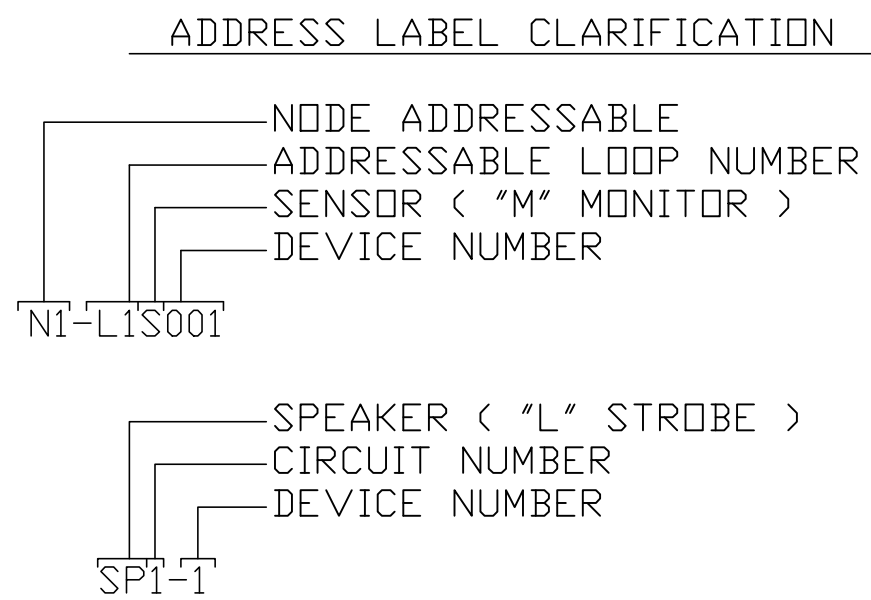


DEVICE LEGEND																	
SYMBOL	DESCRIPTION																
Ⓢ	SMOKE DETECTOR																
Ⓣ	THERMAL DETECTOR																
F	MANUAL PULL STATION																
WF	WATERFLOW SWITCH																
TS	TAMPER SWITCH																
DD	DUCT SMOKE DETECTOR																
MM	MONITOR MODULE <tr><td>CM</td><td>CONTROL MODULE</td></tr> <tr><td>RA</td><td>REMOTE ANNUNCIATOR</td></tr> <tr><td>FACP</td><td>FIRE ALARM CONTROL PANEL</td></tr> <tr><td>TRAN</td><td>TRANSPONDER PANEL</td></tr> <tr><td>FCC</td><td>FIRE COMMAND CENTER PANEL</td></tr> <tr><td>SCP</td><td>SMOKE CONTROL PANEL</td></tr> <tr><td>MDN</td><td>FIRE ALARM MONITORING PANEL</td></tr> <tr><td>ASD</td><td>VESDA AIR SAMPLING DETECTOR</td></tr>	CM	CONTROL MODULE	RA	REMOTE ANNUNCIATOR	FACP	FIRE ALARM CONTROL PANEL	TRAN	TRANSPONDER PANEL	FCC	FIRE COMMAND CENTER PANEL	SCP	SMOKE CONTROL PANEL	MDN	FIRE ALARM MONITORING PANEL	ASD	VESDA AIR SAMPLING DETECTOR
CM	CONTROL MODULE																
RA	REMOTE ANNUNCIATOR																
FACP	FIRE ALARM CONTROL PANEL																
TRAN	TRANSPONDER PANEL																
FCC	FIRE COMMAND CENTER PANEL																
SCP	SMOKE CONTROL PANEL																
MDN	FIRE ALARM MONITORING PANEL																
ASD	VESDA AIR SAMPLING DETECTOR																

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM 4001J:

- INX = NODE 6 INX VOICE PANEL
TRAN = N4-LIM02I 4TH FLOOR TRANSPONDER PANEL
Ⓢ = N4-L2S024
CM = N4-L2M095 SECURITY INTERFACE

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM 4000L:

- FACP = NODE 13 FIRE ALARM PANEL
INX = NODE 14 INX VOICE PANEL
TRAN = N13-LIM02I 4TH FLOOR TRANSPONDER PANEL
Ⓢ = N13-LIS001
CM = N13-LIM097 SECURITY INTERFACE

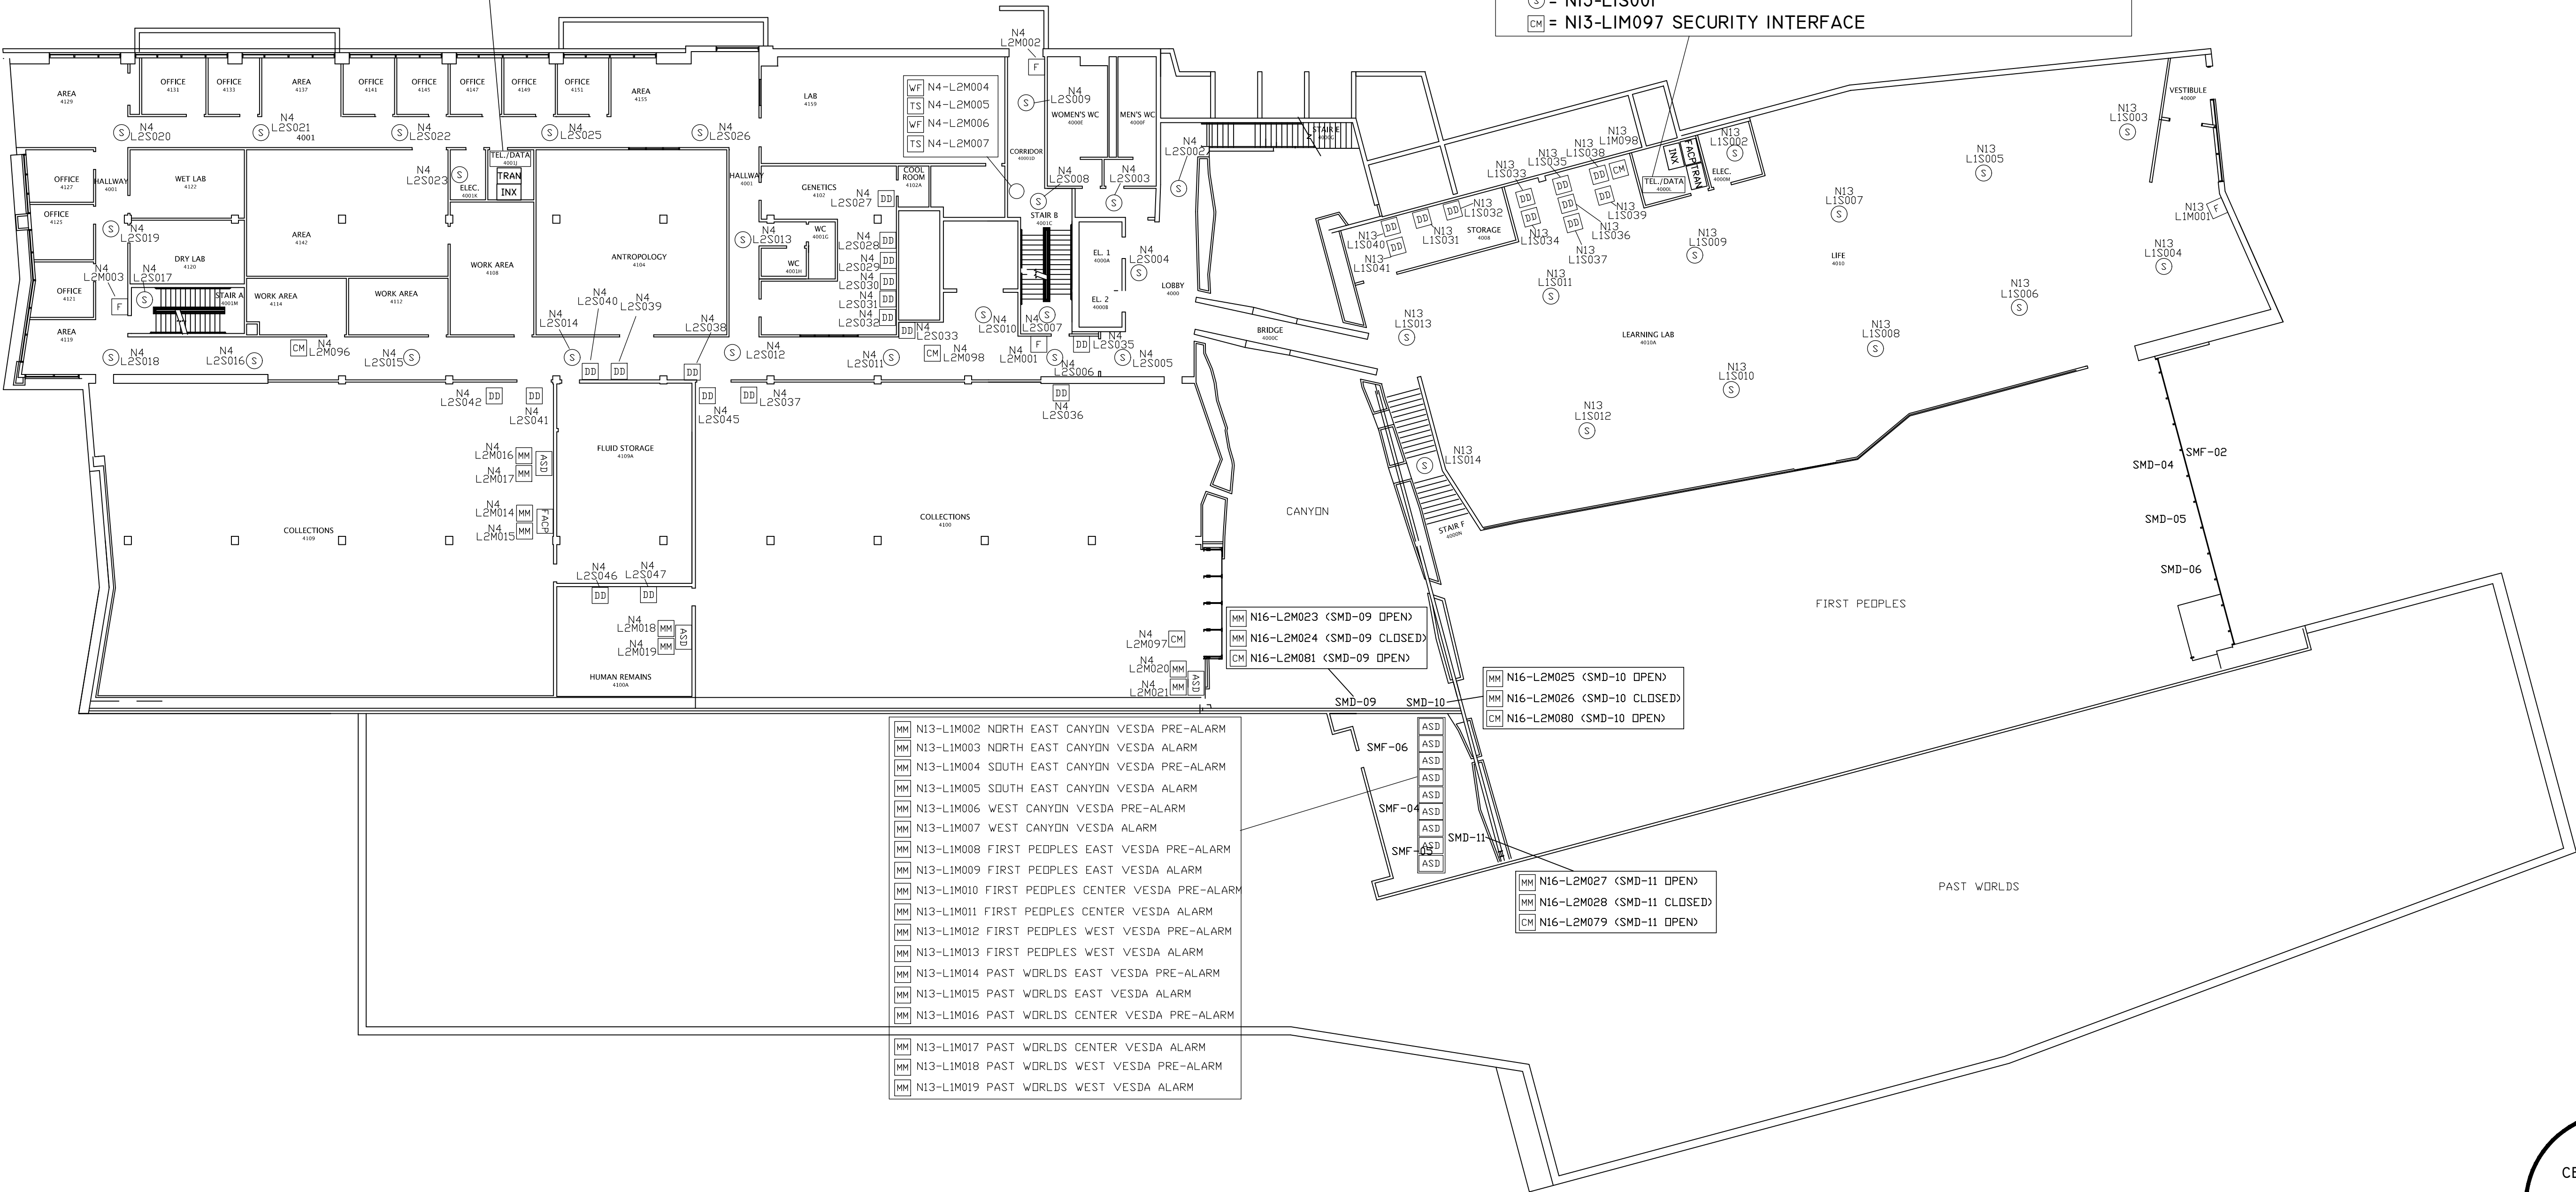

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 4
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
LEVEL 4.DWG

FIRE ALARM SYSTEM
SPRINKLER DEVICE
DEVICES

PAGE:
NFS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

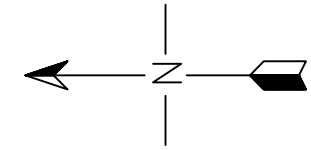

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 4
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	TCT
DESIGNED BY:	XXXX
APPROVED BY:	DPS
DATE:	2/1/10
SCALE:	1/16" = 1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	LEVEL 4.DWG


FIRE ALARM SYSTEM

VESDA

PAGE:

FA-4-04

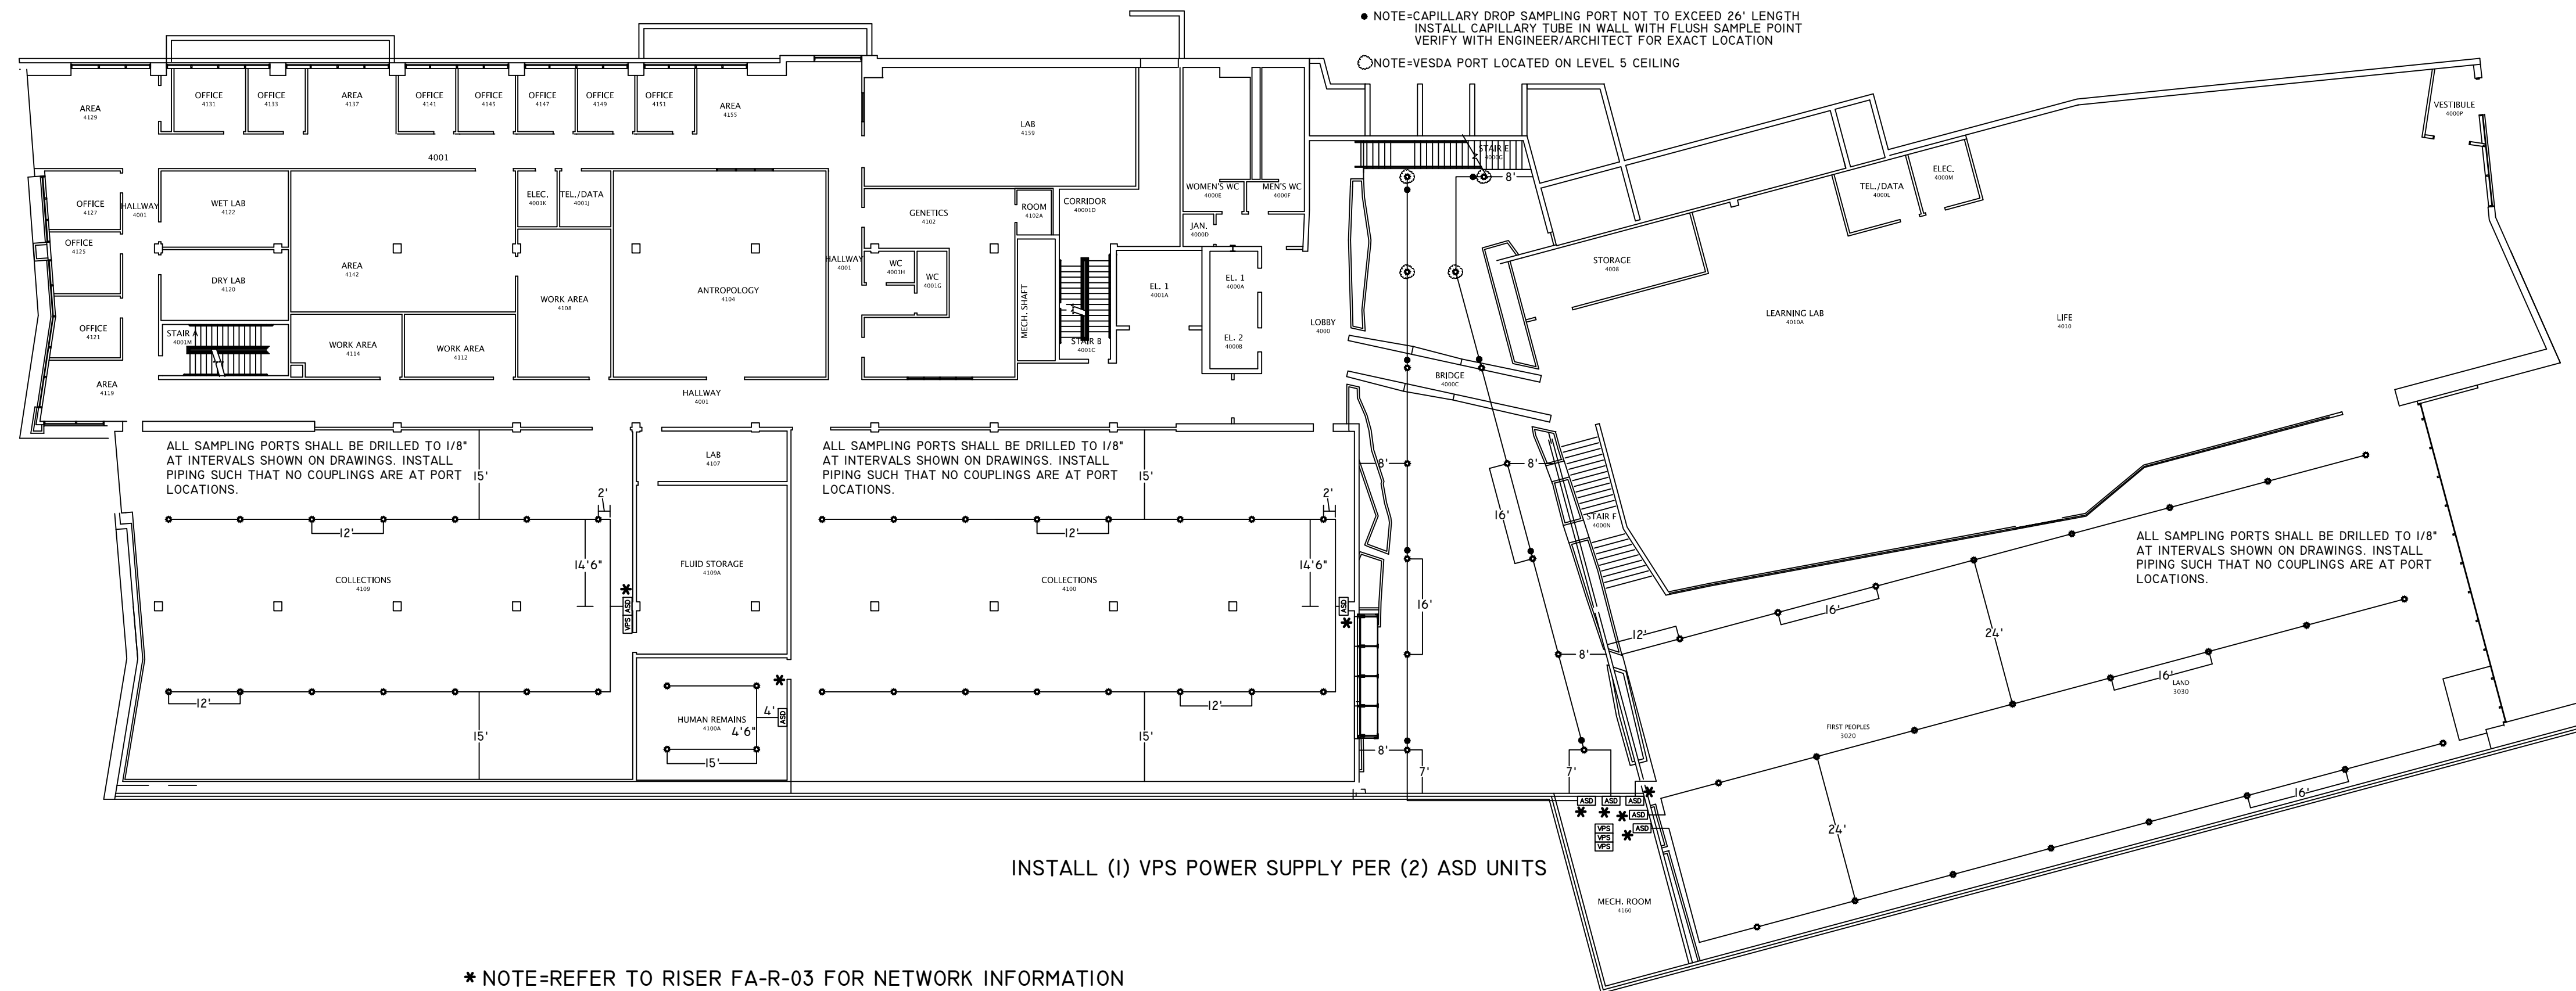

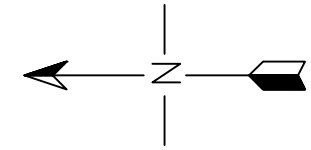

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 5
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: DPS
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
LEVEL 5.DWG

FIRE ALARM SYSTEM

SHOWN ALARM DEVICE
DEVELOPERS

PAGE:

NFS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

ADDRESS LABEL CLARIFICATION

— NODE ADDRESSABLE
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER

— SPEAKER ("L" STROBE)
— CIRCUIT NUMBER
— DEVICE NUMBER

SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DD	DUCT SMOKE DETECTOR
MM	MONITOR MODULE
CM	CONTROL MODULE
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FCC	FIRE COMMAND CENTER PANEL
SCP	SMOKE CONTROL PANEL
MDN	FIRE ALARM MONITORING PANEL
ASD	VESDA AIR SAMPLING DETECTOR

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM :


- FACP = NODE 7 FIRE ALARM PANEL
- INX = NODE 8 INX VOICE PANEL
- TRAN = N7-LIM021 5TH FLOOR TRANSPONDER PANEL
- Ⓢ = N7-LIS019
- CM = N7-LIM097 SECURITY INTERFACE

THE FOLLOWING EQUIPMENT IS LOCATED IN TEL/DATA ROOM 5000L :


- INX = NODE 15 INX VOICE PANEL
- TRAN = NI3-L2M021 5TH FLOOR TRANSPONDER PANEL
- = NI3-L2S012
- = NI3-L2M097 SECURITY INTERFACE

THE FOLLOWING DEVICES ARE
LOCATED IN ELECTRICAL ROOM 5000K:

- MM N16-L2M033 (SMD-08 OPEN)
- MM N16-L2M034 (SMD-08 CLOSED)
- CM N16-L2M075 (SMD-08 OPEN)
- MM N16-L2M031 (SMD-07 OPEN)
- MM N16-L2M032 (SMD-07 CLOSED)
- CM N16-L2M076 (SMD-07 OPEN)

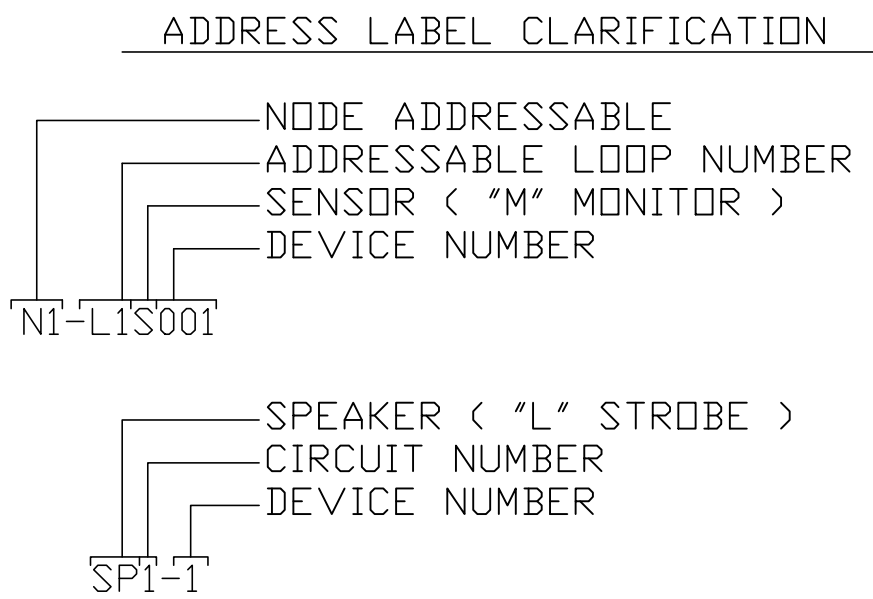


DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
WF	WATERFLOW SWITCH
TS	TAMPER SWITCH
DB	DUCT SMOKE DETECTOR
MM	MONITOR MODULE
CM	CONTROL MODULE
RA	REMOTE ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FCC	FIRE COMMAND CENTER PANEL
SCP	SMOKE CONTROL PANEL
MDN	FIRE ALARM MONITORING PANEL
ASD	VESDA AIR SAMPLING DETECTOR

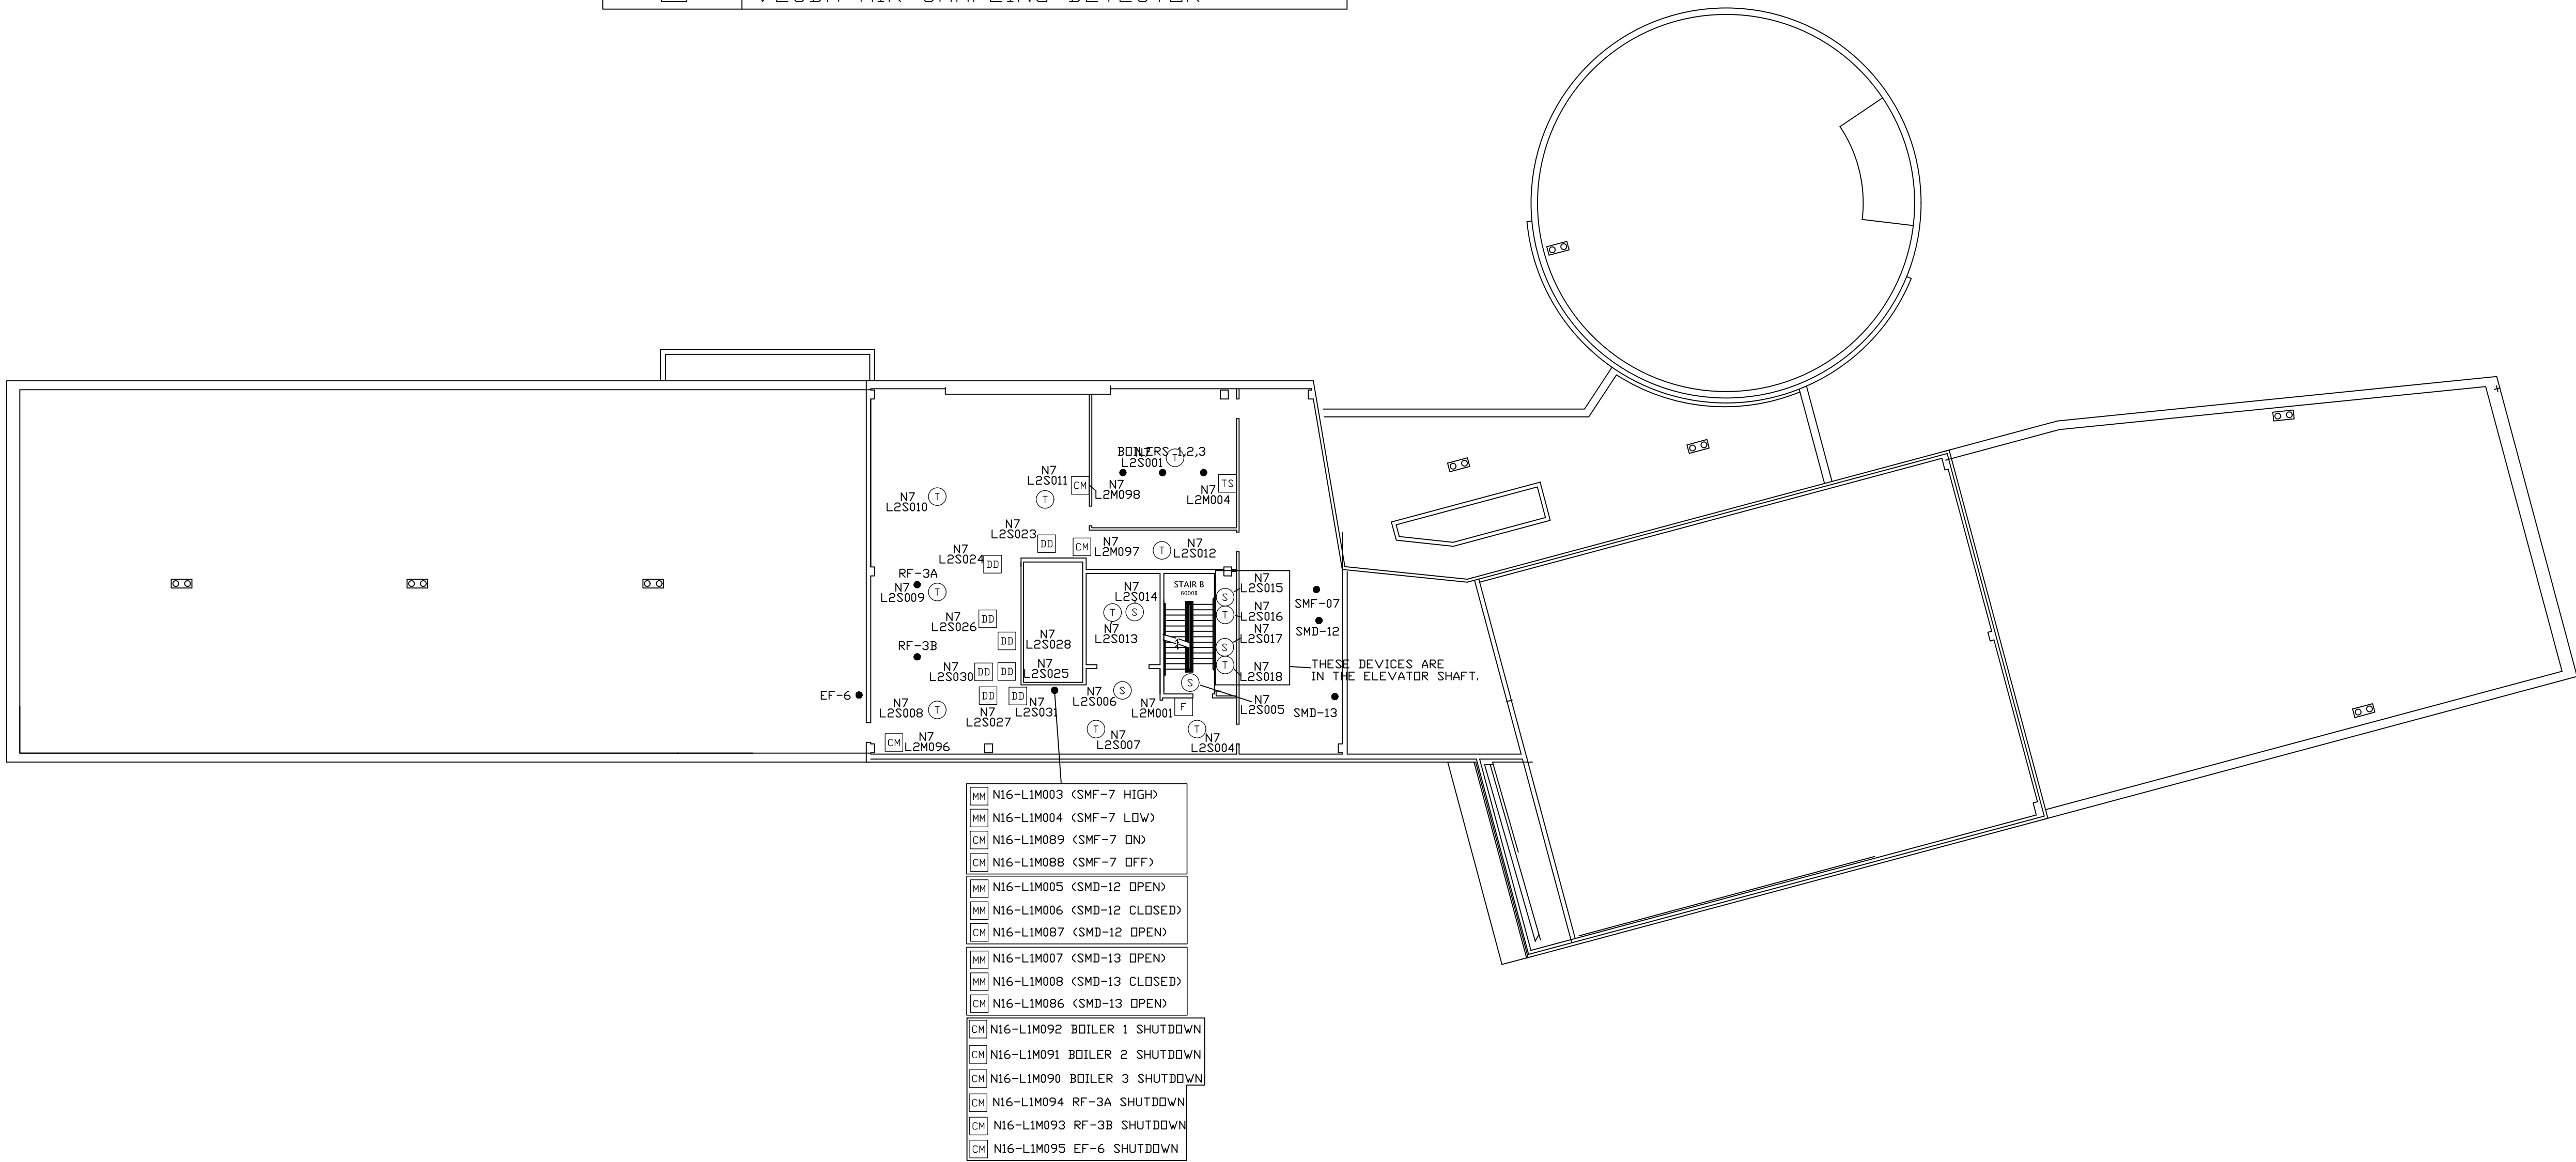

N.I.C.E.T.
LEVEL IV
CERTIFICATION

FIRE ALARM SYSTEMS

DONNY SCHULTZ
#104396

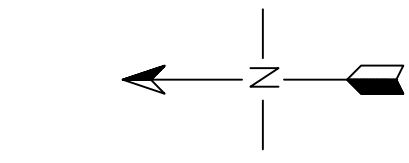

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

MUSEUM OF NATURAL HISTORY
UNIVERSITY OF UTAH
LEVEL 6
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: JJG
DESIGNED BY: XXXX
APPROVED BY: XXXX
DATE: 4/10/12
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
LEVEL 6.DWG

FIRE ALARM SYSTEM

FIRE ALARM DEVICES

DEVICES

PAGE:

NFS