

N.I.C.E.T.
LEVEL IV
CERTIFICATION

RUSTY SELIN
#92414

ADDRESS LABEL CLARIFICATION

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001


NI-LIS001

NI-LIS001

NI-LIS001

NI-LIS001

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	WATERFLOW SWITCH
⊙	TAMPER SWITCH
⊙	HORN/STROBE
⊙	WEATHERPROOF HORN
⊙	STROBE LIGHT
⊙	MIA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊙	RELAY
⊙	DOORHOLDER
⊙	REMOTE ANNUNCIATOR
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊙	MONITOR MODULE

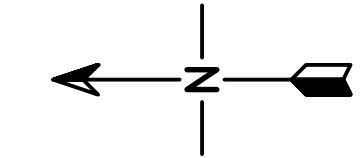

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED FOR THE PROJECT. NFS IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH

NEUROPSYCHIATRIC INSTITUTE EXPANSION

FIRST FLOOR

501 CHIPETA WAY

SALT LAKE CITY, UTAH 84108

FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS

801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	4/13/2012
SCALE:	1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UNI IST FLR.DWG

FIRE ALARM SYSTEM

DEVICE ADDRESS

PAGE:

FA-I




 HORN/STROBE ("L" STROBE
 CIRCUIT NUMBER
 DEVICE NUMBER
 HSI-1

DEVICE LEGEND	
SYMBOL	DESCRIPTION
③	SMOKE DETECTOR
①	THERMAL DETECTOR
⑦	MANUAL PULL STATION
⑧	DUCT SMOKE DETECTOR
⑤	WATERFLOW SWITCH
⑫	TAMPER SWITCH
⑪	HORN/STROBE
⑭	WEATHERPROOF HORN
⑬	STROBE LIGHT
⑥	MIJA W/ MONITOR MODULE
④	CONTROL MODULE
⑩	RELAY
⑨	DOORHOLDER
②	REMOTE ANNUNCIATOR
⑮	FIRE-ALARM CONTROL PANEL
⑬	TRANSPENDER PANEL
⑬	FIRE SMOKE DAMPER
⑫	KITCHEN HOOD

NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE FOR THE LOCATION, SIZE, AND SCHEDULING OF THE SUITABILITY OF A/E FIRE SENSING, LOCATION, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING AND DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	4/13/2012
SCALE:	1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UNI 2ND FLR.DWG

FIRE ALARM SYSTEM



ADDRESSABLE NUMBERS

PAGE:
FA-2

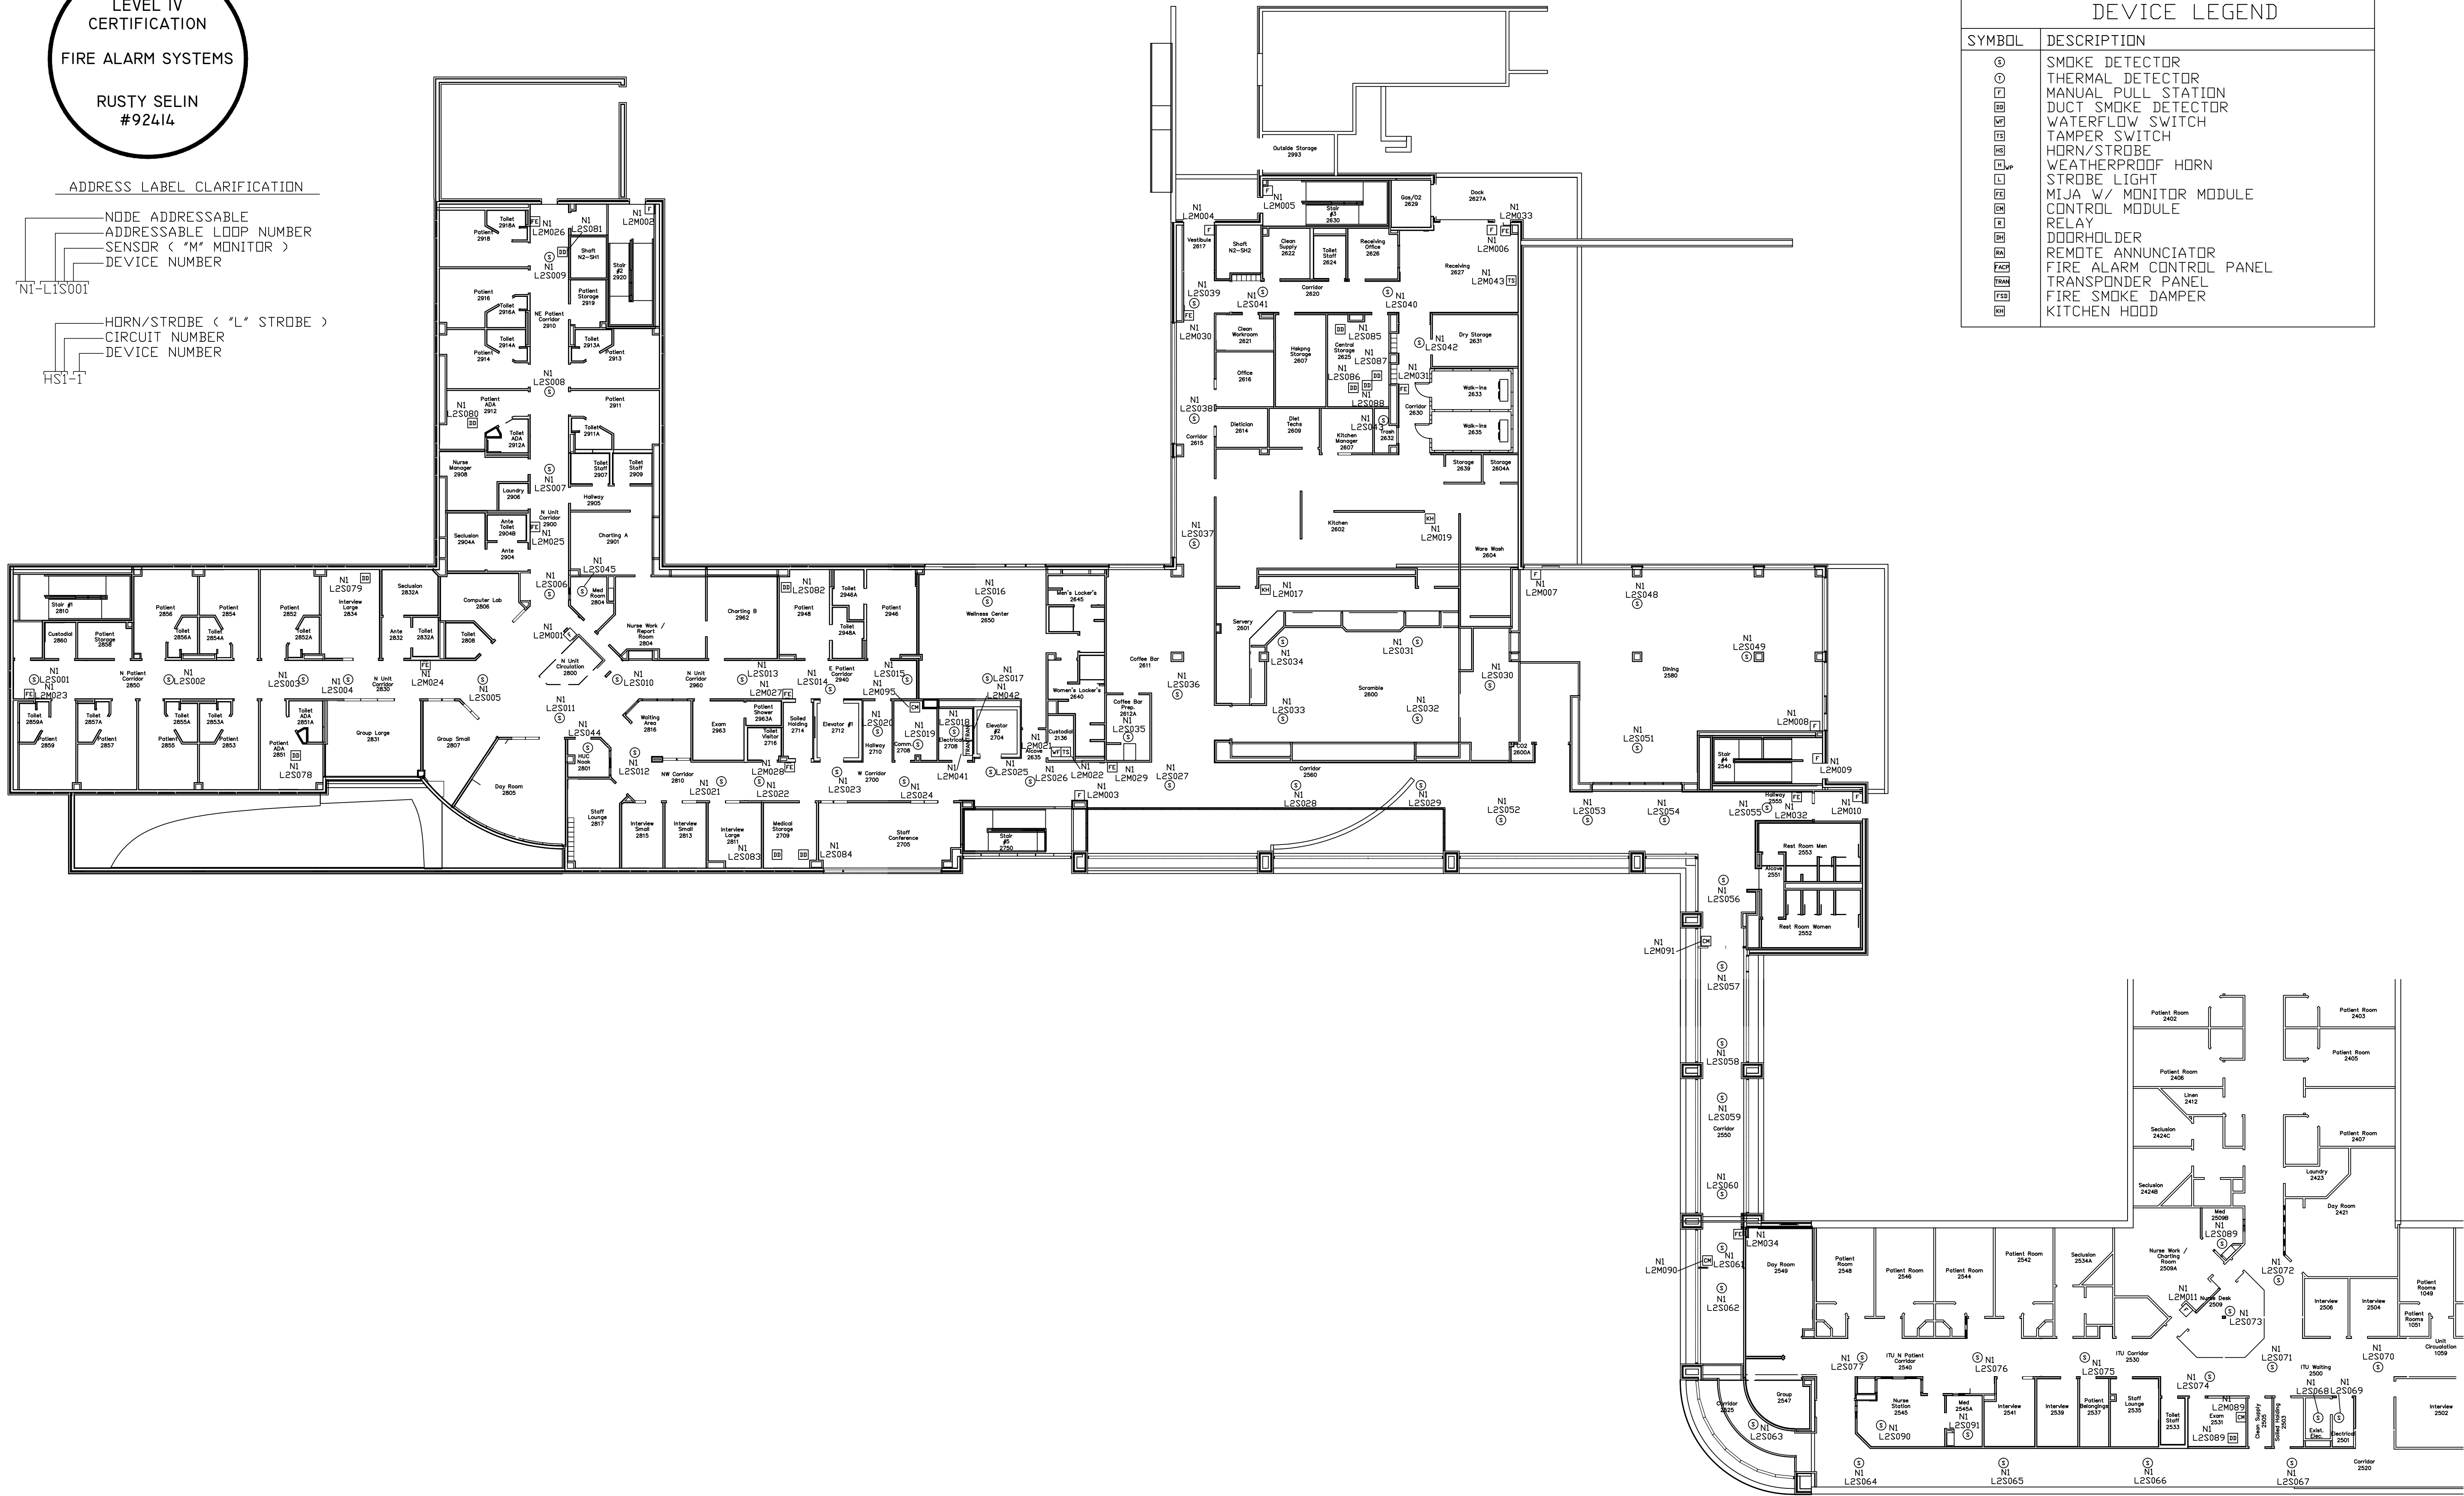




ADDRESS LABEL CLARIFICATION

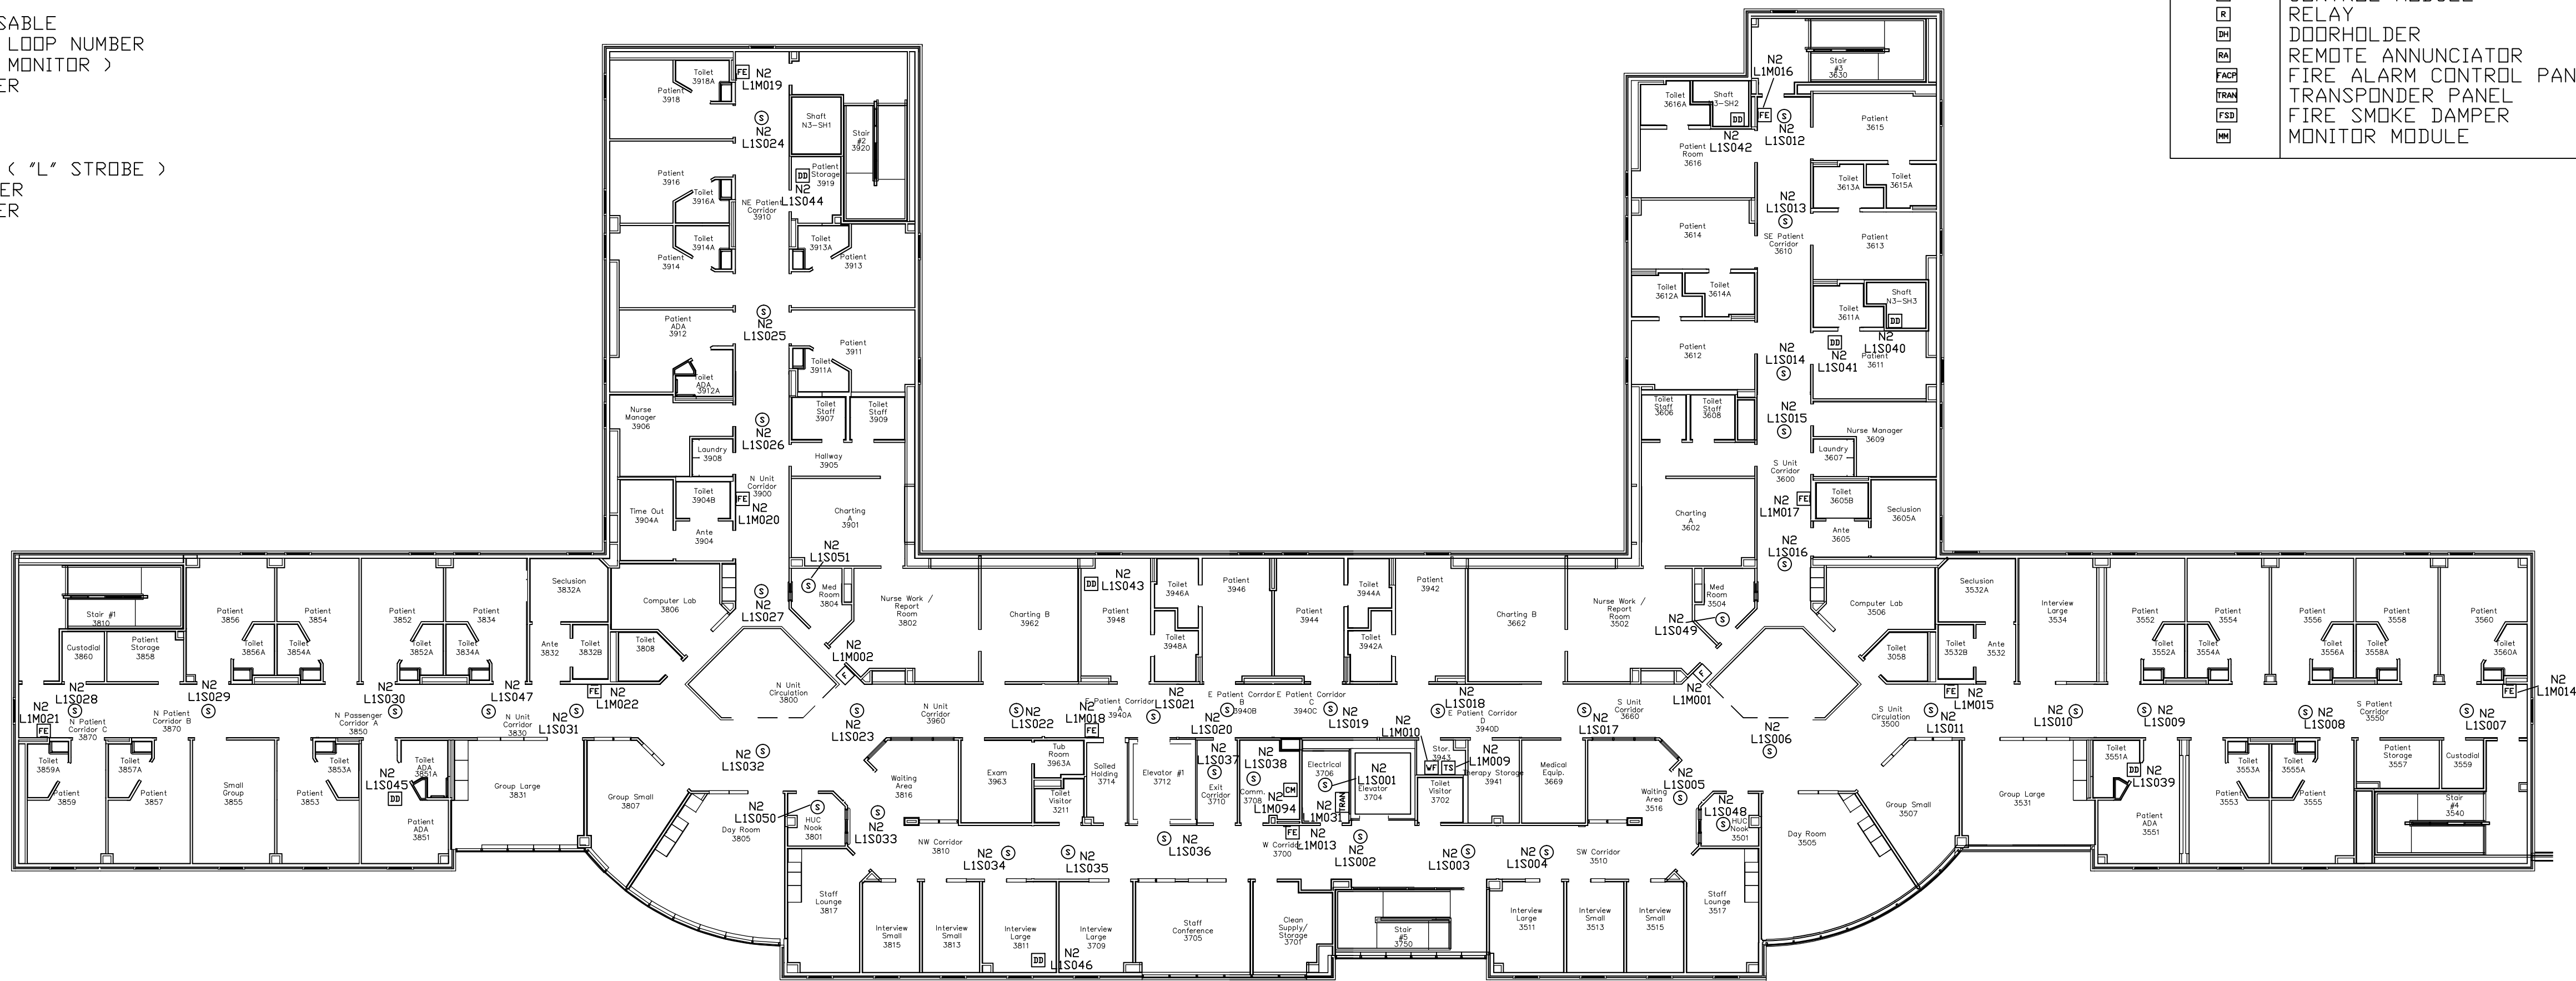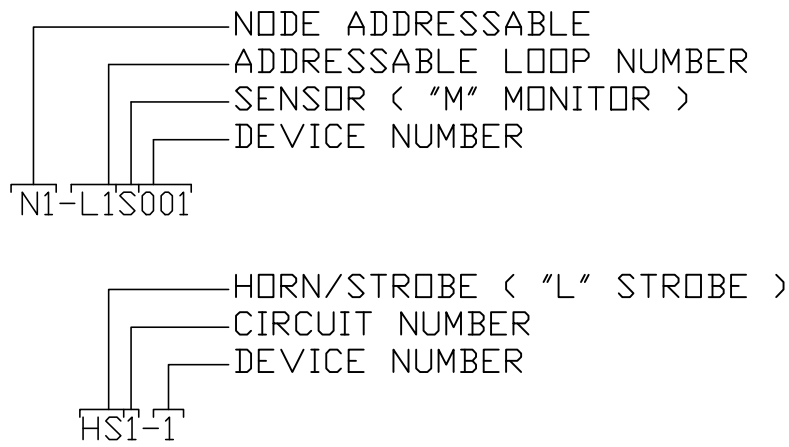

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊖	THERMAL DETECTOR
⊕	MANUAL PULL STATION
⊗	DUCT SMOKE DETECTOR
⊙	WATERFLOW SWITCH
⊕	TAMPER SWITCH
⊗	HORN/STROBE
⊙	WEATHERPROOF HORN
⊕	STROBE LIGHT
⊗	MIJA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊕	RELAY
⊗	DOORHOLDER
⊙	REMOTE ANNUNCIATOR
⊕	FIRE ALARM CONTROL PANEL
⊗	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊕	MONITOR MODULE

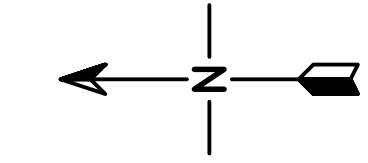

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
FURNISHED/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED/ENGINEER (A/E) IS SOLELY RESPONSIBLE
FOR THE ACCURACY OF THE INFORMATION SHOWN
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
NEUROPSYCHIATRIC INSTITUTE EXPANSION
THIRD FLOOR
501 CHIPETA WAY
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM




NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	9/16/11
SCALE:	1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UNI 3RD FLR.DWG

FIRE ALARM SYSTEM
ADDRESSABLE NUMBERS




ADDRESS LABEL CLARIFICATION

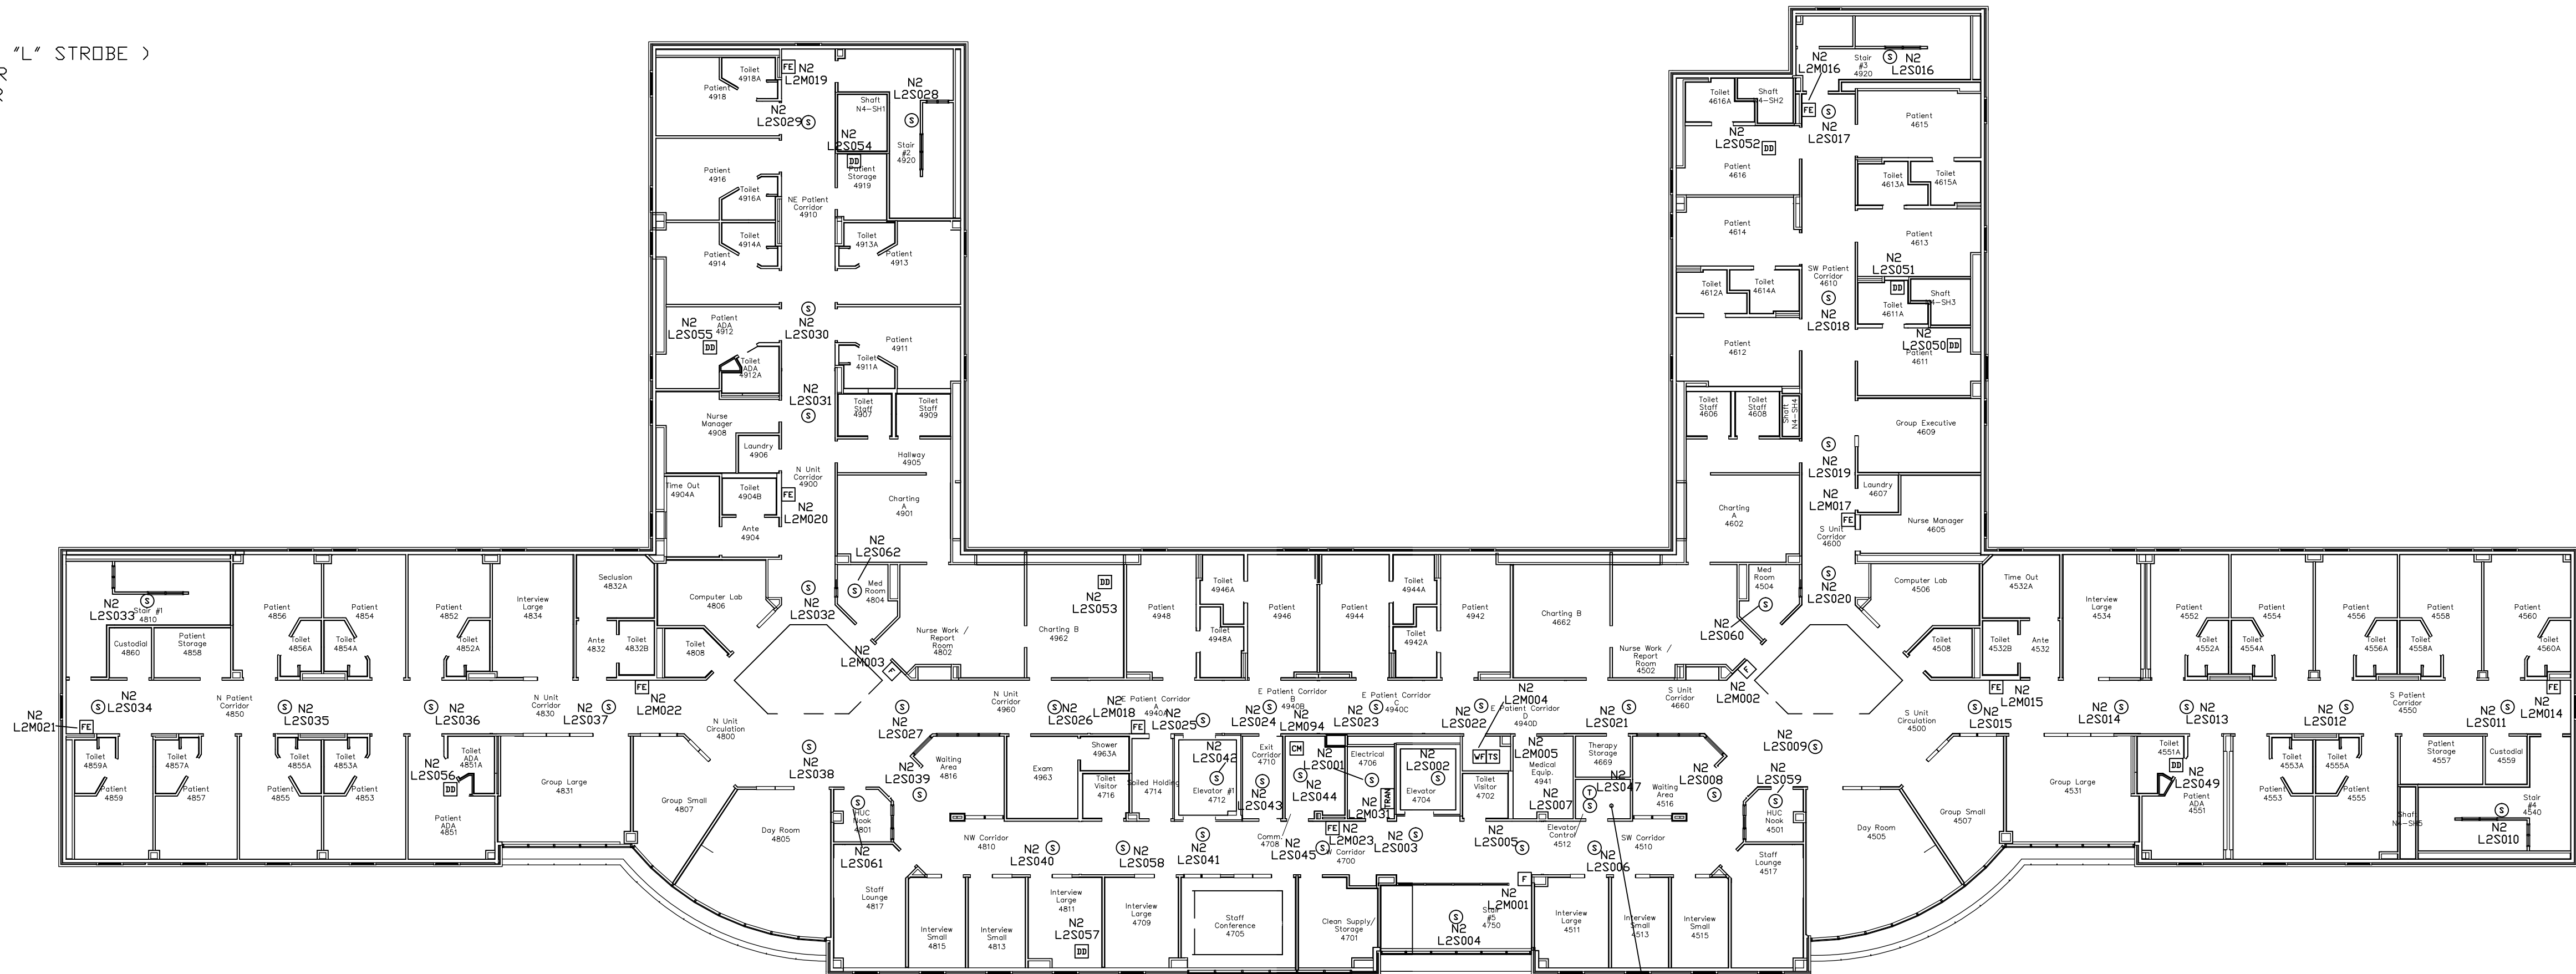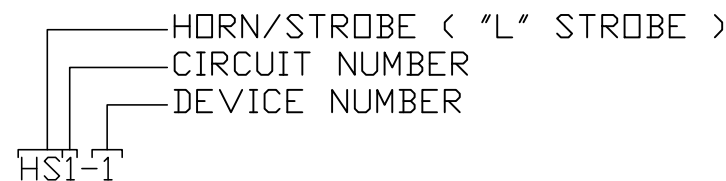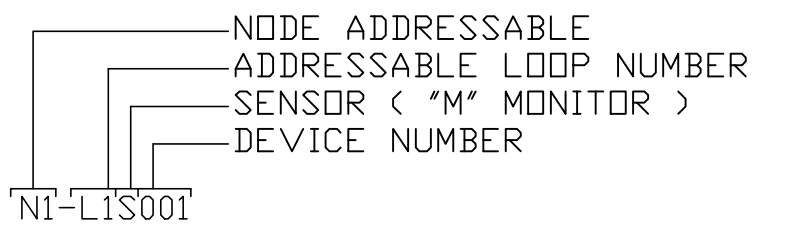

N2-L2M097 ELEV 2 RECALL TO MAIN
N2-L2M098 ELEV 2 RECALL TO ALT
N2-L2M099 ELEV 2 EQUIP RM/SHAFT

N2-L2M093 ELEV 1 RECALL TO MAIN
N2-L2M092 ELEV 1 RECALL TO ALT
N2-L2M091 ELEV 1 EQUIP RM/SHAFT

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR
⊙	THERMAL DETECTOR
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	WATERFLOW SWITCH
⊙	TAMPER SWITCH
⊙	HORN/STROBE
⊙	WEATHERPROOF HORN
⊙	STROBE LIGHT
⊙	MIJA W/ MONITOR MODULE
⊙	CONTROL MODULE
⊙	RELAY
⊙	DOORHOLDER
⊙	REMOTE ANNUNCIATOR
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL
⊙	FIRE SMOKE DAMPER
⊙	MONITOR MODULE

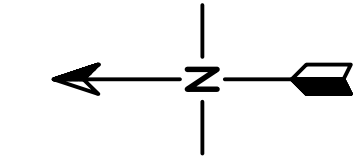

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
NFS DESIGN/ENGINEER (NFS) PLANS AND SPECIFICATIONS
FURNISHED FOR THE PROJECT. NFS IS NOT RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARM CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
NEUROPSYCHIATRIC INSTITUTE EXPANSION
FOURTH FLOOR
501 CHIPETA WAY
SALT LAKE CITY, UTAH 84108
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	JJG
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	9/16/11
SCALE:	1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UNI 4TH FLR.DWG

FIRE ALARM SYSTEM
ADDRESSABLE NUMBERS

PAGE:
FA-4