


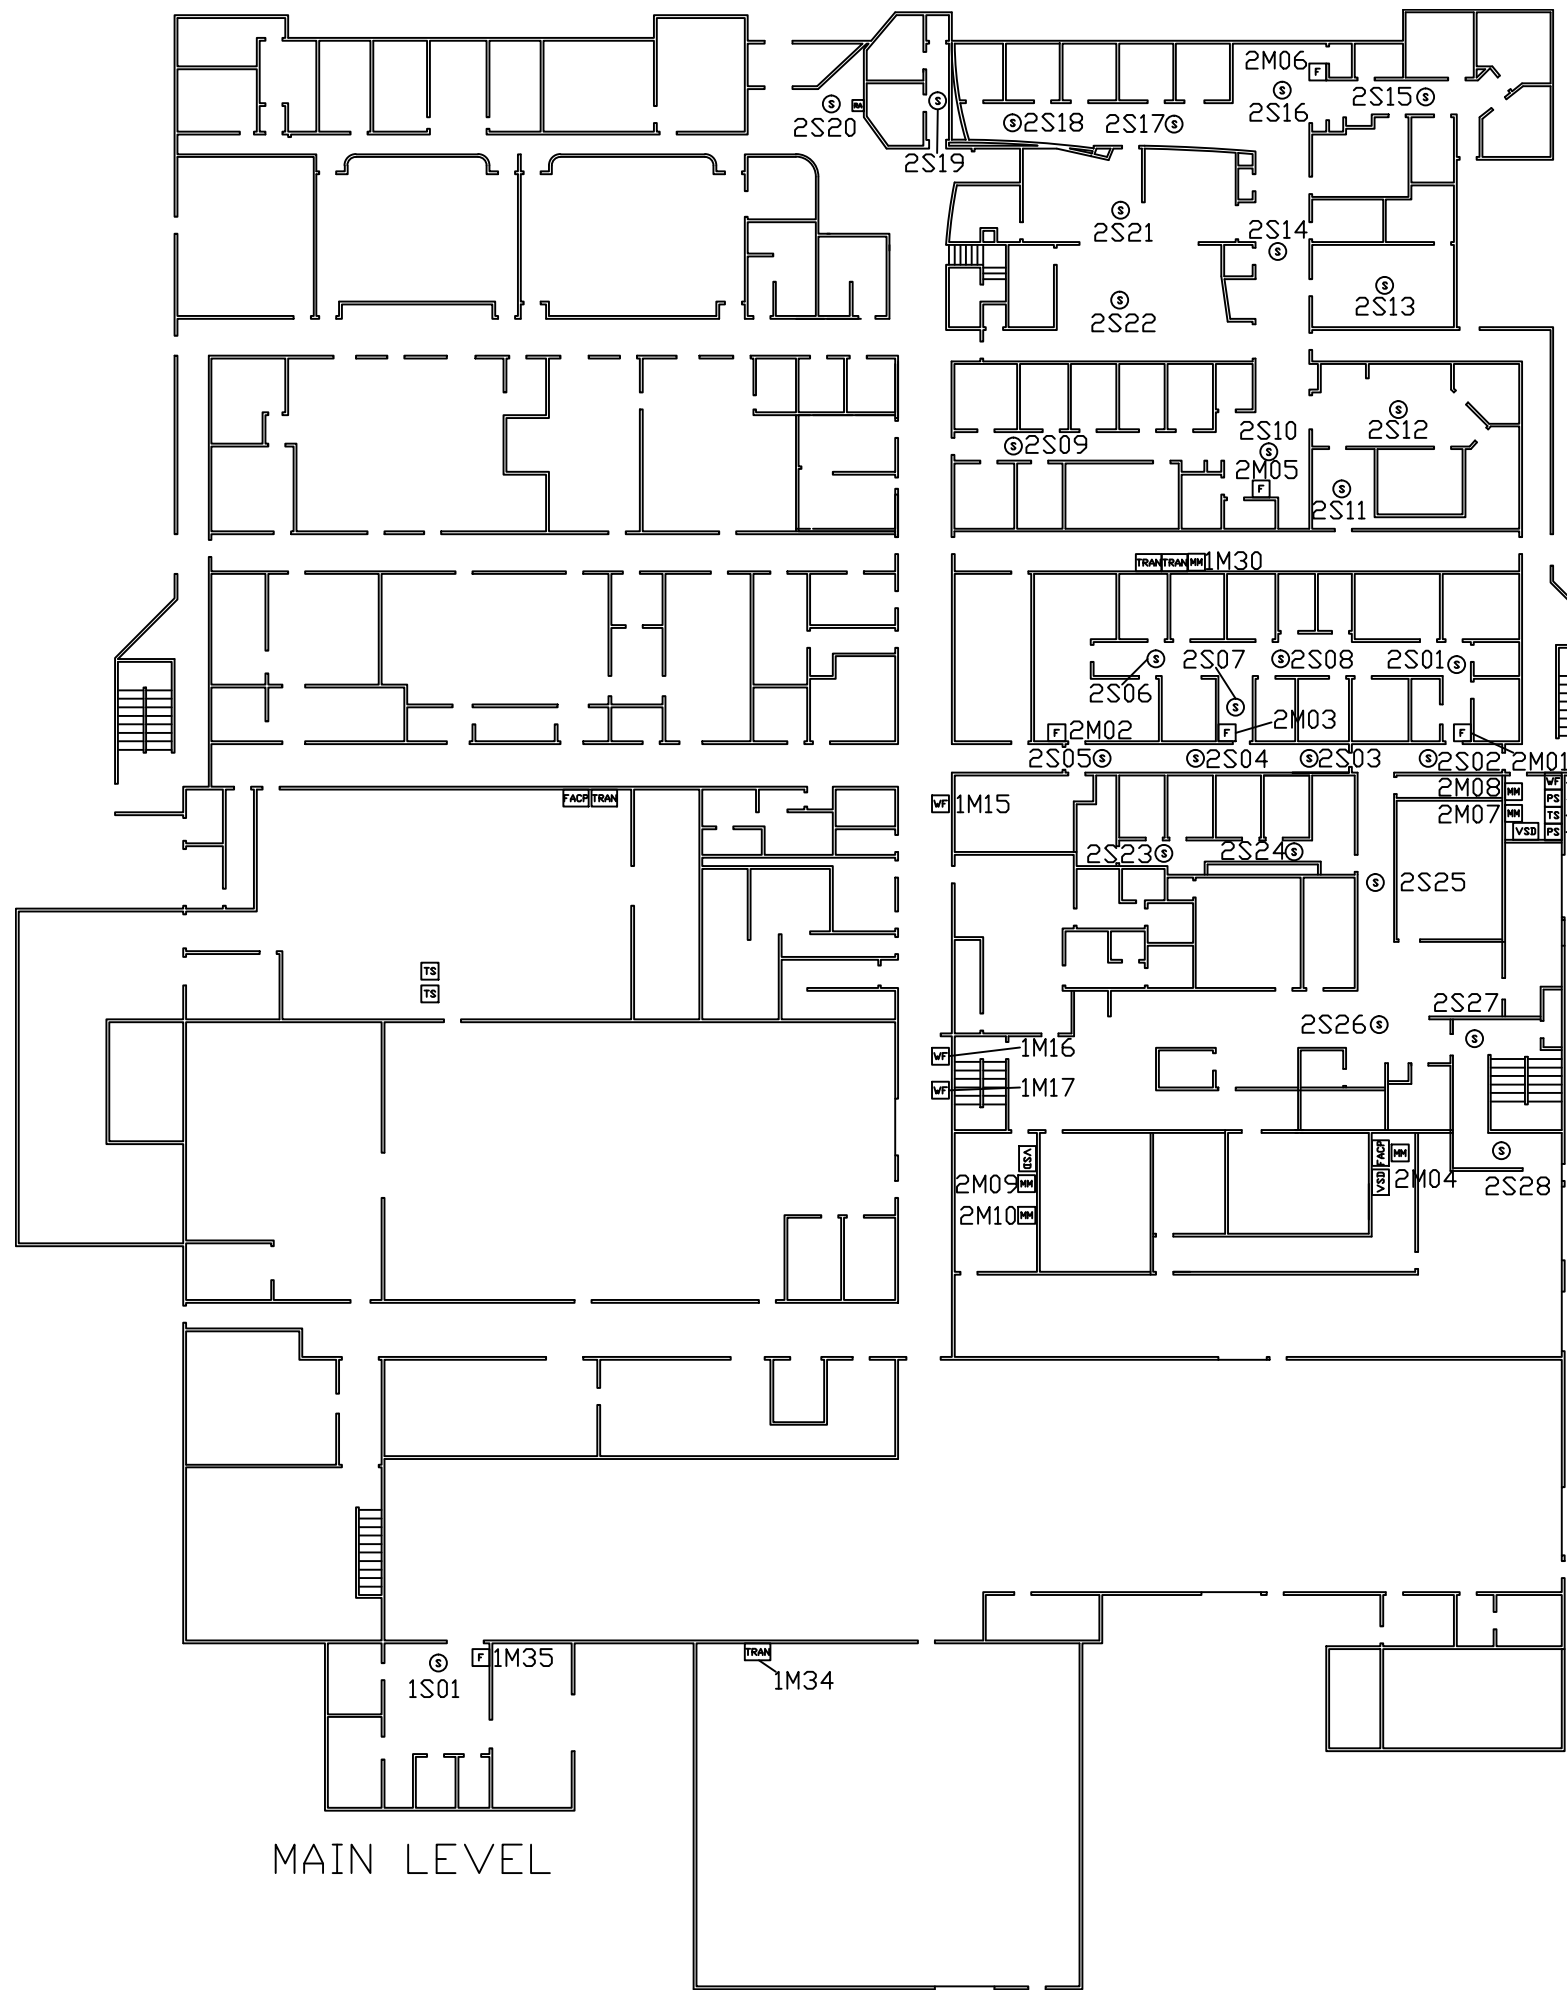



MAIN LEVEL

PV
1M23
CAMT
UNIVERSITY OF UTAH
FEBRUARY 4, 2011
CAMT.DWG

NFS

NELSON FIRE SYSTEMS
801-468-8300

- LEGEND
- ⊙ SMOKE DETECTOR
 - ⊙ HEAT DETECTOR
 - F MANUAL PULL STATION
 - D DUCT DETECTOR
 - WF WATERFLOW SWITCH
 - TS TAMPER SWITCH
 - PS PRESSURE SWITCH
 - PV POST INDICATOR VALVE(PIV)
 - H HORN/STROBE
 - CS CHIME/STROBE
 - L STROBE
 - R RELAY
 - RA REMOTE ANNUNCIATOR
 - FACP FIRE ALARM CONTROL PANEL
 - TRAN TRANSPONDER PANEL
 - VSD VESDA AIR SAMPLING DETECTOR

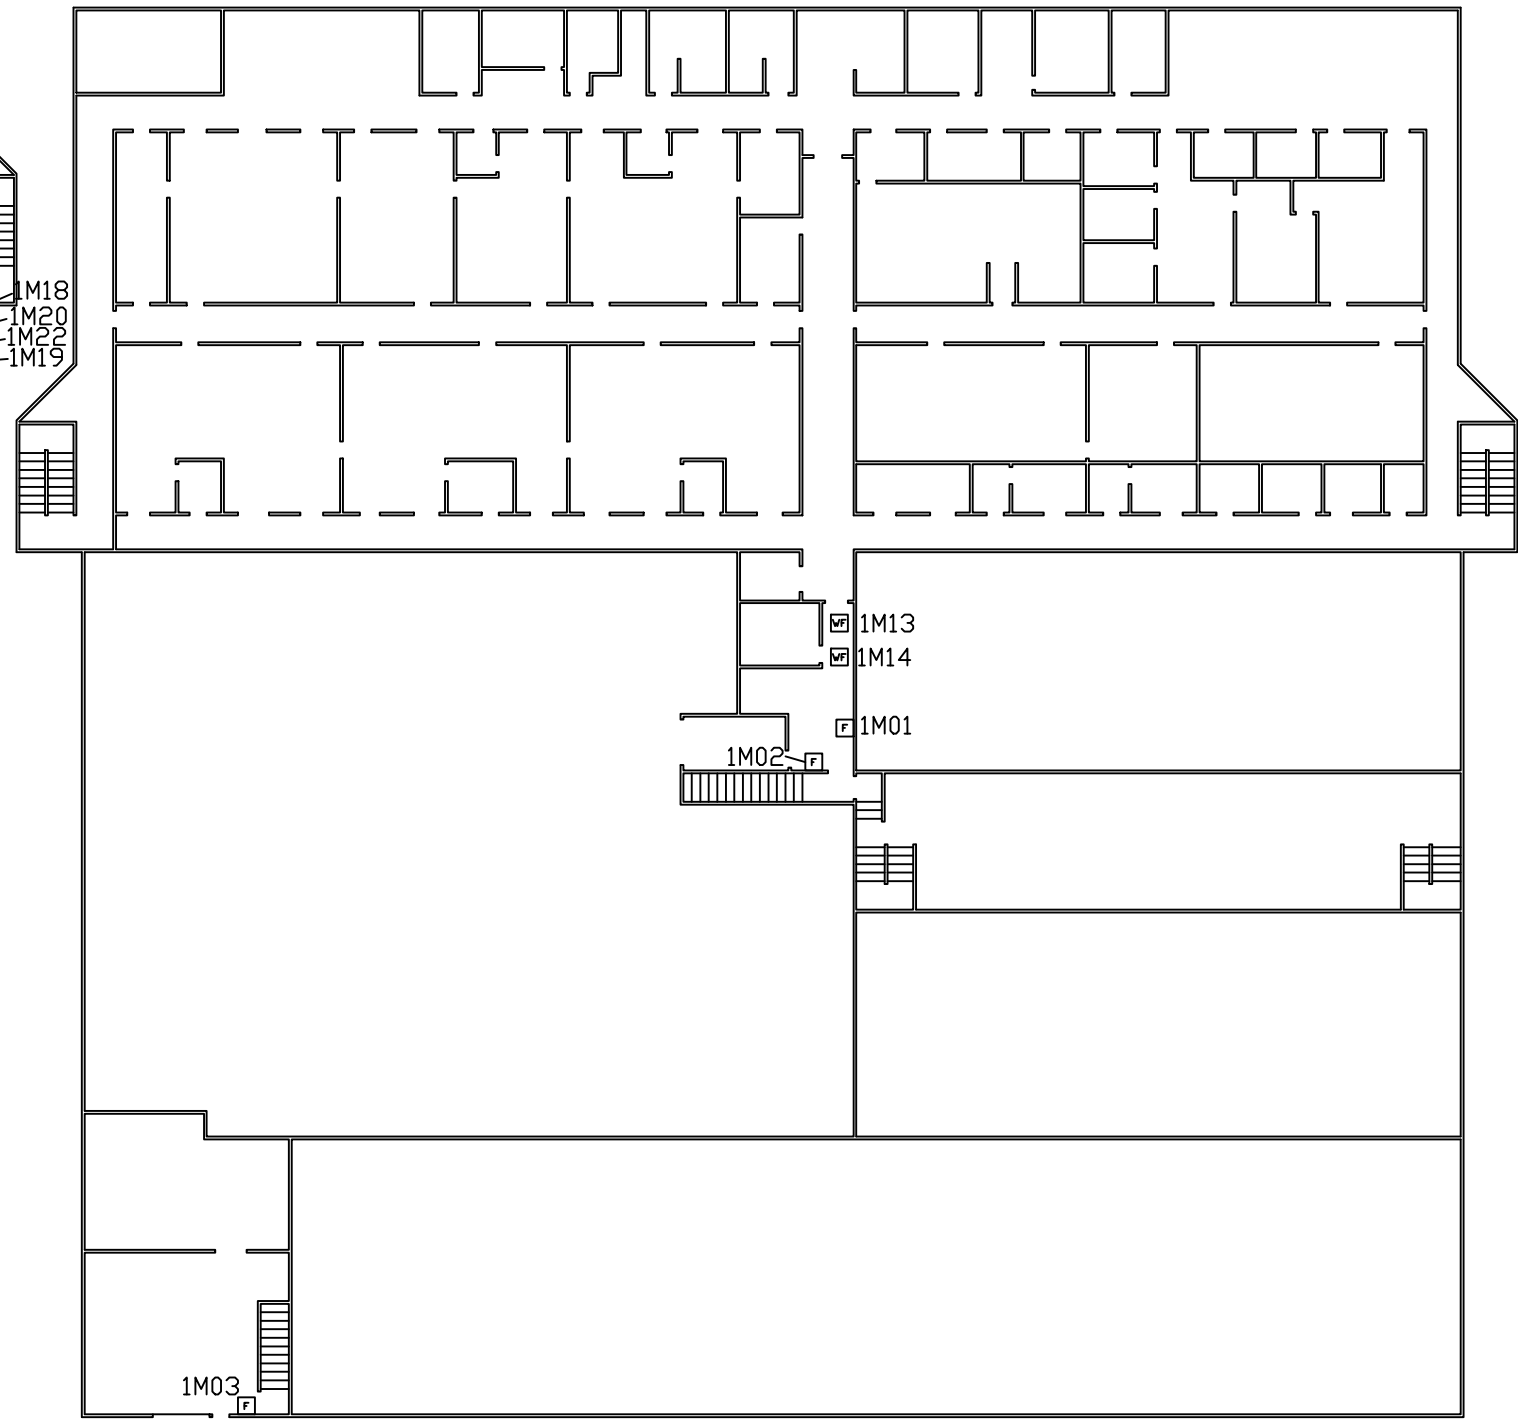

MEZZANINE LEVEL