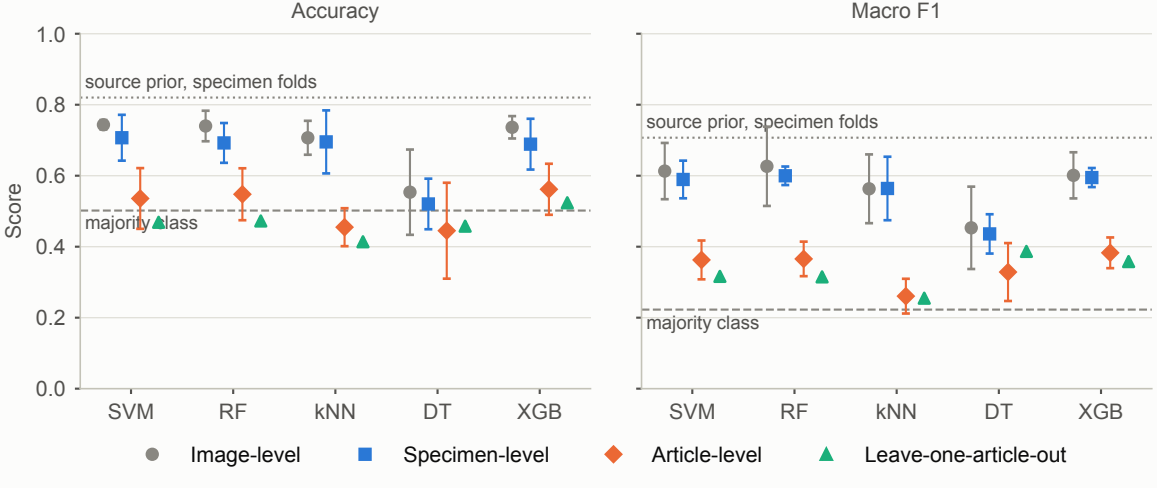
Accuracy
Macro F1
Score
1.0
0.8
0.6
0.4
0.2
0.0
source prior, specimen folds
majority class
SVM
RF
kNN
DT
XGB
Image-level
Specimen-level
Article-level
Leave-one-article-out