



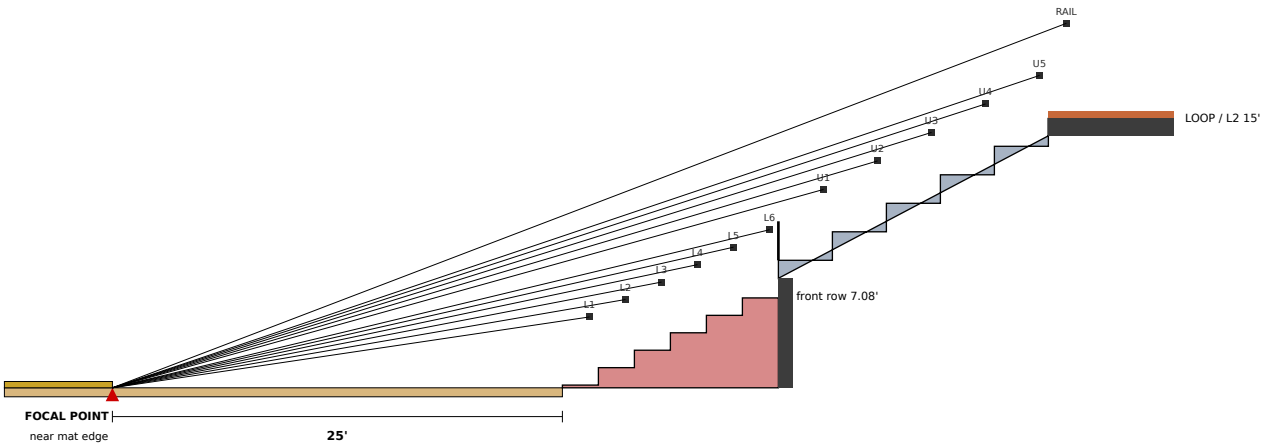


1 AS DRAWN (REV E) — NORTH / SOUTH SIDE (seated eyes)

3/32" = 1'-0" · focal 25' (10' clear + 15' table zone) · telescopic 11¼" · upper 19"/row, front 7.08'

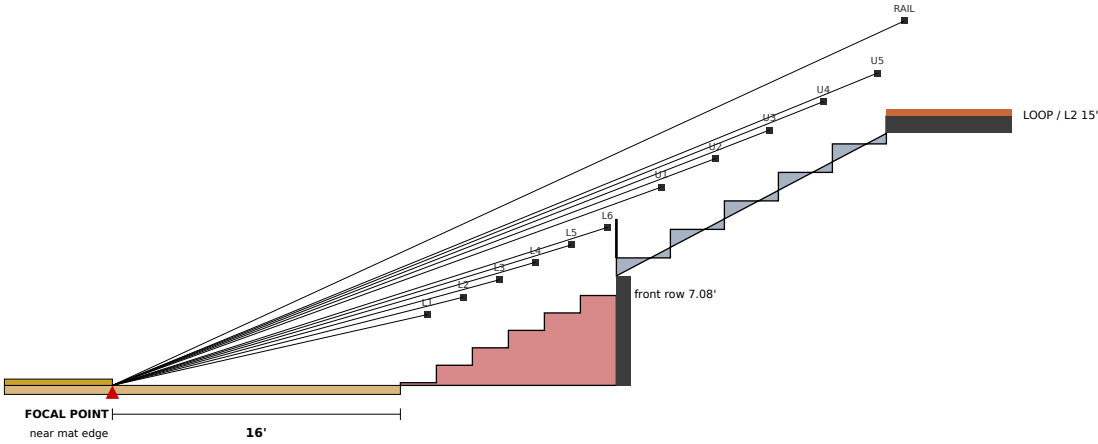

2 AS DRAWN (REV E) — EAST SIDE (seated eyes)

3/32" = 1'-0" · focal 16' (D-053) · upper 19"/row · worst side

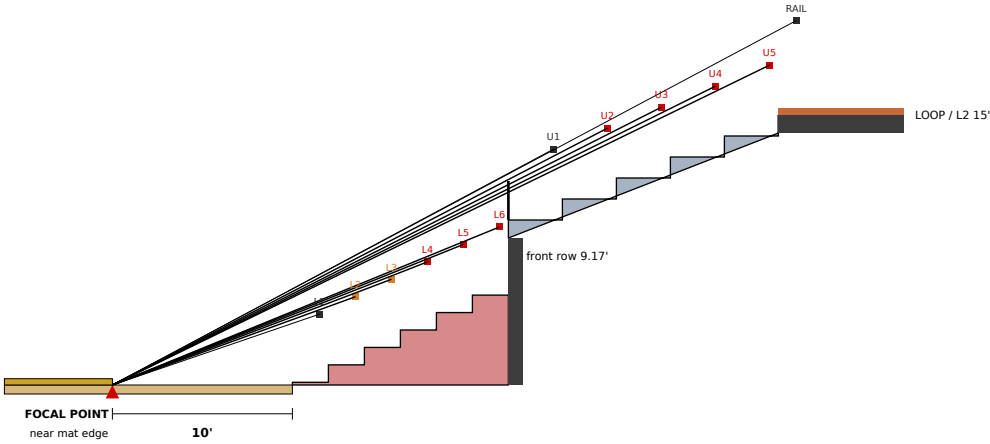

3 REV D BASIS (SUPERSEDED) — EAST SIDE (seated eyes)

3/32" = 1'-0" · focal 10' · upper 14"/row, front 9.17' · P2-A-302 Rev A 'as drawn'


SIGHTLINE GRADE (C, mm)

- ≥ 90 PASS
- 60-90 MARGINAL
- < 60 FAIL

Dots = eyes; label colour = C of that row over the row in front. Values: table.


4 TELESCOPIC STACK UNDER THE UPPER-TIER FRONT

3/16" = 1'-0" · recessed (Hussey) · N/S as drawn · dashed = Rev D 9.17' front

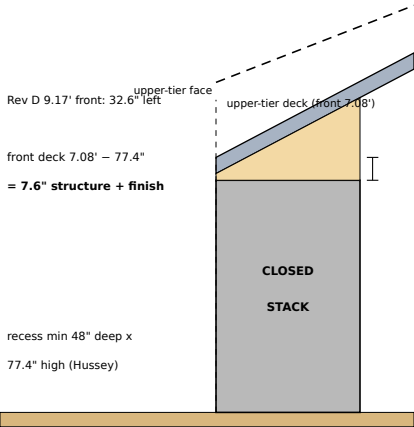

(a) CLOSED — only 7.6" left for structure: DOES NOT FIT

7'-6" ceiling over row 6 (1003.2) = 12.34' need
deck at recess back 9.19' — structure

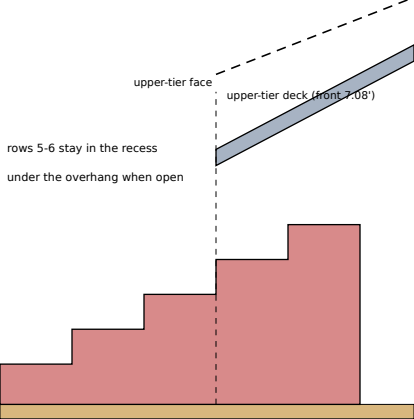

(b) OPEN — rows 5-6 under the overhang: CONFLICT

METHOD

- C = D(N + R)/(D + T) – R (Green Guide 12.3), computed from each actual eye position (also covers the step between tiers and the loop rail). Focal point = near edge of the nearest mat at floor level (Shane). Eyes: seated 1.2 m above the tread, 0.15 m forward of the row's rear edge; standing 1.6 m (5'-3") — secondary sources, see R-020. Grades: ≥ 90 mm PASS (FIFA preferred, CEN/TR 15913 new stands), 60-90 MARGINAL, < 60 FAIL (FIFA minimum 60).
- Focal distances from P2-A-101 Rev E: N and S tier fronts 25' from the nearest mat (10' clear + 15' table zone); E tier front 16' (D-053; building 210'). No west tier. Section-only study (2D); corners and wheelchair positions TBD.

RESULTS — AS DRAWN (REV E, D-053 DECIDED)

- Upper 19" per 36" row (3 aisle risers of 6½", 12" treads; IBC 1030.14.2), front row 7.08' (back stays at the loop, D-049). Every seated row PASSES: N/S ≥ 149 mm, E ≥ 101. Standing: N/S ≥ 127; E ≥ 72 (L4-L6, U4-U5 MARGINAL, none FAIL).
- Lower tier stays at the Hussey 11¼" rise. U1 clears the 26" fascia (326 mm N/S, 263 E seated).

REV D BASIS (SUPERSEDED, P2-A-302 Rev A 'as drawn')

- 14"/row upper + 10' east focal: upper FAILS on every side (N/S seated 40-49, E negative); E lower L4-L6 FAIL. Kept for comparison only; fixed by D-053 on Plan Rev E.

TELESCOPIC STACK UNDER THE UPPER-TIER FRONT (D-049)

- Closed stack, recessed (Hussey min 4'-0" deep x 6'-5¾" high) under the 7.08' front leaves 7.6" for structure + finish — DOES NOT FIT. Open: rows 5-6 would sit under the overhang (< 7'-6", 1003.2). Keep the stack in front of the upper-tier face (as P2-A-301 Rev C).

LOW BAND + EXIT PATHS (D-061 OPEN, R-022)

- 1.5' tier structure (ASSUMED) leaves 5.6' / 7.2' under rows 1-2 (6' low band). Exit N, Exit E, SE concourse and the lobby / portal / athlete-route edge run under it. Option A: omit rows 1-2 there (–125 seats; –56 with rails). Option B: L2 17'-9" + 21" risers (front 9.0'): C unchanged (149 / 101 seated).

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT

Hazel Green Regional Athletic Complex
Trojan Horse Arena · Hazel Green area, Madison
County, Alabama (site TBD, D-006)

PHASE

PHASE 2

SHEET TITLE

SIGHT-LINE STUDY
SCHEMATIC · COLOR

SCALE

AS
NOTED

DATE

October
2026

REV

B

DRAWN BY

Drawn by KEYSTONE (AI) for
Shane Brazelton

SHEET

P2-A-302