



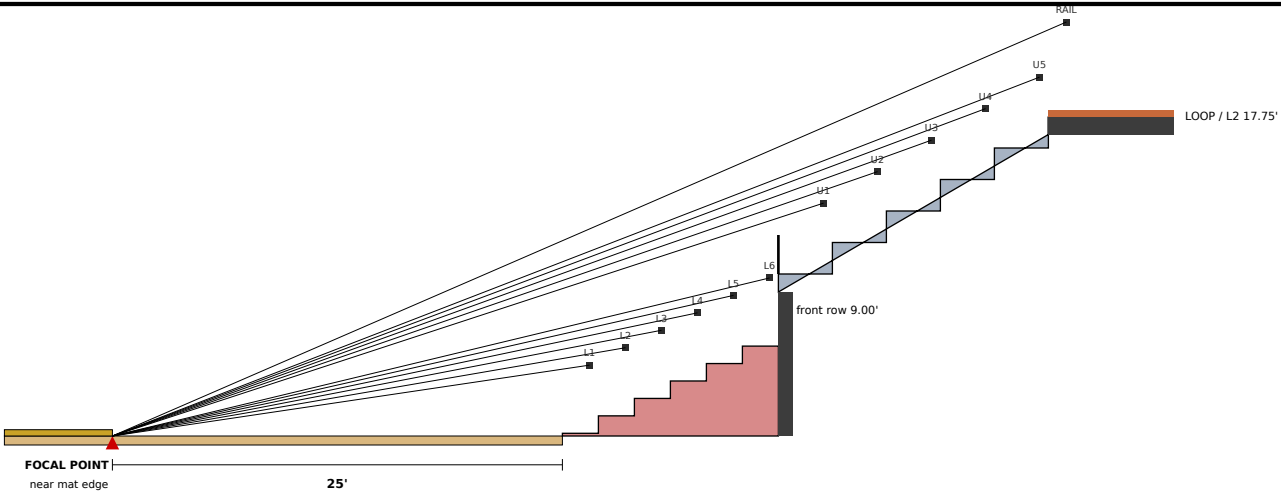


1 AS DRAWN (REV F) — NORTH / SOUTH SIDE (seated eyes)

3/32" = 1'-0" · focal 25' (10' clear + 15' table zone) · telescopic 11¼" · upper 21"/row, L2 17'-9", front 9.0'

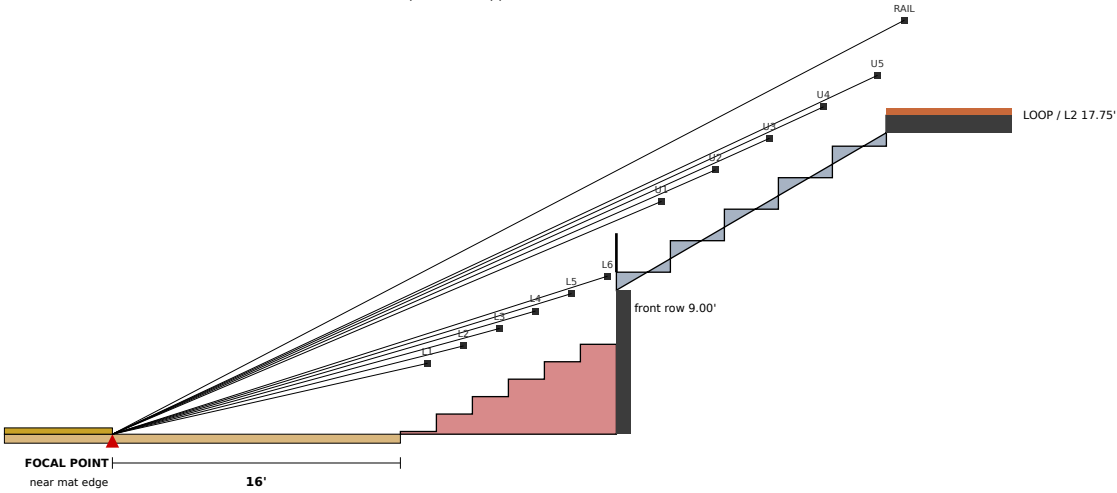

2 AS DRAWN (REV F) — EAST SIDE (seated eyes)

3/32" = 1'-0" · focal 16' (D-053) · upper 21"/row, L2 17'-9" · worst side

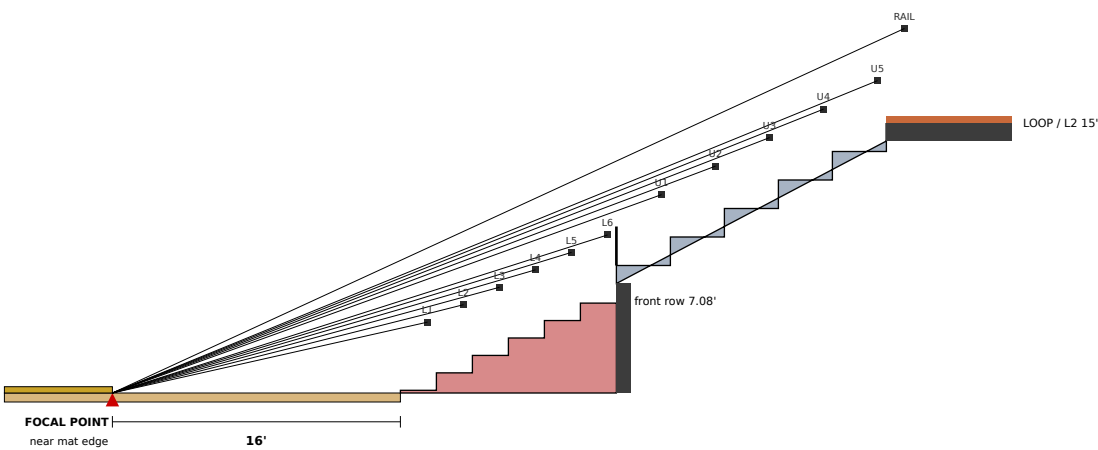

3 REV E BASIS (SUPERSEDED) — EAST SIDE (seated eyes)

3/32" = 1'-0" · focal 16' · L2 15' · upper 19"/row, front 7.08' · P2-A-302 Rev B 'as drawn'


SIGHTLINE GRADE (C, mm)

- ≥ 90 PASS
- 60-90 MARGINAL
- < 60 FAIL



Dots = eyes; label colour = C of that row over the row in front. Values: table.

4 TELESCOPIC STACK UNDER THE UPPER-TIER FRONT

3/16" = 1'-0" · recessed (Hussey) · N/S as drawn 9.0' · dashed = Rev E 7.08'

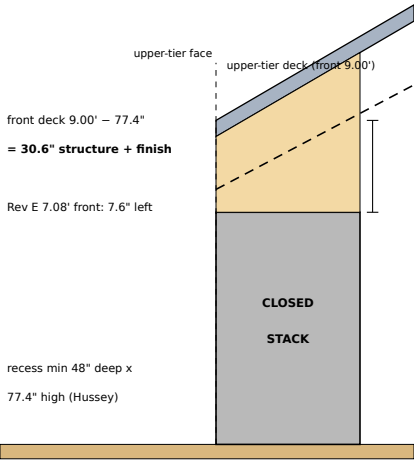

(a) CLOSED — fits only if structure ≤ 30.6" (as drawn)

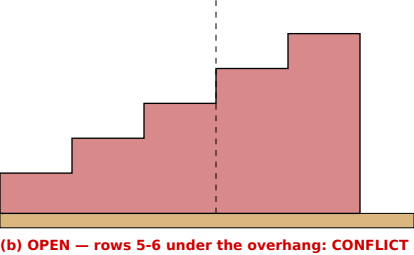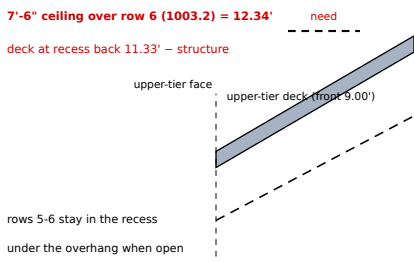

| ROW             | AS DRAWN (P2-A-101 Rev F / A-301 Rev D) |               |              |             | REV E BASIS (superseded) |               |              |             |
|-----------------|-----------------------------------------|---------------|--------------|-------------|--------------------------|---------------|--------------|-------------|
|                 | N/S 25' seated                          | N/S 25' stand | E 16' seated | E 16' stand | N/S 25' seated           | N/S 25' stand | E 16' seated | E 16' stand |
| L2              | 190                                     | 162           | 142          | 101         | 190                      | 162           | 142          | 101         |
| L3              | 178                                     | 152           | 129          | 92          | 178                      | 152           | 129          | 92          |
| L4              | 167                                     | 142           | 118          | 84          | 167                      | 142           | 118          | 84          |
| L5              | 157                                     | 134           | 109          | 77          | 157                      | 134           | 109          | 77          |
| L6              | 149                                     | 127           | 101          | 72          | 149                      | 127           | 101          | 72          |
| U1              | 967                                     | 937           | 879          | 840         | 428                      | 397           | 352          | 313         |
| U2              | 217                                     | 189           | 133          | 97          | 211                      | 183           | 139          | 103         |
| U3              | 203                                     | 177           | 122          | 89          | 198                      | 171           | 127          | 94          |
| U4              | 191                                     | 166           | 112          | 82          | 185                      | 161           | 118          | 87          |
| U5              | 179                                     | 156           | 105          | 76          | 175                      | 151           | 109          | 81          |
| RAIL (stands)   | 736                                     | 336           | 696          | 296         | 709                      | 309           | 673          | 273         |
| fascia clr (U1) | 289                                     | 664           | 215          | 583         | 326                      | 701           | 263          | 631         |
| front row (ft)  | 9.00                                    | 9.00          | 9.00         | 9.00        | 7.08                     | 7.08          | 7.08         | 7.08        |

METHOD

- C = D(N + R)/(D + T) – R (Green Guide 12.3), computed from each actual eye position (also covers the step between tiers and the loop rail). Focal point = near edge of the nearest mat at floor level (Shane). Eyes: seated 1.2 m above the tread, 0.15 m forward of the row's rear edge; standing 1.6 m (5'-3") — secondary sources, see R-020. Grades: ≥ 90 mm PASS (FIFA preferred, CEN/TR 15913 new stands), 60-90 MARGINAL, < 60 FAIL (FIFA minimum 60).
- Focal distances from P2-A-101 Rev F: N and S tier fronts 25' from the nearest mat (10' clear + 15' table zone); E tier front 16' (D-053). No west tier. Section-only study (2D); corners and wheelchair positions TBD.

RESULTS — AS DRAWN (REV F, D-061 DECIDED)

- L2 FF 17'-9", upper 21" per 36" row (3 aisle risers of 7", 12" treads; IBC 1030.14.2), front row 9.0'. Every seated row PASSES: N/S ≥ 149 mm, E ≥ 101 (lower tier governs, same as Rev E). Upper tier seated N/S ≥ 179, E ≥ 105.
- Standing: N/S ≥ 127; E ≥ 72 (L4-L6 and U3-U5 MARGINAL, none FAIL). U1 clears the 26" fascia (289 mm N/S, 215 E seated).

REV E BASIS (SUPERSEDED, P2-A-302 Rev B 'as drawn')

- L2 15', 19"/row, front 7.08': same lower-tier minimums; upper seated N/S ≥ 175, E ≥ 109; standing E ≥ 81. Kept for comparison only.

TELESCOPIC STACK UNDER THE UPPER-TIER FRONT (D-049)

- Closed stack, recessed (Hussey min 4'-0" deep x 6'-5½" high) under the 9.0' front leaves 30.6" for structure + finish (1.5' = 18" ASSUMED) — FITS closed. Open: rows 5-6 still sit under the overhang (< 7'-6", 1003.2): keep the stack in front of the upper-tier face (as P2-A-301 Rev D).

EXIT PATHS (D-061 DECIDED, Option B)

- 1.5' tier structure (ASSUMED) leaves 7'-6" under row 1 (1003.2 minimum, no margin) and 9.25'+ under rows 2-5: no low band; Exit N, Exit E, SE concourse and the lobby / portal / athlete-route edge are clear. 0 seats lost.

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT

Hazel Green Regional Athletic Complex  
Trojan Horse Arena · Hazel Green area, Madison  
County, Alabama (site TBD, D-006)

PHASE

PHASE 2

SHEET TITLE

SIGHT-LINE STUDY  
SCHEMATIC · COLOR

SCALE

AS  
NOTED

DATE

October  
2026

REV

C

DRAWN BY

Drawn by KEYSTONE (AI) for  
Shane Brazelton

SHEET

P2-A-302