



EVENT LOCKER ROOM 1 — 900 SF · 18 occ.

1/8" = 1'-0" · door on the E wall → EXIT (N) passage · common path 46 ft ≤ 75 (PASS)

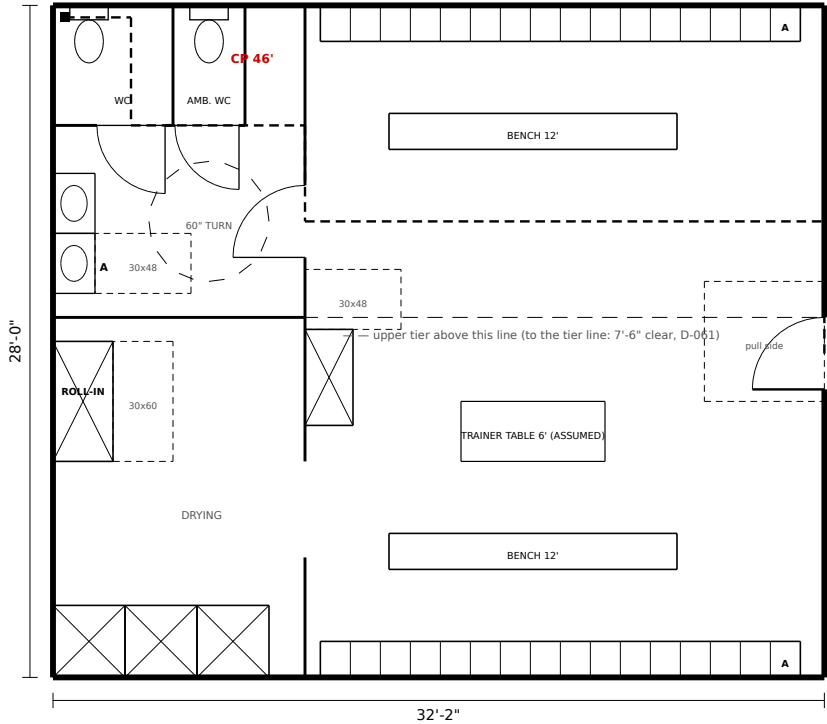


EVENT LOCKER ROOM 2 — 900 SF · 18 occ.

1/8" = 1'-0" · door on the W wall → EXIT (N) passage · common path 46 ft ≤ 75 (PASS)

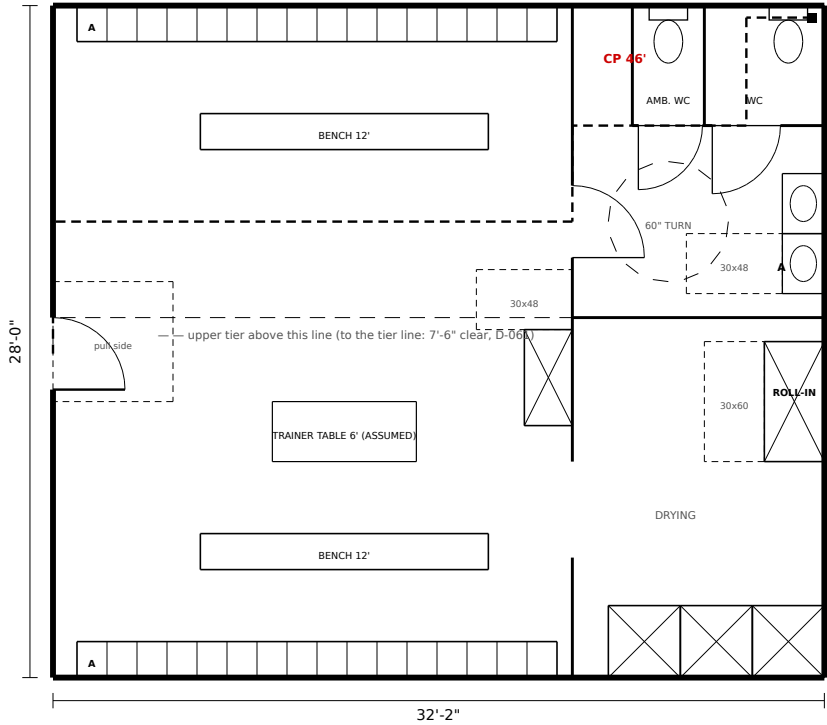


EVENT LOCKER ROOM 3 — 900 SF · 18 occ.

1/8" = 1'-0" · door on the S wall → EXIT (E) passage · common path 51 ft ≤ 75 (PASS)

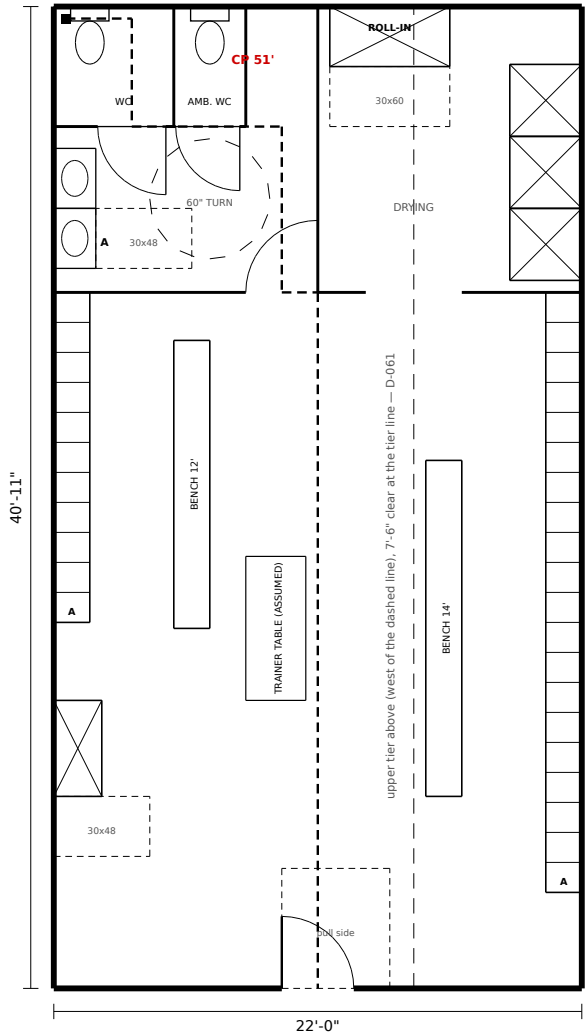

EVENT LOCKER ROOM 4 — 900 SF · 18 occ.

1/8" = 1'-0" · door on the N wall → EXIT (E) passage · common path 51 ft ≤ 75 (PASS)

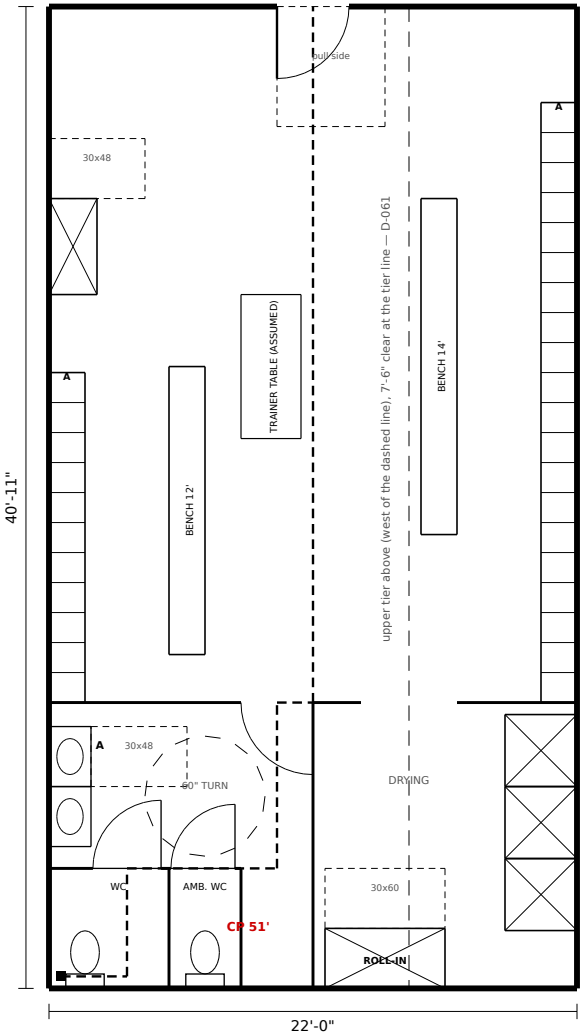


WOMEN — L1 (chairs-only) — TEST-FIT

42 WC · 12 lav · 1,353 SF net

KEY PLAN — L1 (A-101 H)


1" = 250' · grey = rooms 1-4



blue = drawn M / W (L1)

MEN — L1 (chairs-only) — TEST-FIT

8 WC + 14 urinals · 9 lav · 782 SF net

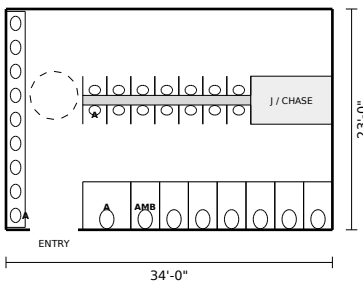

Test-fit plans 1" = 20'. Rooms NOT redrawn on A-101 Rev H (D-069 OPEN). A = accessible · AMB = ambulatory · dashed circle = 60 in turning space · grey = chase / janitor.

Schematic enlarged plans: fixture counts, benches, lockers and showers ASSUMED (KEYSTONE). Accessible fixture sizes are ADA 2010 minimums for the architect to develop; not a code review (D-008).

COMMON PATH — VERIFIED ON THIS LAYOUT (T1006.2.1)

One exit access doorway allowed when the space holds <= 49 occupants and the common path of egress travel is <= 75 ft (Group A, sprinklered) — IBC 2021 1006.2.1, Table 1006.2.1.

ROOM	OCC.	WORST POINT	CP ft	RESULT	+ TO EXIT
1	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
2	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
3	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft
4	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft

Rooms 1-4 unchanged from Rev A (approved, D-068); envelopes identical on plan Rev H. Travel to the exit door ≤ 66 ft vs 250 ft (T1017.2).

LOCKER ROOMS — FIXTURES (ASSUMED; ADA 2010)

ITEM	RM 1-2	RM 3-4	BASIS
Water closets	2	2	1 wheelchair 60x60 (604.8.1) + 1 ambulatory (604.8.2)
Lavatories	2	2	1 accessible (606)
Showers	4	4	1 roll-in 30x60 (608.2.2) + 3 at 36x36
Lockers 15 in	32	31	2 accessible ≥ 5 % (225.2.1, 811)
Benches	2 + 1	2 + 1	+ 1 accessible 24x48 (903)
Occupant load	18	18	900 SF / 50 gross (T1004.5): one door

Accessibility per Rev A: 604.8, 606, 608, 803, 811, 903; turning space 304 in each room. Wet zones on the inner walls (ASSUMED).

L1 PUBLIC RESTROOMS — CHAIRS-ONLY (D-064 · D-069 OPEN)

D-064 DECIDED Option 2 (Shane 1:22 PM CT): L1 load = chairs-only floor 2,346 + lower seats 1,100 = 3,446 (IBC 2021 T2902.1, 50/50 split 2902.1.1). Drawn rooms (A-101 Rev H) hold the Rev I set (1,428).

FIXTURE	REQUIRED	DRAWN	TEST-FIT	SHORT
Men WC (urinals ≤ 67 %, IPC 424.2)	22	10	8 + 14 ur	+12
Men lavatories	9	4	9	+5
Women WC	42	18	42	+24
Women lavatories	12	5	12	+7
Drinking fountains (hi-lo)	4	2	concourse	+2
ROOM AREA (SF)	DRAWN	TEST-FIT NET	+10 %	SHORT
Men (drawn 20 x 35)	700	782	860	+160
Women (drawn 23 x 50)	1,150	1,353	1,488	+338
2 more fountains (alcoves)			36	+36
TOTAL — tight test-fit				+535
TOTAL — 50 SF / fixture (program)				+2,400

FINDING D-069 (OPEN): the drawn L1 rooms are short by about +535 SF on a tight test-fit (stalls 36 x 60 in, 6 ft aisles, +10 % walls / chases, all ASSUMED) and about +2,400 SF on the program's 50 SF per fixture. The architect's layout lands between. Not redrawn — Shane decides:

- Option 1 — grow inside the building: women's room east into the E concourse (about +340 to +1,550 SF; X8 kept reachable), men's room west into the SW flex / storage (about +160 to +850 SF; changes D-039)
- Option 2 — second L1 restroom pair in a one-storey bump-out (about +535 SF test-fit to +2,400 SF planning factor; location TBD, east side by the concourse closest)
- Option 3 — mix: Option 1 for the men's room + Option 2 for the women's room (as D-069)

Until D-069 is decided: events above the drawn fixture count use temporary units (D-064 Option 2).

Sources: params/phase2_enlarged.yaml, phase2_enlarged_rev_b.yaml, phase2_plan_rev_h.yaml; IBC 2021 T2902.1, 2902.1.1, 1006.2.1, T1004.5, T1017.2; IPC 2021 405.3.1, 405.3.5, 424.2 (UpCodes, retrieved 2026-10-04); ADA 2010 213.3, 304.3, 604.8, 605, 606, 608, 811, 903 (www.ada.gov); D-060, D-061, D-064, D-068, D-069; Shane 2026-10-04 1:21 / 1:22 PM CT.

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT	PHASE	SHEET TITLE	SCALE	DATE	REV	DRAWN BY	SHEET
Hazel Green Regional Athletic Complex Trojan Horse Arena · Hazel Green area, Madison County, Alabama (site TBD, D-006)	PHASE 2	ENLARGED PLANS LOCKER RMS 1-4 + RESTROOM TEST-FIT	AS NOTED	October 2026	B	Drawn by KEYSTONE (AI) for Shane Brazelton	P2-A-401