



EVENT LOCKER ROOM 1 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the E wall → EXIT (N) passage • common path 46 ft ≤ 75 (PASS)

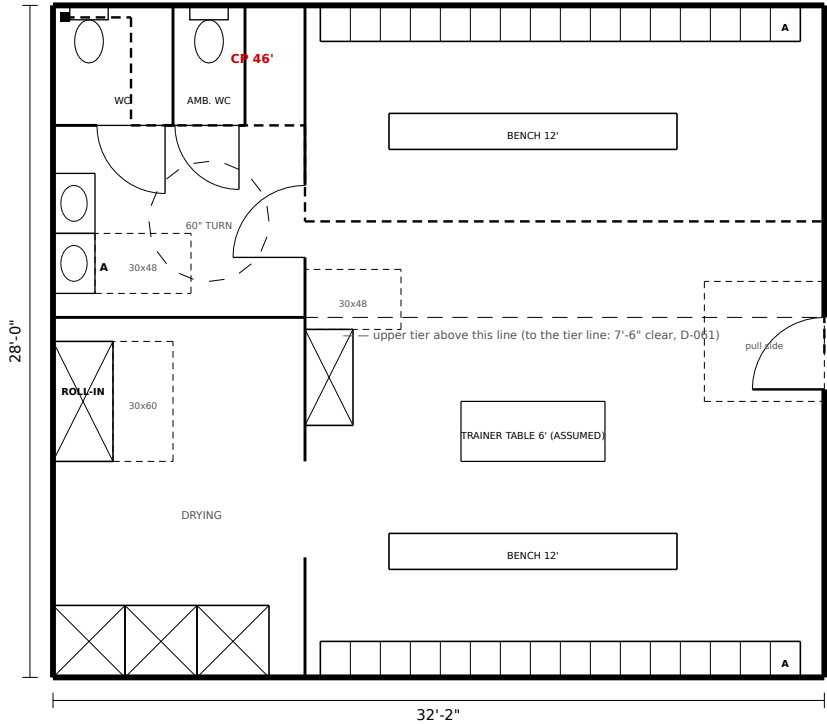


EVENT LOCKER ROOM 2 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the W wall → EXIT (N) passage • common path 46 ft ≤ 75 (PASS)

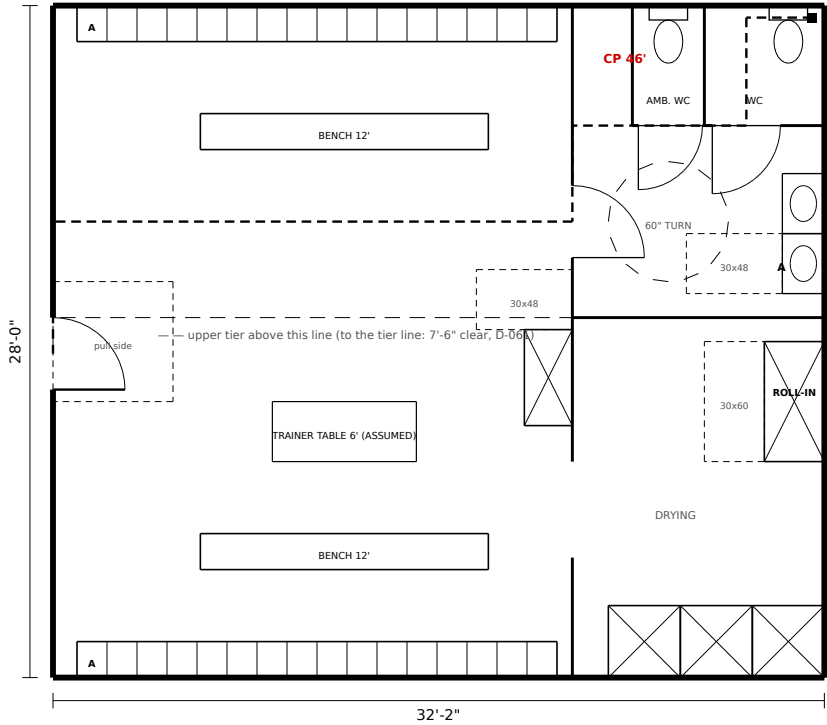


EVENT LOCKER ROOM 3 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the S wall → EXIT (E) passage • common path 51 ft ≤ 75 (PASS)

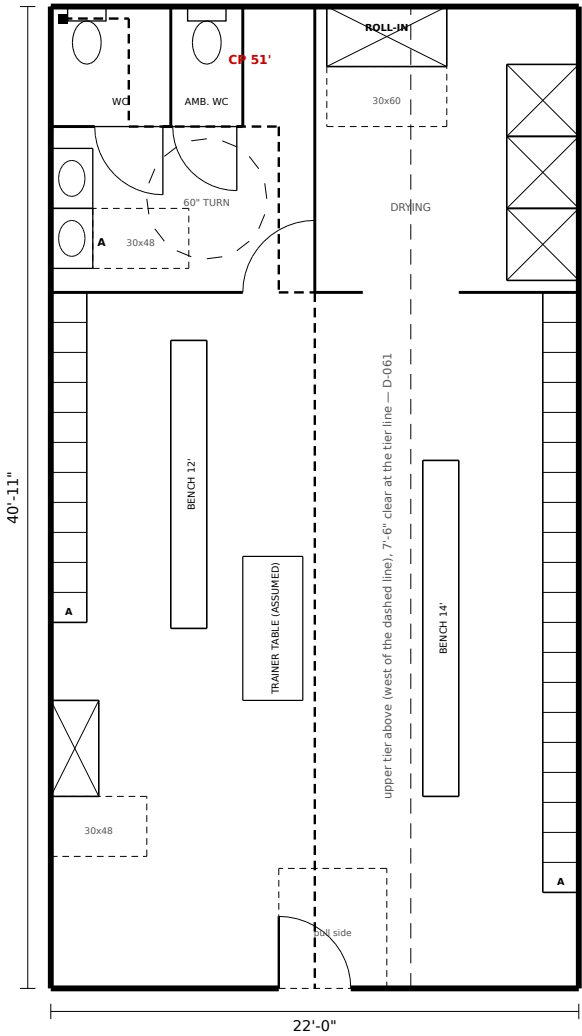


EVENT LOCKER ROOM 4 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the N wall → EXIT (E) passage • common path 51 ft ≤ 75 (PASS)

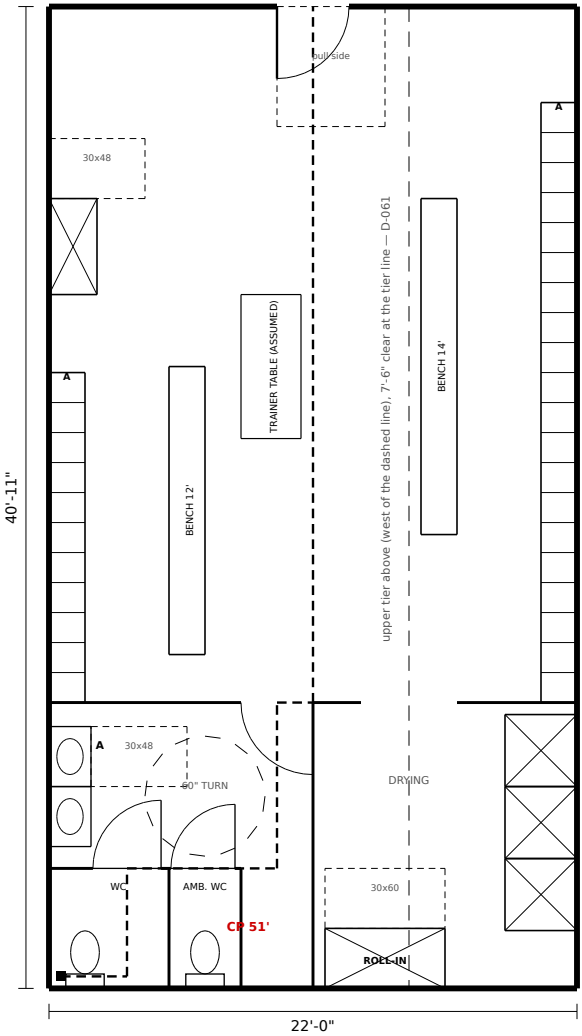

KEY PLAN — L1 (A-101 J)

1" = 250' • grey = rooms 1-4



blue = restrooms • green = public corridor (E)

CORE 2 AREA (SF)	DRAWN	TEST-FIT NET	WALLS / CHASE
Women (2), 30 x 34 (bump-out)	1,020	957	+6.6 %
Mech (E2), 30 x 22 (bump-out)	660		
BUMP-OUT 30 x 56 (A-101 J)	1,680		
Men (2), 14 x 26 (strip)	364	331.5	+9.8 %
DF alcove + janitor, 14 x 4	56		
Public corridor (E), 8 x 78.18	625		
Mech (E), 14 x 48.18	674.5		was 1,720
OLD MECH (E) STRIP 22 x 78.18	1,720		GSF ±0

WHY THE CORRIDOR (D-072): on plan Rev I the public reached core 2 only through V2 / EXIT (E) — across the event floor, with restroom queues in the exit passage. Rev J slides the bump-out 42 ft south (entirely south of EXIT (E)) and adds an 8 ft public corridor from Concourse (E), behind the tier line: restroom doors open only onto it, EXIT (E) stays clear, and X11 gives the corridor its own exit (common path 61 ft ≤ 75).

MEP (OPEN): Mech (E) 1,720 -> 674.5 SF + MECH (E2) 660 SF; total mech = 3,496 SF = 4.1 % of 85,793 GSF vs 5 % planning (R-014). Engineer to confirm; the storage annex (north) can absorb ~800 SF later. Plumbing: men's (strip) and women's (bump-out) wet walls meet across the corridor; waste / vent under slab (ASSUMED).

Public toilets within one storey and 500 ft of every seat (IBC 2902.3.3): PASS. Dead end past the last door ≈ 5 ft ≤ 20 ft (1020.5).

Sources: params/phase2_enlarged.yaml, phase2_enlarged_rev_d.yaml, phase2_plan_rev_j.yaml, phase2_program.yaml (rev_k); IBC 2021 T2902.1, 2902.3.3, 1003.6, 1006.2.1, 1020.5, T1017.2; IPC 2021 405.3.1, 405.3.5, 424.2; ADA 2010 211.2, 213.3, 304.3, 602, 604.8, 605, 606; D-064, D-068, D-069, D-070, D-072; R-014; Shane 2026-10-04 evening.

Schematic enlarged plans: fixture counts, benches, lockers and showers ASSUMED (KEYSTONE). Accessible fixture sizes are ADA 2010 minimums for the architect to develop; not a code review (D-008).

COMMON PATH — VERIFIED ON THIS LAYOUT (T1006.2.1)

One exit access doorway allowed when the space holds ≤ 49 occupants and the common path of egress travel is ≤ 75 ft (Group A, sprinklered) — IBC 2021 1006.2.1, Table 1006.2.1.

ROOM	OCC.	WORST POINT	CP ft	RESULT	+ TO EXIT
1	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
2	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
3	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft
4	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft

Rooms 1-4 unchanged (Rev A approved, D-068). Rooms 3-4 reach X7 on the building wall again (EXIT (E) clear, D-072): travel ≤ 66 ft vs 250 ft (T1017.2). Locker fixtures as Rev A (ADA 604.8, 606, 608, 803, 811, 903).

L1 PUBLIC RESTROOMS — CHAIRS-ONLY (D-064 • D-069 • D-072)

L1 load chairs-only 2,346 + 1,100 = 3,446 (IBC 2021 T2902.1, 50/50 split 2902.1.1). Lobby core = rooms 4 + 5; core 2 = women (2) in the bump-out + men (2) and DF in the old Mech (E) strip, all off the public corridor (E).


FIXTURE	REQ.	LOBBY	CORE 2	TOTAL	RESULT
Men WC (incl. urinals)	22	10	5 + 7 ur	22	PASS
Men lavatories	9	4	5	9	PASS
Women WC	42	18	24	42	PASS
Women lavatories	12	5	7	12	PASS
Drinking fountains	4	2	2 (hi-lo)	4	PASS

Urinals: core 2 7 ≤ 8 = 67 % of its 12 (IPC 2021 424.2, R-009). 1 accessible urinal (ADA 213.3.3, 605); 1 wheelchair + 1 ambulatory compartment per room (213.3.1, 604.8); 1 accessible lav (606); 60 in turning space (304.3); hi-lo fountains (211.2, 602).

RESTROOM CORE 2 + PUBLIC CORRIDOR (E) — D-072 • ENLARGED PLAN

1" = 22'-0" • plan turned: north → right, east → down • test-fits ASSUMED

25 MEN (2) • 364 SF • 5 WC + 7 UR • 5 LAV

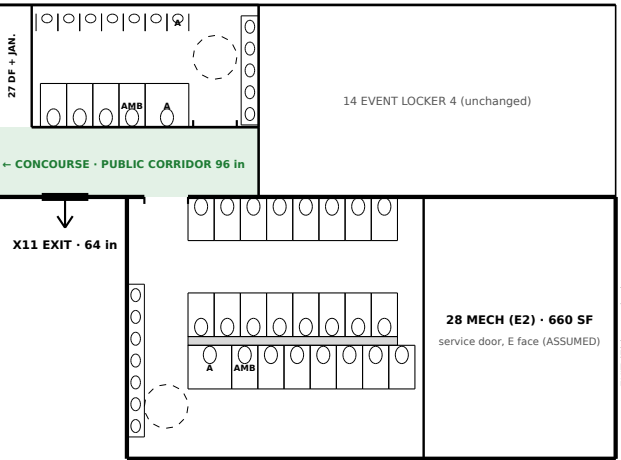

26 WOMEN (2) • 1,020 SF • 24 WC • 7 LAV

bump-out 56'-0" (N-S) x 30'-0" (E-W) = 1,680 SF, one storey

A = accessible • AMB = ambulatory • dashed circle = 60 in turning space • grey = chase • ticks = room entry

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT	PHASE	SHEET TITLE	SCALE	DATE	REV	DRAWN BY	SHEET
Hazel Green Regional Athletic Complex Trojan Horse Arena • Hazel Green area, Madison County, Alabama (site TBD, D-006)	PHASE 2	ENLARGED PLANS LOCKER RMS + RESTROOM CORE 2	AS NOTED	October 2026	D	Drawn by Claude (AI) for Shane Brazelton	P2-A-401