



1 SECTION A-A (NORTH-SOUTH) — looking west

1/32" = 1'-0" · x = 100 (see key plan)

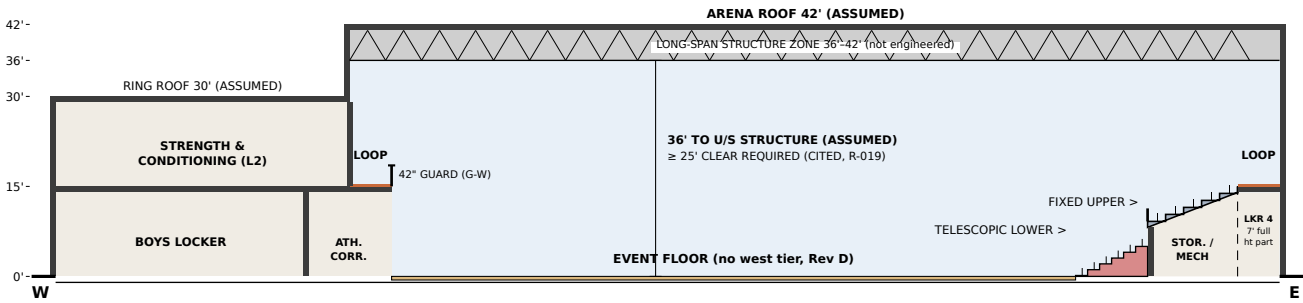


2 SECTION B-B (EAST-WEST) — looking north

1/32" = 1'-0" · y = 150 (see key plan)

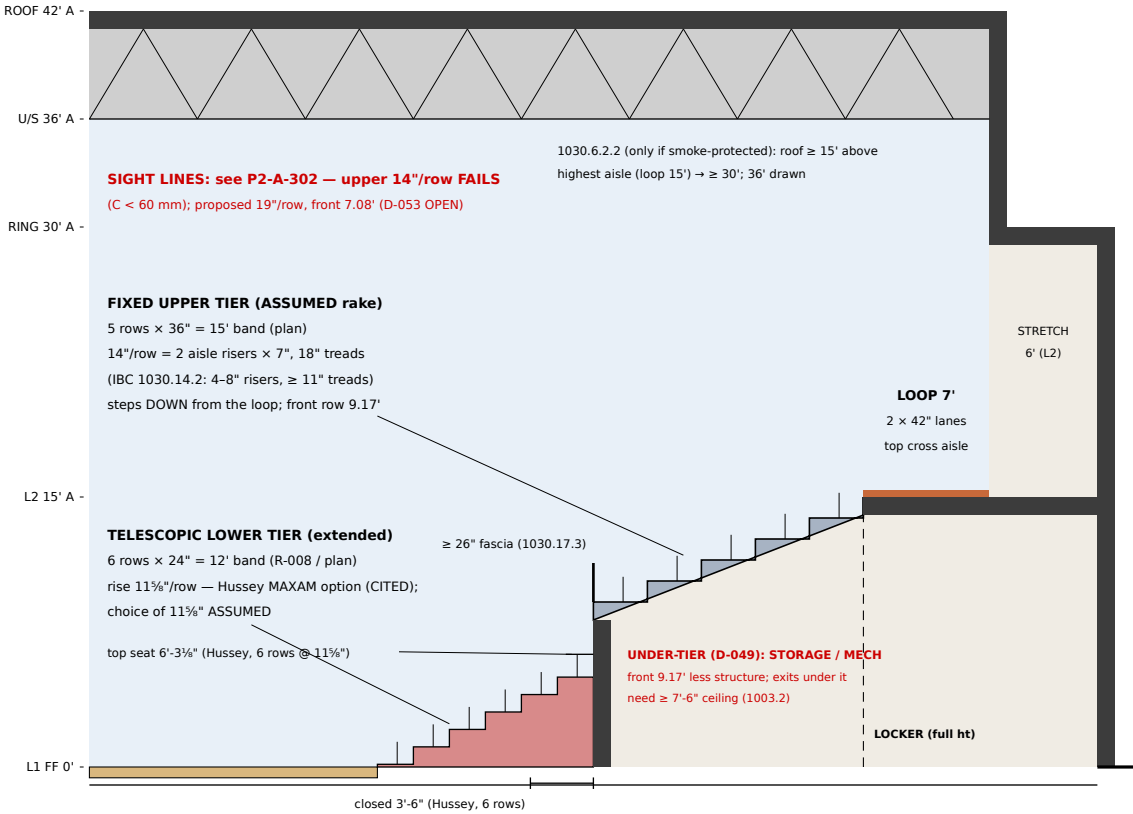


3 NORTH BOWL EDGE (ENLARGED PART OF A-A)

3/32" = 1'-0" · y 196-252 at x = 100

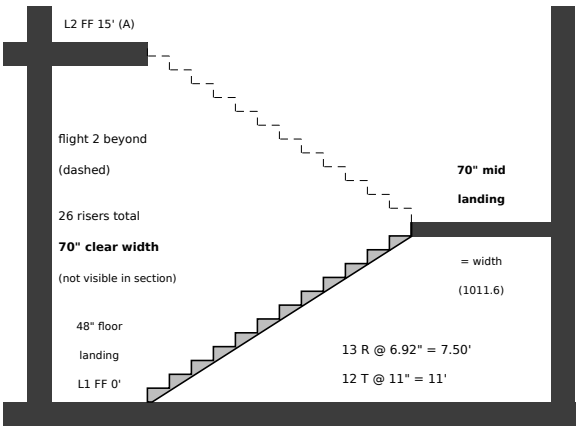


4 TYPICAL EXIT STAIR — 70" CLEAR

1/8" = 1'-0" · 70" mid landing (D-051) · 11.67' × 20.83' plan

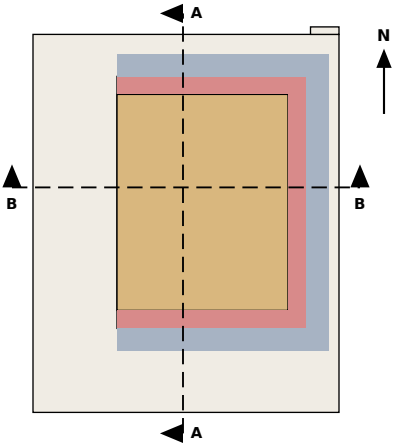

5 KEY PLAN — CUTS

1" = 128' · north up



HEIGHTS USED (ft above L1 FF 0'-0")

- L2 FF 15' — ASSUMED (R-015, 15 ft floor-to-floor).
- Ring roof 30' — ASSUMED (L2 + 15 ft).
- Arena structure underside 36' — ASSUMED; ≥ 25' clear over the floor is CITED (R-019: NFHS via Draper, LA RAP) → 11' margin.
- Arena roof top 42' — ASSUMED (36' + 6' long-span structure zone, not engineered).
- Slab, wall and roof thicknesses are graphic only (not designed). Parapets TBD.

SEATING

- Lower tier: telescopic, 6 rows × 24" (R-008, plan Rev D 12' band). Hussey MAXAM rises 9%, 11%, 16" (CITED); 11% drawn (ASSUMED choice): top seat 6'-3½", closed 3'-6" (Hussey tables). Hussey open depth at 24" is 11'-3" vs the 12' band.
- Upper tier: fixed, 15' band (plan); 5 rows × 36", 14"/row (2 × 7" aisle risers, 18" treads) — ASSUMED, within IBC 2021 1030.14.2. Steps DOWN from the loop (L2 FF = top cross aisle) to a 9.17' front row. Not drawn: tier on the L2 deck rising to ≈ 21' (the 36' basis in phase2_elev.yaml).
- UNDER THE UPPER TIER (D-049 DECIDED): steps DOWN from the loop as drawn; under the low front edge: telescopic stack (at the tier face), storage, mechanical. Lockers only where headroom is full (under the flat L2 slab — ASSUMED reading). Front ≈ 9.2' less structure; exit passages under it need ≥ 7'-6" (1003.2). Event lockers 1-4 re-planned at the next A-101.
- SIGHT LINES: P2-A-302 Rev A. Rake unchanged here pending Shane: upper 14"/row fails (C < 60 mm); proposed 19"/row + east tier 6' further out (D-053 OPEN). Closed stack recessed under the tier front conflicts — keep it at the tier face.

GUARDS

- Loop open edges G-W (x = 56) and G-S (y = 34): 42" guards, IBC 2021 1015.2 / 1015.3.
- Upper-tier front: sightline-constrained fascia ≥ 26" (1030.17.3); 36" at the foot of aisles (1030.17.4). Type TBD.

STAIRS (ST-1..ST-4)

- 70" clear — D-038 CLOSED (Shane 6:45 AM CT). Handrail projections ≤ 4½" each side (1014.8): architect to confirm how 'clear' is measured.
- 26 risers @ 6.92" (15' ÷ 26), 2 flights of 13, 11" treads (1011.5.2). Intermediate (switchback) landing 70" = stair width (1011.6 width rule at the 180° turn; 48" = straight-run depth) — D-051; floor landings 48". Typical shown (not on A-A / B-B).
- Per stair: 11.67' × 20.83' (2 × 70" by 48 + 132 + 70") = 243.1 SF per level, clear — +37.9 SF vs the frozen 10.8' × 19' (205.2); × 4 stairs × 2 levels ≈ +303 GSF at the next A-101/A-102 revision. Egress worst case still 12.4" short: proposed 4 × 76" stairs (D-052 OPEN, R-018.9) — not drawn.

ROOF HEIGHT (IBC 2021 1030.6.2.2)

- Applies only if smoke-protected seating is used: lowest roof deck ≥ 15' above the highest aisle. Highest aisle = the loop at 15' → ≥ 30'; 36' drawn.

CUTS

- A-A: x = 100, looking west (south at left). B-B: y = 150, looking north (west at left). Geometry from P2-A-101/102 Rev D (frozen).
- Colors are graphic only; materials TBD. 'A' = ASSUMED.

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT	PHASE	SHEET TITLE	SCALE	DATE	REV	DRAWN BY	SHEET
Hazel Green Regional Athletic Complex Trojan Horse Arena · Hazel Green area, Madison County, Alabama (site TBD, D-006)	PHASE 2	BUILDING SECTIONS SCHEMATIC · COLOR	AS NOTED	October 2026	B	Drawn by KEYSTONE (AI) for Shane Brazelton	P2-A-301