



EVENT LOCKER ROOM 1 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the E wall → EXIT (N) passage • common path 46 ft ≤ 75 (PASS)

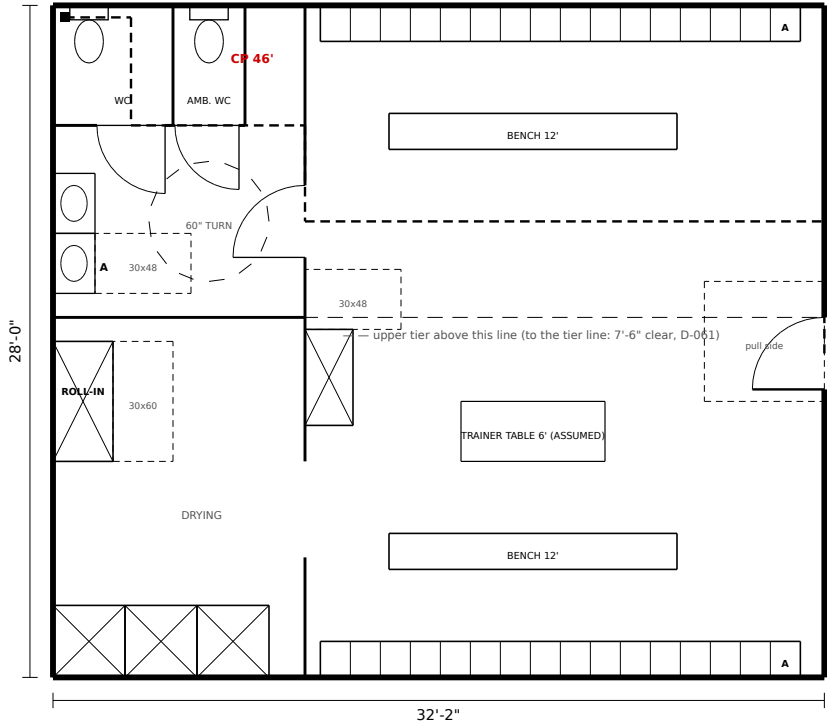


EVENT LOCKER ROOM 2 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the W wall → EXIT (N) passage • common path 46 ft ≤ 75 (PASS)

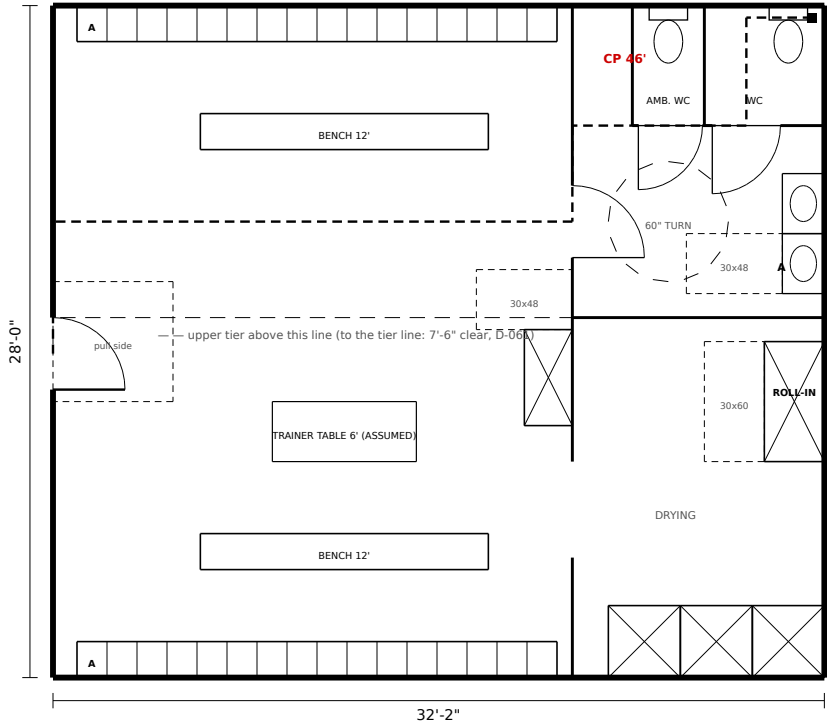


EVENT LOCKER ROOM 3 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the S wall → EXIT (E) passage • common path 51 ft ≤ 75 (PASS)

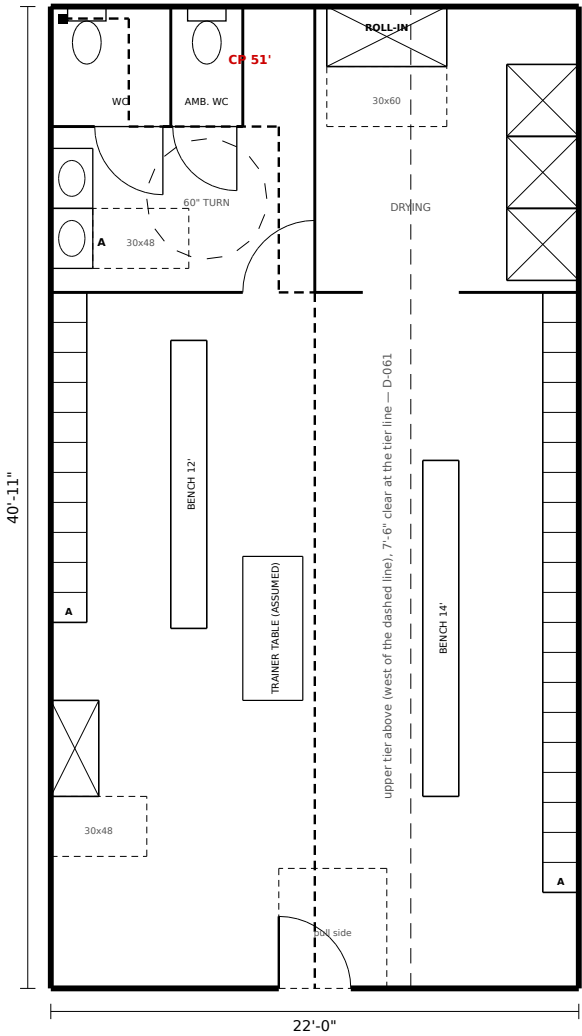


KEY PLAN — L1 (A-101 G) • 1" = 150'

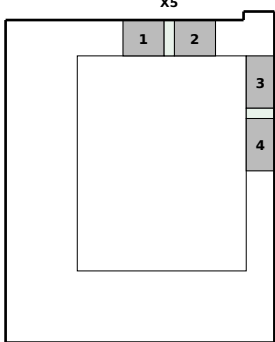

grey = rooms 1-4 • green = EXIT (N) / (E) passages

EVENT LOCKER ROOM 4 — 900 SF • 18 occ.

1/8" = 1'-0" • door on the N wall → EXIT (E) passage • common path 51 ft ≤ 75 (PASS)

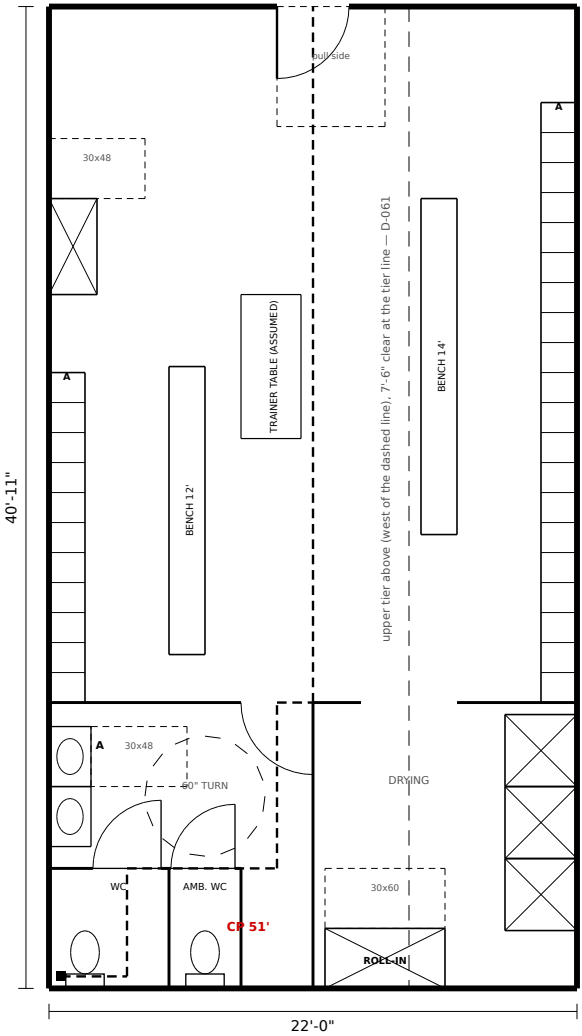

FIXTURES + FURNITURE PER ROOM (ASSUMED; ADA 2010 minimums)

ITEM	RM 1-2	RM 3-4	BASIS
Water closets	2	2	1 wheelchair 60x60 (604.8.1) + 1 ambulatory 36x60 (604.8.2)
Lavatories	2	2	1 accessible: 30x48 forward, rim ≤ 34 in (606)
Showers	4	4	1 roll-in 30x60 + 30x60 clear (608.2.2) + 3 at 36x36
Lockers 15 in	32	31	2 accessible ≥ 5 % = 2 / 2 (225.2.1, 811)
Benches	2 + 1	2 + 1	team benches + 1 accessible 24x48, wall-affixed (903)
Room door	36 in	36 in	34 in clear (404.2.3), swings in (IBC 1010.1.2.1, < 50)
Occupant load	18	18	900 SF / 50 gross (T1004.5) ≤ 49: one door OK

Schematic enlarged plans: fixture counts, benches, lockers and showers ASSUMED (KEYSTONE). Accessible fixture sizes are ADA 2010 minimums for the architect to develop; not a code review (D-008).

COMMON PATH — VERIFIED ON THIS LAYOUT (T1006.2.1)

One exit access doorway allowed when the space holds ≤ 49 occupants and the common path of egress travel is ≤ 75 ft (Group A, sprinklered) — IBC 2021 1006.2.1, Table 1006.2.1. Measured rectilinear from the most remote point, through the inner doorways, to the room door; the common path ends at the room door because the exit passage offers two directions (exterior exit door, or vomitory to the event floor).

ROOM	OCC.	WORST POINT	CP ft	RESULT	+ TO EXIT
1	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
2	18	accessible WC far corner	45.6	≤ 75 PASS	X5 64 ft
3	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft
4	18	accessible WC far corner	50.9	≤ 75 PASS	X7 66 ft

Other points checked per room: shower far corner, locker aisle NW, locker aisle SW (rooms 1-2); all shorter. Travel to the exit door (CP + passage) ≤ 66 ft vs 250 ft (T1017.2). Rectilinear on this layout; walls, door hardware and fixtures ASSUMED → UNVERIFIED until the architect's layout.

ACCESSIBILITY (ADA 2010 STANDARDS) — WHAT IS DRAWN

- 2 WC per room ASSUMED: 1 wheelchair compartment 60 x 60 in (≥ 60 x 59 floor-mounted, 604.8.1.1; WC centerline 18 in from the side wall, 604.2; door in the front partition at the far side, 604.8.1.2) + 1 ambulatory compartment 36 x 60 in (35-37 x ≥ 60, 604.8.2.1; not required below 6 compartments, 213.3.1, provided ASSUMED); 2 lavatories, 1 with forward-approach 30 x 48 in clear floor + knee / toe clearance, rim ≤ 34 in (606.2, 606.3); 60 in turning circle (304.3.1); no urinals (rooms serve either team / sex, ASSUMED)
- 4 showers per room ASSUMED: 1 standard roll-in 30 x 60 in inside with a 60 in entry and a 30 x 60 in clearance at the open face (608.2.2, 608.2.2.1) = the accessible shower (213.3.6); 3 stalls 36 x 36 in (transfer size, 608.2.1)
- freestanding team benches 18 in deep ASSUMED; one accessible bench per room: 24 x 48 in seat, 17-19 in high, affixed to a wall (back support), 30 x 48 in clear floor at its end parallel to its short axis (ADA 803.4, 903.2-903.5)
- 15 x 18 x 72 in single-tier lockers ASSUMED; at least 5 % (min. 1) accessible: storage within 15-48 in reach (ADA 225.2.1, 811, 308.2.1), 30 x 48 in clear floor (305.3)
- 36 in leaf ≈ 34 in clear ≥ 32 in (ADA 404.2.3; IBC 1010.1.1); swings INTO the room so the 8 ft exit passage stays clear — allowed below 50 occupants (IBC 1010.1.2.1) with a 30 x 48 in space beyond the swing (ADA 803.3); pull-side maneuvering 60 in perpendicular + 18 in beyond the latch (ADA Table 404.2.4.1)
- 36 in min clear width along the locker aisles and to every accessible element (ADA 403.5.1)
- Locker room itself: turning space 304 inside (803.2); door swing leaves 30 x 48 clear beyond the arc (803.3). Scoping: 5 % / min. 1 of each locker-room type (222.1) — all 4 rooms laid out the same way.

NOTES

- Rooms: 3,600 SF total (4 x 900, D-060 settled), envelopes from P2-A-101 Rev G, unchanged. The 15 ft of each room nearest the arena lies under the upper tier: 7'-6" clear at the tier line rising away from it (D-061; 1'-6" structure ASSUMED, zero margin) — lockers 72 in and shower / toilet partitions fit.
- Wet zone on the inner wall (rooms 1-2) / inner end (rooms 3-4), away from the exterior wall; plumbing walls back onto equipment / mech rooms (ASSUMED). No urinals: rooms serve either team (ASSUMED). Floor drains, finishes, ventilation: architect / MEP.
- Rooms 2 and 4 are mirror images of rooms 1 and 3 (doors face the shared exit passages).

RESTROOM CORE — NOT IN THIS REVISION

L1 public restroom core NOT in this revision: waits on D-064 (OPEN: size for the worst case or limit the events). Drawn later on P2-A-401 once Shane decides.

Legend: A = accessible element • dashed box = ADA clear floor / clearance • dashed circle = 60 in turning space • X box = shower / accessible bench • red dashed = worst common path (dot = remote point).

Sources: params/phase2_enlarged.yaml; params/phase2_plan_rev_g.yaml; ADA 2010 Standards 213.3.1, 213.3.6, 222.1, 225.2.1, 304.3, 305.3, 308.2.1, 403.5.1, 404.2.3, 404.2.4.1, 604, 606, 608, 803, 811, 903 (www.ada.gov, retrieved 2026-10-04); IBC 2021 1006.2.1, 1010.1.1, 1010.1.2.1, T1004.5, T1017.2 (UpCodes); D-060, D-061, D-064; Shane 2026-10-04 11:24 AM CT.

PRELIMINARY — CONCEPTUAL DESIGN — NOT FOR CONSTRUCTION

PROJECT	PHASE	SHEET TITLE	SCALE	DATE	REV	DRAWN BY	SHEET
Hazel Green Regional Athletic Complex Trojan Horse Arena • Hazel Green area, Madison County, Alabama (site TBD, D-006)	PHASE 2	ENLARGED PLANS EVENT LOCKER ROOMS 1-4	1/8" = 1'-0"	October 2026	A	Drawn by KEYSTONE (AI) for Shane Brazelton	P2-A-401