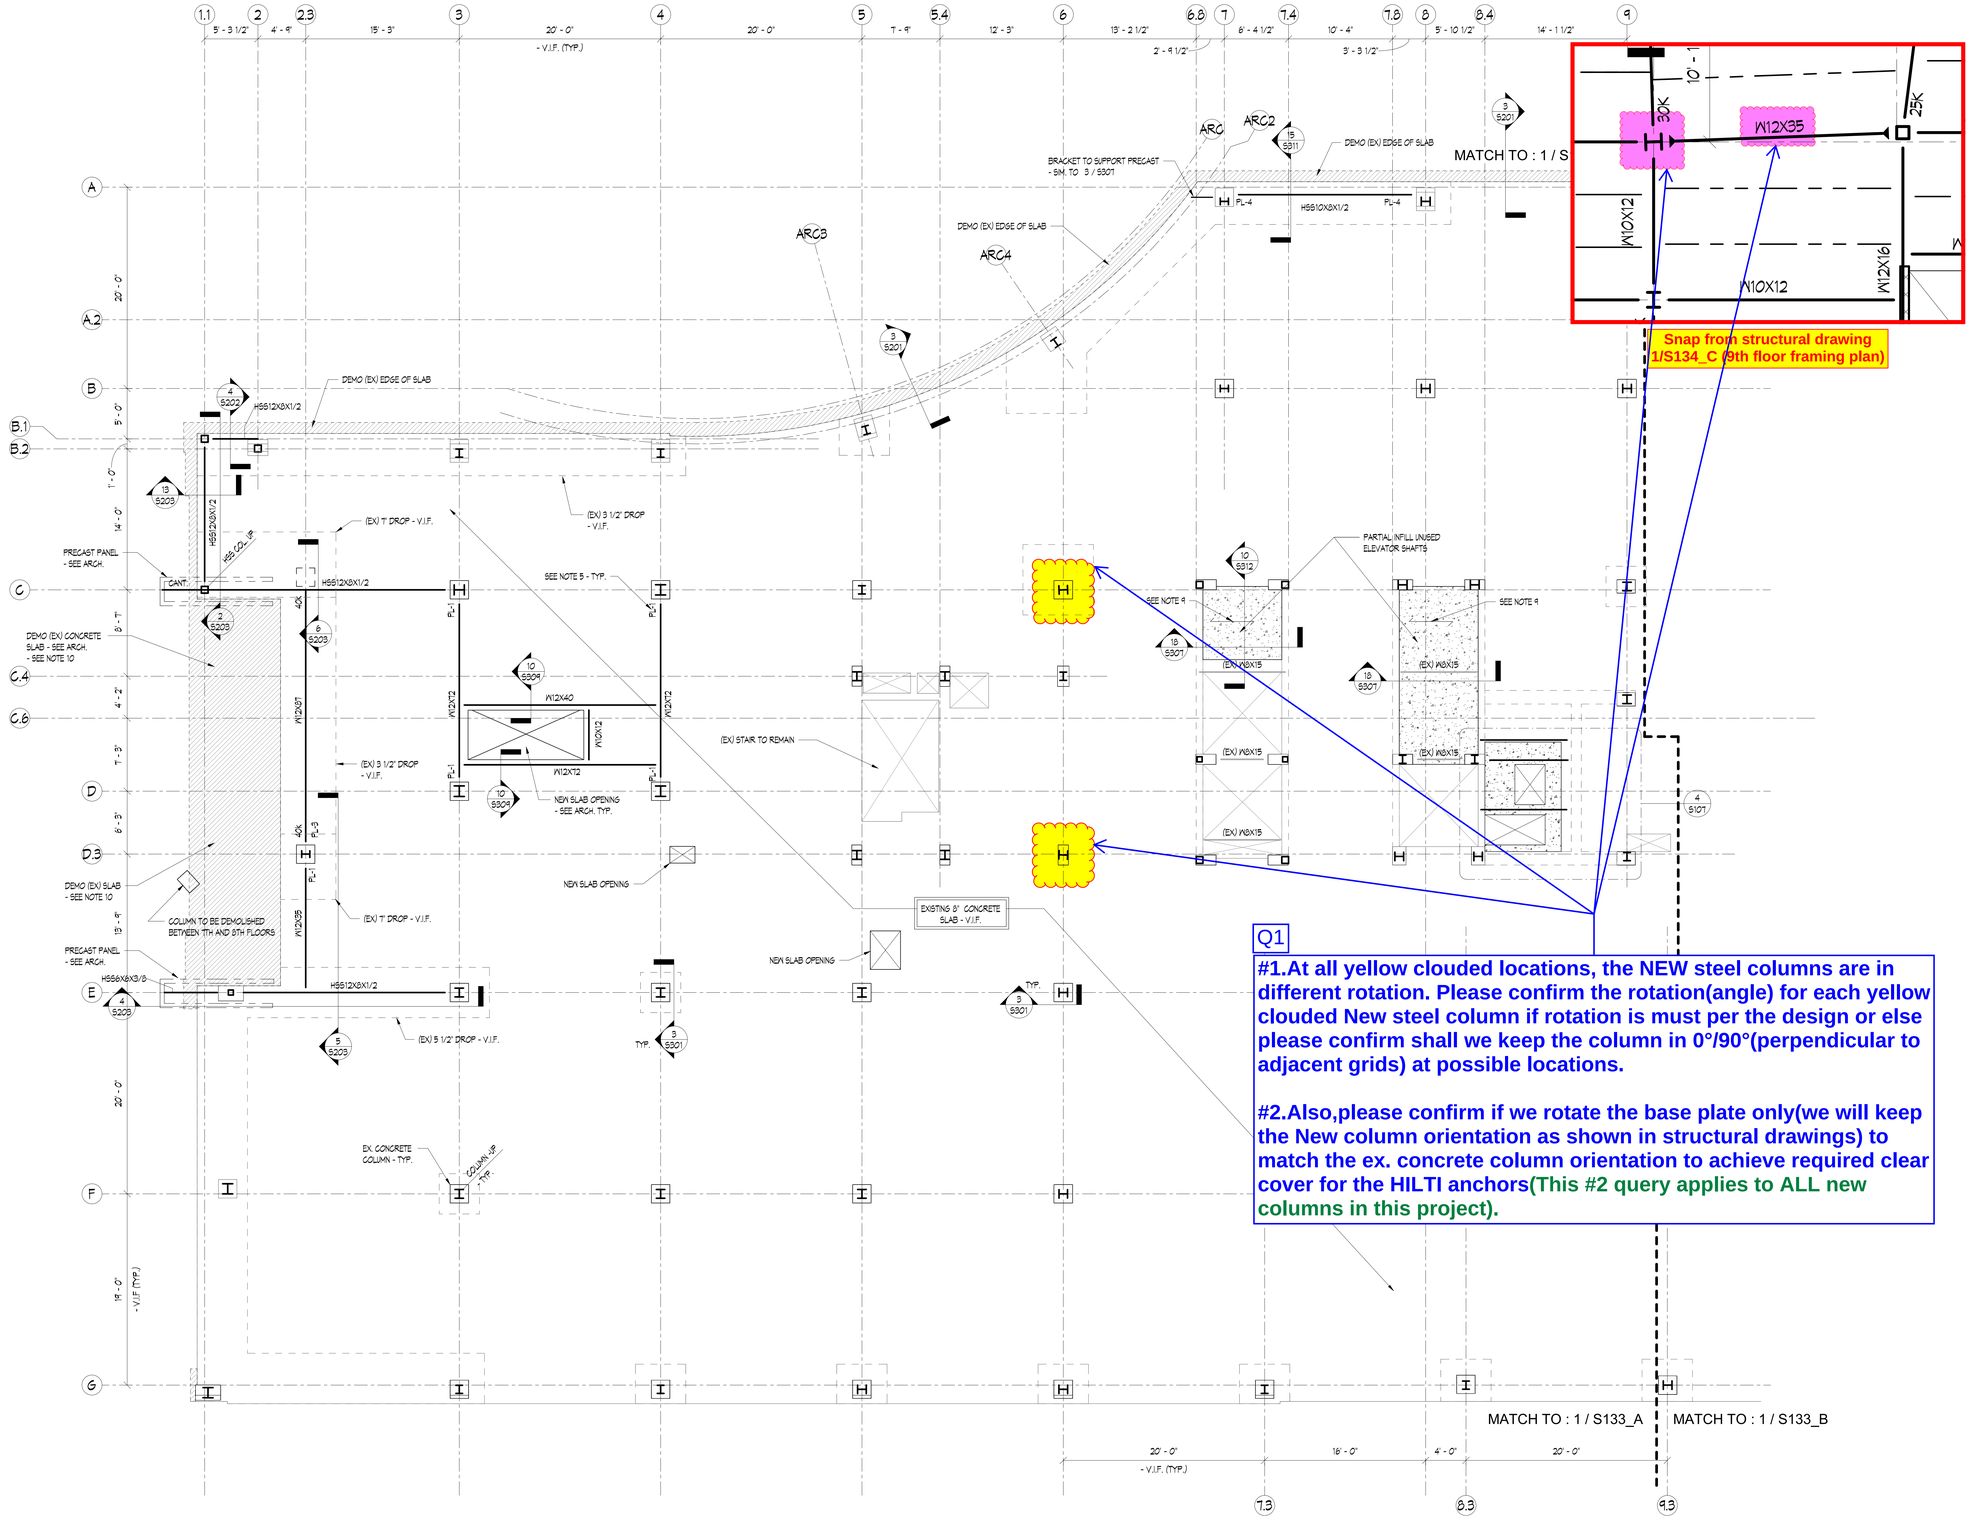

1 PARTIAL LEVEL 08 FRAMING PLAN - ZONE A

SCALE: 3/16" = 1'-0"

PLAN NOTES:
1) TOP OF EXISTING LEVEL 8 SLAB ELEVATION = 125' - 1" (VERIFY IN FIELD).
2) NEW COLUMNS CENTERED OVER EXISTING COLUMNS SHOWN THUS:

EXISTING COLUMN TO 3'-0" ABOVE THE FLOOR SLAB

NEW STEEL COLUMN - SEE SCHEDULE ON S301, S302, AND S303

3) USE GPR/X-RAY OPERATIONS TO LOCATE ALL REBAR IN SLAB PRIOR TO ANY CORE DRILLS. SUBMIT TO STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.
4) ALL DIMENSIONS FOR NEW OPENINGS IN EXISTING SLAB TO BE VERIFIED WITH ARCHITECTAL DRAWINGS PRIOR TO DEMOLITION OF CONCRETE.
5) SEE SCHEDULE 3 / S304 FOR CONNECTION TO EXISTING STRUCTURAL MEMBERS.
6) SEE S001 FOR GENERAL NOTES.
7) SEE S201, S202, S203, S301, S302, S303, S304, S306, S307, S308, S309, AND S401 FOR TYPICAL DETAILS.
8) ALL GRID DIMENSIONS TO BE VERIFIED IN FIELD.
9) STRUCTURAL SLAB TO BE 5" NORMAL WEIGHT CONCRETE OVER 3" DEEP x 18 GAGE GALVANIZED FORM DECK (TOTAL THICKNESS = 8") REINFORCED WITH 4x4 - W4.0xW4.0 WWF.
10) NEW BEAMS MUST BE INSTALLED PRIOR TO SLAB REMOVAL OR TEMPORARY SHORING TO BE PROVIDED AT CONTRACTOR'S OPTION.
11) SEE SHEET S006 FOR REINFORCING AT EXISTING CONCRETE SLAB AND EXISTING CONCRETE COLUMN WHERE OCCURS.

Q1

#1.At all yellow clouded locations, the NEW steel columns are in different rotation. Please confirm the rotation(angle) for each yellow clouded New steel column if rotation is must per the design or else please confirm shall we keep the column in 0°/90°(perpendicular to adjacent grids) at possible locations.

#2.Also,please confirm if we rotate the base plate only(we will keep the New column orientation as shown in structural drawings) to match the ex. concrete column orientation to achieve required clear cover for the HILTI anchors(This #2 query applies to ALL new columns in this project).

All yellow clouded column location (See page#1 thru #6) seems to have their column orientation rotated. So, kindly provide the required rotation angle for columns if the rotation is required per structural design.

(OR)

We intend to follow all yellow clouded columns (See page#1 thru #6) orientation to match with structural beam framing condition at 9th level and above levels (See magenta clouded location for your reference). Please confirm.

Also,
We intend to align the orientation of the new steel column base plates with that of the existing concrete columns to ensure consistency and clear cover for the hilti anchors. Please confirm is it acceptable. (Typical at all new column locations)

DOB STAMP

1250 Maryland Avenue
1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024

312-274-0707

LIGHTING
CM KLING + ASSOCIATES
703-684-6270

KEY PLAN

STAMP

NO	DATE	DESCRIPTION
4	02/14/2025	50% CD ADDENDUM 4
1	12/13/2024	50% CD ADDENDUM 1

REVISIONS

SUBMITTAL

85% CONSTRUCTION DOCUMENTS

DRAWING TITLE

PARTIAL LEVEL 08

SK#08
05 pages
Date: 05-08-2025

01 page of 05

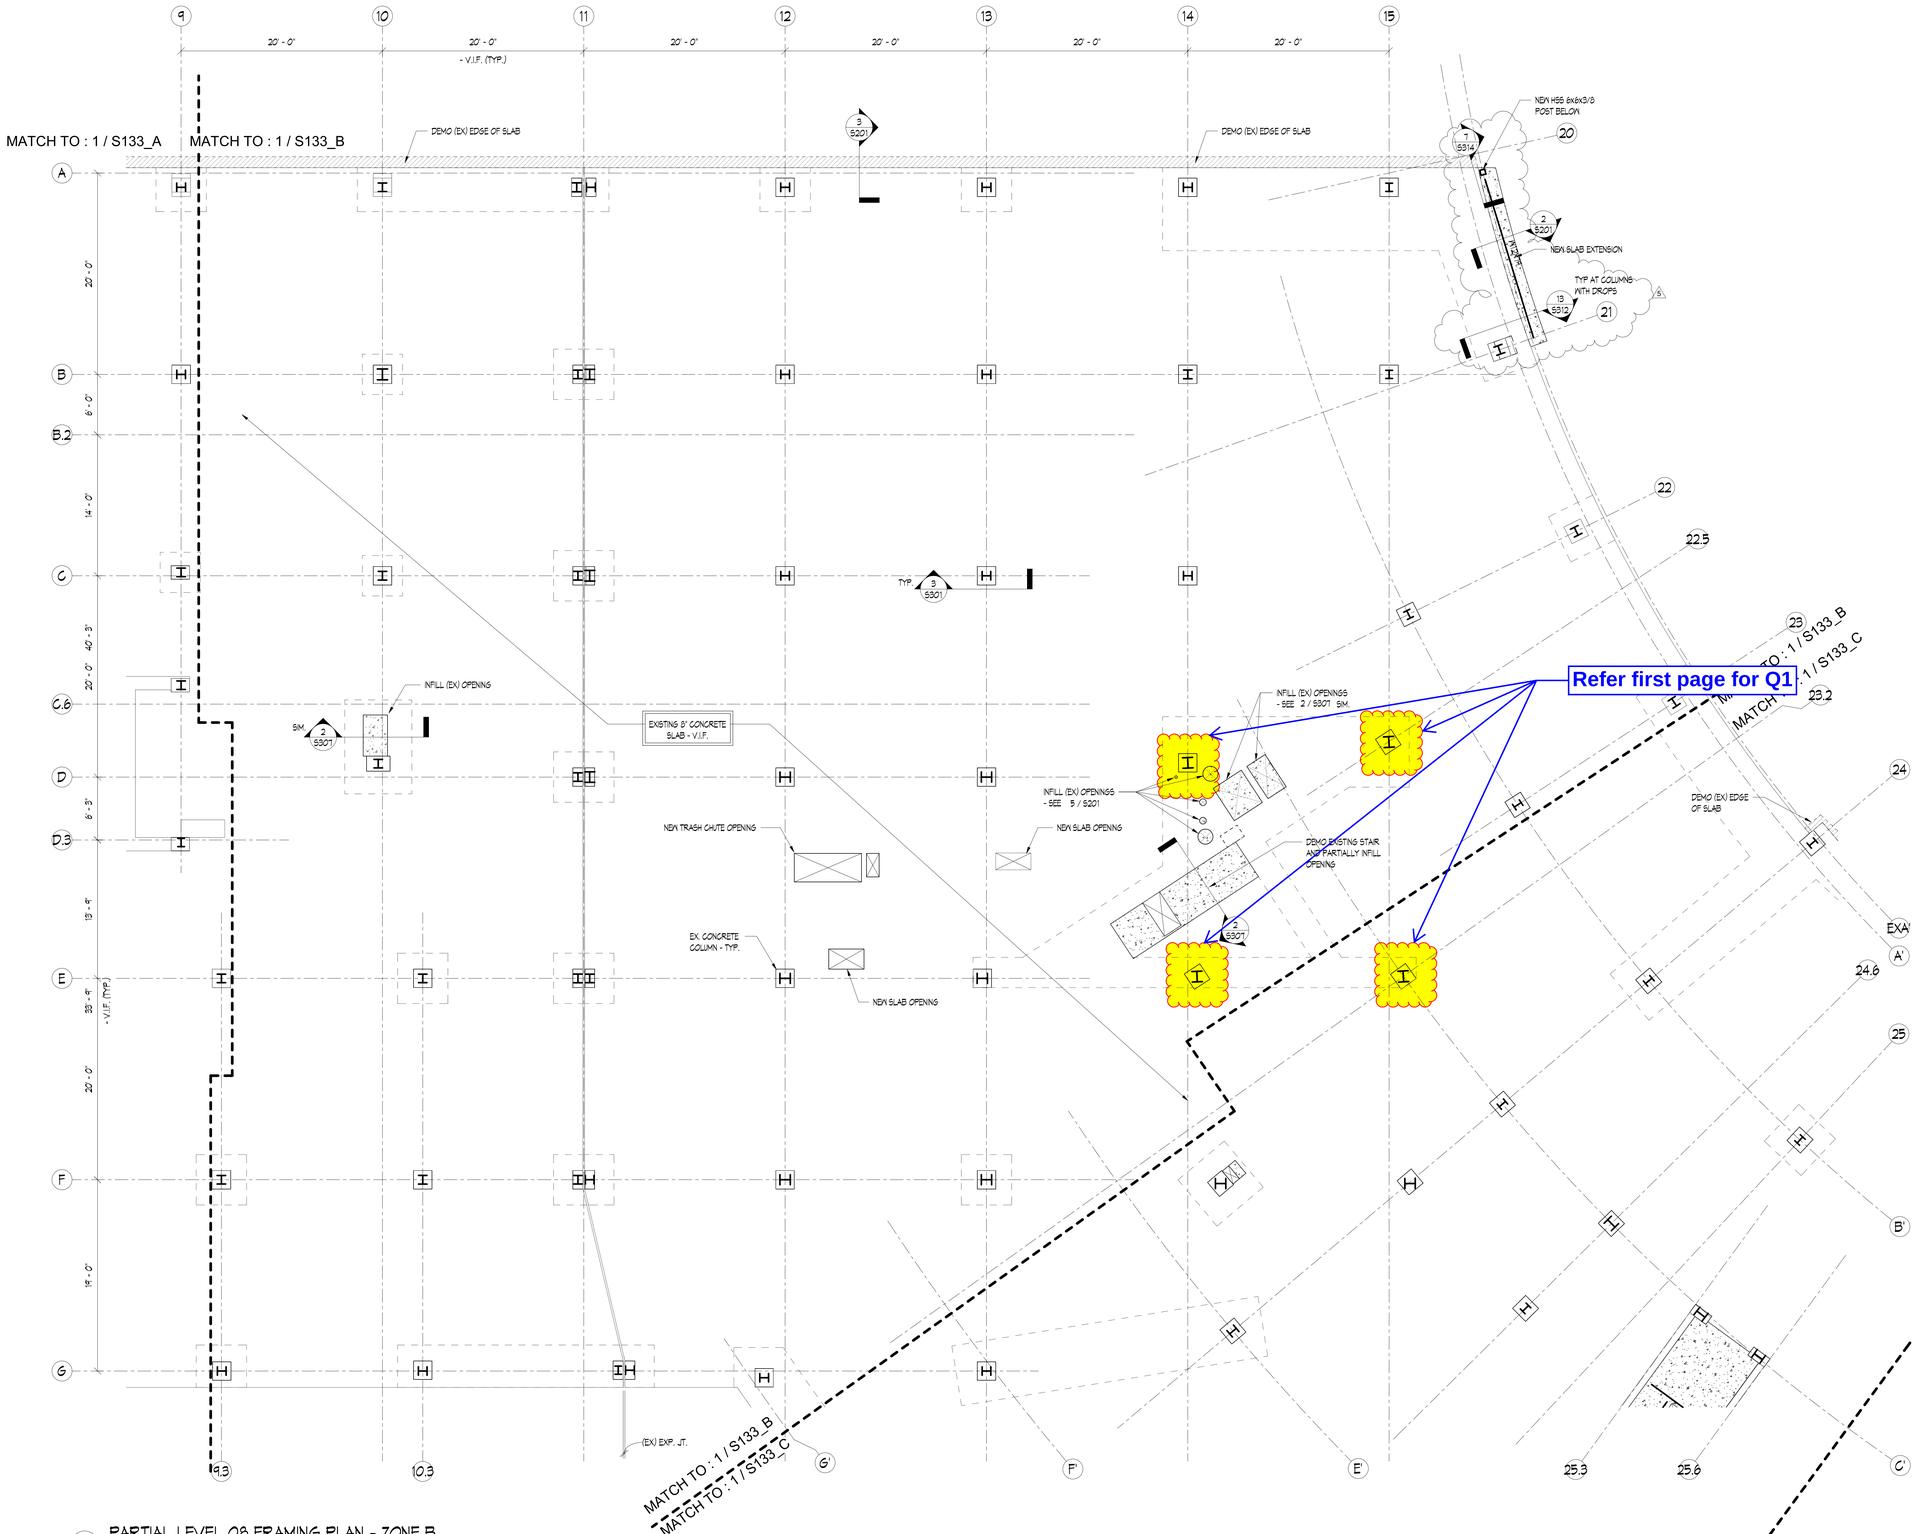

1 PARTIAL LEVEL 08 FRAMING PLAN - ZONE B

SCALE: 3/16" = 1'-0"

PLAN NOTES:

1) TOP OF EXISTING LEVEL 8 SLAB ELEVATION = 125' - 1" (VERIFY IN FIELD).
2) NEW COLUMNS CENTERED OVER EXISTING COLUMNS SHOWN THUS:

EXISTING COLUMN TO 9'-0" ABOVE THE FLOOR SLAB

NEW STEEL COLUMN - SEE SCHEDULE ON S301, S302, AND S303

3) USE GPR/X-RAY OPERATIONS TO LOCATE ALL REBAR IN SLAB PRIOR TO ANY CORE DRILLS. SUBMIT TO STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.
4) ALL DIMENSIONS FOR NEW OPENINGS IN EXISTING SLAB TO BE VERIFIED WITH ARCHITECTAL DRAWINGS PRIOR TO DEMOLITION OF CONCRETE.
5) SEE SCHEDULE 9 / S304 FOR CONNECTION TO EXISTING STRUCTURAL MEMBERS.
6) SEE S001 FOR GENERAL NOTES.
7) SEE S201, S202, S203, S301, S302, S303, S304, S306, S307, S308, S309, AND S401 FOR TYPICAL DETAILS.
8) ALL GRID DIMENSIONS TO BE VERIFIED IN FIELD.
9) STRUCTURAL SLAB TO BE 5" NORMAL WEIGHT CONCRETE OVER 3" DEEP x 18 GAGE GALVANIZED FORM DECK (TOTAL THICKNESS = 8") REINFORCED WITH 4x4 - W4.0xW4.0 WWF.
10) NEW BEAMS MUST BE INSTALLED PRIOR TO SLAB REMOVAL OR TEMPORARY SHORING TO BE PROVIDED AT CONTRACTOR'S OPTION.
11) SEE SHEET S006 FOR REINFORCING AT EXISTING CONCRETE SLAB AND EXISTING CONCRETE COLUMN WHERE OCCURS.

NOTE IF THIS SHEET IS NOT 36"W x 48"D THEN IT IS NOT THE INTENDED SIZE. IN ALL CASES, WORK TO FIGURED DIMENSIONS.

DOB STAMP

1250 Maryland Avenue
1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024

BEYER BLINDER BELLE
3307 M Street Northwest, Suite 301
Washington, DC, 20007
202 333 8000

MECHANICAL & PLUMBING
HURST ENGINEERS
703-534-7872

ELECTRICAL
POWER DESIGN INC.
727-497-9811

STRUCTURAL
RATHGEBBER GOSS ASSOCIATES
301-590-0071

CIVIL
GORDON DC
202-869-1600

LANDSCAPE
OVS
202-546-7575

INTERIORS
KTGY SDDG
312-274-0707

LIGHTING
CM KLING + ASSOCIATES
703-684-6270

KEY PLAN

STAMP

NO	DATE	DESCRIPTION
5	03/14/2025	85% CD
4	02/14/2025	50% CD ADDENDUM 4
3	01/24/2025	50% CD ADDENDUM 3
1	12/13/2024	50% CD ADDENDUM 1

REVISIONS

SUBMITTAL

85% CONSTRUCTION DOCUMENTS

DRAWING TITLE

PARTIAL LEVEL 08
FRAMING PLAN - ZONE B

SCALE	As indicated
DATE	01/24/25
PROJECT NUMBER	6415.00

DRAWING NUMBER

S133_B

of

Autodesk Docs://6415 - 1250 Maryland Avenue/S/6415-1250 Maryland Ave-R24.rvt

3/13/2025 5:31:27 PM

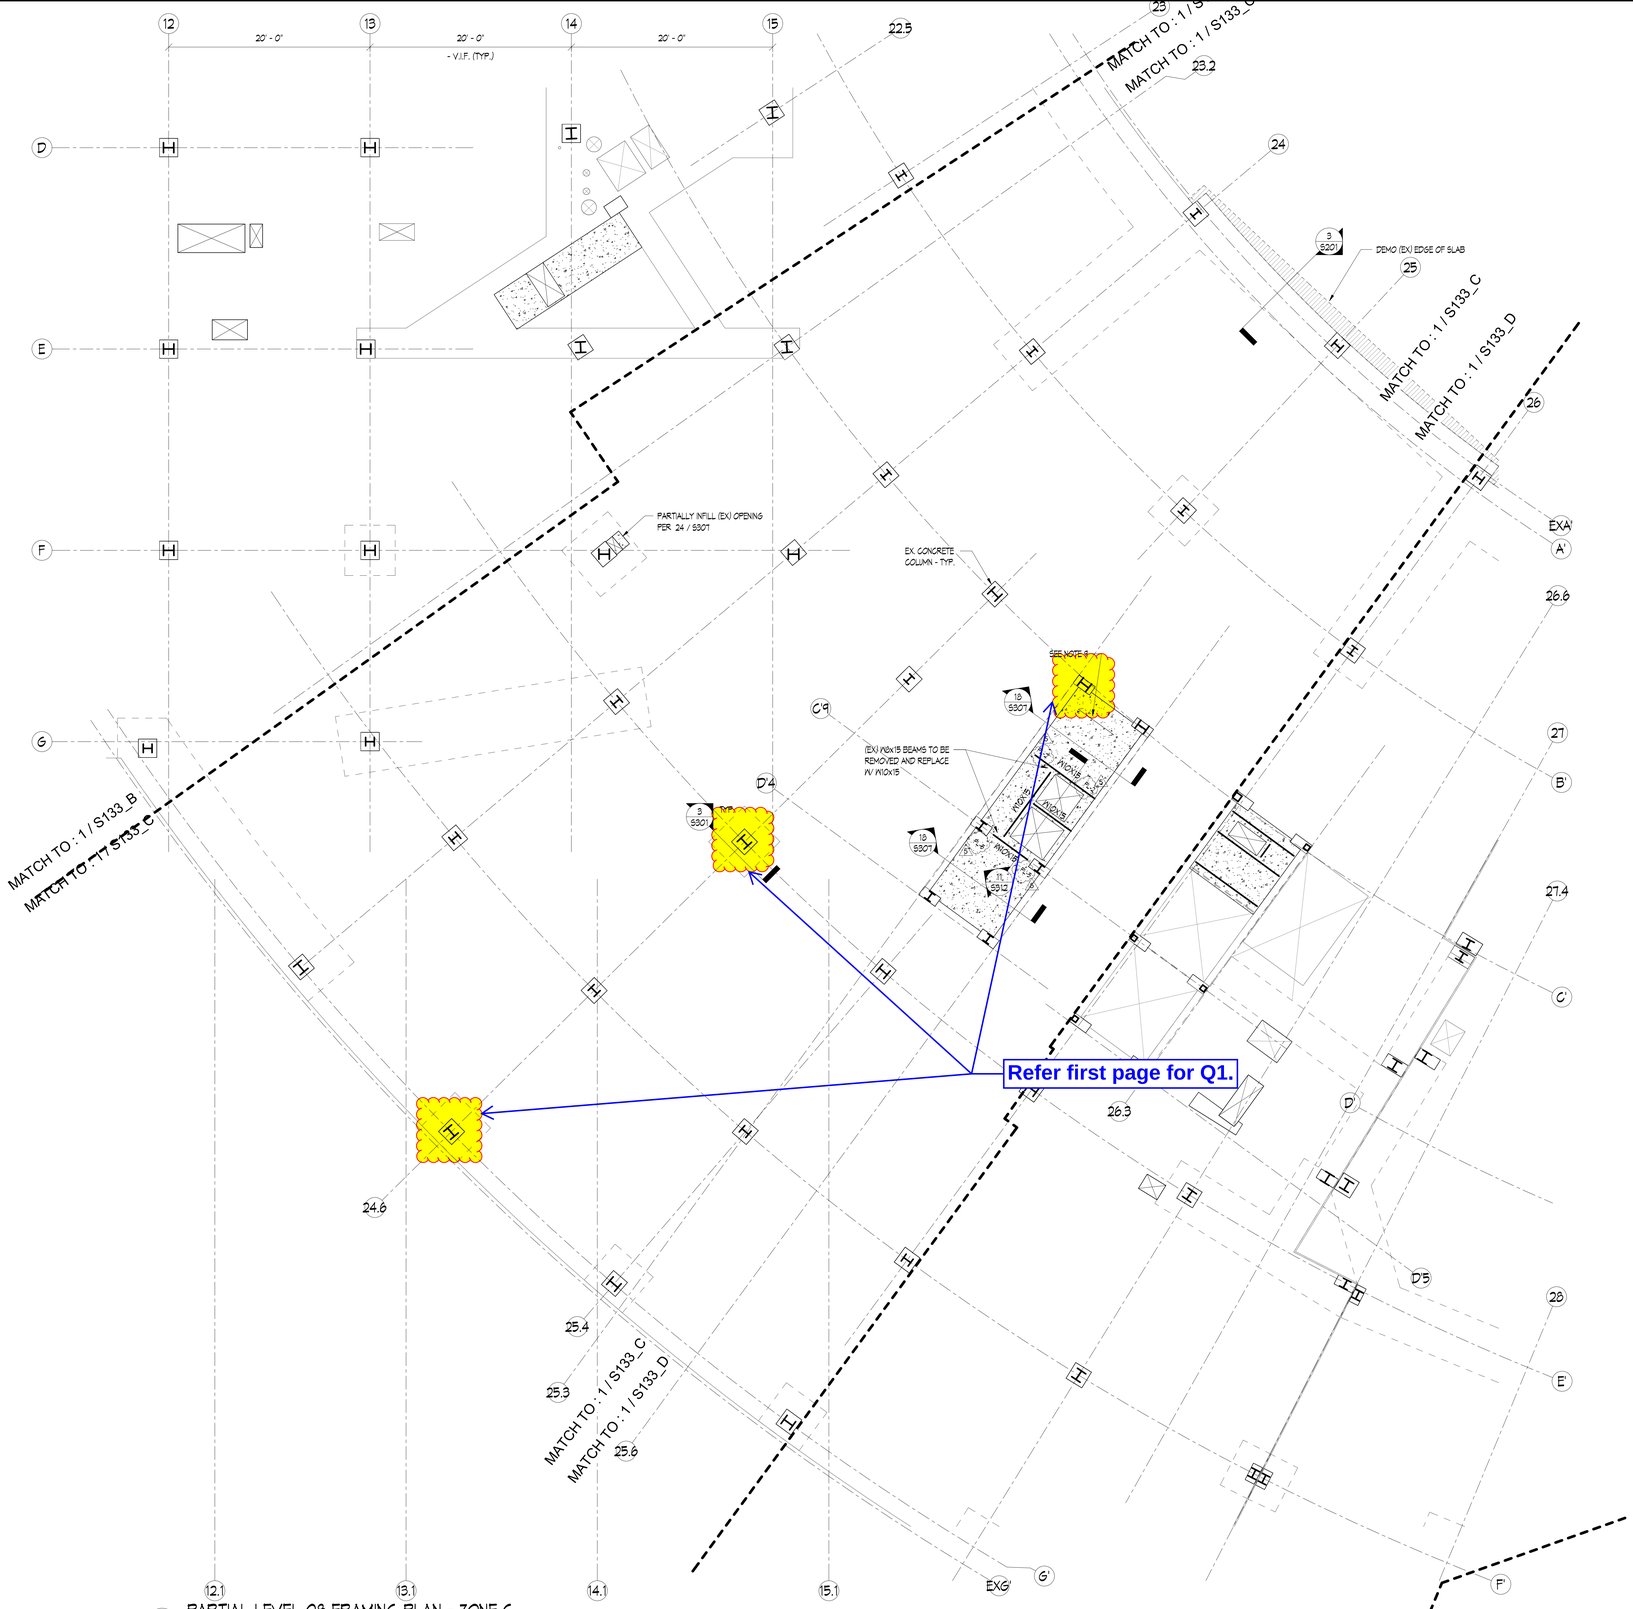

1 PARTIAL LEVEL 08 FRAMING PLAN - ZONE C

SCALE: 3/16" = 1'-0"

PLAN NOTES:

1) TOP OF EXISTING LEVEL 8 SLAB ELEVATION = 125' - 1" (VERIFY IN FIELD).
2) NEW COLUMNS CENTERED OVER EXISTING COLUMNS SHOWN THUS:

EXISTING COLUMN TO 3'-0" ABOVE THE FLOOR SLAB

NEW STEEL COLUMN - SEE SCHEDULE ON S301, S302, AND S303

3) USE GPR/X-RAY OPERATIONS TO LOCATE ALL REBAR IN SLAB PRIOR TO ANY CORE DRILLS. SUBMIT TO STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.
4) ALL DIMENSIONS FOR NEW OPENINGS IN EXISTING SLAB TO BE VERIFIED WITH ARCHITECTAL DRAWINGS PRIOR TO DEMOLITION OF CONCRETE.
5) SEE SCHEDULE 3 / S304 FOR CONNECTION TO EXISTING STRUCTURAL MEMBERS.
6) SEE S001 FOR GENERAL NOTES.
7) SEE S201, S202, S203, S301, S302, S303, S304, S306, S307, S308, S309, AND S401 FOR TYPICAL DETAILS.
8) ALL GRID DIMENSIONS TO BE VERIFIED IN FIELD.
9) STRUCTURAL SLAB TO BE 5" NORMAL WEIGHT CONCRETE OVER 3" DEEP x 18 GAGE GALVANIZED FORM DECK (TOTAL THICKNESS = 8") REINFORCED WITH 4x4 - W4.0x4.0 WWF.
10) NEW BEAMS MUST BE INSTALLED PRIOR TO SLAB REMOVAL OR TEMPORARY SHORING TO BE PROVIDED AT CONTRACTOR'S OPTION.
11) SEE SHEET S006 FOR REINFORCING AT EXISTING CONCRETE SLAB AND EXISTING CONCRETE COLUMN WHERE OCCURS.

03 page of 05

NOTE IF THIS SHEET IS NOT 36"W X 48"D THEN IT IS NOT THE INTENDED SIZE. IN ALL CASES, WORK TO FIGURED DIMENSIONS.

0 6" 12" 24" 36" 48"

Autodesk Docs://6415 - 1250 Maryland Avenue/S6415-1250 Maryland Ave-R24.rvt

3/13/2025 5:31:30 PM

DOB STAMP

1250 Maryland Avenue
1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024

BEYER BLINDER BELLE
3307 M Street Northwest, Suite 301
Washington, DC, 20007
202 333 8000

MECHANICAL & PLUMBING
HURST ENGINEERS
703-534-7872

ELECTRICAL
POWER DESIGN INC.
727-497-9811

STRUCTURAL
RATHGEBBER GOSS ASSOCIATES
301-590-0071

CIVIL
GORDON DC
202-869-1600

LANDSCAPE
OVS
202-546-7575

INTERIORS
KTGY SDDG
312-274-0707

LIGHTING
CM KLING + ASSOCIATES
703-684-6270

KEY PLAN

STAMP

NO	DATE	DESCRIPTION
5	03/14/2025	85% CD
4	02/14/2025	50% CD ADDENDUM 4
1	12/13/2024	50% CD ADDENDUM 1

REVISIONS

SUBMITTAL

85% CONSTRUCTION DOCUMENTS

DRAWING TITLE

PARTIAL LEVEL 08 FRAMING PLAN - ZONE C

SCALE	As indicated
DATE	01/24/25
PROJECT NUMBER	6415.00
DRAWING NUMBER	

S133_C

of

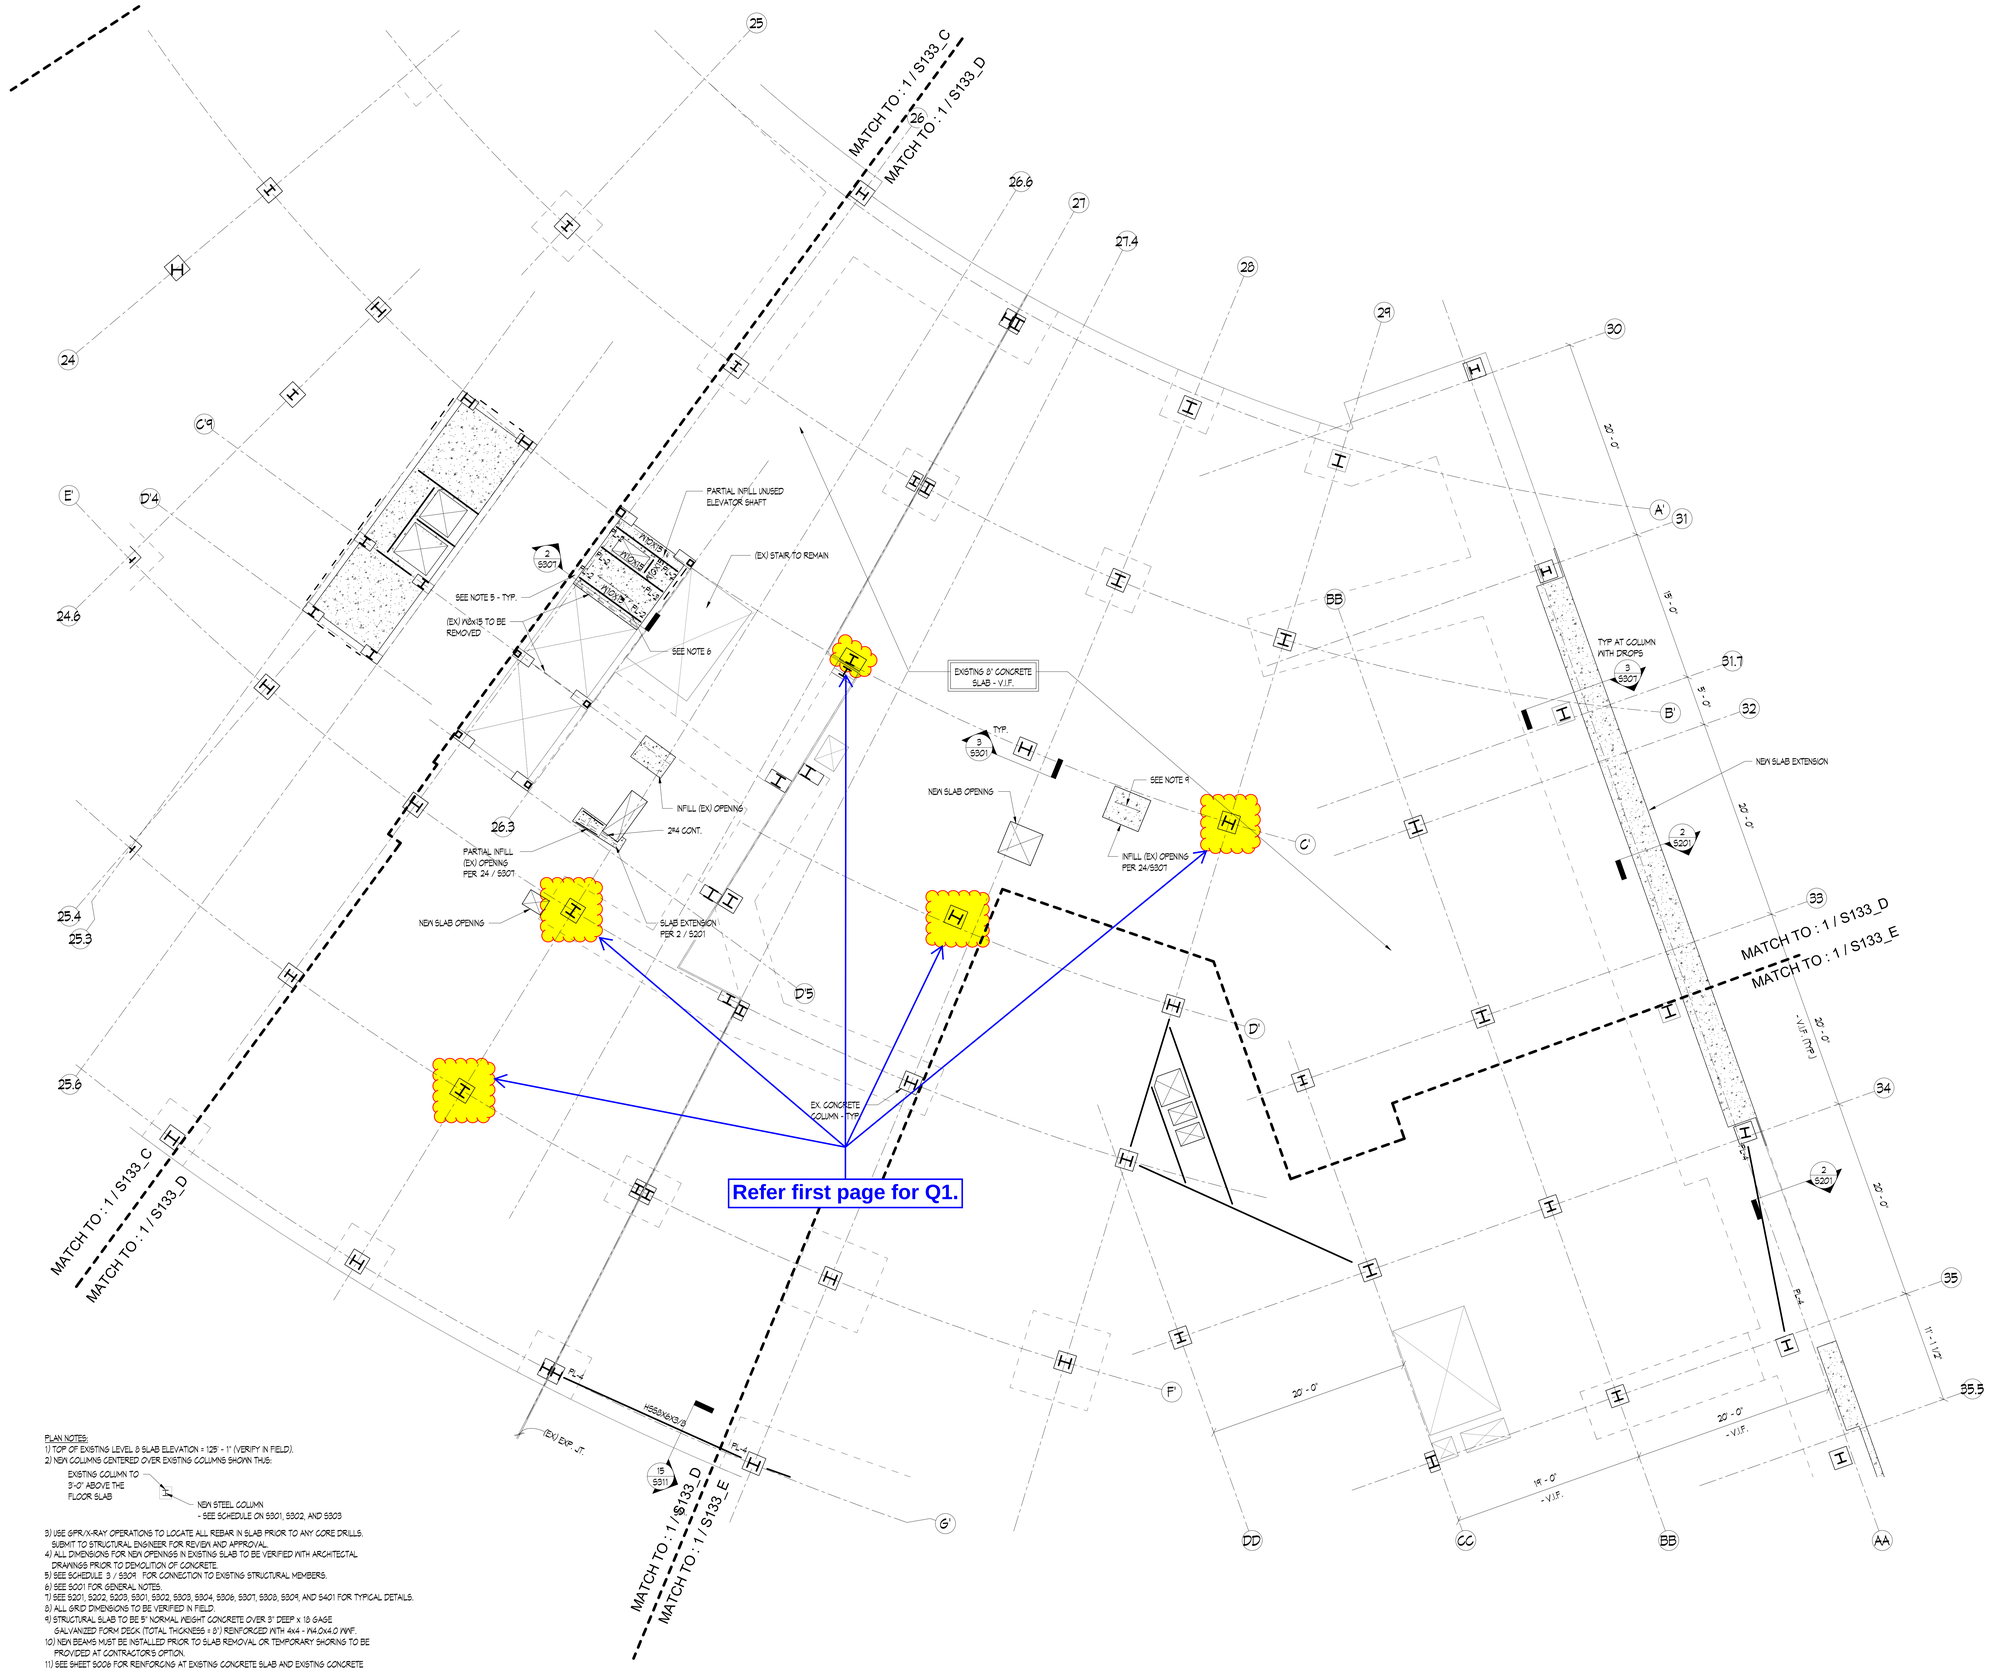

PLAN NOTES:
1) TOP OF EXISTING LEVEL 8 SLAB ELEVATION = 125' - 1" (VERIFY IN FIELD).
2) NEW COLUMNS CENTERED OVER EXISTING COLUMNS SHOWN THUS:
EXISTING COLUMN TO 9'-0" ABOVE THE FLOOR SLAB
NEW STEEL COLUMN - SEE SCHEDULE ON S301, S302, AND S303
3) USE GPR/X-RAY OPERATIONS TO LOCATE ALL REBAR IN SLAB PRIOR TO ANY CORE DRILLS. SUBMIT TO STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.
4) ALL DIMENSIONS FOR NEW OPENINGS IN EXISTING SLAB TO BE VERIFIED WITH ARCHITECTAL DRAWINGS PRIOR TO DEMOLITION OF CONCRETE.
5) SEE SCHEDULE 3 / S304 FOR CONNECTION TO EXISTING STRUCTURAL MEMBERS.
6) SEE S001 FOR GENERAL NOTES.
7) SEE S201, S202, S203, S301, S302, S303, S304, S306, S307, S308, S309, AND S401 FOR TYPICAL DETAILS.
8) ALL GRID DIMENSIONS TO BE VERIFIED IN FIELD.
9) STRUCTURAL SLAB TO BE 9" NORMAL WEIGHT CONCRETE OVER 3" DEEP X 18 GAGE GALVANIZED FORM DECK (TOTAL THICKNESS = 8") REINFORCED WITH 4x4 - W4.0xW4.0 WWF.
10) NEW BEAMS MUST BE INSTALLED PRIOR TO SLAB REMOVAL OR TEMPORARY SHORING TO BE PROVIDED AT CONTRACTOR'S OPTION.
11) SEE SHEET S006 FOR REINFORCING AT EXISTING CONCRETE SLAB AND EXISTING CONCRETE COLUMN WHERE OCCURS.

1 PARTIAL LEVEL 08 FRAMING PLAN - ZONE D
SCALE: 3/16" = 1'-0"

DOB STAMP

1250 Maryland Avenue
1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024

BEYER BLINDER BELLE
3307 M Street Northwest, Suite 301
Washington, DC, 20007
202 333 8000

MECHANICAL & PLUMBING
HURST ENGINEERS
703-534-7872

ELECTRICAL
POWER DESIGN INC.
727-497-9811

STRUCTURAL
RATHGEBBER GOSS ASSOCIATES
301-590-0071

CIVIL
GORDON DC
202-869-1600

LANDSCAPE
OVS
202-546-7575

INTERIORS
KTGY SDDG
312-274-0707

LIGHTING
CM KLING + ASSOCIATES
703-684-6270

KEY PLAN

STAMP

NO	DATE	DESCRIPTION
4	03/14/2025	50% CD ADDENDUM 4
3	01/24/2025	50% CD ADDENDUM 3
1	12/13/2024	50% CD ADDENDUM 1

REVISIONS

SUBMITTAL
85% CONSTRUCTION DOCUMENTS

DRAWING TITLE
PARTIAL LEVEL 08 FRAMING PLAN - ZONE D

SCALE	As indicated
DATE	01/24/25
PROJECT NUMBER	6415.00

DRAWING NUMBER
S133_D
of

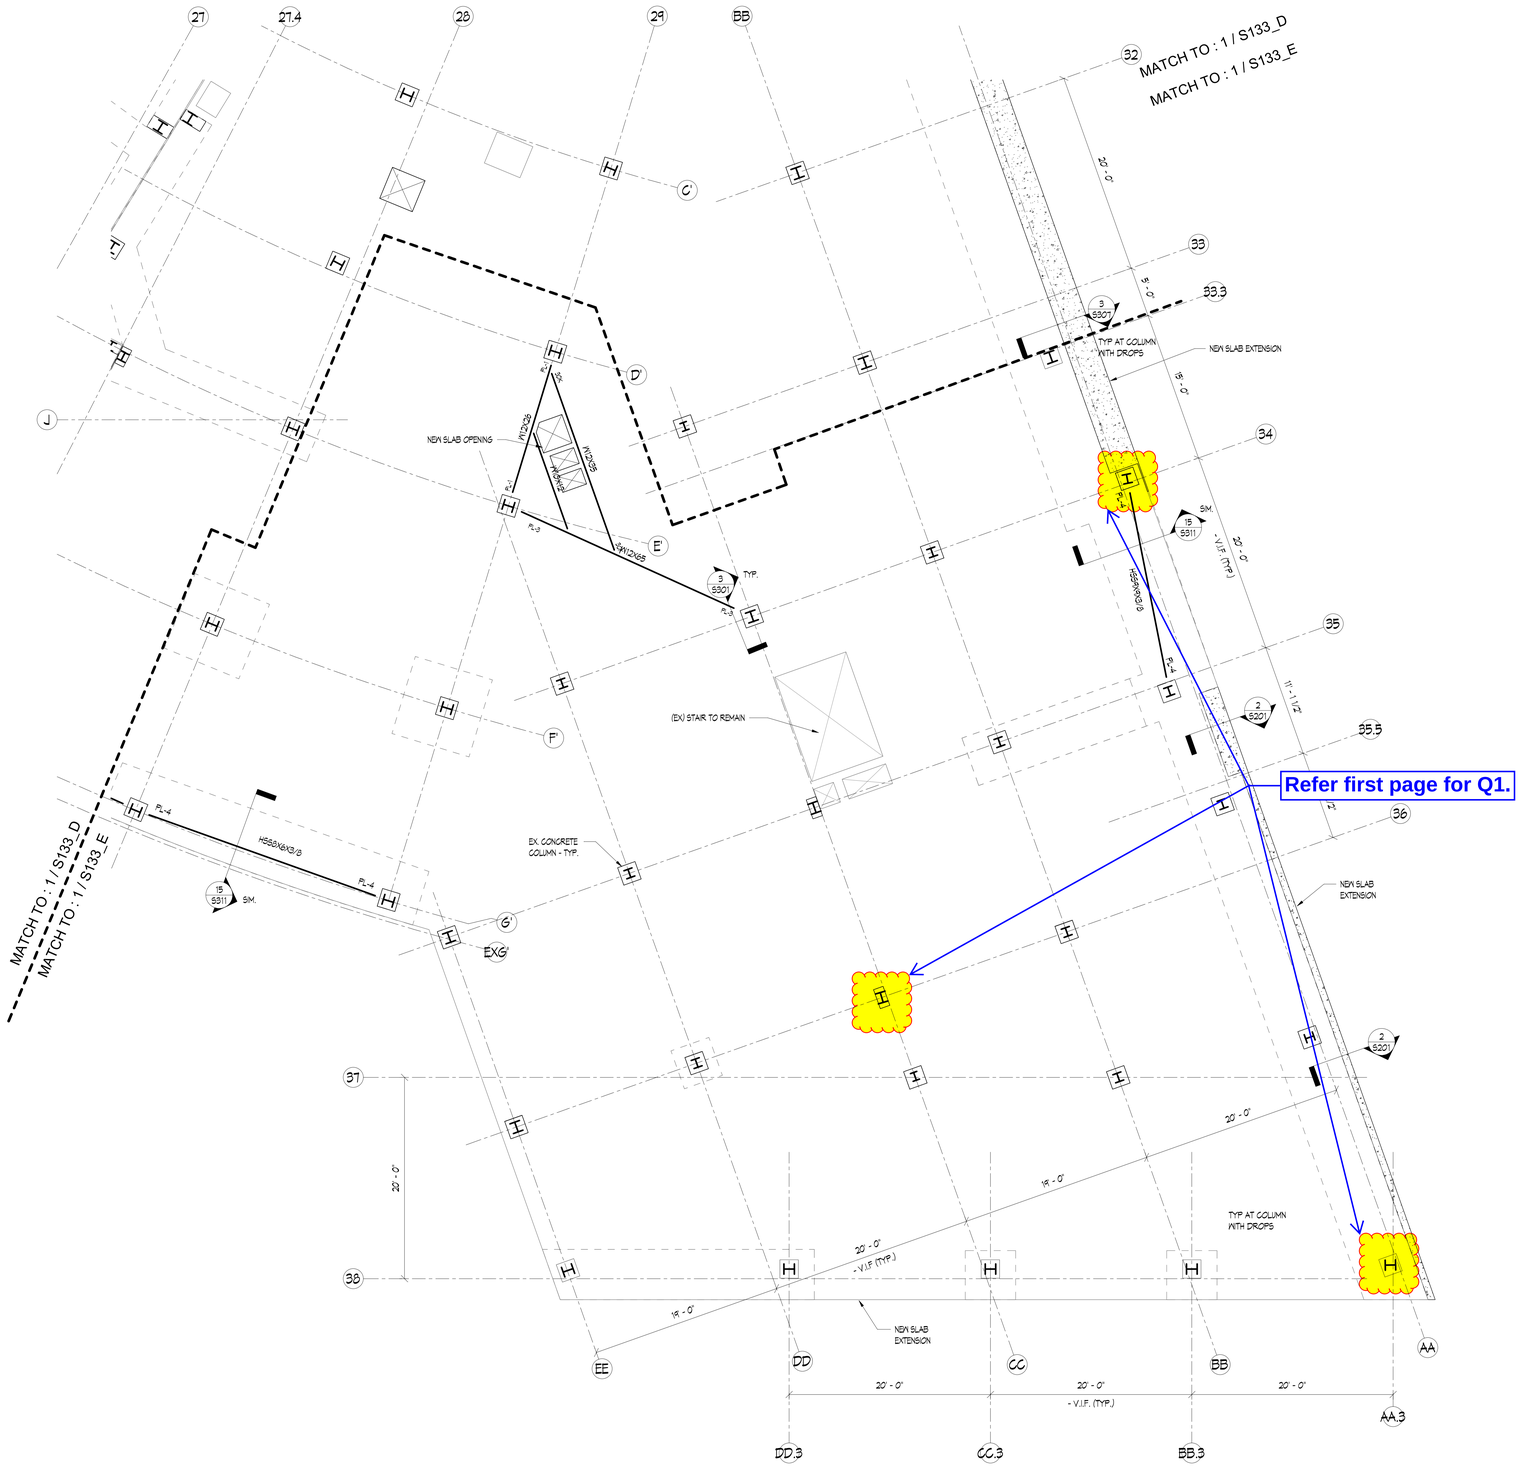

1 PARTIAL LEVEL 08 FRAMING PLAN - ZONE E

SCALE: 3/16" = 1'-0"

PLAN NOTES:

1) TOP OF EXISTING LEVEL 8 SLAB ELEVATION = 125' - 1' (VERIFY IN FIELD).
2) NEW COLUMNS CENTERED OVER EXISTING COLUMNS SHOWN THIS:

EXISTING COLUMN TO 3'-0" ABOVE THE FLOOR SLAB

NEW STEEL COLUMN - SEE SCHEDULE ON S301, S302, AND S303

3) USE GPR/X-RAY OPERATIONS TO LOCATE ALL REBAR IN SLAB PRIOR TO ANY CORE DRILLS. SUBMIT TO STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.
4) ALL DIMENSIONS FOR NEW OPENINGS IN EXISTING SLAB TO BE VERIFIED WITH ARCHITECTAL DRAWINGS PRIOR TO DEMOLITION OF CONCRETE.
5) SEE SCHEDULE 3 / S304 FOR CONNECTION TO EXISTING STRUCTURAL MEMBERS.
6) SEE S001 FOR GENERAL NOTES.
7) SEE S201, S202, S203, S301, S302, S303, S304, S306, S307, S308, S309, AND S401 FOR TYPICAL DETAILS.
8) ALL GRID DIMENSIONS TO BE VERIFIED IN FIELD.
9) STRUCTURAL SLAB TO BE 5" NORMAL WEIGHT CONCRETE OVER 3" DEEP X 18 GAGE GALVANIZED FORM DECK (TOTAL THICKNESS = 8") REINFORCED WITH 4x4 - W4.0X4.0 WWF.
10) NEW BEAMS MUST BE INSTALLED PRIOR TO SLAB REMOVAL OR TEMPORARY SHORING TO BE

T EXISTING CONCRETE SLAB AND EXISTING CONCRETE

NOTE IF THIS SHEET IS NOT 36"W X 48"D, THEN IT IS NOT THE INTENDED SIZE. IN ALL CASES, WORK TO FIGURED DIMENSIONS.

0 6" 12" 24" 36" 48"

3/13/2025 5:13:36 PM Autodesk Docs://6415 - 1250 Maryland Avenue/S2-6415-1250 Maryland Ave-R24.rvt

DOB STAMP

1250 Maryland Avenue
1250 MARYLAND AVENUE SW
WASHINGTON, DC 20024

BEYER BLINDER BELLE
3307 M Street Northwest, Suite 301
Washington, DC, 20007
202 333 8000

MECHANICAL & PLUMBING
HURST ENGINEERS
703-534-7872

ELECTRICAL
POWER DESIGN INC.
727-497-9811

STRUCTURAL
RATHGEBBER GOSS ASSOCIATES
301-590-0071

CIVIL
GORDON DC
202-869-1600

LANDSCAPE
OVS
202-546-7575

INTERIORS
KTGY SDDG
312-274-0707

LIGHTING
CM KLING + ASSOCIATES
703-684-6270

KEY PLAN

STAMP

NO	DATE	DESCRIPTION
4	02/14/2025	50% CD ADDENDUM 4
3	01/24/2025	50% CD ADDENDUM 3

REVISIONS

SUBMITTAL

85% CONSTRUCTION DOCUMENTS

DRAWING TITLE

PARTIAL LEVEL 08
FRAMING PLAN - ZONE E

SCALE	As indicated
DATE	01/24/25
PROJECT NUMBER	6415.00

DRAWING NUMBER

S133_E

of